



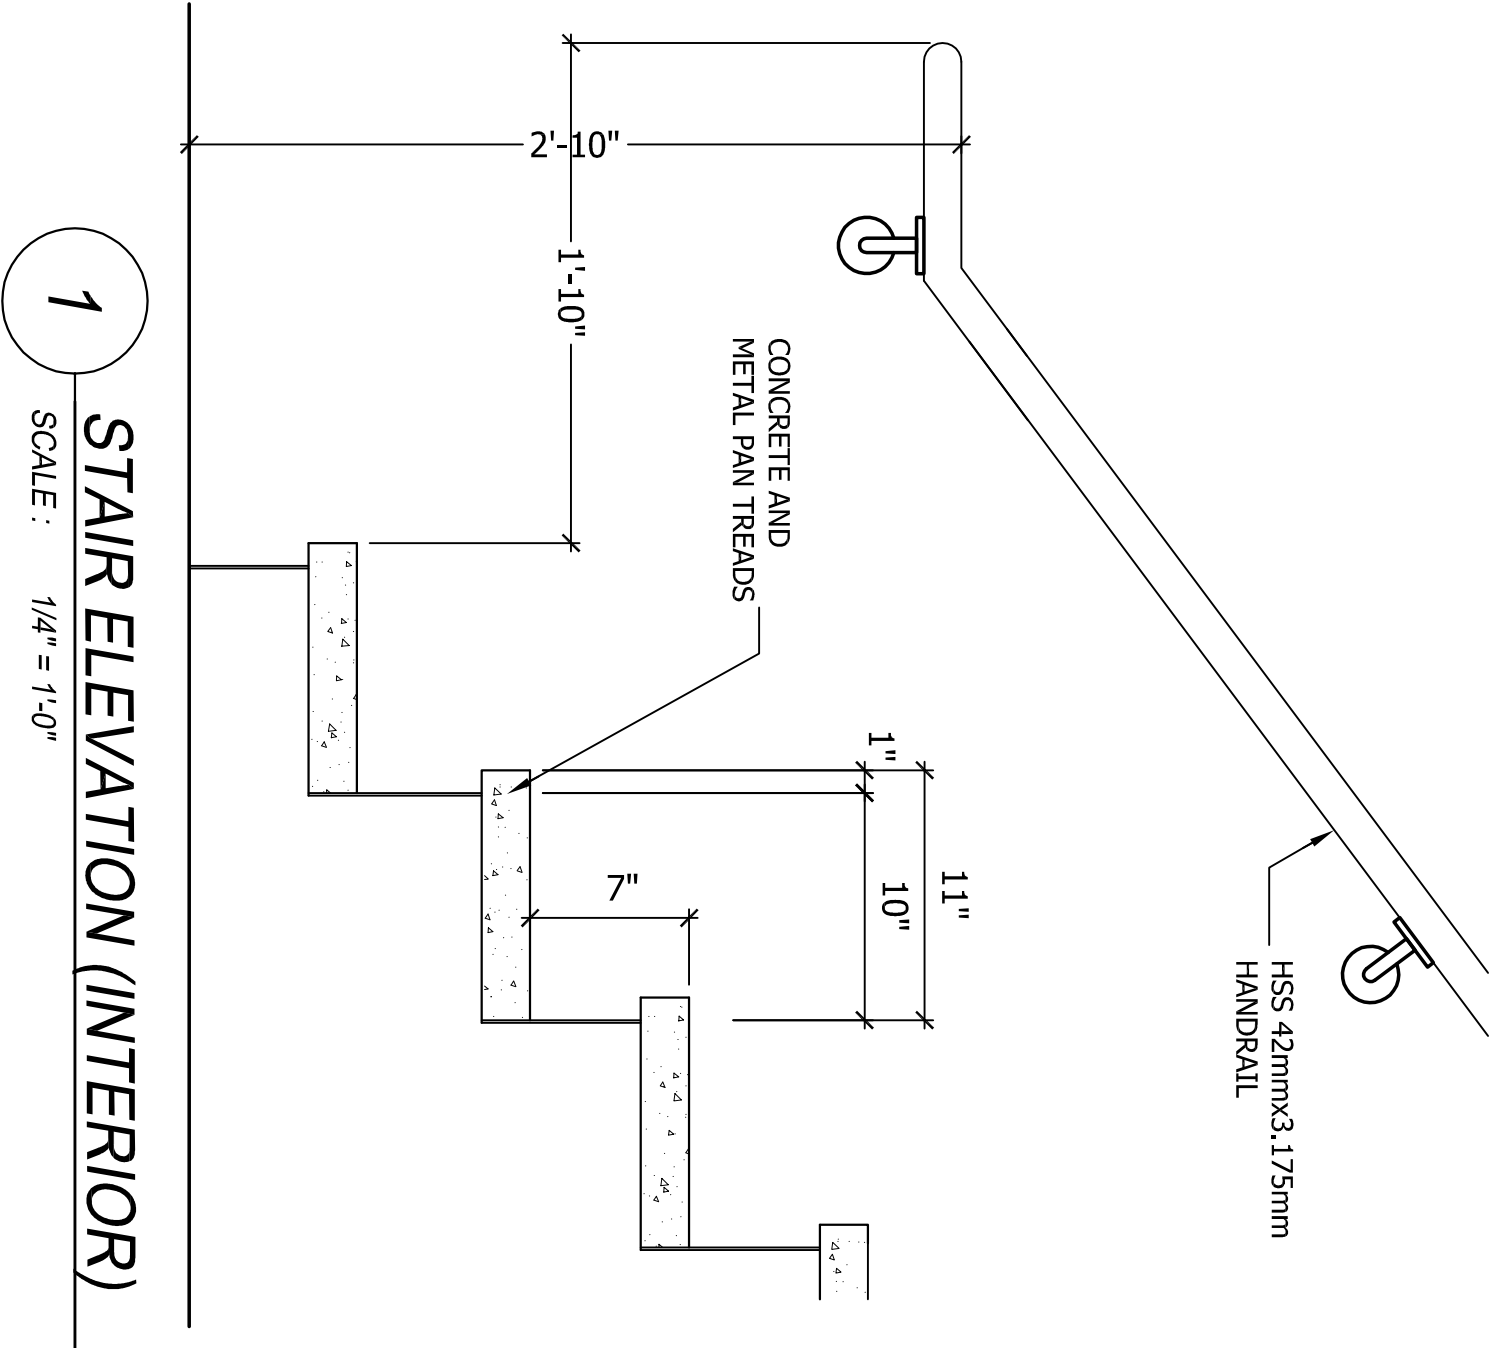

No.	DATE	ISSUED / REVISED
1	17 FEB/15	PERMITTING
2	11 NOV/15	PERMIT REV. A


ALL DRAWING AND WITNESS MATERIALS, CONTRACT AND PERMITS, SHALL BE THE PROPERTY OF CASTELLANOS DESIGN STUDIO AND SHALL BE KEPT IN THE OFFICE OF THE ARCHITECT. THE DRAWINGS AND SPECIFICATIONS WHICH INDICATE THE GENERAL REQUIREMENTS FOR THE DESIGN AND CONSTRUCTION OF THE WORK SHALL BE THE PROPERTY OF CASTELLANOS DESIGN STUDIO. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE APPLICABLE AGENCIES. THE CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE CODES AND REGULATIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE APPLICABLE AGENCIES. IN NO CASE SHALL PERMITS BE OBTAINED WITHOUT THE ARCHITECT'S SIGNATURE AND SEAL.

SEAL:

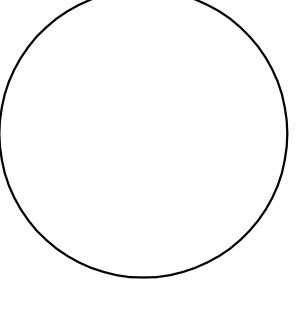


1 STAIR ELEVATION (INTERIOR)
SCALE: 1/4" = 1'-0"


- STAIR NOTES
1. HANDRAILS
 - A. PROVIDE HANDRAIL - MINIMUM ONE SIDE, ONE END, AND ONE CORNER - 30" HIGH WITH 3/4" DIA. ROUND FINISH TUBES.
 - B. PROVIDE HANDRAIL - MINIMUM ONE SIDE, ONE END, AND ONE CORNER - 30" HIGH WITH 3/4" DIA. ROUND FINISH TUBES.
 - C. PROVIDE HANDRAIL - MINIMUM ONE SIDE, ONE END, AND ONE CORNER - 30" HIGH WITH 3/4" DIA. ROUND FINISH TUBES.
 2. TREADS - SURFACES ARE TO BE SLIP RESISTANT.
 3. NOSING - THE NOSING EDGE OF TREADS ARE TO BE 1/2" HIGH AND 1/4" WIDE.
 4. RISERS - THE RISER HEIGHT SHALL BE 6" MAXIMUM.
 5. DIMENSIONS - MAXES WITH INTERIOR FINISHES.
 6. MAXIMUM VARIATION IN HEIGHT OF RISERS OR WIDTH OF TREADS IN ANY GIVEN FLOOR: 1/4"
 7. MINIMUM HEADROOM CLEARANCE - MINIMUM HEADROOM CLEARANCE SHALL BE 8'-0" MINIMUM CLEARANCE SHALL BE 7'-6" MINIMUM CLEARANCE SHALL BE 7'-0"
 8. MAXIMUM VERTICAL DISTANCE BETWEEN STAIRWAY LANDINGS: 12'-0"
 9. STAIR LANDINGS - THE STAIRWAY LANDINGS SHALL BE FINISHED WITH THE SAME FINISH AS THE STAIRS AND SHALL BE 4'-0" WIDE MINIMUM.
 10. SEE INTERIOR FINISH SCHEDULE
 11. HANDRAILS - PROVIDE HANDRAILS TO BE 30" HIGH WITH 3/4" DIA. ROUND FINISH TUBES. PROVIDE HANDRAILS TO BE 30" HIGH WITH 3/4" DIA. ROUND FINISH TUBES. PROVIDE HANDRAILS TO BE 30" HIGH WITH 3/4" DIA. ROUND FINISH TUBES.
 12. ENCLOSED USABLE SPACE UNDER STAIRS - A SPACE BE PROTECTED WITH OVERHEAD FIRE RESISTIVE PROTECTION.

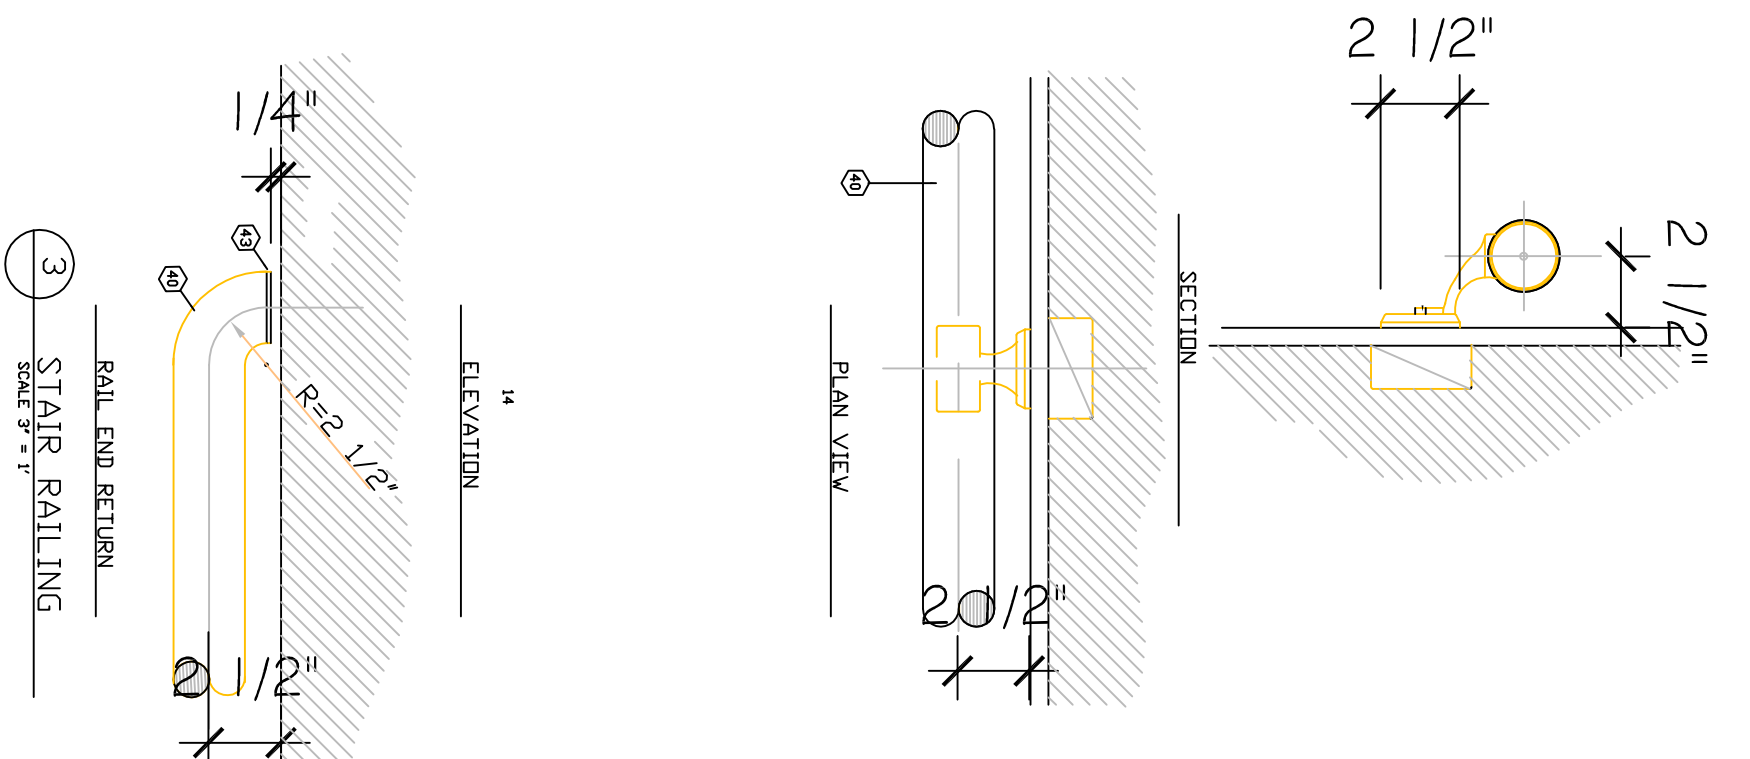

2 HANDRAIL DETAILS (INTERIOR)
SCALE: 3/8" = 1'-0"

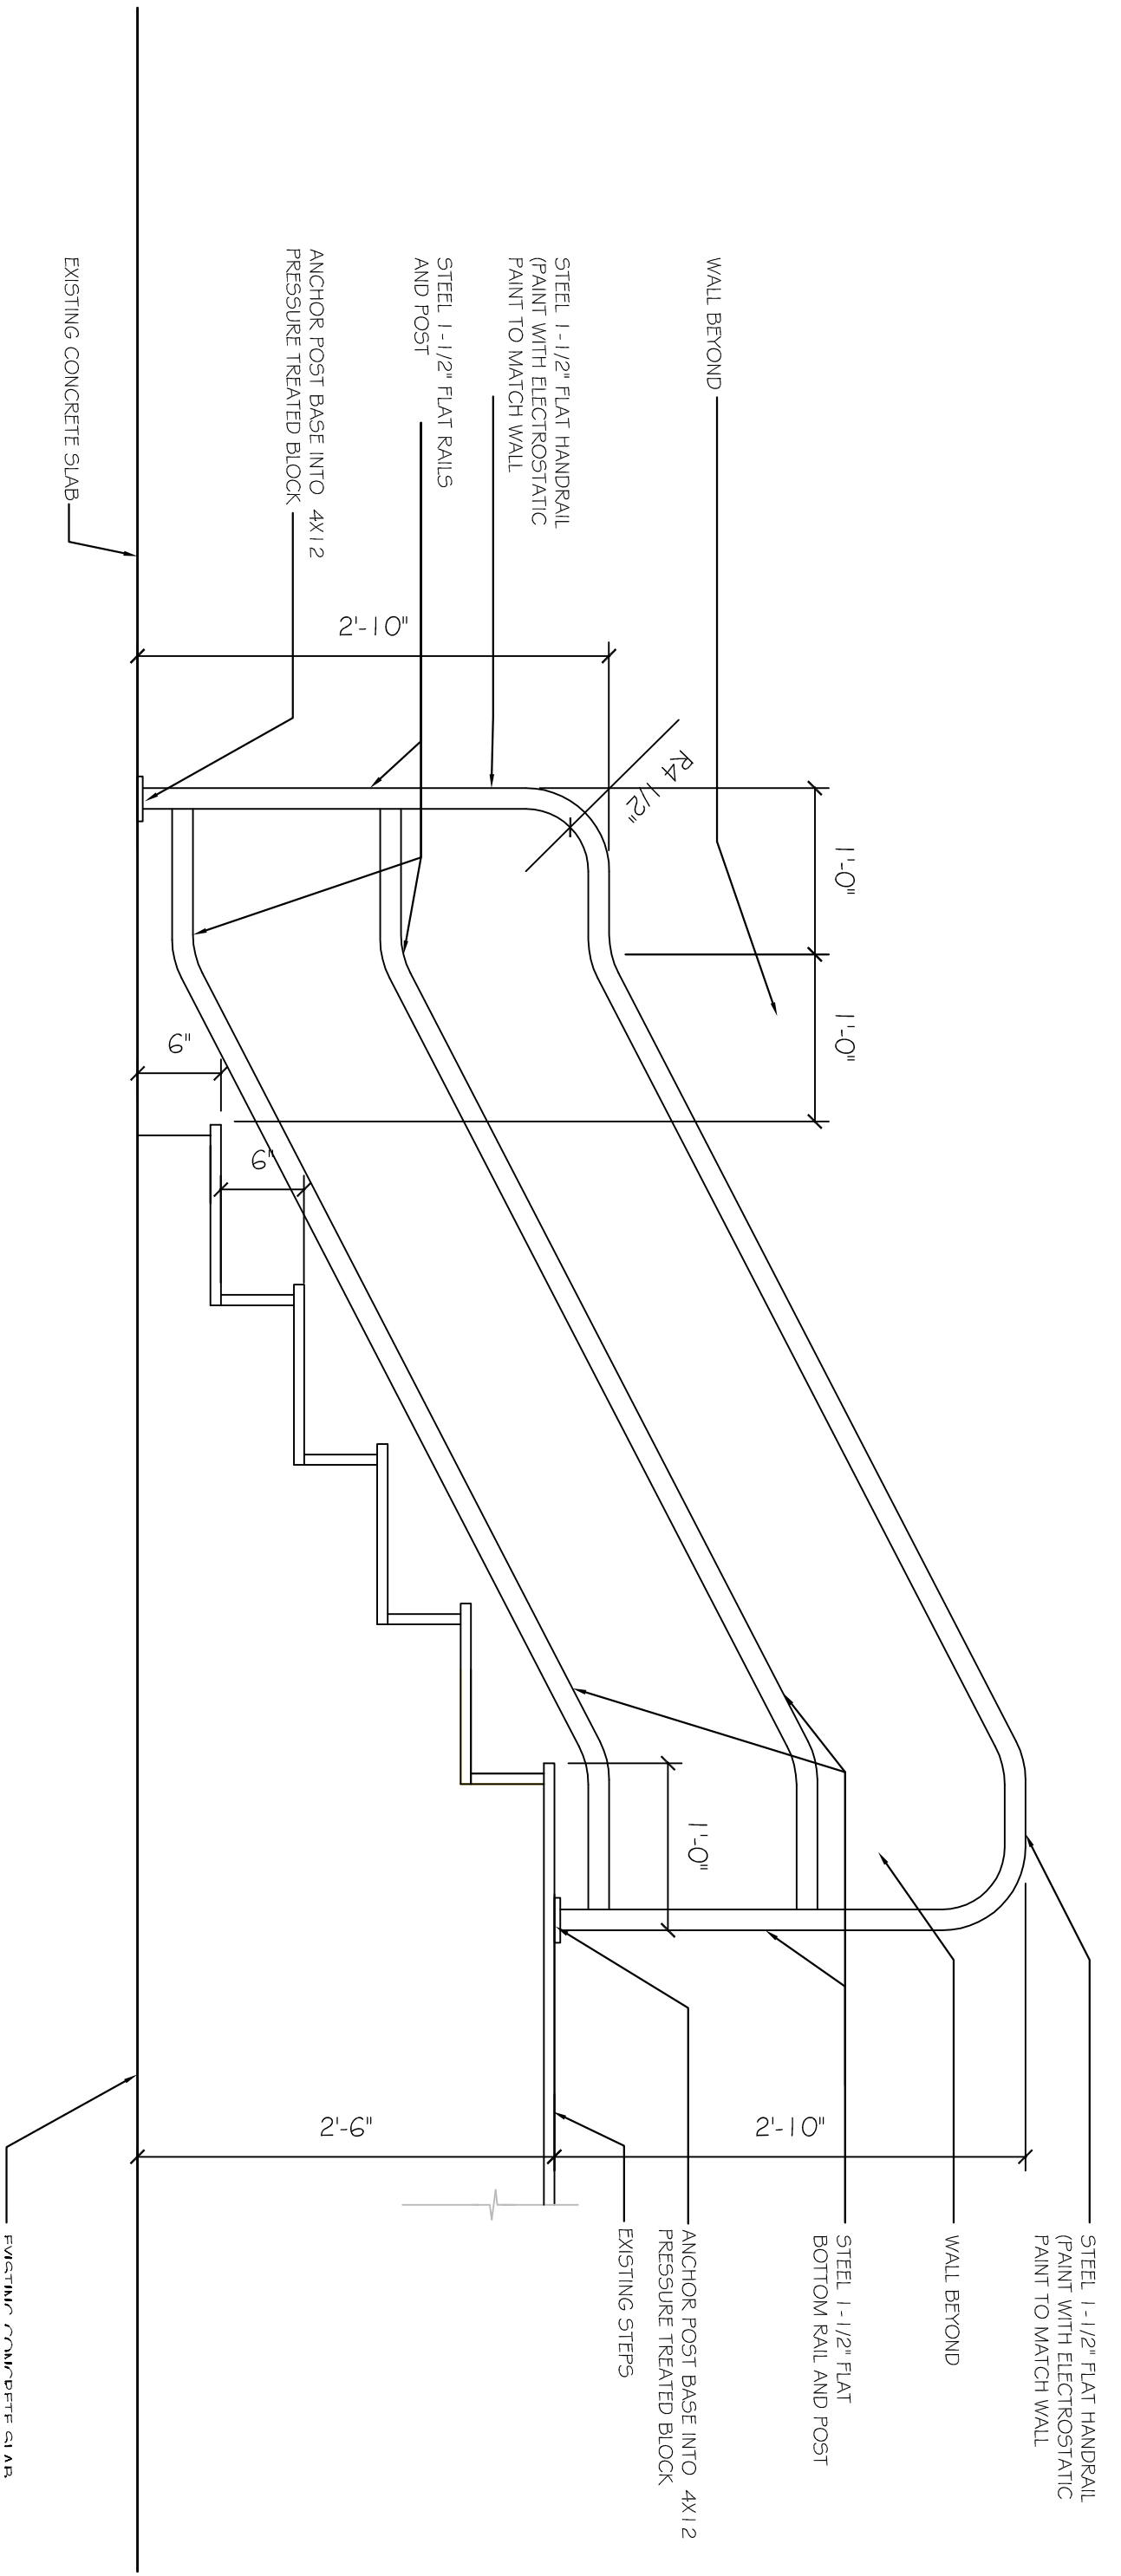

3 STAIR ELEVATION (EXTERIOR)
SCALE: 1/2" = 1'-0"

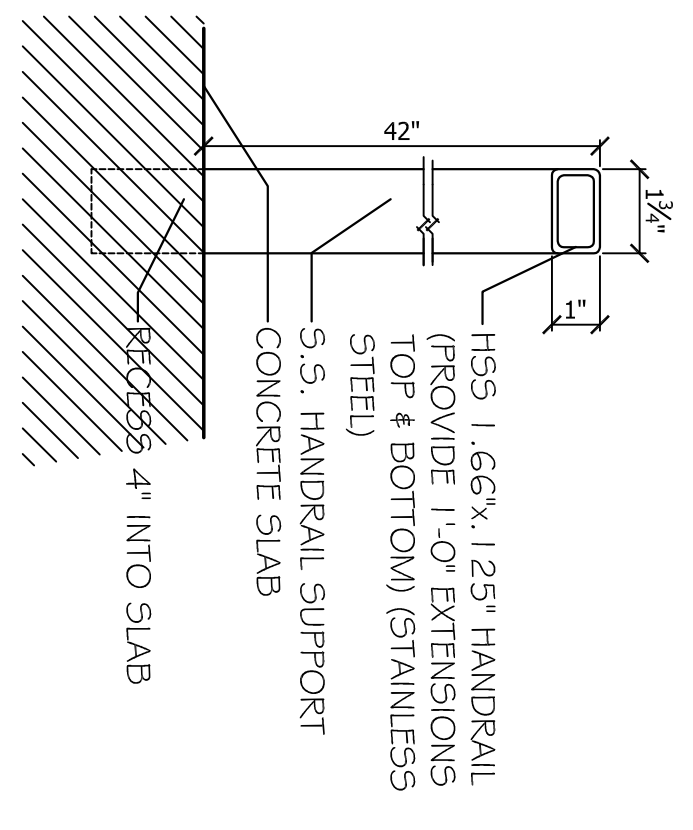

4 HANDRAIL DETAILS (EXTERIOR)
SCALE: 3/8" = 1'-0"