



LU/LA ELEVATOR SHALL BE:
 SYMMETRY "ELEVATION" LIMITED USE/LIMITED APPLICATION
 ELEVATOR WITH 42"W x 54"D STANDARD PLATFORM, RIGHT
 HAND ENTRY AND SHALL CONFORM TO ASME A17.1 AND
 FLORIDA ELEVATOR SAFETY CODE. ALL CONTROLS,
 INDICATORS, SIGNAGE AND COMMUNICATIONS SYSTEMS
 SHALL BE PROVIDED AS REQUIRED BY CODE AND SHALL BE
 INSTALLED IN COMPLIANCE WITH CODE REQUIREMENTS.

CONTACT: JIM JESCHONEK
 ACCESS LIFTS AND ELEVATORS INC.
 8362 PINES BLVD. #380
 PEMBROKE PINES, FL 33024
 PHONE: (954) 826-5438
 jim.jeschonek@gmail.com

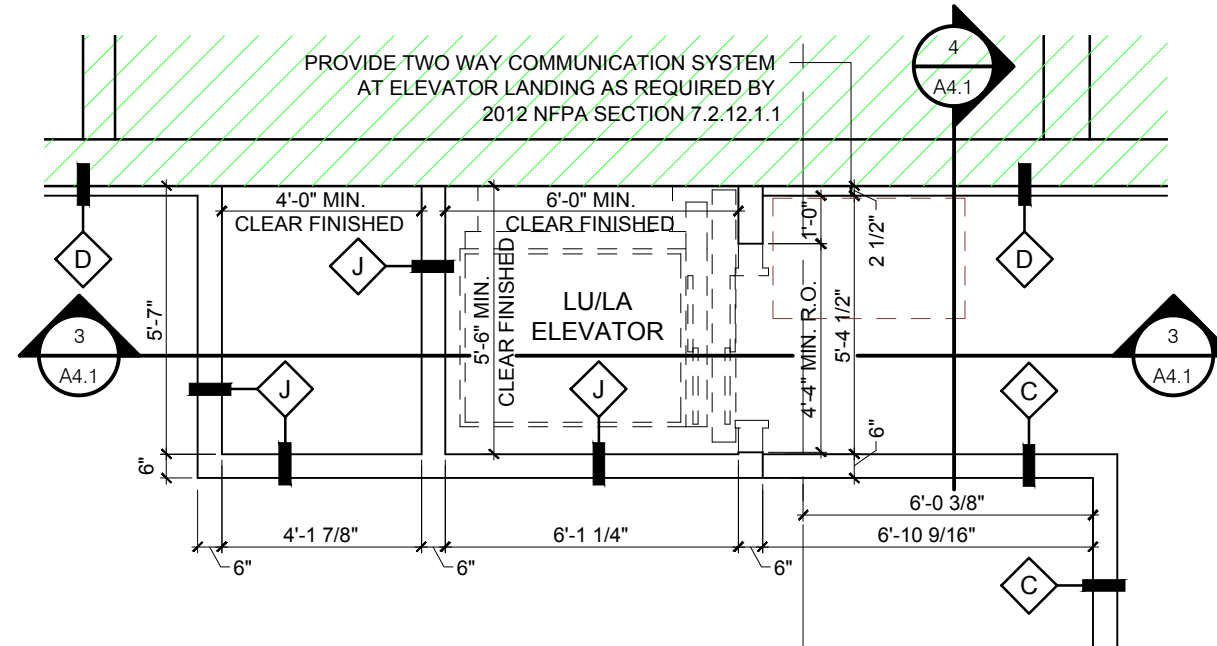


2 ENLARGED MEZZ. PLAN @ LU/LA ELEVATOR & EQUIP. ROOM
 SCALE: 1/4" = 1'-0"
 NORTH

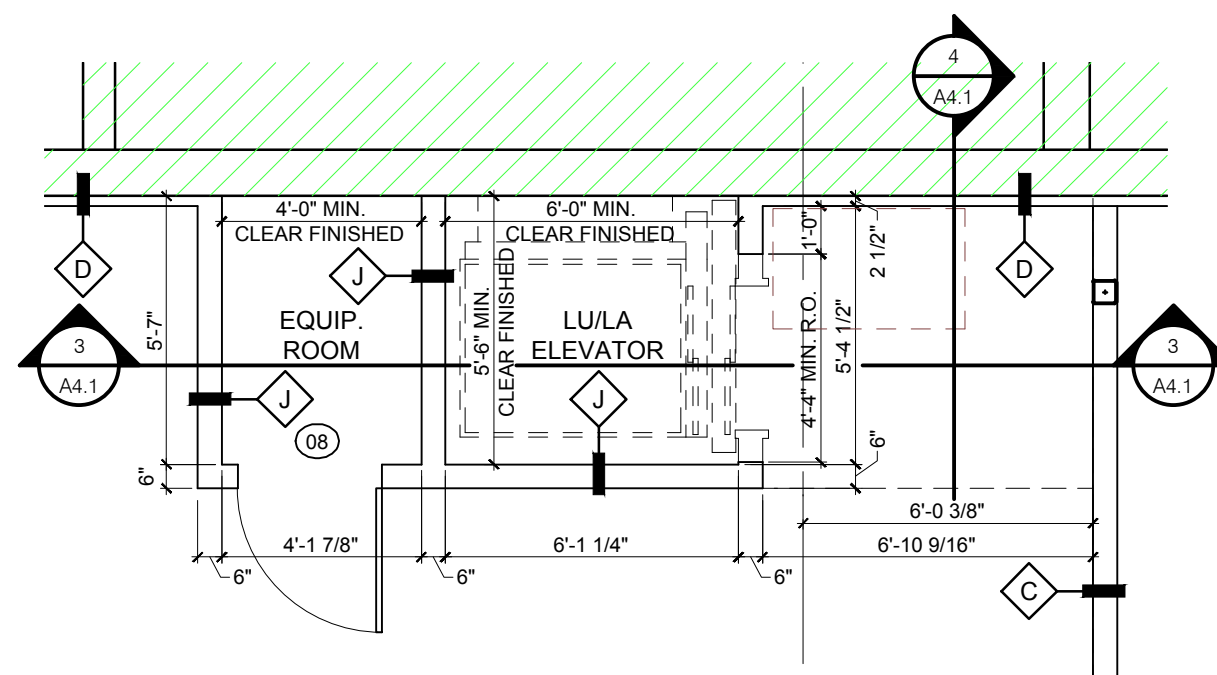


1 ENLARGED FLOOR PLAN @ LU/LA ELEVATOR & EQUIP. ROOM
 SCALE: 1/4" = 1'-0"
 NORTH

PARTITION TYPE SCHEDULE

- | | | |
|--|--|---|
| <p>A 20 GAUGE 6" METAL STUDS @ 16" O.C. W/ 5/8" GYP. BD. EA. SIDE OF STUDS TO BOTTOM OF FLOOR/ROOF DECK ABOVE. FILL VOIDS BETWEEN STUDS W/ SOUND ATTENUATING BATTS. TERMINATE BATTS @ 12" ABOVE ADJACENT CEILING. SUBSTITUTE 5/8" DUROCK CEMENT BOARD AT WET LOCATIONS. USE 18 GAUGE STUDS FOR WALLS GREATER THAN 13'-0" IN HEIGHT.</p> <p>B 20 GAUGE 4" METAL STUDS @ 16" O.C. W/ 5/8" GYP. BD. EA. SIDE OF STUDS TO BOTTOM OF FLOOR/ROOF DECK ABOVE. FILL VOIDS BETWEEN STUDS W/ SOUND ATTENUATING BATTS. TERMINATE BATTS @ 12" ABOVE ADJACENT CEILING. SUBSTITUTE 5/8" DUROCK CEMENT BOARD AT WET LOCATIONS. USE 18 GAUGE STUDS FOR WALLS GREATER THAN 13'-0" IN HEIGHT.</p> <p>C 25 GAUGE 6" METAL STUDS @ 16" O.C. W/ 5/8" GYP. BD. EA. SIDE OF STUDS TO 42" A.F.F. - WRAP TOP OF WALL W/ 5/8" GYP. BD. INSTALL 3" SQUARE STEEL POSTS @ 12'-0" O.C., ANCHOR STEEL POSTS TO SLAB.</p> | <p>D 25 GAUGE 2 1/2" METAL STUD FURRING @ 16" O.C. ON EXIST. CMU WALL W/ 5/8" GYP. BD. ON INTERIOR SIDE OF STUDS TO BOTTOM OF FLOOR/ROOF DECK ABOVE. FILL VOIDS BETWEEN STUDS W/ 2 1/2" R-8 BATTS. SUBSTITUTE 5/8" DUROCK CEMENT BOARD AT WET LOCATIONS.</p> <p>E 25 GAUGE 6" METAL STUD FURRING @ 16" O.C. ON EXIST. CMU WALL W/ 5/8" GYP. BD. ON INTERIOR SIDE OF STUDS TO BOTTOM OF FLOOR/ROOF DECK ABOVE. FILL VOIDS BETWEEN STUDS W/ 2 1/2" R-8 BATTS. SUBSTITUTE 5/8" DUROCK CEMENT BOARD AT WET LOCATIONS.</p> <p>F EXIST CMU WALL TO REMAIN. CLEAN AND PREPARE FOR TENANT APPLIED FINISHES.</p> <p>G 20 GAUGE NOMINAL 2" METAL STUDS @ 16" O.C. W/ 5/8" DUROCK CEMENT BOARD EA. SIDE OF STUDS TO BOTTOM OF FLOOR/ROOF DECK ABOVE. FILL VOIDS BETWEEN STUDS W/ SOUND ATTENUATING BATTS. TERMINATE BATTS @ 12" ABOVE ADJACENT CEILING. USE 18 GAUGE STUDS FOR WALLS GREATER THAN 13'-0" IN HEIGHT.</p> | <p>H INFILL EXIST. CMU WALL OPENING W/ CONSTRUCTION TO MATCH ADJACENT WALLS PER UL NO. U905 W/ CORE FILL 500 FOAM INSULATION IN ALL VOID CELLS. FINISH EXTERIOR FACE OF CMU TO MATCH ADJACENT EXTERIOR BUILDING WALLS.</p> <p>J SAME AS PARTITION TYPE A, EXCEPT USE 5/8" TYPE X GYP. BD. FOR 1 HOUR FIRE RATED ASSEMBLY AS PER UL DESIGN NO. U425 FOR LOAD BEARING INTERIOR METAL STUD WALL. ALL WALL PENETRATIONS SHALL BE PROTECTED AS PER UL SYSTEM NO. W-1054.</p> |
|--|--|---|

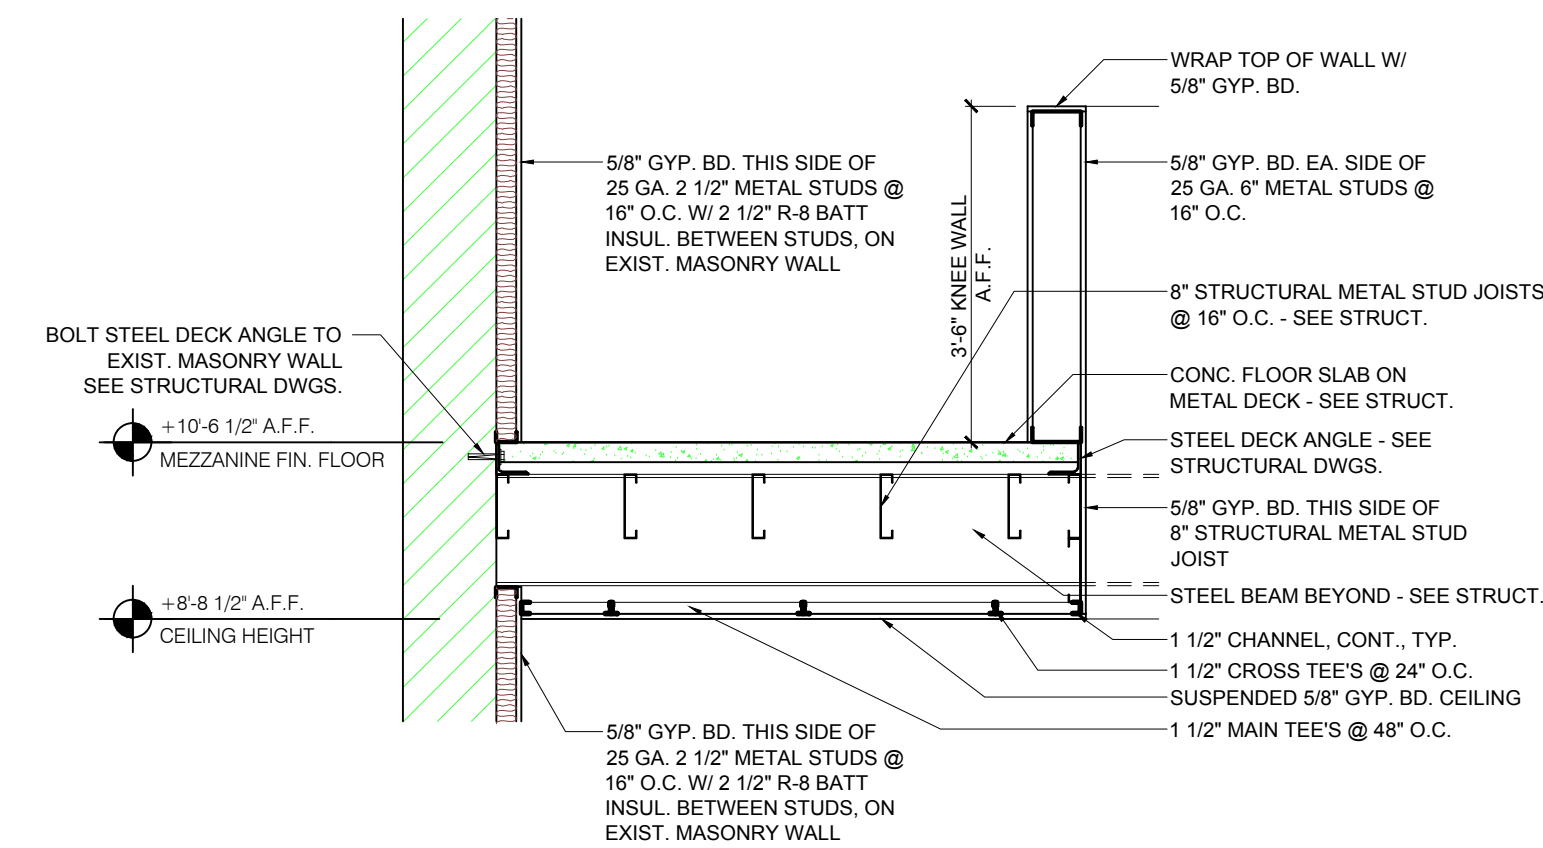

4 SECTION @ LANDING
 SCALE: 1/2" = 1'-0"

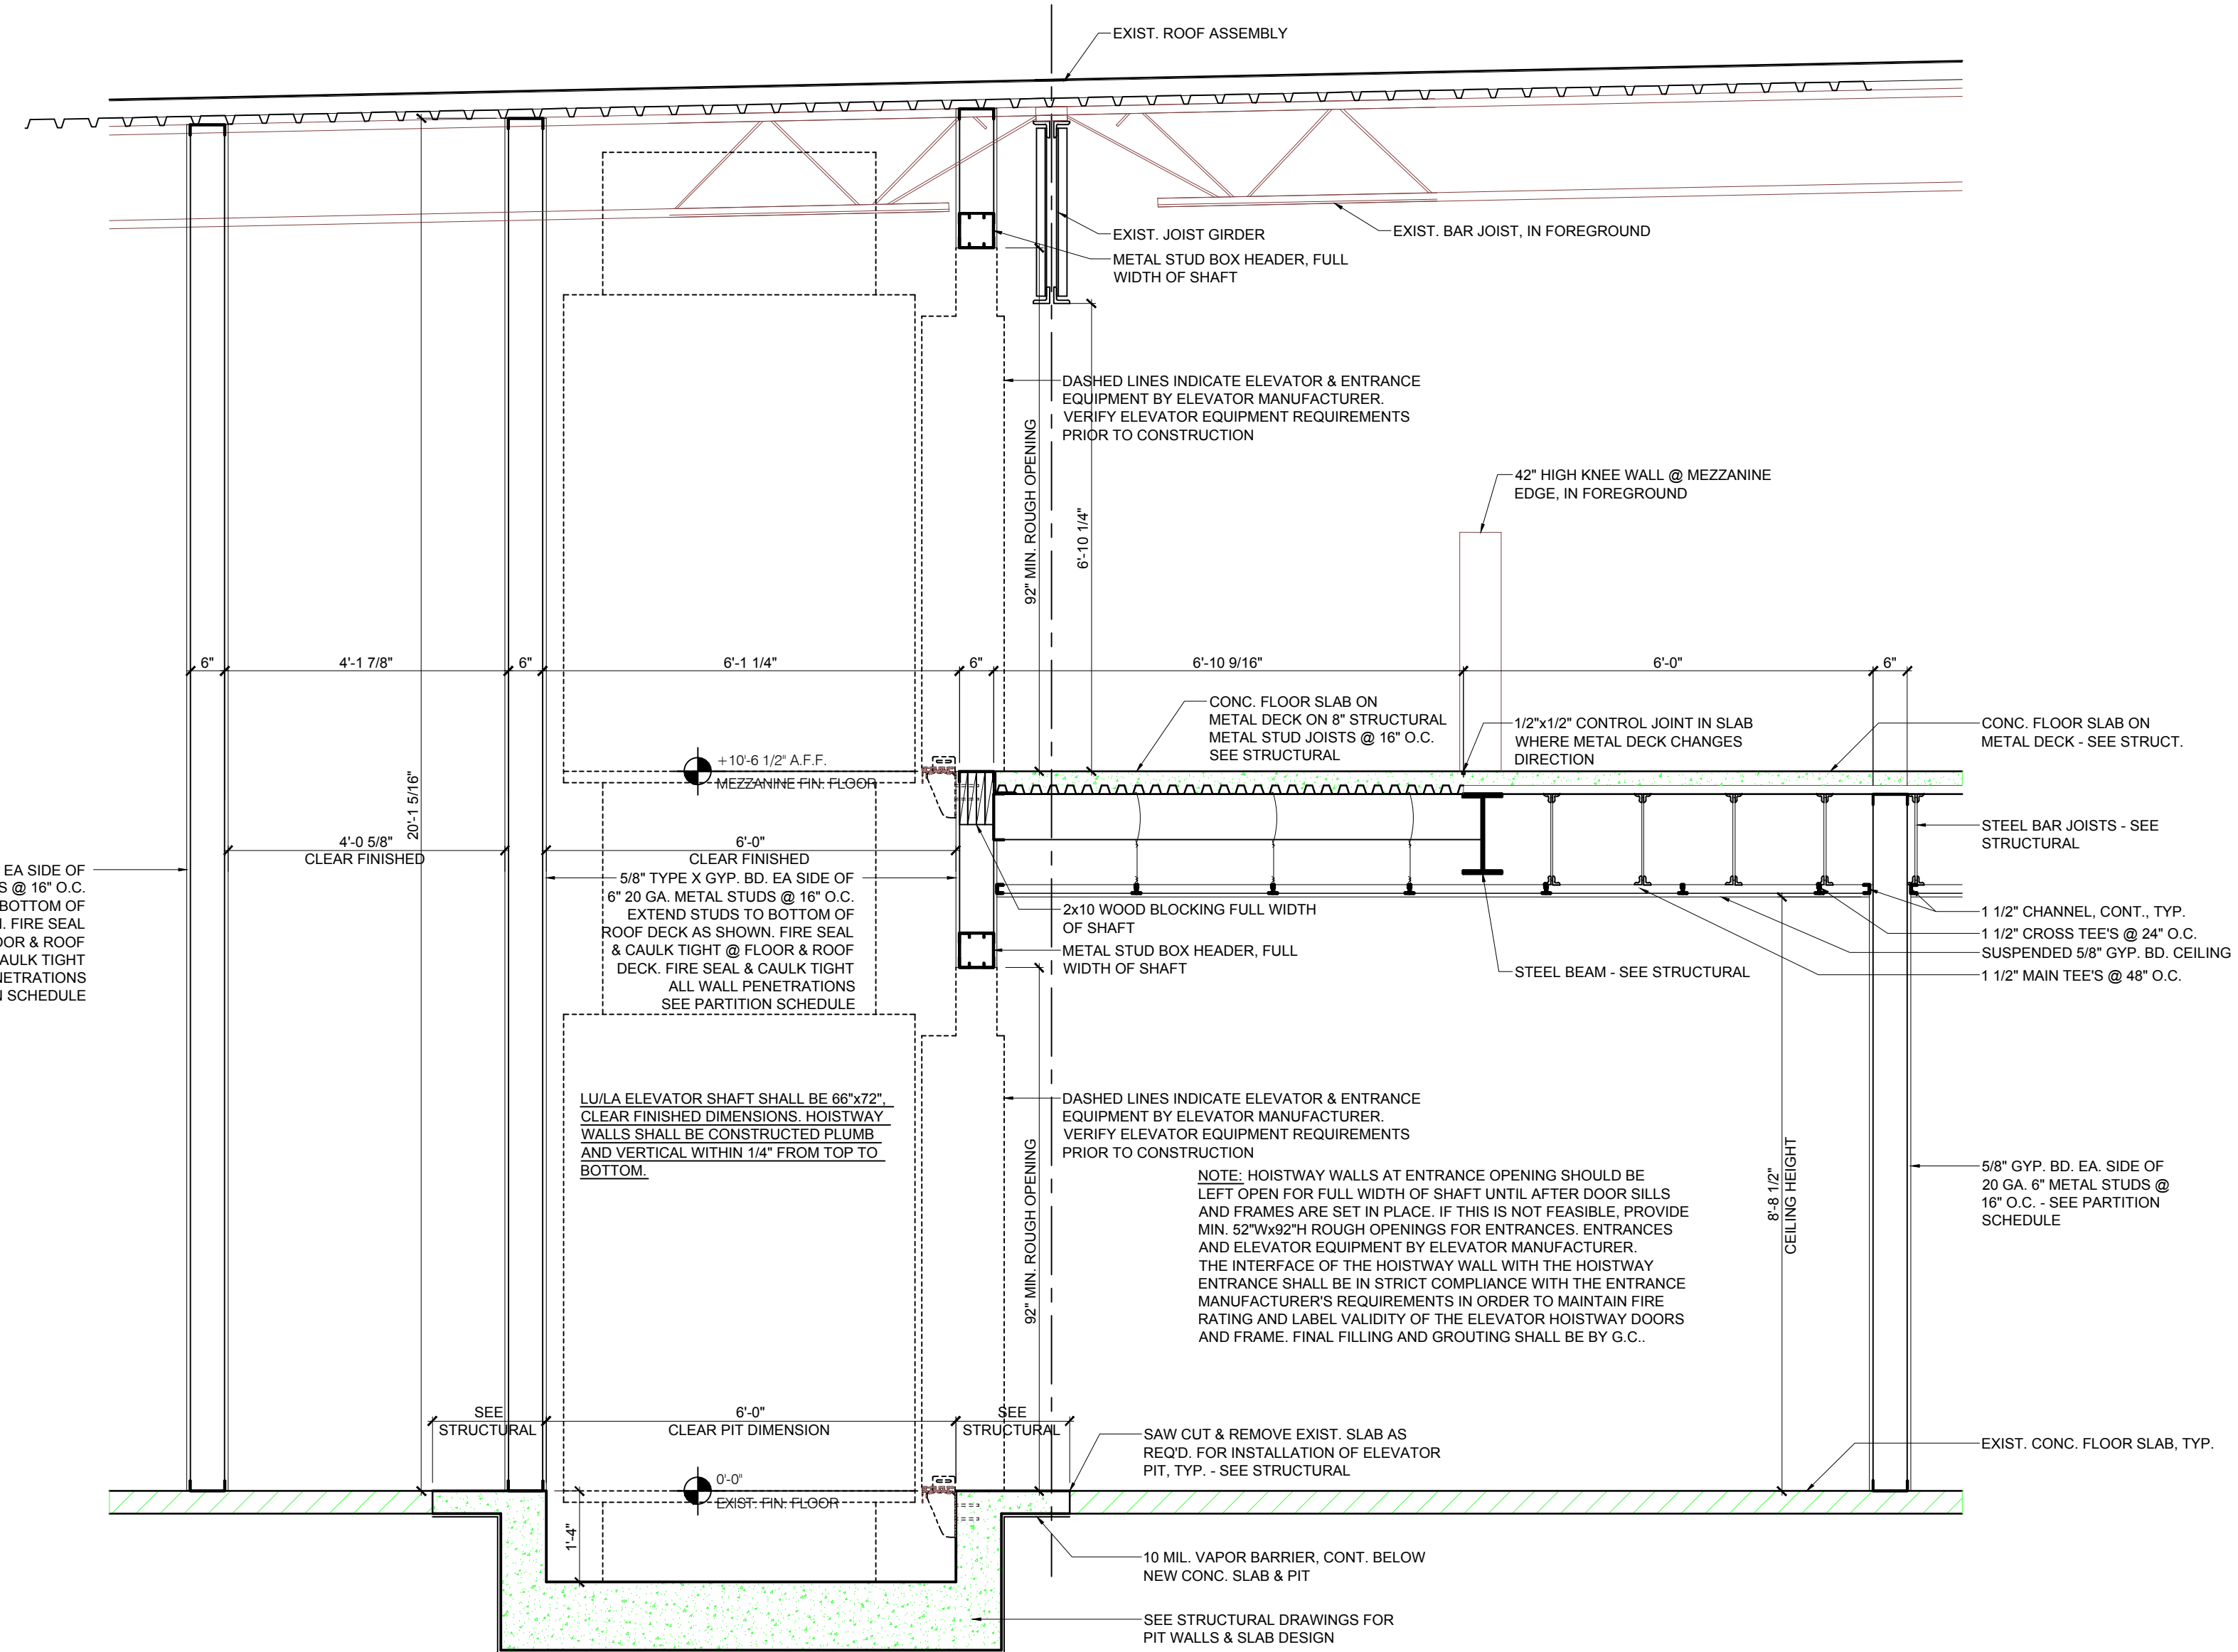


3 SECTION @ ELEVATOR SHAFT & EQUIP. ROOM
 SCALE: 1/2" = 1'-0"

AROUND THE CLOCK FITNESS
 ALICO COMMONS SHOPPING CENTER
 FT. MYERS, FLORIDA

ZITO • RUSSELL
 ARCHITECTS, P.C.
 820 S. UNIVERSITY BLVD., SUITE 202
 MOBILE, AL 36609
 PHONE (251) 343-6161
 FAX (251) 343-5505

© COPYRIGHT 2014
 ZITO • RUSSELL
 ARCHITECTS, P.C.

REVISIONS	DATE	DESCRIPTION
1	01/05/15	COUNTY COMMENTS

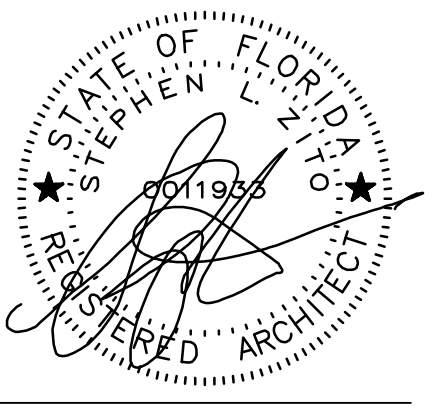

FILE 3840
 DATE NOV. 26, 2014
 SHEET

A4.1
 Enlarged Plan, Section & Detail