

Florida HERS BESTEST results for:

Software Name: EnergyGauge USA v.4.0

User input data fields indicated by pale yellow

Test result fields indicated by pale green

Annual Heating Loads: Orlando

Heating	range max	range min	Result	pass/fail
L100AO	10.56	1.54	5.33	pass
L110AO	14.71	5.54	8.60	pass
L120AO	8.57	-0.44	3.99	pass
L130AO	7.86	-0.48	3.99	pass
L140AO	8.34	-0.05	3.55	pass
L150AO	9.55	0.37	5.52	pass
L155AO	9.95	0.78	5.59	pass
L160AO	10.71	1.74	5.64	pass
L170AO	14.37	4.78	9.76	pass
L200AO	25.55	13.41	17.67	pass
L202AO	26.24	13.87	17.80	pass
L302XO	12.09	-0.04	3.50	pass
L304XO	10.36	-0.97	3.12	pass
L322XO	14.82	-0.25	2.63	pass
L324XO	10.15	-1.87	1.99	pass

Annual Heating Load deltas: Orlando

Heating	range max	range min	Result	pass/fail
L110AO-L100AO	8.15	-0.05	3.27	pass
L120AO-L100AO	2.39	-5.99	-1.34	pass
L130AO-L100AO	2.15	-6.70	-1.34	pass
L140AO-L100AO	2.52	-6.22	-1.78	pass
L150AO-L100AO	3.20	-5.17	0.19	pass
L155AO-L100AO	4.41	-3.69	0.07	pass
L160AO-L100AO	4.28	-3.85	0.31	pass
L170AO-L100AO	8.11	-0.81	4.43	pass
L200AO-L100AO	18.99	7.81	12.34	pass
L202AO-L200AO	4.82	-3.53	0.13	pass
L302XO-L100AO	5.60	-6.60	-1.83	pass
L302XO-L304XO	5.73	-3.18	0.38	pass
L322XO-L100AO	8.26	-6.12	-2.70	pass
L322XO-L324XO	8.67	-2.65	0.64	pass


Annual Cooling Loads: Orlando

Cooling	range max	range min	Result	pass/fail
L100AO	55.15	39.34	46.42	pass
L110AO	55.65	39.61	46.69	pass
L120AO	51.57	38.11	42.79	pass
L130AO	38.46	25.10	32.42	pass
L140AO	24.75	12.55	19.87	pass
L150AO	65.62	46.54	56.66	pass
L155AO	53.20	39.53	47.12	pass
L160AO	58.90	42.65	50.38	pass
L170AO	40.63	28.95	33.97	pass
L200AO	63.08	40.81	52.13	pass
L202AO	53.11	36.51	39.63	pass


Annual Cooling Load deltas: Orlando

Cooling	range max	range min	Result	pass/fail
L110AO-L100AO	4.49	-3.73	0.27	pass
L120AO-L100AO	2.77	-6.89	-3.63	pass
L130AO-L100AO	-10.24	-20.76	-14.00	pass
L140AO-L100AO	-22.79	-34.56	-26.55	pass
L150AO-L100AO	13.53	3.61	10.24	pass
L155AO-L150AO	-3.42	-16.21	-9.54	pass
L160AO-L100AO	7.68	-0.69	3.96	pass
L170AO-L100AO	-6.39	-17.76	-12.45	pass
L200AO-L100AO	10.77	-1.59	5.71	pass
L202AO-L200AO	13.49	1.06	12.50	pass


Annual Heating Loads: Orlando, FL

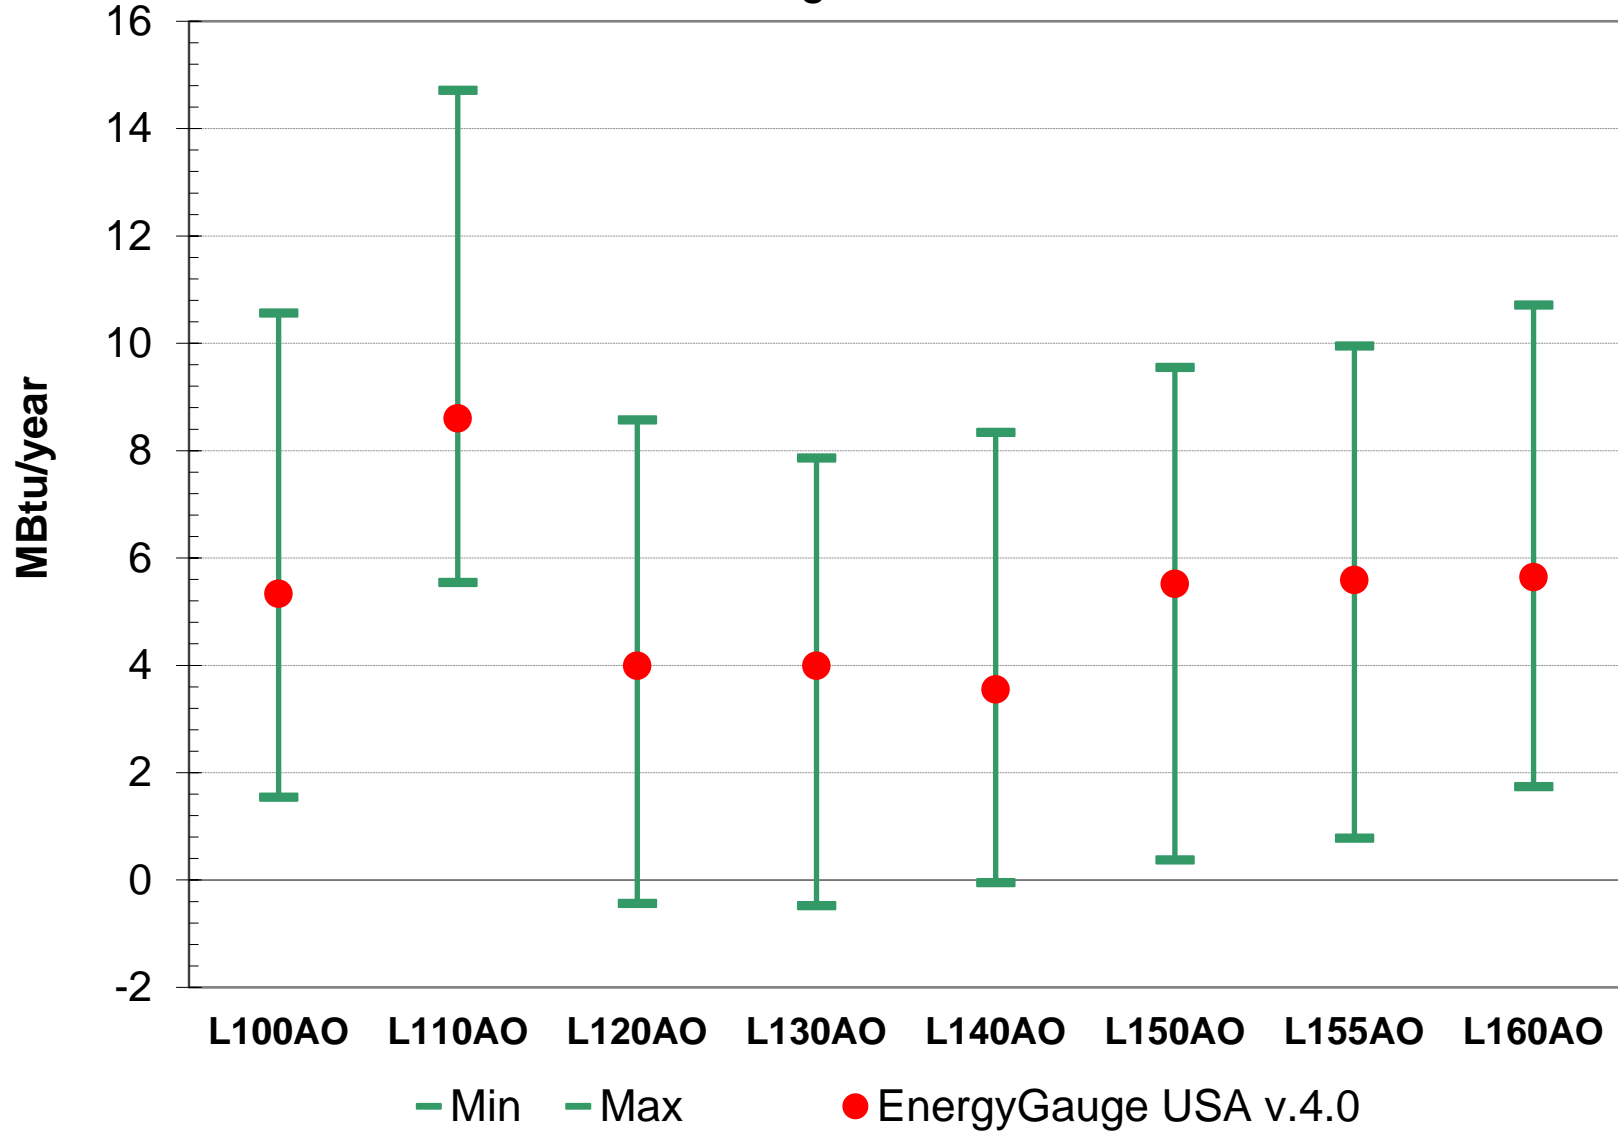


Annual Heating Loads: Orlando, FL

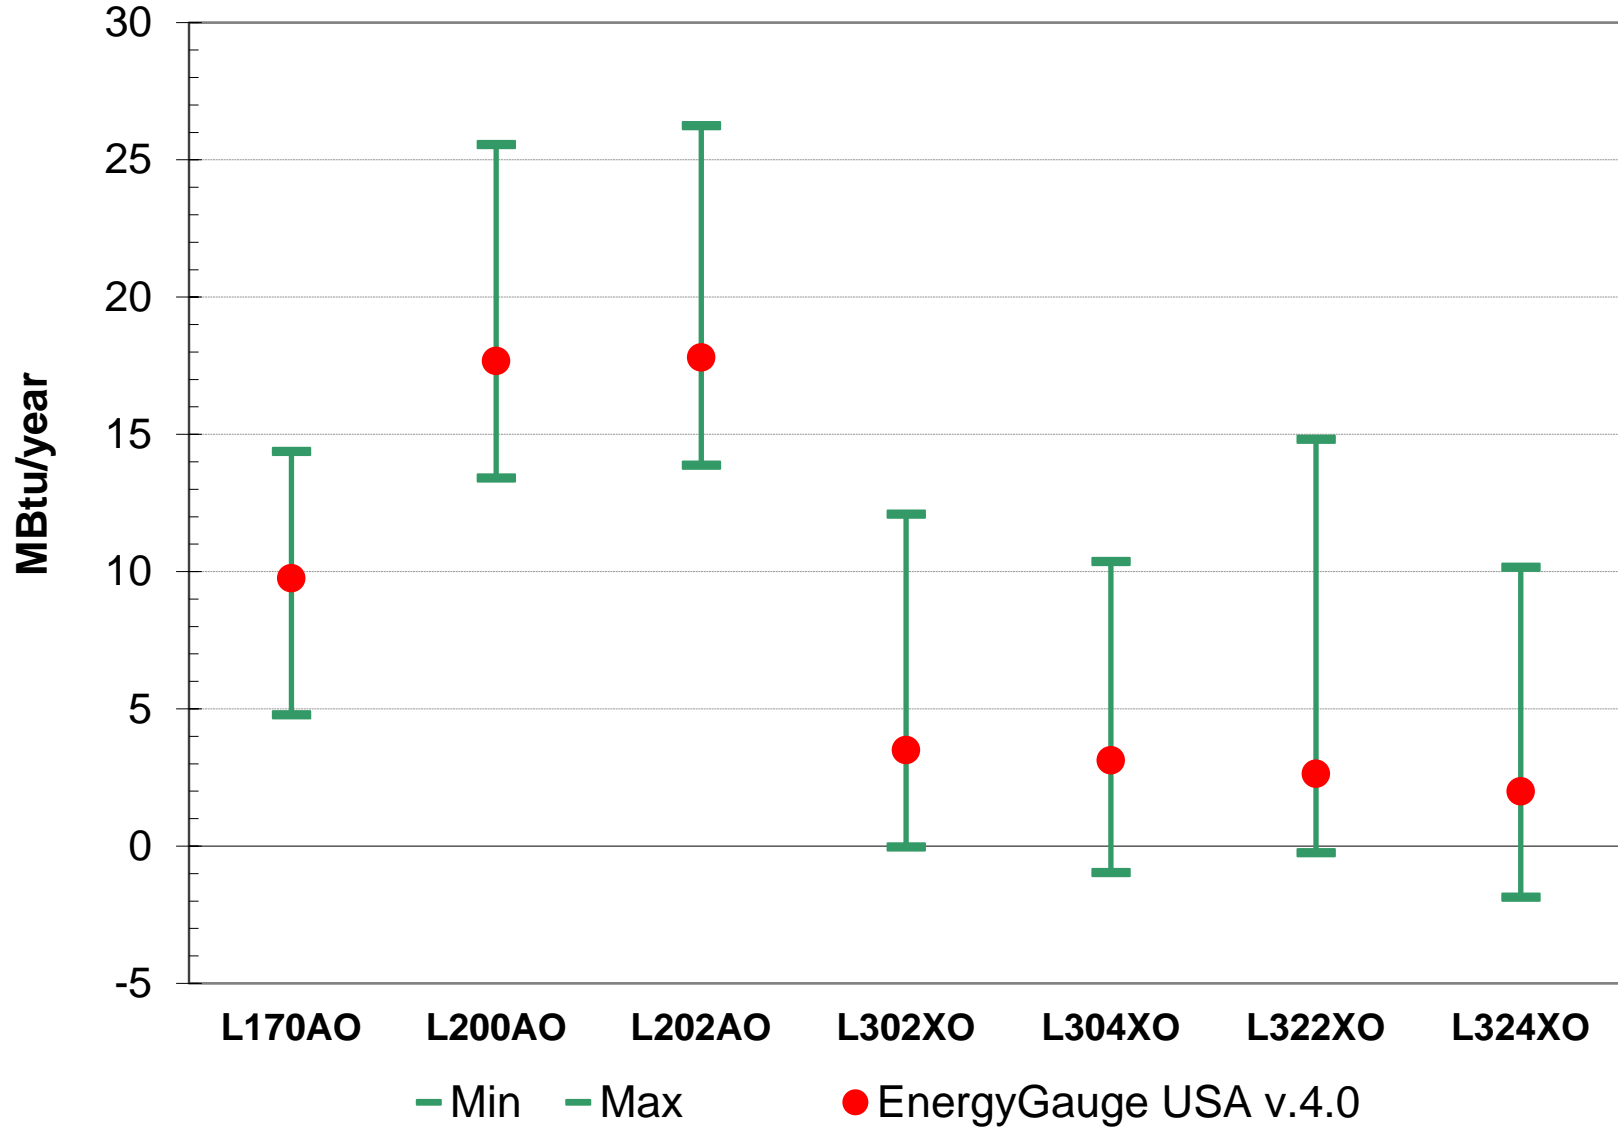


Annual Heating Load Deltas: Orlando, FL

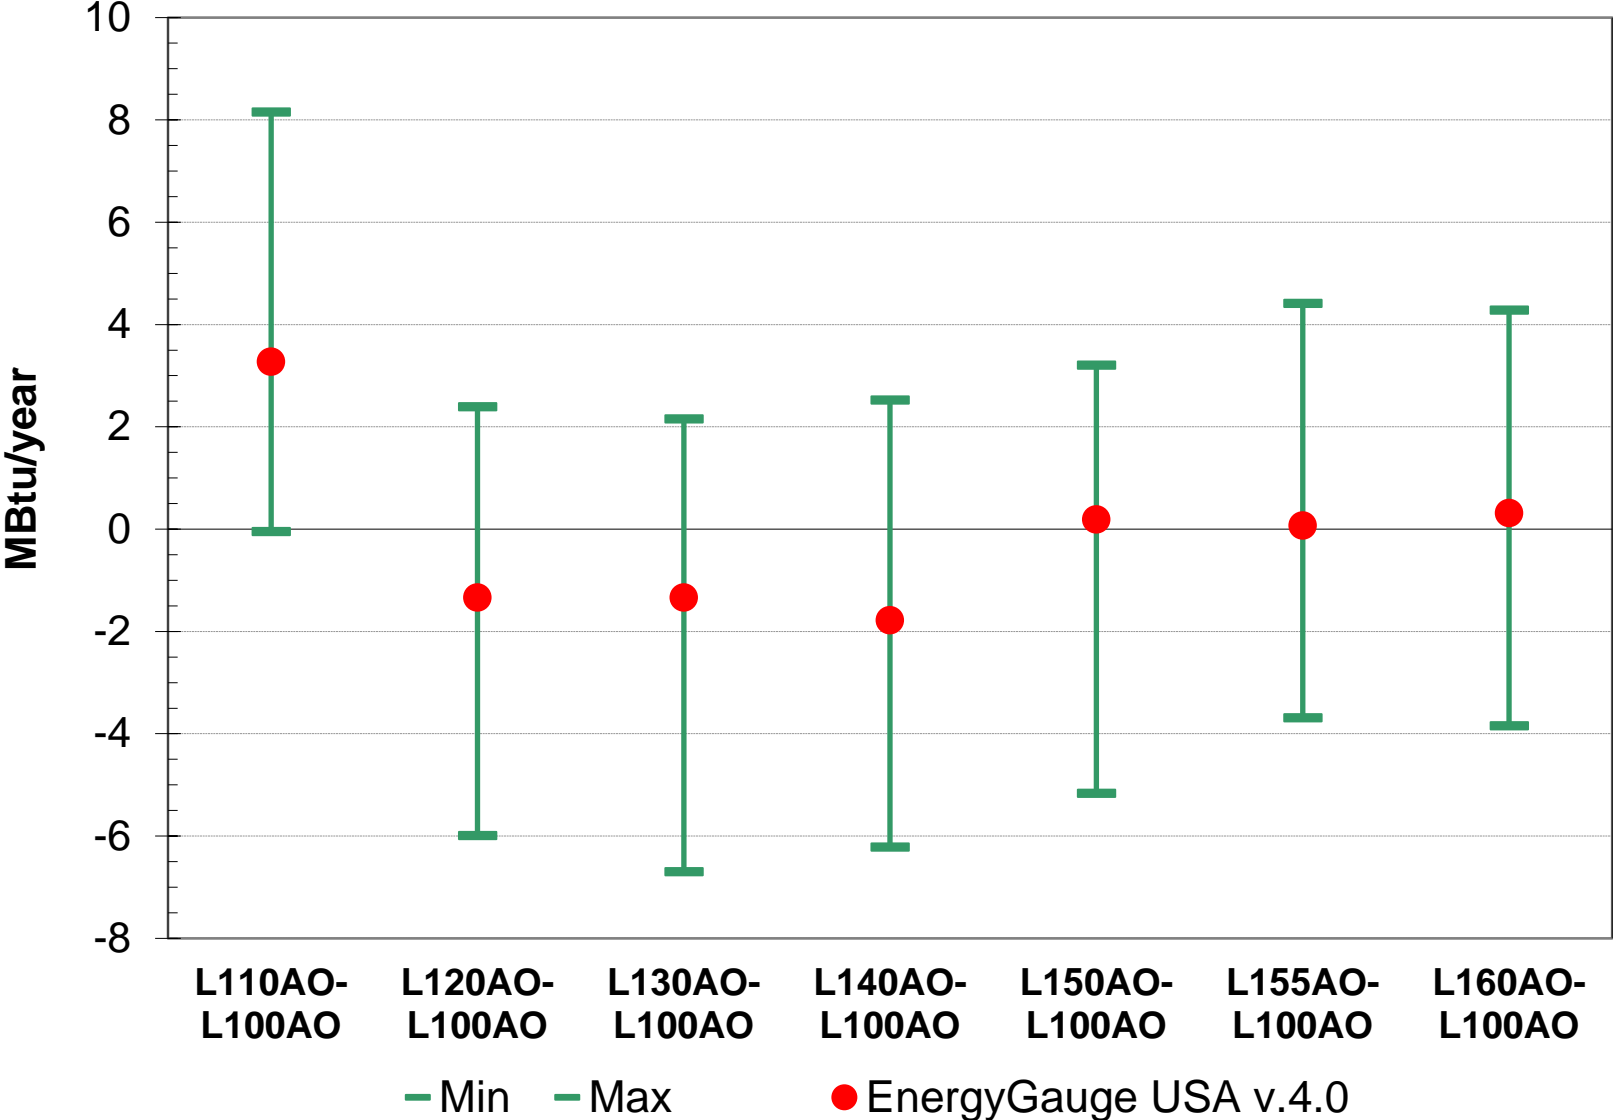


Annual Heating Load Deltas: Orlando, FL

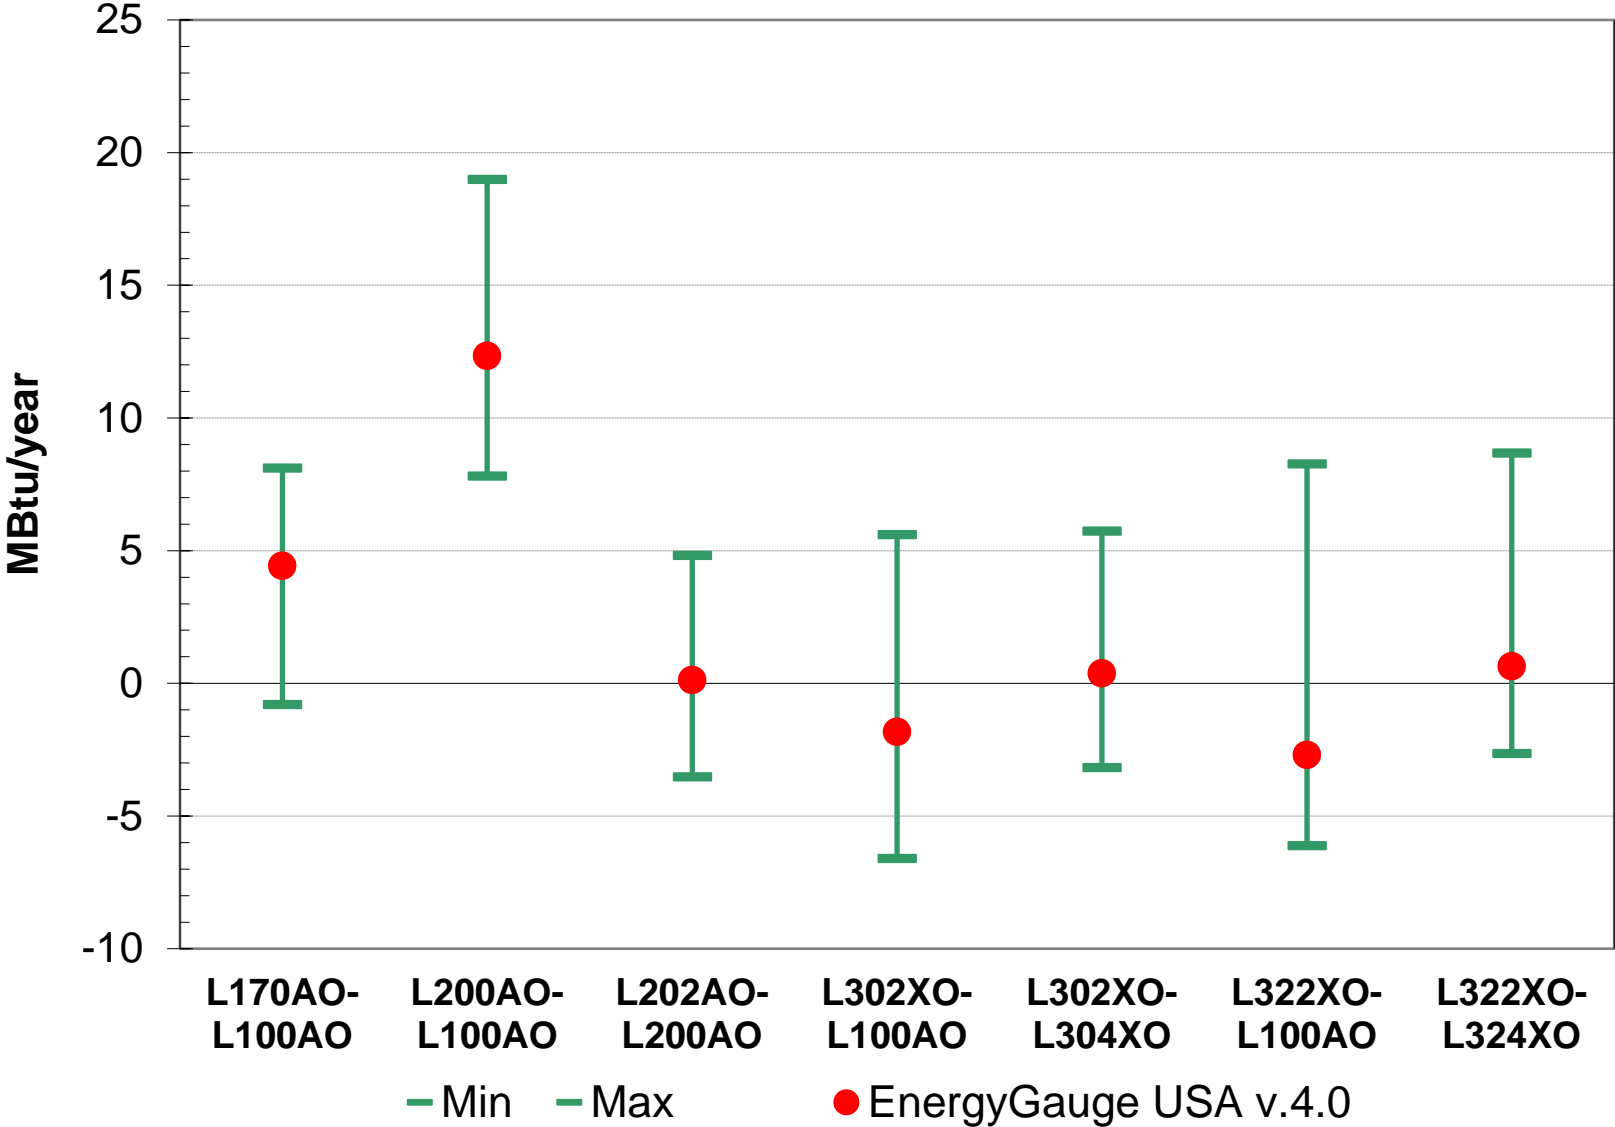


Annual Cooling Loads: Orlando, FL

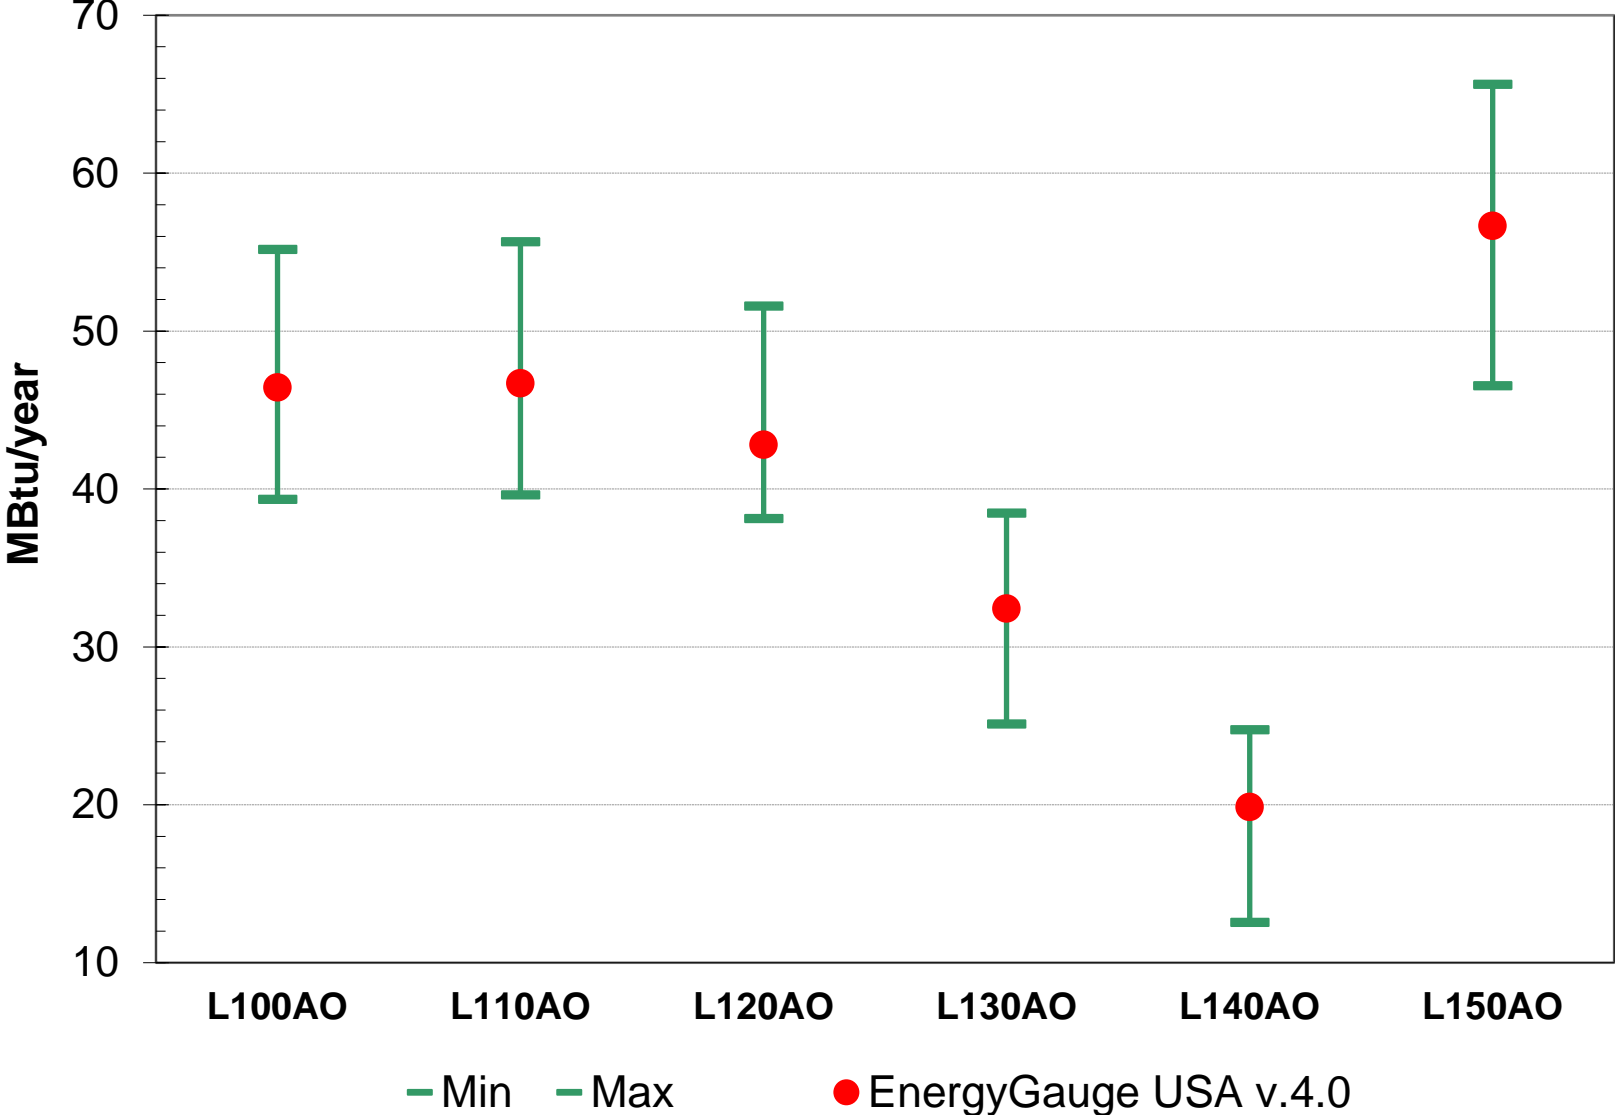

Annual Cooling Loads: Orlando, FL

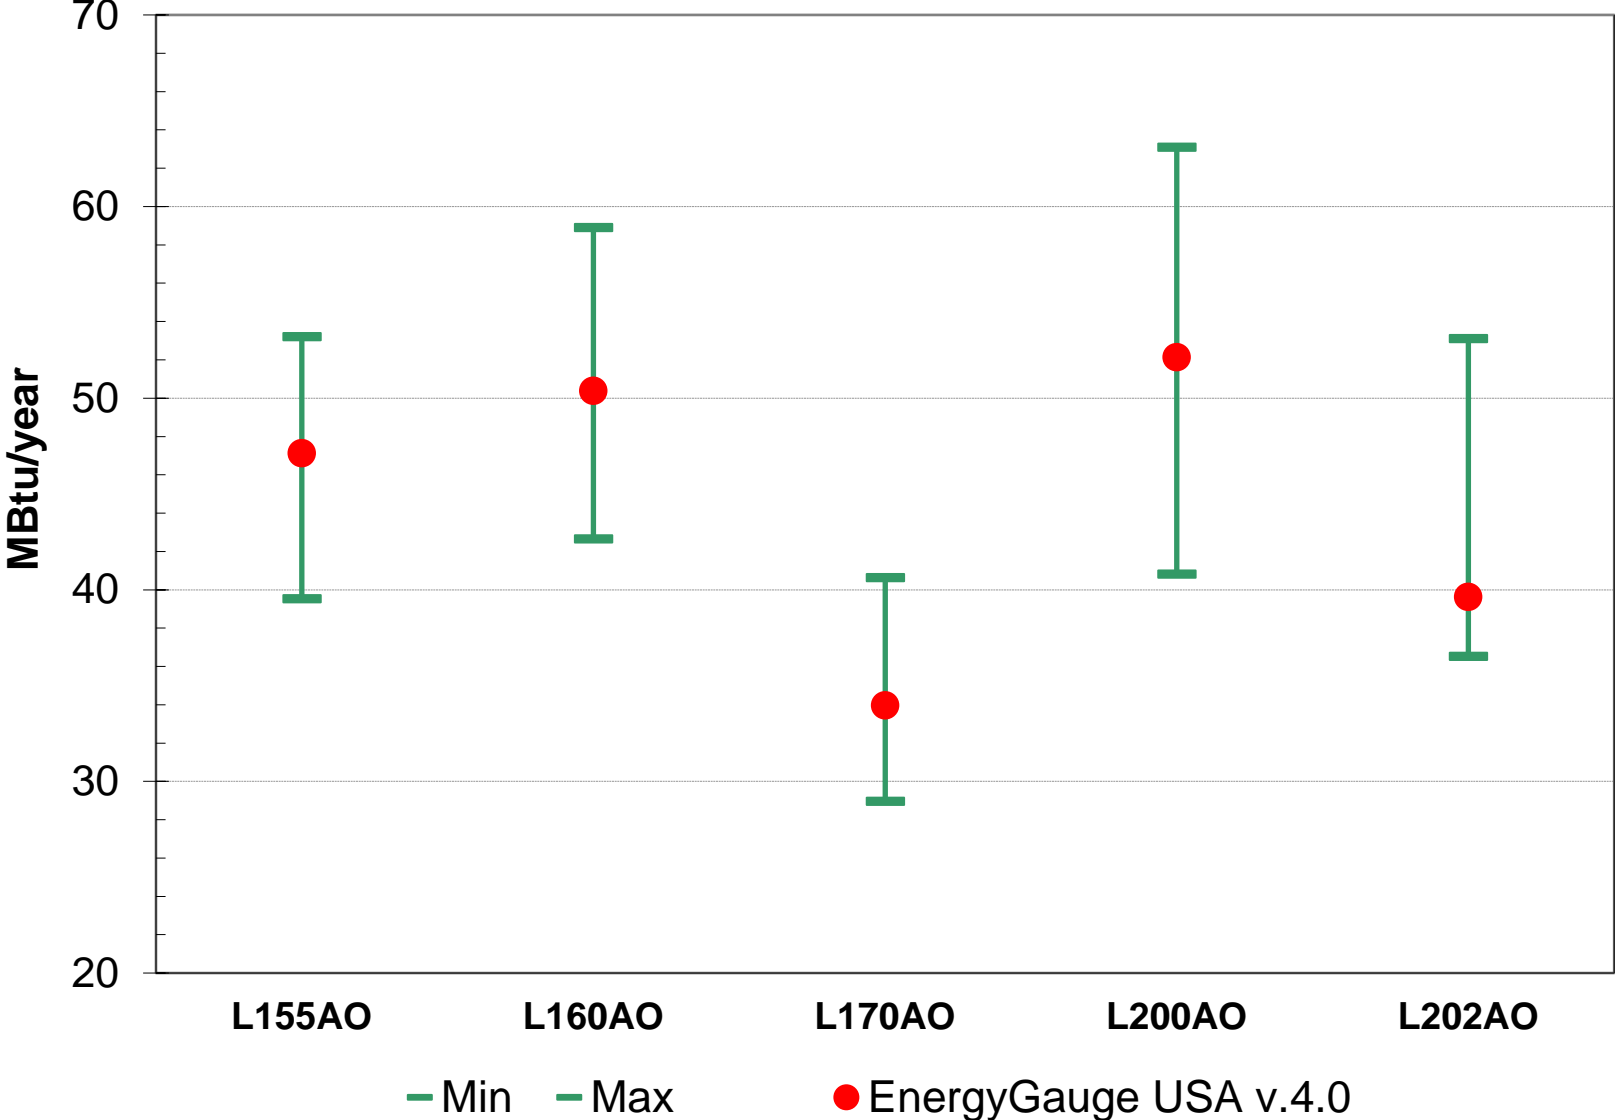

Annual Cooling Load Deltas: Orlando, FL

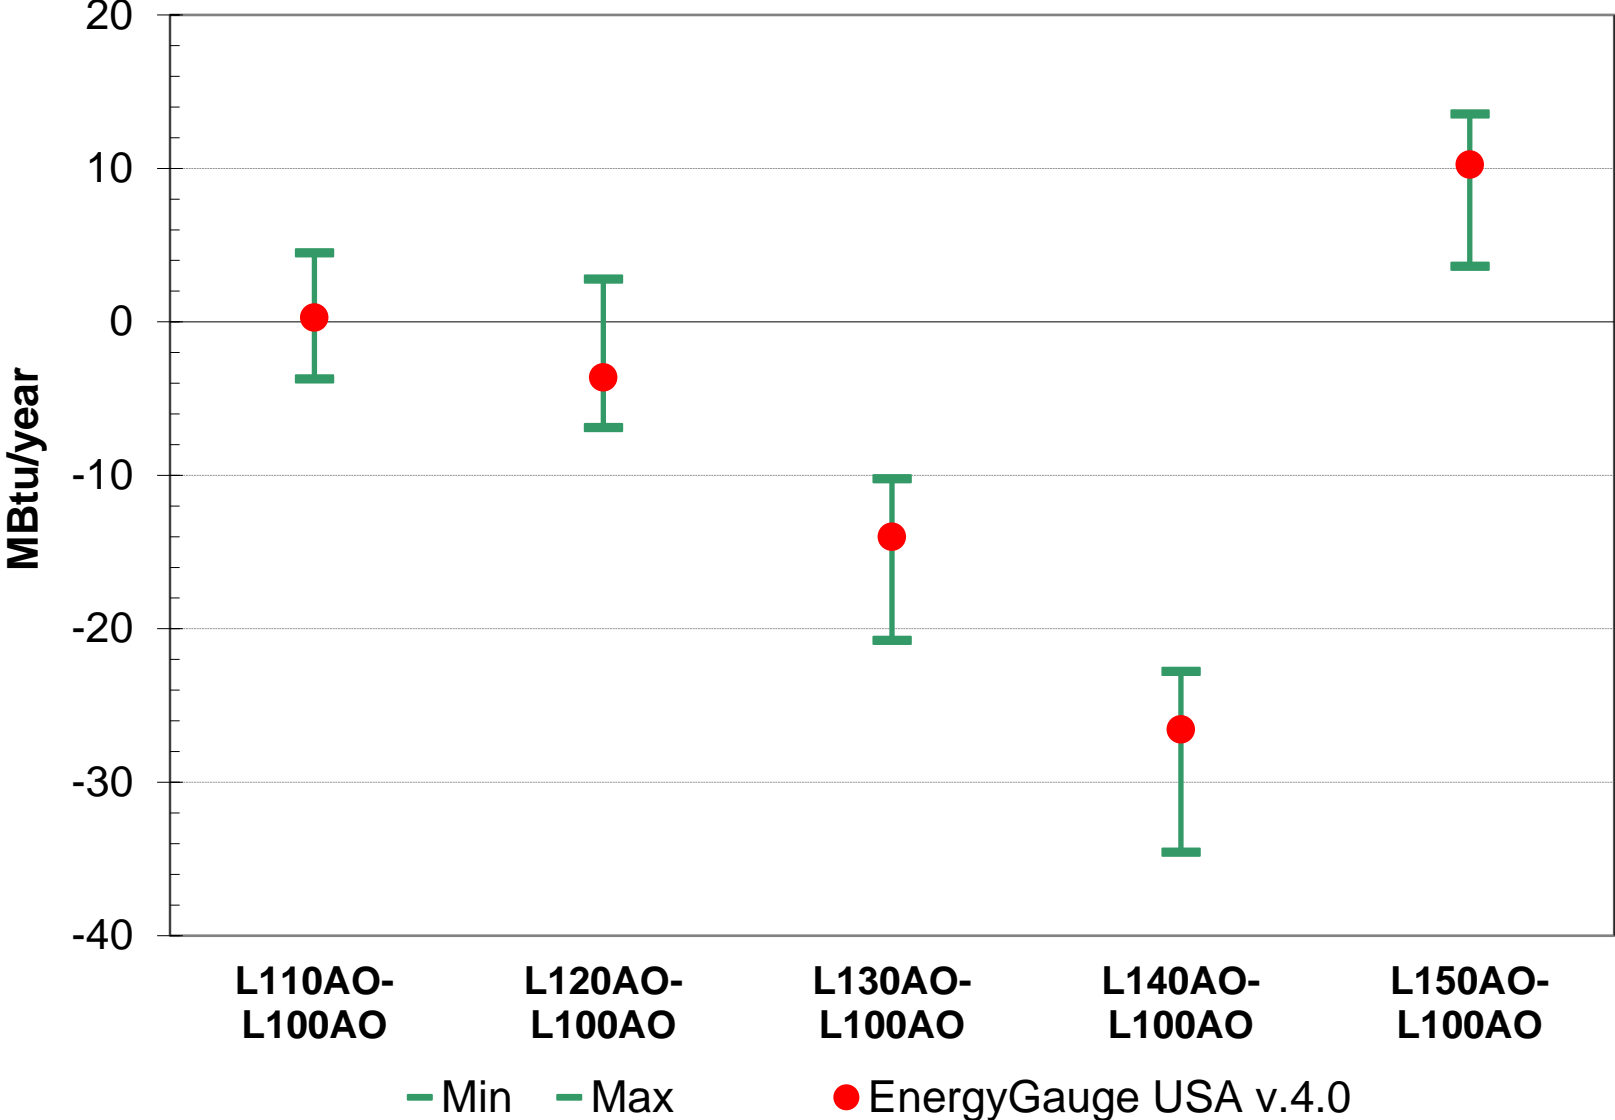

Annual Cooling Load Deltas: Orlando, FL

