

RESNET HVAC Test Suite Results:**Software Name:** EnergyGauge USA v4.0

User input data fields indicated by pale yellow

Test result fields indicated by pale green

Results


Cooling tests:


Case	Cool	Cool Fan	Cool Tot	% change	Criteria		
					min	max	
HVAC-1a	5424	957	6381	---			
HVAC-1b	4171	957	5128	-19.64%	-21.24%	-17.38%	pass

Heating tests:

Case	Heat	Heat Fan	Heat Tot	% change	Criteria		
					min	max	
HVAC-2a	857	668	87.98	---			
HVAC-2b	743	668	76.58	-12.96%	-13.30%	-11.57%	pass

Case	Heat	Heat Fan	Heat Tot	% change	Criteria		
					min	max	
HVAC-2c	10114	1424	11538	---			
HVAC-2d	8002	1089	9091	-21.21%	-29.03%	-16.73%	pass
HVAC-2e	18337	1002	19339	67.61%	41.81%	80.81%	pass

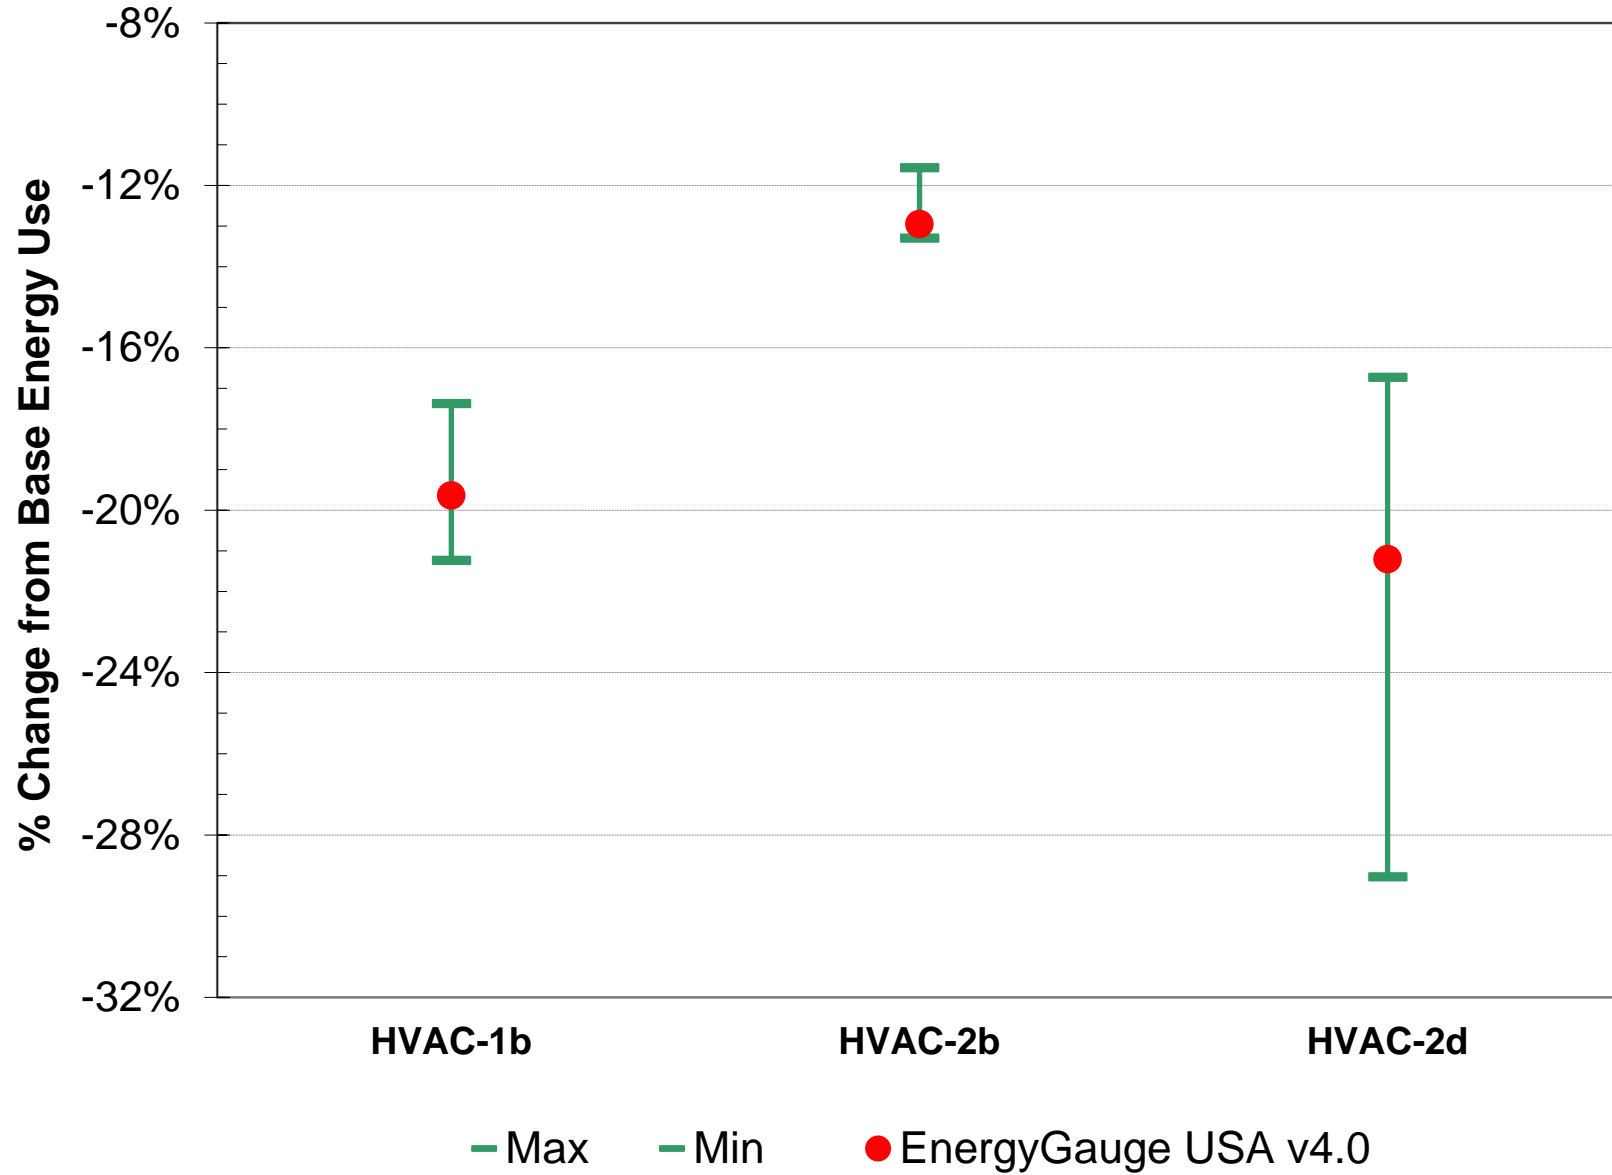

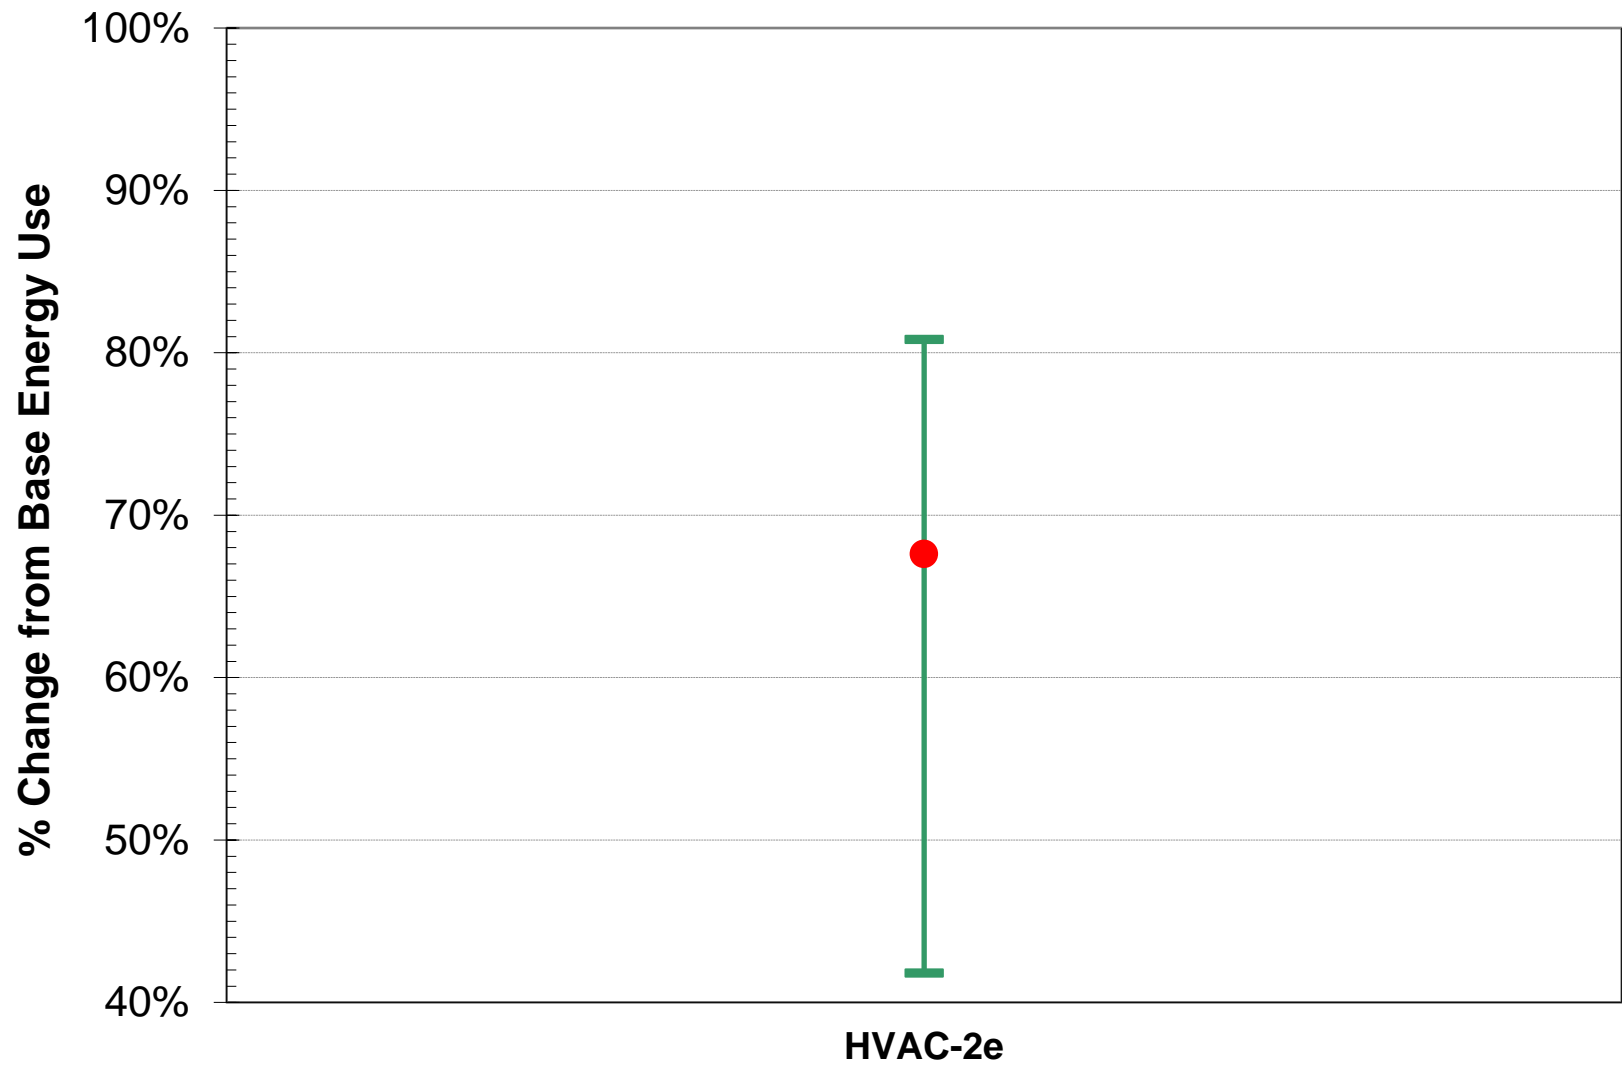

— Max — Min ● EnergyGauge USA v4.0