

ICC-ES Evaluation Report

ESR-2138

Reissued March 2019

Revised July 2019

This report is subject to renewal March 2020.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

DIVISION: 03 00 00—CONCRETE
Section: 03 16 00—Concrete Anchors

DIVISION: 04 00 00—MASONRY
Section: 04 05 19.16—Masonry Anchors

DIVISION: 05 00 00—METALS
Section: 05 05 23—Metal Fastenings

DIVISION: 06 00 00—WOOD, PLASTICS AND COMPOSITES
Section: 06 05 23—Wood, Plastic and Composite Fastenings

REPORT HOLDER:

SIMPSON STRONG-TIE COMPANY INC.

EVALUATION SUBJECT:

SIMPSON STRONG-TIE® POWDER-ACTUATED FASTENERS, THREADED STUDS AND ASSEMBLIES

1.0 EVALUATION SCOPE

Compliance with the following codes:

- 2018, 2015, 2012, 2009 and 2006 *International Building Code*® (IBC)
- 2018, 2015, 2012, 2009 and 2006 *International Residential Code*® (IRC)

For evaluation for compliance with codes adopted by Los Angeles Department of Building and Safety (LADBS), see [ESR-2138 LABC and LARC Supplement](#).

Property evaluated:

Structural

2.0 USES

The Simpson Strong-Tie® Powder-Actuated Fasteners and Threaded Studs are used to fasten building components, such as wood and steel, to base materials of normal-weight concrete, sand-lightweight concrete, steel deck filled with sand-lightweight concrete, structural steel, and hollow concrete masonry units (CMUs). The fasteners are alternatives to the cast-in-place anchors described in 2018 and 2015 IBC Section [1901.3](#) (2012 IBC Section [1908](#); 2009 and 2006 IBC Section [1911](#)); the embedded anchors described in Section 8.1.3 of TMS 402-16 and 402-13, referenced in Section [2107](#) of the 2018 and 2015 IBC, respectively (Section 2.1.4 of TMS 402-11, -08 and

-05, referenced in Section [2107](#) of the 2012, 2009 and 2006 IBC, respectively) for placement in masonry; and the welds and bolts used to attach materials to structural steel, described in IBC Sections [2204.1](#) and [2204.2](#), respectively.

The Simpson Strong-Tie Ceiling Clip Assemblies are used to attach steel wire to concrete and concrete-filled steel deck panels; the Simpson Strong-Tie Threaded Rod Hanger Assemblies are used to attach threaded steel rod to concrete and concrete-filled steel deck panels.

For structures regulated under the IRC, the fasteners and assemblies may be used where an engineered design is submitted in accordance with IRC Section [R301.1.3](#).

3.0 DESCRIPTION

3.1 Powder-Actuated Fasteners and Threaded Studs:

3.1.1 Materials: The PINW and PINWP fasteners and PSLV3 threaded studs are power-actuated fasteners (PAFs) manufactured from steel complying with [ASTM A510](#), Grades 1060 to 1065 or 10B60 to 10B65, and the PDPA headed fasteners are power-actuated fasteners manufactured from steel complying with ASTM A510, Grade 1060. The fasteners are hardened in accordance with the manufacturer's documented specifications.

3.1.2 Finish: Unless otherwise noted in [Table 1](#) of this report, the fasteners have a mechanically plated zinc finish complying with [ASTM B695](#), Class 5, Type I.

3.1.3 Shank Type and Dimensions: The fasteners have straight shanks which are either smooth or knurled. See [Table 1](#) for shank type and fastener dimensions. Maximum point length is the maximum specified length from the tip of the fastener to the location where the diameter of the shank becomes constant. Minimum effective shank length is the minimum specified length from the underside of the fastener head to the tip of the fastener, except for fasteners with premounted washers, where the minimum effective shank length is the minimum specified length from the underside of the washer, in its installed condition, to the tip of the fastener. See [Figure 11](#) for illustrations of definitions of point length and effective shank length.

3.2 Powder-Actuated Assemblies:

Ceiling clip assemblies consist of a powder-actuated fastener and a steel angle (clip) which is premounted on the fastener at the manufacturing facility. The clip has a hole in the outstanding leg for attachment of ceiling wire.

Threaded rod hanger assemblies consist of a powder-actuated fastener and a steel bracket which is premounted on the fastener at the manufacturing facility.

The bracket has a threaded hole in the outstanding leg for attachment of threaded rod.

See [Table 1](#) for additional descriptions of the assemblies.

3.3 Substrate Materials:

3.3.1 Concrete: Normal weight and sand-lightweight concrete must comply with [Chapter 19](#) of the IBC or Section [R402.2](#) of the IRC, as applicable. The minimum concrete compressive strength at the time of fastener installation must be as noted in the applicable allowable load table.

3.3.2 Concrete Masonry Units: Concrete masonry units (CMUs) must be minimum 8-inch-thick (203 mm) lightweight blocks complying with [ASTM C90](#). Mortar must comply with [ASTM C270](#). Grout must be coarse grout complying with [ASTM C476](#). Concrete masonry walls must have a minimum compressive strength, f'_m , of 1900 psi (13.1 MPa). See [Table 6](#) for applicable CMU density and grout type.

3.3.3 Structural Steel: Structural steel substrates must comply with the minimum requirements of [ASTM A36](#), [ASTM A572](#), Grade 50, or [ASTM A992](#), and have a thickness as noted in [Table 3](#).

3.3.4 Steel Deck: Steel deck panels must conform to [ASTM A653](#) SS Grade 33 (minimum) with a minimum yield strength of 38,000 psi and a minimum tensile strength of 45,000 psi. Steel deck configurations must be as described in [Table 7](#) and Figures [8, 9, and 10](#).

3.3.5 Sill Plates: Sill plates must be nominal 2-inch-thick naturally durable wood complying with the definition in 2018, 2015 and 2012 IBC Section [202](#) (2009 and 2006 IBC Section [2302](#)) or IRC Section [R202](#), as applicable, or wood that has been preservative-treated in accordance with 2018 and 2015 IBC Section [2303.1.9](#) (2012, 2009 and 2006 IBC Section [2303.1.8](#)) or 2018, 2015, 2012 and 2009 IRC Section [R317.1](#) (2006 IRC Section [R319.1](#)), as applicable.

4.0 DESIGN AND INSTALLATION

4.1 Design:

4.1.1 General: Selection of fasteners must take into consideration the applicable base material and the length of the fastener. The minimum fastener length must be determined as follows:

- For installation into concrete, concrete-filled steel deck panels, and steel base materials, the minimum effective shank length shown in [Table 1](#) must equal or exceed the sum of the thickness of the attached material and the minimum embedment depth (penetration) shown in the applicable tables in this report.
- For installation through steel or CMU base materials, the minimum effective shank length shown in [Table 1](#) must equal or exceed the sum of the following: the thickness of the attached material, the thickness of the base material and the required point penetration shown in the applicable tables in this report.

4.1.2 Allowable Loads: The applicable allowable load tables for Simpson Strong-Tie® Powder-Actuated Fasteners and assemblies driven into different base materials may be determined by referencing [Table 1](#).

The most critical applied loads, excluding seismic load effects, resulting from the load combinations in IBC Section [1605.3.1](#) or [1605.3.2](#), must not exceed the allowable loads. For fasteners which are subjected to seismic loads, see Section 4.1.6 for additional information. The stress increases and load reductions described in IBC Section [1605.3](#) are not allowed.

Allowable shear loads, tension (pullout) loads and oblique loads (applied at a 45-degree angle with respect to the fastener axis) listed in this report apply only to the connection of the fasteners to the base materials and to the connection of pre-mounted accessories to the fastener. Other limit states applicable to the design of a connection, such as fastener pull-through (pull-over) and lateral bearing on the attached material, which are governed by the properties of the attached material, are outside the scope of this report. Design of the connection to the attached material must comply with the applicable requirements of the IBC. When designing the connection of wood members to the base material, the bending yield strength of the PAFs can be assumed to be the same as that of a nail with the same shank diameter.

4.1.3 Combined Loading: For fasteners subjected to both tension and shear loads, compliance with the following interaction equation must be verified:

$$(p/P_a) + (v/V_a) \leq 1.0$$

Where:

p = Actual applied tension load on fastener, lbf (N).

P_a = Allowable tension load on fastener, lbf (N).

v = Actual applied shear load on fastener, lbf (N).

V_a = Allowable shear load on fastener, lbf (N).

4.1.4 Sill Plate Connections:

The fasteners listed in [Table 4](#) may be used to attach wood sill plates to concrete for structural walls in areas classified as Seismic Design Category A or B. [Table 4](#) specifies the allowable fastener shear and tension loads for attachment of wood sill plates to concrete. Bearing area and thickness of the washers, are also given in [Table 4](#). For shear loads, spacing of fasteners must be determined considering the lesser of allowable shear load from [Table 4](#) and allowable load on the wood sill plate, determined in accordance with the NDS, with a fastener bending yield strength, $F_{yb} = 90,000$ psi (621 MPa) and a concrete dowel bearing strength, $F_e = 7,500$ psi (52 MPa). For tension loads, spacing of fasteners must be determined considering the lesser of allowable tension load from [Table 4](#) and pull through capacity of the wood sill plate, based on Section 3.10 of the NDS, using the washer bearing area from [Table 4](#).

The fasteners listed in [Table 5](#) may be used to attach wood sill plates to concrete for interior, nonstructural walls [maximum horizontal transverse load on the wall must not exceed 5 psf (0.24 kN/m²)] in Seismic Design Categories A through F, when installed as described in [Table 5](#).

4.1.5 Steel-to-steel Connections: When the Simpson Strong-Tie® fasteners listed in [Table 3](#) are used in connections of two steel elements in accordance with Section J5 of AISI S100-16 (Section E5 of AISI S100-12), connection capacity must be determined in accordance with Sections 4.1.5.1 and 4.1.5.2, as applicable.

4.1.5.1 Connection Strength - Tension: To determine tensile connection strength in accordance with Section J5.2 of AISI S100-16 (E5.2 of AISI S100-12), the fastener tension strength, pull-out strength and pull-over strength must be known. These characteristics must be determined as follows:

- **PAF Tensile Strength:** The available tension strengths must be calculated in accordance with Section J5.2.1 of AISI S100-16 (Section E5.2.1 of AISI S100-12) using a value of 260,000 psi for F_{uh} .
- **Pull-out Strength:** See [Table 3](#) for available pull-out strength.

- **Pull-over Strength:** The available pull-over strengths must be calculated in accordance with Section J5.2.3 of AISI S100-16 (Section E5.2.3 of AISI S100-12).

4.1.5.2 Connection Strength - Shear: To determine shear connection strength in accordance with Section J5.3 of AISI S100-16 (Section E5.3 of AISI S100-12), the fastener shear strength, bearing and tilting strength, pull-out strength in shear, net section rupture strength and shear strength limited by edge distance must be known. These characteristics must be determined as follows:

- **PAF Shear Strength:** The available shear strengths must be calculated in accordance with Section J5.3.1 of AISI S100-16 (Section E5.3.1 of AISI S100-12) using a value of 260,000 psi for F_{uh} .
- **Bearing and Tilting Strength:** The available bearing and tilting strengths must be calculated in accordance with Section J5.3.2 of AISI S100-16 (Section E5.3.2 of AISI S100-12).
- **Pull-out Strength in Shear:** The available pull-out strength in shear must be the applicable allowable shear strength from [Table 3](#), or must be calculated in accordance with Section J5.3.3 of AISI S100-16 (Section E5.3.3 of AISI S100-12).
- **Net Section Rupture Strength and Shear Strength Limited by Edge Distance:** These limit states have not been considered in the determination of allowable loads in this report and must be addressed in the calculations submitted to the code official. The net section rupture strength must be determined in accordance with Section J5.3.4 of AISI S100-16 (Section E5.3.4 of AISI S100-12) and the shear strength limited by edge distance must be determined in accordance with Section J5.3.5 of AISI S100-16 (Section E5.3.5 of AISI S100-12).

4.1.6 Seismic Considerations: The Simpson Strong-Tie fasteners and assemblies are recognized for use when subjected to seismic loads as follows:

1. The fasteners and assemblies may be used for attachment of nonstructural components listed in Section 13.1.4 of [ASCE 7](#), which are exempt from the requirements of ASCE 7.
2. Concrete base materials: The fasteners and assemblies installed in concrete may be used to support acoustical tile or lay-in panel suspended ceiling systems, distributed systems and distribution systems where the service load on any individual fastener does not exceed the lesser of 90 lbf (400 N) or the published allowable load in [Tables 2](#), and [7](#), as applicable.
3. Steel base materials: The fasteners and assemblies installed in steel may be used where the service load on any individual fastener does not exceed the lesser of 250 lbf (1112 N) or the published allowable load shown in [Table 3](#) except as noted in [Table 3](#) Footnotes 8, 9 or 10.
4. The fasteners listed in [Table 4](#) may be used to attach wood sills to concrete, subject to the limitations described in Section 4.1.4.
5. For interior, nonstructural walls that are not subject to sustained tension loads and are not a bracing application, the fasteners may be used to attach steel track to concrete or steel in all Seismic Design Categories. In Seismic Design Categories D, E, and F, the allowable shear load due to transverse pressure must be no more than 90 pounds (400 N) when attaching to concrete; or 250 pounds (1,112 N) when attaching to steel. Substantiating calculations must be submitted addressing the fastener-to-base-material

capacity and the fastener-to-attached-material capacity. Interior nonstructural walls are limited to locations where bearing walls, shear walls or braced walls are not required by the approved plans. The design load on the fastener must not exceed the allowable load established in this report for the concrete or steel base material.

4.2 Installation:

The installation of fasteners and assemblies requires a powder-actuated fastening tool, in accordance with the Simpson Strong-Tie recommendations. The fasteners must be installed in accordance with Simpson Strong-Tie published installation instructions. A copy of these instructions must be available on the jobsite at all times during fastener installation.

The fastener size, minimum embedment depth or penetration, minimum spacing, and edge distances must comply with [Tables 2](#) through 7, as applicable. For fasteners installed into concrete, the fasteners must not be driven until the concrete has reached the designated compressive strength.

5.0 CONDITIONS OF USE

The Simpson Strong-Tie® Powder-Actuated Fasteners, Threaded Studs and Assemblies described in this report comply with, or are suitable alternatives to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1 The fasteners and assemblies must be manufactured and identified in accordance with this report.
- 5.2 Fasteners must be installed in accordance with this report and Simpson Strong-Tie published installation instructions. In the event of a conflict between this report and the Simpson Strong-Tie published installation instructions, the more restrictive requirements govern.
- 5.3 Fasteners must not be used in preservative-treated wood or fire-retardant-treated wood, except for the mechanically galvanized fasteners (with MG in the designation), which may be used to attach preservative-treated wood to concrete.
- 5.4 Installation is limited to dry, interior environments, which include exterior walls which are protected by an exterior wall envelope.
- 5.5 See Section 4.1.6 for seismic considerations.
- 5.6 Calculations demonstrating that the applied loads are less than the allowable loads described in this report must be submitted to the code official. The calculations must be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.
- 5.7 For steel-to-steel connections that meet the applicability requirements of Section J5 of AISI S100-16 (Section E5 of AISI S100-12), calculations demonstrating that the available connection strength has been determined in accordance with Section J5 of AISI S100-16 (Section E5 of AISI S100-12) and Section 4.1.5 of this report, and equals to or exceeds the applied load, must be submitted to the code official. The calculations must be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.
- 5.8 For fasteners installed into concrete, the minimum concrete thickness must be three times the fastener embedment in concrete, except where noted otherwise in this report.

- 5.9 Use of fasteners in concrete or masonry is limited to installation in uncracked concrete or masonry. Cracking occurs when $f_t > f_r$ due to service loads or deformations.
- 5.10 The Simpson Strong-Tie products addressed in this report are manufactured under a quality control program with inspections by ICC-ES.

6.0 EVIDENCE SUBMITTED

- 6.1 Data in accordance with the ICC-ES Acceptance Criteria for Power-Actuated Fasteners Driven into Concrete, Steel and Masonry Elements (AC70), dated February 2016 (Editorially revised November 2017).
- 6.2 Data in accordance with ICC-ES AC70 Annex A for values addressed in Footnotes 8, 9 and 10 to [Table 3](#).

7.0 IDENTIFICATION

- 7.1 Containers of the fasteners are labeled with the Simpson Strong-Tie Company, Inc. name and address; the fastener product size and type; the

evaluation report number (ESR-2138); and the manufacturing date and lot number. In addition, the fastener heads are identified with one of the following markings:



- 7.2 The report holder's contact information is the following:

SIMPSON STRONG-TIE COMPANY INC.
5956 WEST LAS POSITAS BOULEVARD
PLEASANTON, CALIFORNIA 94588
(800) 999-5099
www.strongtie.com



PDBA

FIGURE 1—FASTENERS



PDPAWL

FIGURE 2—FASTENERS WITH PREMOUNTED FLAT WASHERS



PINW



PINWP



PDPAT

FIGURE 3—FASTENERS WITH PREMOUNTED TOPHAT WASHERS



PSLV3

FIGURE 4—THREADED STUDS



PCLDPA

FIGURE 5—CEILING CLIP ASSEMBLIES



PECLDPA



PTRHA

FIGURE 6—THREADED ROD HANGER ASSEMBLIES

TABLE 1—SIMPSON STRONG-TIE® POWDER-ACTUATED FASTENERS AND ASSEMBLIES¹

FASTENERS (see Figure 1)								
FASTENER MODEL NUMBER ¹	SHANK TYPE	SHANK DIAMETER (inch)	NOMINAL HEAD DIAMETER (inch)	MAXIMUM POINT LENGTH (inch)	MINIMUM EFFECTIVE SHANK LENGTH (inch)	FASTENER GALVANIZATION	APPLICABLE BASE MATERIAL	APPLICABLE LOAD TABLES
PDPA-XX(X)	Smooth	0.157	0.300	0.354	XX(X)/100 - 0.04	ASTM B695 Class 5, Type 1	Concrete Steel Conc.-filled deck Masonry	2, 3, 6, 7
PDPA-XXK	Knurled	0.157	0.300	0.354	XX/100 - 0.04	ASTM B695 Class 5, Type 1	Steel	3
PDPA-XXXMG	Smooth	0.157	0.300	0.354	XXX/100 - 0.04	ASTM B695 Class 65, Type 1	Concrete Steel Conc.-filled deck Masonry	2, 3, 6, 7
FASTENERS WITH PREMOUNTED FLAT WASHERS (see Figure 2)								
ASSEMBLY MODEL NUMBER ¹	FASTENER	WASHER DESCRIPTION	MAXIMUM POINT LENGTH (inch)	MINIMUM EFFECTIVE SHANK LENGTH (inch)	WASHER MATERIAL & GALVANIZATION	APPLICABLE BASE MATERIAL	APPLICATION TABLES	
PINW-XXX	0.145" diameter smooth shank with 0.300" head diameter	1 ⁷ / ₁₆ inch diameter, 0.078 inch thick	0.354	XXX/100 - 0.118	Carbon steel w/ electroplated zinc coating	Concrete Steel Conc.-filled deck Masonry	2, 3, 6, 7	
PINWP-XXX		1 ³ / ₈ inch diameter, 0.125 inch thick		XXX/100 - 0.165	Gray plastic			
PINWP-XXXW					White plastic			
PDPAWL-XX(X)	PDPA-XX(X)	1 inch diameter, 0.070 inch thick	See PDPA fastener	XXX/100 - 0.110	Carbon steel w/ electroplated zinc coating	Concrete Steel Conc.-filled deck Masonry	2, 3, 4, 5, 6, 7	
PDPAWL-XXXMG	PDPA-XXXMG	1 inch diameter, 0.070 inch thick		XXX/100 - 0.110	Carbon steel, ASTM B695 Class 65, Type 1			
FASTENERS WITH PREMOUNTED TOPHAT WASHERS (see Figure 3)								
ASSEMBLY MODEL NUMBER ¹	FASTENER	WASHER DESCRIPTION	MAXIMUM POINT LENGTH (inch)	MINIMUM EFFECTIVE SHANK LENGTH (inch)	WASHER MATERIAL & GALVANIZATION	APPLICABLE BASE MATERIAL	APPLICATION TABLES	
PDPAT-XX(X)	PDPA-XX(X)	Tophat	See PDPA fastener	XXX/100 - 0.055	Carbon steel w/ electroplated zinc coating	Concrete Steel Conc.-filled deck Masonry	2, 3, 6, 7	
PDPAT-XXK	PDPA-XXK	Tophat		XX/100 - 0.055	Carbon steel w/ electroplated zinc coating			
THREADED STUDS (see Figure 4)								
FASTENER MODEL NUMBER ¹	SHANK TYPE	SHANK DIAMETER (inch) / THREADS	MAXIMUM POINT LENGTH (inch)	MINIMUM EFFECTIVE SHANK LENGTH (inch)	FASTENER GALVANIZATION	APPLICABLE BASE MATERIAL	APPLICATION TABLES	
PSLV3-XXXZZZ	Smooth / Threaded	0.205 / ³ / ₈ -16	0.433	ZZ(Z)/100 - 0.0156	ASTM B695 Class 5, Type 1	Concrete Steel Conc.-filled deck	2, 3, 7	
PSLV3-XXZZK	Knurled / Threaded	0.205 / ³ / ₈ -16	0.433	ZZ/100 - 0.0156	ASTM B695 Class 5, Type 1	Steel	3	
CEILING CLIP ASSEMBLIES (see Figure 5)								
ASSEMBLY MODEL NUMBER ¹	FASTENER	CLIP DESCRIPTION			CLIP MATERIAL & GALVANIZATION	APPLICABLE BASE MATERIAL	APPLICATION TABLES	
PCLDPA-XXX	PDPAT-XXX	0.075 inch thick, 90° clip angle, ⁵ / ₁₆ " dia. hole			Carbon steel w/ electroplated zinc coating	Concrete Conc.-filled deck	2, 7	
PECLDPA-XXX	PDPA-XXX	0.075 inch thick, 120° clip angle, ⁵ / ₁₆ " dia. hole			Carbon steel w/ electroplated zinc coating	Concrete Conc.-filled deck	2, 7	

TABLE 1—SIMPSON STRONG-TIE® POWDER-ACTUATED FASTENERS AND ASSEMBLIES¹ (Continued)

THREADED ROD HANGER ASSEMBLIES (see Figure 6)					
ASSEMBLY MODEL NUMBER ¹	FASTENER	BRACKET DESCRIPTION	BRACKET MATERIAL & GALVANIZATION	APPLICABLE BASE MATERIAL	APPLICATION TABLES
PTRHA3-XXX	PDPA-XXX	0.075 inch thick with 3/8-16 threaded eyelet	Carbon steel w/ electroplated zinc coating	Concrete Conc.-filled deck	2, 7
PTRHA4-XXX	PDPA-XXX	0.075 inch thick with 1/4-20 threaded eyelet	Carbon steel w/ electroplated zinc coating	Concrete Conc.-filled deck	2, 7

For SI: 1 inch = 25.4 mm.

¹For fastener designations:

- The XX(X) designation in the model number divided by 100 represents the fastener length in inches.
- For threaded studs, the XXX and ZZ(Z) designations represent the length of the threaded portion of the fastener and the length of the shank portion of the fastener, respectively. The XXX and ZZ(Z) designations divided by 100 represent the lengths in inches.
- The K at the end of the designation denotes a knurled fastener.
- MG in the designation denotes a mechanically galvanized zinc coating complying with [ASTM B695](#), Class 65, Type 1.

TABLE 2—ALLOWABLE LOADS FOR FASTENERS DRIVEN INTO NORMALWEIGHT CONCRETE^{1,2}

FASTENER MODEL NUMBER	SHANK DIAMETER (inch)	MINIMUM EMBEDMENT DEPTH (inches)	MINIMUM EDGE DISTANCE (inches)	MINIMUM SPACING (inches)	ALLOWABLE LOADS (lbf)							
					2,500 psi		3,000 psi		4,000 psi		6,000 psi	
Concrete Compressive Strength:					Tension	Shear	Tension	Shear	Tension	Shear	Tension	Shear
Load Direction for Fasteners and Threaded Rod Hanger Assemblies and Threaded Studs:					Tension	Shear	Tension	Shear	Tension	Shear	Tension	Shear
FASTENERS												
PINW-XXX PINWP-XXX(W)	0.145	1	3	4	70	140	100	165	150	205	150	205
		1 1/4	3	4	195	265	255	265	370	265	370	265
PDPA-XX(X) PDPA-XXXMG PDPAT-XX(X) PDPAWL-XX(X) PDPAWL-XXXMG	0.157	3/4	3.5	5	110	120	110	125	110	135	110	130
		1	3.5	5	210	285	240	290	310	310	160	350
		1 1/4	3.5	5	320	360	340	380	380	420	365	390
		1 1/2	3.5	5	375	405	400	430	450	485	465	495
THREADED ROD HANGER ASSEMBLIES												
PTRHA3-131 PTRHA4-131	0.157	1 1/4	3.5	5	185	-	-	-	220	-	190	-
THREADED STUDS												
PSLV3-125125	0.205	1 1/4	4	6	260	-	-	-	-	-	-	-
CEILING CLIP ASSEMBLIES												
Load Direction for Ceiling Clip Assemblies:					Tension	Oblique	Tension	Oblique	Tension	Oblique	Tension	Oblique
PCLDPA-87	0.157	3/4	3.5	5	70	115	-	-	120	105	130	140
PCLDPA-106		1	3.5	5	175	255	-	-	180	240	190	245
PCLDPA-131		1 1/4	3.5	5	210	250	-	-	210	265	190	265
PECLDPA-106	0.157	7/8	3.5	5	90	135	-	-	110	130	85	115
PECLDPA-131		1	3.5	5	180	225	-	-	155	230	180	255

For SI: 1 inch = 25.4 mm, 1 psi = 6.89 kPa, 1 lbf = 4.45 N.

¹The fasteners must not be driven until the concrete has reached the designated minimum compressive strength.

²The fasteners and assemblies listed in the table above may be used for static load conditions and for the seismic load conditions described in Section 4.1.6, as applicable. The tabulated allowable loads apply to static load conditions. For seismic load conditions, the allowable loads must be limited in accordance with Section 4.1.6, Items 2 and 5, as applicable.

TABLE 3—ALLOWABLE LOADS FOR FASTENERS DRIVEN INTO STEEL^{1,2}

FASTENER MODEL NUMBER	SHANK DIAMETER (inch)	MINIMUM EDGE DISTANCE (inch)	MINIMUM SPACING (inches)	ALLOWABLE LOADS (lbf)									
				Steel Thickness (inch):		³ / ₁₆		¹ / ₄		³ / ₈		¹ / ₂	
Load Direction for Fasteners and Threaded Studs:				Tension	Shear	Tension	Shear	Tension	Shear	Tension	Shear	Tension	Shear
FASTENERS IN A36 STEEL													
PINW-XXX PINWP-XXX(W)	0.145	0.5	1.0	155 ⁷	395	-	-	-	-	-	-	-	-
PDPA-XX(X) PDPA-XXX PDPA-XXXMG PDPAT-XX(X) PDPAT-XXX PDPAWL-XX(X) PDPAWL-XXXMG	0.157	0.5	1.0	260 ^{7,8}	410 ⁸	370 ^{7,8}	365 ⁸	380 ^{6,9}	385 ^{6,8}	530 ^{6,8}	385 ^{6,8}	195 ³	325 ³
FASTENERS IN A572 OR A992 STEEL													
PDPA-XX(X) PDPA-XXX PDPA-XXXMG PDPAT-XX(X) PDPAT-XXX PDPAWL-XX(X) PDPAWL-XXXMG	0.157	0.5	1.0	305 ^{7,10}	420 ⁸	335 ^{7,8}	365 ⁸	355 ^{6,8}	290 ^{6,8}	485 ⁴	275 ⁴	170 ⁵	275 ⁵
THREADED STUDS IN A36 STEEL²													
PSLV3-XX(X)ZZ(Z)	0.205	1.0	1.5	270 ⁷	770	680 ⁷	1120	-	-	-	-	-	-
PSLV3-12575K	0.205	1.0	1.5	270 ⁷	930	870 ⁷	1130	-	-	-	-	-	-

For **SI**: 1 inch = 25.4 mm, 1 lbf = 4.45 N.

- ¹The entire pointed portion of the fastener must penetrate through the steel to obtain the tabulated values, unless otherwise noted.
- ²The fasteners listed in the table above may be used for static load conditions and for the seismic load conditions described in Section 4.1.6, as applicable. The tabulated allowable loads apply to static load conditions. For seismic load conditions, the allowable loads must be limited in accordance with Section 4.1.6, Items 3 and 5, as applicable, unless otherwise noted in Footnotes 8, 9 or 10.
- ³Based upon a minimum penetration depth of 0.46 inch (11.7 mm).
- ⁴Based upon a minimum penetration depth of 0.58 inch (14.7 mm), which can be achieved due to deformation of the steel base material.
- ⁵Based upon a minimum penetration depth of 0.36 inch (9.1 mm).
- ⁶The fastener must be driven to where at least some of the point of the fastener penetrates through the steel.
- ⁷For steel-to-steel connections designed in accordance with Section 4.1.5, the tabulated allowable load may be increased by a factor of 1.25, and the design strength may be taken as the tabulated allowable load multiplied by a factor of 2.0.
- ⁸Tabulated values are not subjected to 250 lbf seismic load limitation described in Section 4.1.6 item 3.
- ⁹For seismic load conditions, the allowable load is limited to 370 lbf and is not subjected to the 250 lbf seismic load limitation described in Section 4.1.6 item 3.
- ¹⁰For seismic load conditions, the allowable load is limited to 280 lbf and is not subjected to the 250 lbf seismic load limitation described in Section 4.1.6 item 3.

TABLE 4—ALLOWABLE LOADS ON FASTENERS USED TO ATTACH WOOD SILL PLATES TO NORMAL-WEIGHT CONCRETE^{1,2,3,4,5,6}

FASTENER MODEL NUMBER ⁴	OVERALL LENGTH (inches)	NOMINAL HEAD DIAMETER (inch)	SHANK DIAMETER (inch)	WASHER THICKNESS (inch)	WASHER BEARING AREA (in ²)	ALLOWABLE LOADS (lbf)	
						Tension	Shear
PDPAWL-287 PDPAWL-287MG	2 ⁷ / ₈	0.300	0.157	0.070	0.767	200	205

For **SI**: 1 inch = 25.4 mm, 1 foot = 305 mm, 1 lbf = 445 N, 1 psi = 6.89 kPa.

- ¹The fasteners must not be driven until the concrete has reached a minimum compressive strength of 2,500 psi.
- ²Minimum edge distance is 1³/₄ inches (44 mm).
- ³Wood members connected to the substrate must be investigated for compliance with the applicable code in accordance with referenced design criteria, for both lateral resistance and fastener pull-through.
- ⁴Only mechanically galvanized fasteners (with 'MG' in the designation) are suitable for use with preservative-treated wood, in accordance with 2018 and 2015 IBC Section [2304.10.5.1](#) (2012, 2009 and 2006 IBC Section [2304.9.5.1](#)) and IRC Section [R317.3.1](#) (2006 IRC Section [R319.3](#)).
- ⁵Minimum spacings must be 4 inches on center or must comply with the NDS to prevent splitting of the wood.
- ⁶The fasteners listed in the table above may be used for static load conditions and for the seismic load conditions described in Section 4.1.6, as applicable. The tabulated allowable loads apply to static and seismic load conditions.

TABLE 5—LOAD AND SPACING REQUIREMENTS FOR WOOD SILL PLATE ANCHORAGE OF INTERIOR NONSTRUCTURAL WALLS^{1,2,3,5,6,8,9}

FASTENER TYPE	NOMINAL FASTENER SHANK LENGTH (inches)	NOMINAL FASTENER SHANK DIAMETER (inch)	MINIMUM EMBEDMENT DEPTH	CONCRETE EDGE DISTANCE (inches)	FASTENER SPACING ^{4,7} (ft.)	MAXIMUM WALL HEIGHT (ft.)
PDPAWL-287 PDPAWL-287MG	2 ⁷ / ₈	0.157	Washer bearing on sill plate	1 ³ / ₄	4	14

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 psi = 6.89 kPa.

- ¹The fasteners must not be driven until the concrete has reached a minimum compressive strength of 2,500 psi.
- ²Interior nonstructural walls are limited to locations where bearing walls, shear walls or braced walls are not required by the approved plans.
- ³Fasteners must be driven into the center of the nominally 2-inch-thick wood sill plate and must be at least 1³/₄ inch from the concrete edge.
- ⁴Walls must have fasteners placed at 6 inches from ends of sill plates with maximum spacing between, as shown in this table.
- ⁵Walls must be laterally supported at the top and the bottom.
- ⁶Sill or bottom plates must comply with IBC Section 2304 and be of lumber with a specific gravity of 0.50 or greater.
- ⁷Minimum spacings must be 4 inches on center or as required by the NDS to prevent splitting of the wood.
- ⁸Only mechanically galvanized fasteners (with 'MG' in the designation) are suitable for use in contact with preservative-treated wood in accordance with 2018 and 2015 IBC Section 2304.10.5.1 (2012, 2009 and 2006 IBC Section 2304.9.5.1) and IRC Section R317.3.1 (2006 IRC Section R319.3).
- ⁹The maximum horizontal transverse load on the wall, in accordance with 2018 IBC Section 1607.15 (2015, 2012, 2009 and 2006 IBC Section 1607.14), must be 5 psf (0.24 kN/m²).

TABLE 6—ALLOWABLE LOADS FOR FASTENERS DRIVEN INTO THE FACE SHELL OF HOLLOW AND GROUT-FILLED CONCRETE MASONRY UNITS (CMUs)^{2,4}

FASTENER MODEL NUMBER	SHANK DIAMETER (inch)	MINIMUM CMU FACE SHELL THICKNESS (inches)	ALLOWABLE LOADS (lbf)			
			HOLLOW CMUs ^{1,3}		GROUT-FILLED CMUs ⁵	
			Tension	Shear	Tension	Shear
PINW-XXX PINWP-XXX(W)	0.145	1 ¹ / ₄	110	200	-	-
PDPA-XXX PDPA-XXXMG PDPAWL-XXX PDPAWL-XXXMG PDPAT-XX(X)	0.157	1 ¹ / ₄	125	210	190	245

For SI: 1 lbf = 4.448 N, 1 inch = 25.4 mm.

- ¹The tabulated allowable load values are for fasteners installed in hollow lightweight CMUs conforming to ASTM C90. The minimum allowable nominal size of the CMU must be 8 inches high by 8 inches wide by 16 inches long, with a minimum 1¹/₄-inch-thick face shell thickness.
- ²The tabulated allowable load values are for fasteners installed in the center of a CMU face shell. See Figure 7 for the applicable placement zone. Only one PAF may be installed at each cell. Allowable loads for fasteners installed in mortar head and bed joints, or into the web of the CMU, are outside the scope of this report.
- ³The entire pointed portion of the fastener must penetrate through the thickness of the face shell to obtain the tabulated values.
- ⁴The fasteners listed in the table above may be used for static load conditions and for the seismic load conditions described in Item 1 of Section 4.1.6.
- ⁵The tabulated allowable load values are for fasteners installed in grout-filled lightweight CMUs conforming to ASTM C90 with coarse grout conforming to ASTM C476. The minimum allowable nominal size of the CMU must be 8 inches high by 8 inches wide by 16 inches long, with a minimum 1-1/4-inch-thick face shell thickness.

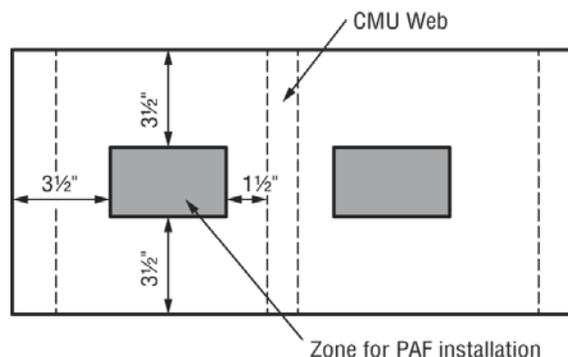


FIGURE 7—ZONE FOR FASTENER INSTALLATION IN FACE SHELL OF CMU

TABLE 7—ALLOWABLE LOADS FOR FASTENERS DRIVEN INTO MINIMUM 3,000 psi SAND-LIGHTWEIGHT CONCRETE AND SAND-LIGHTWEIGHT CONCRETE FILLED STEEL DECK^{1,6}

FASTENER MODEL NUMBER	SHANK DIAMETER (inch)	MINIMUM EMBEDMENT DEPTH (inches)	ALLOWABLE LOADS (lbf)							
			Fasteners Installed Directly into Concrete ⁵		Fasteners Installed through Lower Flute of Steel Deck into Concrete					
Fastener Location:					3" Deep Deck with 3 1/4" Concrete Fill ²		3" Deep Deck with 2 1/2" Concrete Fill ³		1 1/2" Deep Deck with 2" Concrete Fill ⁴	
Load Direction for Fasteners and Threaded Studs:			Tension	Shear	Tension	Shear	Tension	Shear	Tension	Shear
FASTENERS										
PDPA-XX(X) PDPA-XXXMG PDPAT-XX(X) PDPAWL-XX(X) PDPAWL-XXXMG	0.157	3/4	85	105	105	280	-	-	160	275
		1	150	225	145	280	-	-	210	370
		1 1/4	320	420	170	320	-	-	265	460
		1 1/2	385	455	325	520	-	-	-	-
PINW-XXX PINWP-XXX(W)	0.145	7/8	85	250	40	275	-	-	-	-
THREADED STUDS										
PSLV3 -125125	0.205	1 1/4	-	-	225	-	-	-	-	-
CEILING CLIP ASSEMBLIES										
Load Direction for Ceiling Clip Assemblies:			Tension	Oblique	Tension	Oblique	Tension	Oblique	Tension	Oblique
PCLDPA-87	0.157	3/4	-	-	115	155	115	155	60	175
PCLDPA-106		1	-	-	140	175	140	175	160	240
PCLDPA-131		1 1/4	-	-	160	185	160	185	180	280
PECLDPA-106	0.157	7/8	-	-	80	110	80	110	95	110
PECLDPA-131		1	-	-	120	145	120	145	135	175
THREADED ROD HANGER ASSEMBLIES										
Load Direction for Threaded Rod Hanger Assemblies:			Tension		Tension		Tension		Tension	
PTRHA3-131 PTRHA4-131	0.157	1 1/4	-		-		160		175	

For SI: 1 lbf = 4.448 N, 1 inch = 25.4 mm, 1 psi = 6.89 kPa.

¹Fasteners must not be driven until the concrete has reached a minimum concrete compressive strength of 3,000 psi.

²The steel deck must have a minimum thickness of 20 gage (0.0359-inch-thick base-steel thickness). Figure 8 shows nominal flute dimensions, fastener locations, and tension and shear load orientations. Oblique loads are applied at a 45-degree angle to the fastener. The fastener must be a minimum of 1 1/2 inches from the edge of the deck web and 4 inches from the end of the deck. The minimum fastener spacing is 4 inches.

³The steel deck must have a minimum thickness of 20 gage (0.0359-inch-thick base-steel thickness). Figure 9 shows nominal flute dimensions, fastener locations, and tension and shear load orientations. Oblique loads are applied at a 45-degree angle to the fastener. The fastener must be a minimum of 1 1/2 inches from the edge of the deck web and 4 inches from the end of the deck. The minimum fastener spacing is 4 inches.

⁴The steel deck must have a minimum thickness of 20 gage (0.0359-inch-thick base-steel thickness). Figure 10 shows nominal flute dimensions, fastener locations, and tension and shear load orientations. Oblique loads are applied at a 45 degree angle to the fastener. The fastener must be a minimum of 7/8 inches from the edge of the deck web and 4 inches from the end of the deck. The minimum fastener spacing is 4 inches.

⁵Minimum edge distance must be 3 1/2 inches and minimum spacing must be 4 inches.

⁶The fasteners and assemblies listed in the table above may be used for static load conditions and for the seismic load conditions described in Section 4.1.6, as applicable. The tabulated allowable loads apply to static load conditions. For seismic load conditions, the allowable loads must be limited in accordance with Section 4.1.6, Items 2 and 5, as applicable.

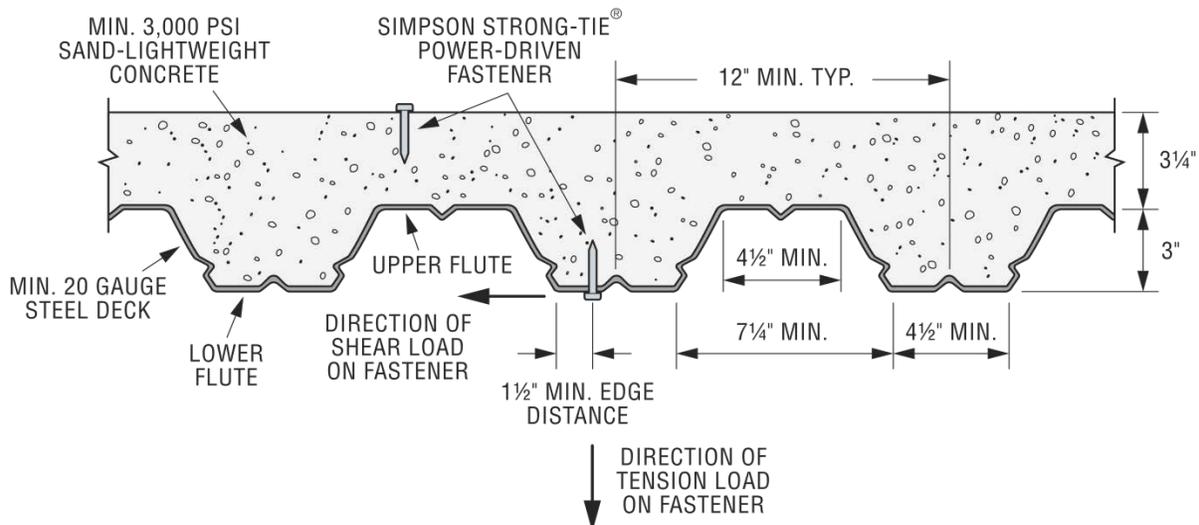


FIGURE 8—INSTALLATION IN 3 1/4-INCH CONCRETE FILL OVER 3-INCH-DEEP STEEL DECK

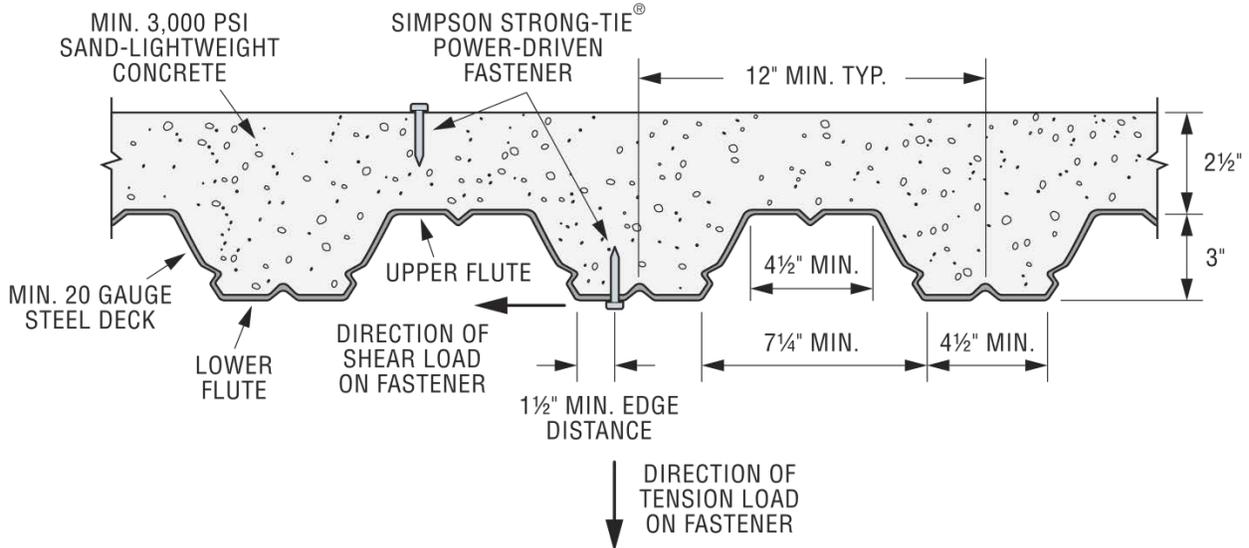


FIGURE 9—INSTALLATION IN 2 1/2-INCH CONCRETE FILL OVER 3-INCH-DEEP STEEL DECK

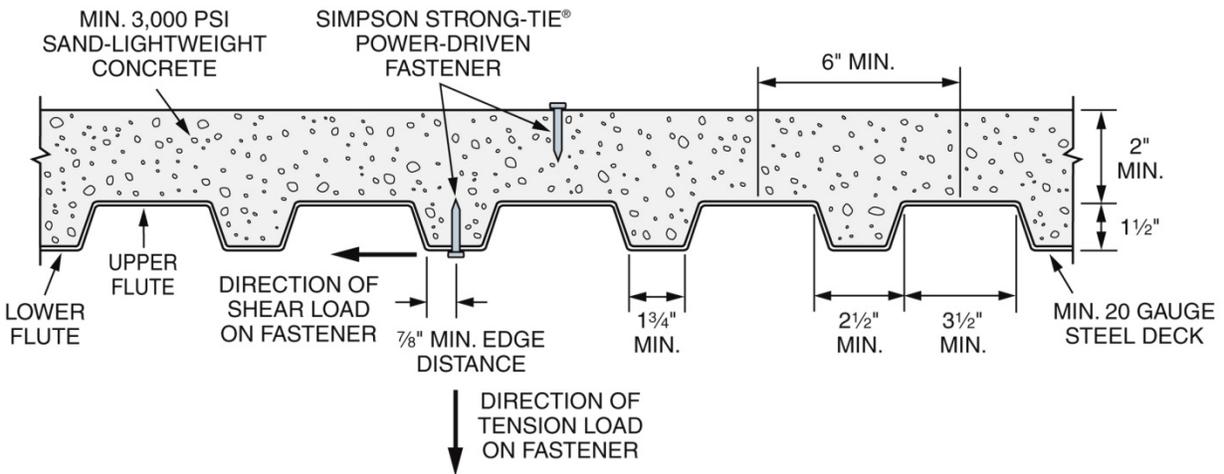


FIGURE 10—INSTALLATION IN 2-INCH CONCRETE FILL OVER 1 1/2-INCH-DEEP STEEL DECK

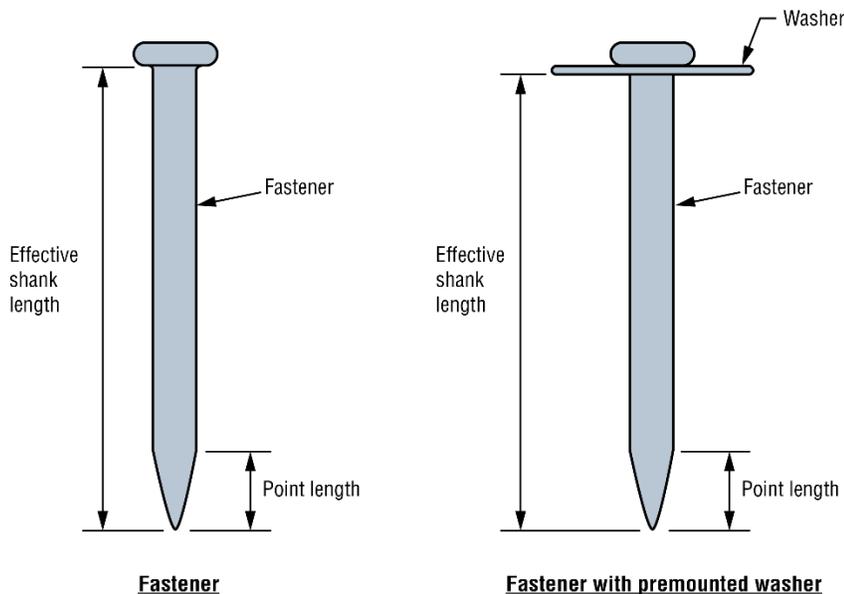


FIGURE 11—DEFINITIONS OF MINIMUM EFFECTIVE SHANK LENGTH AND MAXIMUM POINT LENGTH

ICC-ES Evaluation Report

ESR-2138 LABC and LARC Supplement

Reissued March 2019

Revised July 2019

This report is subject to renewal March 2020.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

DIVISION: 03 00 00—CONCRETE

Section: 03 16 00—Concrete Anchors

DIVISION: 04 00 00—MASONRY

Section: 04 05 19.16—Masonry Anchors

DIVISION: 05 00 00—METALS

Section: 05 05 23—Metal Fastenings

DIVISION: 06 00 00—WOOD, PLASTICS AND COMPOSITES

Section: 06 05 23—Wood, Plastic and Composite Fastenings

REPORT HOLDER:

SIMPSON STRONG-TIE COMPANY INC.

EVALUATION SUBJECT:

SIMPSON STRONG-TIE® POWDER-ACTUATED FASTENERS, THREADED STUDS AND ASSEMBLIES

1.0 REPORT PURPOSE AND SCOPE

Purpose:

The purpose of this evaluation report supplement is to indicate that the Simpson Strong-Tie® Powder-Actuated Fasteners, Threaded Studs and Assemblies, described in ICC-ES master evaluation report [ESR-2138](#), have also been evaluated for compliance with the codes noted below as adopted by the Los Angeles Department of Building and Safety (LADBS).

Applicable code editions:

- 2017 *City of Los Angeles Building Code* (LABC)
- 2017 *City of Los Angeles Residential Code* (LARC)

2.0 CONCLUSIONS

The Simpson Strong-Tie® Powder-Actuated Fasteners, Threaded Studs and Assemblies, described in Sections 2.0 through 7.0 of the master evaluation report [ESR-2138](#), comply with the LABC Chapter 19, and the LARC, and are subject to the conditions of use described in this supplement.

3.0 CONDITIONS OF USE

The Simpson Strong-Tie® Powder-Actuated Fasteners, Threaded Studs and Assemblies described in this evaluation report must comply with all of the following conditions:

- All applicable sections in the master evaluation report [ESR-2138](#).
- The design, installation, conditions of use and identification of the Simpson Strong-Tie® Powder-Actuated Fasteners, Threaded Studs and Assemblies are in accordance with the 2015 *International Building Code*® (2015 IBC) provisions noted in the master evaluation report [ESR-2138](#).
- The design, installation and inspection are in accordance with additional requirements of LABC Chapters 16 and 17, as applicable.
- Under the LARC, an engineered design in accordance with LARC Section R301.1.3 must be submitted.
- The allowable values listed in the attached report and tables are for the fasteners only. Connected members shall be checked for their capacity (which may govern).
- No increase is permitted in the tabulated allowable load values for short duration loading.

This supplement expires concurrently with the master report, reissued March 2019 and revised July 2019.