



EVALUATION SUBJECT: AT-XP® ADHESIVE ANCHORS FOR CRACKED AND UNCRACKED CONCRETE

REPORT HOLDER:
Simpson Strong-Tie Company Inc.
5956 West Las Positas Boulevard
Pleasanton, California 94588
(800) 999-5099
www.strongtie.com

CSI Section: 03 16 00—Concrete Anchors

CSI Section: 03 15 19 Cast-in Concrete Anchors

CSI Section: 05 05 19—Post-Installed Concrete Anchors

1.0 SCOPE OF EVALUATION

1.1 Compliance to the following codes & regulations:

- 2018, 2015, 2012, 2009 and 2006 International Building Code® (IBC)
- 2018, 2015, 2012, 2009 and 2006 International Residential Code® (IRC)
- 2017 City of Los Angeles Building Code (LABC) – attached Supplement
- 2017 City of Los Angeles Residential Code (LARC) – attached Supplement

1.2 Evaluated in accordance with:

- ICC-ES AC308, approved October 2017 (editorially revised April 2018)
- ACI 318-14, ACI 318-11
- ACI 355.4-11

1.3 Properties assessed:

- Structural

2.0 PRODUCT USE

The Simpson Strong-Tie® AT-XP Adhesive Anchors are used to resist static, wind and earthquake (Seismic Design Categories A through F under the IBC) tension and shear loads in cracked and uncracked normal-weight concrete having a specified compressive strength, f'_c , of 2,500 psi to 8,500 psi (17.2 MPa to 58.6 MPa). Uncracked concrete in the region of the anchorage may be assumed provided analysis indicates no cracking at service loads in accordance with ACI 318-14 17.4.2.6 and 17.5.2.7 or ACI 318-11 D.5.2.6 and D.6.2.7. The analysis for the determination of crack formation shall include the effects of restrained shrinkage, as applicable in accordance with 24.4.2 of ACI 318-14 (7.12.1.2 of ACI 318-11). The adhesive anchor is an alternative to anchors described in Section 1901.3 of the 2018 and 2015 IBC, Sections 1908 and 1909 of the 2012 IBC and Sections 1911 and 1912 of the 2009 and 2006 IBC. The anchors may

also be used where an engineering design is submitted in accordance with Section R301.1.3 of the IRC.

3.0 PRODUCT DESCRIPTION

3.1 Product information: The AT-XP Adhesive Anchors are post-installed anchors, inserted into hardened concrete that transfer loads to the concrete by bond between the anchor and the adhesive, and bond between the adhesive and the concrete. The adhesive anchor system is comprised of the following components:

- AT-XP adhesive packaged in cartridges
- Adhesive mixing and dispensing equipment
- Equipment for hole cleaning and adhesive injection

AT-XP adhesive is used with continuously threaded steel rods or deformed steel reinforcing bars. The Manufacturer's Printed Installation Instructions (MPII) are included with each adhesive unit package as shown in [Figure 1](#) of this report.

3.2 Material information

3.2.1 AT-XP Adhesive: AT-XP adhesive is an injectable, two component, acrylic-based adhesive that is mixed in a 10 to 1 volume ratio of resin to initiator. AT-XP is available in 9.4 ounce (280 mL), 12.5 ounce (370 mL) and 30 ounce (885 mL) cartridges. The two components combine and react when dispensed through a static mixing nozzle attached to the cartridge. Gel and cure times after placement into holes occurs according to conditions given in [Table 10](#) of this report. The shelf life of AT-XP in unopened cartridges is twelve months from the date of manufacture when stored at temperatures between 32°F and 80°F (0°C and 27°C) in accordance with the MPII.

3.2.2 Dispensing Equipment: AT-XP adhesive shall be dispensed using Simpson Strong-Tie manual dispensing tools, battery-powered dispensing tools or pneumatic dispensing tools as listed in [Tables 8](#) and [9](#) of this report.

3.2.3 Hole Cleaning Equipment:

3.2.3.1 Standard Equipment: Hole cleaning equipment consists of hole-cleaning brushes and air nozzles. Brushes shall be Simpson Strong-Tie hole cleaning brushes, identified by Simpson Strong-Tie catalog number series ETB. [Tables 8](#) and [9](#) in this report, and the MPII shown in [Figure 1](#) of this report provide additional information. Air nozzles shall be equipped with an extension capable of reaching the bottom of the drilled hole.

3.2.3.2 Vacuum Dust Extraction System with Bosch®/Simpson Strong-Tie DXS Hollow Carbide Drill Bits: For the elements described in Section 3.2.4 of this

The product described in this Uniform Evaluation Service (UES) Report has been evaluated as an alternative material, design or method of construction in order to satisfy and comply with the intent of the provision of the code, as noted in this report, and for at least equivalence to that prescribed in the code in quality, strength, effectiveness, fire resistance, durability and safety, as applicable, in accordance with IBC Section 104.11. This document shall only be reproduced in its entirety.





report for 5/8 to 1 1/4 inch (15.9 to 31.9 mm) diameter steel threaded rods and No. 4 to No. 10 steel reinforcing bars, the Bosch/Simpson Strong-Tie DXS hollow carbide drill bit with a carbide drilling head conforming to ANSI B212.15 shall be used. A dust extraction adapter is used in conjunction with a vacuum equipped with an automatic filter cleaning system, which has a minimum airflow = 129 cfm (3.7 m³/min.). The maximum no-load rpm for the rotary hammer drill used with the vacuum dust extraction system is 760 rpm. The vacuum dust extraction system removes the drilling dust during the drilling operation, eliminating the need for additional hole cleaning.

3.2.4 Anchor Materials

3.2.4.1 Threaded Steel Rods: Threaded anchor rods, having diameters from 3/8 inch to 1-1/4 inch (9.5 mm to 31.7 mm), shall be carbon steel conforming to [ASTM F1554](#), Grade 36, or [ASTM A193](#), Grade B7; or stainless steel conforming to ASTM A193, Grade B6, B8, or B8M. [Table 3](#) in this report provides additional details. Threaded rods shall be clean, straight and free of indentations or other defects along their lengths. The embedded portions of the threaded rods shall be free of mill scale, rust, mud, oil, and other coatings that may impair the bond with the adhesive. The tensile strength of the threaded anchor rods shall not exceed 145,000 psi (1,000 MPa).

3.2.4.2 Deformed Steel Reinforcing Bars (Rebars): Deformed steel rebars, having sizes from No. 3 to No. 8, and No. 10 shall conform to [ASTM A615](#) Grade 60 or [ASTM A706](#) Grade 60. [Table 4](#) in this report provides additional details. The embedded portions of reinforcing bars shall be straight, and free of mill scale, rust, mud, oil, and other coatings that may impair the bond with the adhesive. Reinforcing bars shall not be bent after installation except as set forth in Section 26.6.3.1 (b) of ACI 318-14 or Section 7.3.2 of [ACI 318-11](#), with the additional condition that the bars shall be bent cold, and heating of reinforcing bars to facilitate field bending is not permitted.

3.2.4.3 Ductility: In accordance with ACI 318-14 2.3 or ACI 318-11 D.1, in order for a steel element to be considered ductile, the tensile test elongation shall be at least 14 percent and reduction of area shall be at least 30 percent. Steel elements used for anchoring with a tensile test elongation of less than 14 percent or a reduction of area less than 30 percent, or both, shall be considered brittle. Where values are nonconforming or unstated, the steel shall be considered brittle. Except as modified by ACI 318-14 17.2.3.4.3 (a) (vi) and ACI 318-11 D.3.3.4.3 (a) 6 for earthquake effects, deformed reinforcing bars meeting the requirements of ASTM A615 or A706 shall be considered as ductile steel elements.

3.2.5 Concrete: Normal-weight and lightweight concrete shall conform to Sections 1901 and 1903 of the 2018, 2015 and 2012 IBC or Sections 1903 and 1905 of the 2009 and

2006 IBC. The specified compressive strength of the concrete shall be from 2,500 psi to 8,500 psi (17.2 MPa to 58.6 MPa), but not less than that required by the applicable code, including IBC Section 1904 and ACI 318-14 Section 19.3.2 or ACI 318-11 Section 4.3, or the structural design.

4.0 DESIGN AND INSTALLATION

4.1 Strength Design

4.1.1 General: The design strength of anchors under the 2018 and 2015 IBC and Section R301.1.3 of the 2018 and 2015 IRC shall be determined in accordance with ACI 318-14 as amended in IBC Section 1905 and this report. The design strength of anchors under the 2012, 2009 and 2006 IBC and Section R301.1.3 of the 2012, 2009 and 2006 IRC shall be determined in accordance with ACI 318-11 Appendix D and this report.

Design parameters are based on ACI 318-14 for use with the 2018 and 2015 IBC and ACI 318-11 for use with the 2012, 2009 and 2006 IBC unless noted otherwise in Sections 4.1.1 through 4.1.11 of this report.

The strength design of anchors shall conform to the requirements of ACI 318-14 17.3.1, except as required in ACI 318-14 17.2.3; or ACI 318-11 D.4.1, except as required in ACI [318-11](#) D.3.3.

Anchor categories are as follows:

Bar Size		Continuous Special Inspection		Periodic Special Inspection	
		Dry Concrete	Water-saturated concrete	Dry Concrete	Water-saturated concrete
5/8	#3	1	3	2	3
1/2	#4	1	3	2	3
5/8	#5	1	3	2	3
3/4	#6	1	3	2	3
5/8	#7	1	3	2	3
1	#8	2	3	3	3
1 1/4	#10	2	3	3	3

Anchor designs shall satisfy the requirements of ACI 318-14 17.3.1.1 and 17.3.1.2; or ACI 318-11 D.4.1.1 and D.4.1.2. Anchor group effects shall be considered in accordance with ACI 318-14 17.2.1.1; or ACI 318-11 D.3.1.1. Design parameters are provided in [Tables 3, 4, 5, 6](#) and [7](#) of this report. Strength reduction factors, ϕ , described in ACI 318-14 17.3.3 or ACI 318-11 D.4.3, and noted in [Tables 3, 4, 5, 6](#) and [7](#) of this report, shall be used for load combinations calculated in accordance with Section 1605.2 of the IBC, ACI 318-14 5.3, and ACI 318-11 Section 9.2. Strength reductions factors, ϕ , described in ACI 318-11 D.4.4 shall be used for load combinations calculated in accordance with Appendix C of ACI 318-11. Construction documents shall



include information specified in ACI 318-14 17.7.7 and 26.7; or ACI 318-11 1.2 and D.8.7.

4.1.2 Static Steel Strength in Tension: The nominal steel strength of a single anchor in tension, N_{sa} , in accordance with ACI 318-14 17.4.1.2; or ACI 318-11 D.5.1.2, and the corresponding strength reduction factors, ϕ , depending on whether the steel is considered brittle or ductile, in accordance with ACI 318-14 17.3.3; or ACI 318-11 D.4.3, are provided in [Tables 3](#) and [4](#) of this report for each anchor type referenced in this report.

4.1.3 Static Concrete Breakout Strength in Tension: The nominal static concrete breakout strength of a single anchor or group of anchors in tension, N_{cb} or N_{cbg} , shall be calculated in accordance with ACI 318-14 17.4.2; or ACI 318-11 D.5.2.

The basic concrete breakout strength of a single anchor in tension, N_b , shall be calculated in accordance with ACI 318-14 17.4.2.2; or ACI 318-11 D.5.2.2 using the values of, $k_{c,cr}$, and $k_{c,uncr}$, as described in [Table 5](#) of this report. Where analysis indicates no cracking in accordance with ACI 318-14 17.4.2.6; or ACI 318-11 D.5.2.6, N_b shall be calculated using $k_{c,uncr}$ and $\Psi_{c,N} = 1$. The modification factor, λ , shall be taken as 1.0 for normal weight concrete. For anchors installed in lightweight concrete, the corresponding modification factors, λ and λ_a , shall be applied to the breakout strengths in accordance with ACI 318-14 17.2.6; or ACI 318-11 D.3.6. The value of f'_c used for calculation purposes shall be limited to 8,000 psi (55.1 MPa) maximum.

4.1.4 Static Bond Strength in Tension: The nominal static bond strength of a single anchor or group of anchors in tension, N_a or N_{ag} , shall be calculated in accordance with ACI 318-14 17.4.5 or ACI 318-11 D.5.5. Bond strength values are a function of the concrete condition (cracked or uncracked), the installation conditions (dry or water saturated concrete), drilling method (i.e., rotary hammer drill), and special inspection level (i.e., continuous or periodic) provided. Strength reduction factors, ϕ , listed in this section and in [Tables 6](#) and [7](#) of this report, shall be utilized for anchors installed in dry or saturated concrete in accordance with the level of inspection specified (periodic or continuous), as applicable. Bond strength values, τ_k , shall be modified with the factor K_{sat} , listed below and in [Tables 6](#) and [7](#) of this report, for cases where the holes are drilled in water-saturated concrete as follows:

SPECIAL INSPECTION LEVEL	PERMISSIBLE INSTALLATION CONDITION	BOND STRENGTH	ASSOCIATED STRENGTH REDUCTION FACTOR
Continuous	Dry Concrete	τ_k	$\phi_{dry,ci}$
Continuous	Water-saturated concrete	$\tau_k \times K_{sat,ci}$	$\phi_{sat,ci}$
Periodic	Dry Concrete	τ_k	$\phi_{dry,pi}$
Periodic	Water-saturated concrete	$\tau_k \times K_{sat,pi}$	$\phi_{sat,pi}$

The bond strength τ_k in the table above refers to $\tau_{k,cr}$ or $\tau_{k,uncr}$, and where applicable, the modified bond strengths shall be used in lieu of $\tau_{k,cr}$ or $\tau_{k,uncr}$.

For anchors installed in lightweight concrete, the corresponding modification factors, λ and λ_a , shall be applied to ACI 318-14 Eq. (17.4.5.2) in accordance with ACI 318-14 17.2.6 or ACI 318 Eq. (D-22) in accordance with ACI 318-11 D.3.6.

4.1.4.1 Sustained Loads: In addition to requirements in Section 4.1.4 of this report for the design of a single anchor in tension to resist sustained loads, ACI 318-14 17.3.1.2 or ACI 318-11 D.3.5 and D.4.1.2 shall apply, using $\tau_{k,uncr}$ or $\tau_{k,cr}$ from Tables 6 and 7 of this report in lieu of τ_{cr} .

4.1.4.2 Splitting Control: Replace Section D.5.5.5 of ACI 318-11 Appendix D or Section 17.4.5.5 of ACI 318-14 as follows:

D.5.5.5 (17.4.5.5 for ACI 318-14) – The modification factor for adhesive anchors designed for uncracked concrete in accordance with D.5.5.2 (17.4.5.2 for ACI 318-14) without supplementary reinforcement to control splitting, $\psi_{cp,Na}$, shall be computed as:

If $C_{a,min} \geq C_{ac}$ then $\psi_{cp,Na} = 1.0$ (D-26 for ACI 318-11, or 17.4.5.5.a for ACI 318-14))

If $C_{a,min} < C_{ac}$ then $\psi_{cp,Na} = C_{a,min} / C_{ac}$ (D-27 for ACI 318-11, or 17.4.5.5.b for ACI 318-14)

where

C_{ac} shall be determined in accordance with Eq. (D-27a for ACI 318-11, or 17.4.5.5.c for ACI 318-14) for anchor diameters up to 1-1/4 inches and for characteristic bond strengths in uncracked concrete less than or equal to 3000 psi.

$C_{ac} = h_{ef}(\tau_{k,uncr}/1160)^{0.4} \times [3.1 - 0.7(h/h_{ef})]$ (inches) (D-27a for ACI 318-11, or 17.4.5.5.c for ACI 318-14)

where



(h/h_{ef}) need not be taken as larger than 2.4; and $\tau_{k,uncr}$ = characteristic bond strength stated in Tables 6 and 7 of this Evaluation Report, whereby $\tau_{k,uncr}$ need not be taken as larger than:

$$\tau_{k,uncr} = k_{uncr} ((h_{ef} \times f'_c)^{0.5} / (\pi \times d))$$

For all cases where $C_{Na}/C_{ac} < 1.0$, $\psi_{cp,Na}$ determined from Eq. (D-27) for ACI 318-11, or 17.4.5.5.b for ACI 318-14 need not be taken less than C_{Na}/C_{ac} . For all other cases, $\psi_{cp,Na}$ shall be taken as 1.0.

4.1.5 Static Steel Strength in Shear: The nominal static steel strength of a single anchor in shear as governed by the steel, V_{sa} , and the corresponding strength reduction factors, ϕ , complying with ACI 318-14 17.5.1.2 and 17.3.3; or ACI 318-11 D.6.1.2, and D.4.3, respectively are given in [Tables 3 and 4](#) of this report. Where grout pads are present, the nominal strengths shall be reduced in accordance with ACI 318-14 17.5.1.3 or ACI 318-11 D.6.1.3.

4.1.6 Static Concrete Breakout Strength in Shear: The nominal static concrete breakout strength of a single anchor or group of anchors in shear, V_{cb} or V_{cbg} , shall be calculated in accordance with ACI 318-14 17.5.2; or ACI 318-11 D.6.2, based on information given in [Table 5](#) of this report. The basic concrete breakout strength of a single anchor in shear, V_b , shall be calculated in accordance with ACI 318-14 17.5.2.2; or ACI 318 D.6.2.2 using the values of d_a as described in [Table 5](#) of this report for the corresponding anchor steel. In addition, h_{ef} shall comply with the range given in [Table 5](#) and shall replace l_e in the calculation. In no case shall h_{ef} exceed $8d_a$. For anchors in lightweight concrete, the modification factors λ and λ_a shall be applied in accordance with ACI 318-14 17.2.6; or ACI 318-11 D.3.6. The value of f'_c shall be limited to 8,000 psi (55.1 MPa) maximum, in accordance with ACI 318-14 17.2.7; or ACI 318-11 Section D.3.7.

4.1.7 Static Concrete Pryout Strength in Shear: The nominal static pryout strength of a single anchor or group of anchors in shear, V_{cp} or V_{cpg} , shall be calculated in accordance with ACI 318-14 17.5.3; or ACI 318-11 D.6.3.

4.1.8 Interaction of Tensile and Shear Forces: For designs that include combined tension and shear as noted in ACI 318-14 17.3.1.3 or ACI 318-11 D.4.1.3, the interaction of tension and shear loads shall be calculated in accordance with ACI 318-14 17.6; or ACI 318-11 D.7.

4.1.9 Minimum Member Thickness, h_{min} , Minimum Anchor Spacing, s_{min} , and Minimum Edge Distance, c_{min} : In lieu of ACI 318-14 17.7.1 and 17.7.3; or ACI 318-11 D.8.1 and D.8.3, values of c_{min} and s_{min} used for anchor design and installation shall conform to the values provided in [Tables 1 and 2](#) of this report. In lieu of ACI 318-14 17.7.5 or ACI 318-

11 D.8.5, the minimum member thicknesses, h_{min} , shall be in accordance with [Tables 1 and 2](#) of this report. For anchors where installation will not be torqued, ACI 318-14 17.7.4; or ACI 318-11 D.8.4 applies. For adhesive anchors that will be torqued, the minimum edge distance and spacing shall be taken from [Table 4](#) of this report.

4.1.10 Design Strength in Seismic Design Categories C, D, E and F:

4.1.10.1 General: In structures assigned to Seismic Design Category C, D, E or F under the IBC or IRC, the design shall be performed according to ACI 318-14 17.2.3 as modified by 2018 and 2015 IBC Section 1905.1.8; or ACI 318-11 D.3.3 as modified by Section 4.1.11.2 of this report, which replaces 2012 IBC Section 1905.1.9. The nominal steel shear strength, V_{sa} , shall be adjusted by $\alpha_{v,seis}$ as given in [Tables 3 and 4](#) of this report for the types of anchors included in this report. The nominal bond strength, $\tau_{k,cr}$, shall be adjusted by $\alpha_{N,seis}$ as given in the footnotes to [Table 6](#) of this report.

4.1.10.2 2012, 2009, and 2006 IBC: Replace Section 1905.1.9 of the 2012 IBC with the following:

Modify ACI 318-11 Section D.3.3.4.2, D.3.3.4.3 (d) and D.3.3.5.2 to read as follows:

D.3.3.4.2 - Where the tensile component of the strength-level earthquake force applied to anchors exceeds 20 percent of the total factored anchor tensile force associated with the same load combination, anchors and their attachments shall be designed in accordance with D.3.3.4.3. The anchor design tensile strength shall be determined in accordance with D.3.3.4.4.

Exception:

Anchors designed to resist wall out-of-plane forces with design strengths equal to or greater than the force determined in accordance with [ASCE 7](#) Equation 12.11-1 or 12.14-10 shall be deemed to satisfy Section D.3.3.4.3 (d).

D.3.3.4.3 (d) – The anchor or group of anchors shall be designed for the maximum tension obtained from design load combinations that include E, with E increased by Ω_o . The anchor design tensile strength shall be calculated from D.3.3.4.4.

D.3.3.5.2 – Where the shear component of the strength-level earthquake force applied to anchors exceeds 20 percent of the total factored anchor shear force associated with the same load combination, anchors and their attachments shall be designed in accordance with D.3.3.5.3. The anchor design shear strength for resisting earthquake forces shall be determined in accordance with D.6.



Exceptions:

1. For the calculation of the in-plane shear strength of anchor bolts attaching wood sill plates of bearing or non-bearing walls of light-frame wood structures to foundations or foundation stem walls, the in-plane shear strength in accordance with D.6.2 and D.6.3 need not be computed and D3.3.5.3 need not apply provided all of the following are satisfied:

1.1. The allowable in-plane shear strength of the anchor is determined in accordance with AF&PA NDS Table 11E for lateral design values parallel to grain.

1.2. The maximum anchor nominal diameter is 5/8 inch (16 mm).

1.3. Anchor bolts are embedded into concrete a minimum of 7 inches (178 mm).

1.4. Anchor bolts are located a minimum of 1-3/4 inches (45 mm) from the edge of the concrete parallel to the length of the wood sill plate.

1.5. Anchor bolts are located a minimum of 15 anchor diameters from the edge of the concrete perpendicular to the length of the wood sill plate.

1.6. The sill plate is 2-inch or 3-inch nominal thickness.

2. For the calculation of the in-plane shear strength of anchor bolts attaching cold-formed steel track of bearing or non-bearing walls of light-frame construction to foundations or foundation stem walls, the in-plane shear strength in accordance with D.6.2 and D.6.3 need not be computed and D3.3.5.3 need not apply provided all of the following are satisfied:

2.1. The maximum anchor nominal diameter is 5/8 inch (16 mm).

2.2. Anchors are embedded into concrete a minimum of 7 inches (178 mm).

2.3. Anchors are located a minimum of 1 3/4 inches (45 mm) from the edge of the concrete parallel to the length of the track.

2.4. Anchors are located a minimum of 15 anchor diameters from the edge of the concrete perpendicular to the length of the track.

2.5. The track is 33 to 68 mil designation thickness. Allowable in-plane shear strength of exempt anchors, parallel to the edge of concrete shall be

permitted to be determined in accordance with [AISI S100](#) Section E3.3.1.

3. In light-frame construction, bearing or nonbearing walls, shear strength of concrete anchors less than or equal to 1 inch [25 mm] in diameter attaching a sill plate or track to foundation or foundation stem wall need not satisfy D.3.3.5.3(a) through (c) when the design strength of the anchors is determined in accordance with D.6.2.1(c).

4.2 Allowable Stress Design (ASD)

4.2.1 General: For anchors designed using load combinations in accordance with IBC Section [1605.3](#), allowable loads shall be established using Eq. (4-2) or Eq. (4-3):

$$T_{allowable,ASD} = \phi N_n / \alpha \quad \text{Eq. (4-2)}$$

and

$$V_{allowable,ASD} = \phi V_n / \alpha \quad \text{Eq. (4-3)}$$

where:

$T_{allowable,ASD}$ = Allowable tension load (lbf or kN)

$V_{allowable,ASD}$ = Allowable shear load (lbf or kN)

ϕN_n = The lowest design strength of an anchor or anchor group in tension as determined in accordance with ACI 318-14 Chapter 17 or [ACI 318-11](#) Appendix D as amended in Section 4.1 of this report.

ϕV_n = The lowest design strength of an anchor or anchor group in shear as determined in accordance with ACI 318-14 Chapter 17 or [ACI 318-11](#) Appendix D as amended in Section 4.1 of this report.

α = Conversion factor calculated as a weighted average of the load factors for the controlling load combination. In addition, α shall include all applicable factors to account for non-ductile failure modes and required over-strength.

The requirements for member thickness, edge distance and spacing, described in [Tables 1](#) and [2](#) of this report, shall apply.

4.2.2 Interaction of Tensile and Shear Forces: In lieu of ACI 318-14 17.6.1, 17.6.2, and 17.6.3; or [ACI 318-11](#) Sections D.7.1, D.7.2 and D.7.3, interaction of tension and shear loads shall be calculated as follows:

17.6.1 (D.7.1): If $V_{applied} \leq 0.2 V_{allowable,ASD}$ for the governing strength in shear, then the full allowable strength in tension, $T_{allowable,ASD}$, shall be permitted.

17.6.2 (D.7.2): If $T_{applied} \leq 0.2 T_{allowable,ASD}$ for the governing strength in tension, then the full allowable strength in shear, $V_{allowable,ASD}$, shall be permitted.



17.6.3 (D.7.3): If $V_{applied} \leq 0.2 V_{allowable,ASD}$ for the governing strength in shear and $T_{applied} \leq 0.2 T_{allowable,ASD}$ for the governing strength in tension, then Eq. (4-4) shall apply:

$$T_{applied}/T_{allowable,ASD} + V_{applied}/V_{allowable,ASD} \leq 1.2 \quad \text{Eq. (4-4)}$$

4.3 Installation

Installation parameters are provided in [Tables 1, 2, 8, 9](#) and [10](#) and in [Figure 1](#) of this report. Installation shall be in accordance with ACI 318-14 17.8.1 and 17.8.2; or ACI 318-11 D.9.1 and D.9.2. Anchor locations shall comply with this report and the plans and specifications approved by the building official. Installation of the AT-XP Adhesive Anchor System shall conform to the manufacturer's printed installation instructions (MPII) included in each package unit and as described in [Figure 1](#) of this report. The nozzles, brushes, dispensing tools, adhesive piston plugs, adhesive tubing, and adhesive retaining caps listed in [Tables 8](#) and [9](#) of this report, supplied by the manufacturer, shall be used along with the adhesive cartridges.

The anchors may be used for floor (vertically down), wall (horizontally inclined), and ceiling (upwardly inclined/overhead) applications. For wall and ceiling applications with 3/8-inch (9.7 mm) diameter anchors and No. 3 reinforcing bars, the adhesive shall be directly injected to the back of the hole using the adhesive tubing as described in [Tables 8](#) and [9](#) of this report, cut to appropriate lengths. For wall and ceiling applications with 1/2-inch through 1 1/4-inch (12.7 to 31.8 mm) diameter anchors and No. 4 through No. 10 reinforcing bars, the adhesive shall be directly injected to the back of the hole using the adhesive piston plugs and adhesive tubing cut to appropriate lengths, as described in [Tables 8](#) and [9](#) of this report.

Use of anchors in water-filled holes or submerged concrete is beyond the scope of this report.

4.4 Special Inspection

4.4.1 General: Installations may be made under continuous special inspection or periodic special inspection in accordance with ACI 318-14 26.13.3; ACI 318-11 D.9.2; or as determined by the registered design professional. Section 4.1.4 and [Tables 6](#) and [7](#) of this report specify special inspection requirements, including strength reduction factors, ϕ , corresponding to the type of inspection provided.

Continuous special inspection is required for all cases where adhesive anchors are installed in horizontally or upwardly inclined orientations that are designed to resist sustained tension loads in accordance with ACI 318-14 17.8.2.4 and 26.13.3.2 (c); or ACI 318-11 D.9.2.4.

Under the IBC, additional requirements as set forth in Sections 1704, 1705, 1706, or 1707 shall be observed, where

applicable.

4.4.2 Continuous Special Inspection: Installations made under continuous special inspection with an onsite proof loading program shall be performed in accordance with 2018, 2015 and 2012 IBC Sections 1705.1 and 1705.3, 2009 IBC Sections 1704.4 and 1704.15, or 2006 Sections 1704.4 and 1704.13, whereby continuous special inspection is defined in IBC Section 1702.1 and this report. The special inspector shall be on the jobsite continuously during anchor installation to verify anchor type, adhesive identification and expiration date, anchor dimensions, concrete type, concrete compressive strength and age, hole drilling method, hole dimensions, hole cleaning procedures, anchor spacing, edge distances, concrete thickness, anchor embedment, tightening torque and adherence to the manufacturer's printed installation instructions (MPII).

4.4.3 Periodic Special Inspection: Periodic special inspection shall be performed where required in accordance with 2018, 2015 and 2012 IBC Sections 1705.1 and 1705.3, 2009 IBC Sections 1704.4 and 1714.15 or 2006 IBC Sections 1704.4 and 1704.13 and this report. The special inspector shall be on the jobsite initially during anchor installation to verify anchor type, anchor dimensions, concrete type, concrete compressive strength, adhesive identification and expiration date, hole dimensions, hole cleaning procedures, anchor spacing, edge distances, concrete thickness, anchor embedment, tightening torque and adherence to the MPII. The special inspector shall verify the initial installations of each type and size of adhesive anchor by construction personnel on site. Subsequent installations of the same anchor type and size by the same construction personnel is permitted to be performed in the absence of the special inspector. Any change in the anchor product being installed or the personnel performing the installation shall require an initial inspection. For ongoing installations over an extended period, the special inspector shall make regular inspections to confirm correct handling and installation of the product.

4.4.4 Proof Loading Program: Where required, a program for on-site proof loading, that is, proof loading program, to be conducted as part of the special inspection shall be established by the engineer or design professional of record and shall conform to the following minimum requirements:

1. Frequency of proof loading based on anchor type, diameter, and embedment.
2. Proof loads by anchor type, diameter, embedment and location.
3. Acceptable displacements at proof load.
4. Remedial action in the event of failure to achieve proof load or excessive displacement.

Unless otherwise directed by the engineer or design professional of record, proof loads shall be applied as confined tension tests in accordance with ASTM E488 or ACI 355.4.



Proof loads shall not exceed the lesser of 67 percent of the load corresponding to the nominal bond strength as calculated from the characteristic bond stress for uncracked concrete modified for edge effects and concrete properties or 80 percent of the minimum specified anchor element yield strength ($A_{se,N} \cdot f_{ya}$). Maintain the proof load at the required load level for a minimum of 10 seconds.

5.0 CONDITION OF USE

The Simpson Strong-Tie AT-XP Adhesive Anchor System described in this report is a suitable alternative to what is specified in the codes listed in Section 1.0 of this report, subject to the following conditions:

5.1 AT-XP adhesive anchors shall be installed in accordance with the manufacturer's printed installation instructions (MPII) as shown in [Figure 1](#) of this report.

5.2 The anchors shall be installed in cracked and uncracked normal-weight concrete having a specified compressive strength $f'_c = 2,500$ psi to 8,500 psi (17.2 MPa to 58.6 MPa) and a minimum age of 21 days at the time of installation, subject to the conditions of this report.

5.3 The values of f'_c used for calculation purposes shall not exceed 8,000 psi (55.1 MPa) for both cracked and uncracked concrete.

5.4 Anchors shall be installed in concrete base materials in holes predrilled with carbide-tipped drill bits complying with [ANSI B212.15-1994](#) in accordance with the installation details shown in [Figure 1](#) of this report.

5.5 Loads applied to the anchors shall be adjusted in accordance with Section 1605.2 of the IBC for strength design. Strength design values shall be established in accordance with Section 4.1 of this report.

5.6 Loads applied to the anchors shall be adjusted in accordance with Section 1605.3 of the IBC for allowable stress design. Allowable design values shall be established in accordance with Section 4.2 of this report.

5.7 AT-XP adhesive anchors are recognized for use to resist short and long-term loads, including wind and earthquake loads, subject to the conditions of this report.

5.8 In structures assigned to Seismic Design Category C, D, E, or F under the IBC or IRC, anchor strength shall be adjusted in accordance with Section 4.1.10 of this report.

5.9 AT-XP adhesive anchors are permitted to be installed in concrete that is cracked or that may be expected to crack during the service life of the anchor, subject to the conditions of this report.

5.10 Minimum anchor spacing, minimum edge distance, minimum member thickness, critical spacing, and minimum critical edge distance shall comply with the values described in this report.

5.11 Prior to installation, calculations and details demonstrating compliance with this report shall be submitted to the building official. The calculations and details shall be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.

5.12 Fire-resistive construction: Anchors are not permitted to support fire-resistive construction. Where not otherwise prohibited in the IBC or IRC, AT-XP adhesive anchors are permitted for installation in fire-resistive construction provided at least one of the following conditions is fulfilled:

- Anchors are used to resist wind or seismic forces only.
- Anchors that support gravity load-bearing structural elements are within a fire-resistive envelope or a fire resistive membrane, are protected by approved fire-resistive materials, or have been evaluated for resistance to fire exposure in accordance with recognized standards.
- Anchors are used to support nonstructural elements.

5.13 Since an evaluation criteria for evaluating data to determine the performance of adhesive anchors subjected to fatigue or shock loading is unavailable at this time, the use of these anchors under such conditions is beyond the scope of this report.

5.14 Use of zinc-plated carbon steel threaded rods or steel reinforcing bars is limited to dry, interior locations.

5.15 Steel anchoring materials in contact with preservative-treated and fire-retardant-treated wood shall be zinc coated steel or stainless steel. The coating weights for zinc-coated steel shall be in accordance with [ASTM A153](#) Class C or D.

5.16 Hot-dipped galvanized carbon steel threaded rods with coating weights in accordance with ASTM A153 Class C or D, or stainless steel threaded rods, are permitted for exterior exposure or damp environments.

5.17 Use of anchors in water-filled holes or submerged concrete is beyond the scope of this report.

5.18 Special inspection shall be provided in accordance with Section 4.4 of this report. Continuous special inspection for anchors installed in horizontally or upwardly inclined orientation to resist sustained tension loads shall be provided in accordance with Section 4.4 of this report.



5.19 Anchors installed in a horizontally inclined orientation or upwardly inclined orientation to resist sustained tension loads shall be performed by personnel certified by an applicable certification program in accordance with ACI 318-14 17.8.2.2 or 17.8.2.3; or ACI [318-11](#) D.9.2.2 or D.9.2.3.

5.20 AT-XP adhesive is manufactured and packaged into cartridges by Simpson Strong-Tie Company, Inc., in West Chicago, Illinois, with inspections under the supervision of IAPMO UES.

6.0 EVIDENCE SUBMITTED

6.1 Data in accordance with ACI 318-14, ACI 355.4-11, and the ICC-ES Acceptance Criteria for Post-installed Adhesive Anchors in Concrete (AC308), dated October 2017. Test results are from laboratories in compliance with [ISO/IEC 17025](#).

7.0 IDENTIFICATION

7.1 AT-XP Adhesive is identified in the field by labels on the cartridge or packaging, bearing the company name (Simpson Strong-Tie Company, Inc.), product name (AT-XP), the batch number, the expiration date, one of the IAPMO Uniform Mark of Conformity shown below, and the IAPMO UES evaluation report number (ER-263).

7.2 Threaded rods, nuts, washers and deformed reinforcing bars are standard elements and shall conform to applicable national or international specifications.

Brian Gerber, P.E., S.E.
Vice President, Technical Operations
Uniform Evaluation Service

Richard Beck, PE, CBO, MCP
Vice President, Uniform Evaluation Service

GP Russ Chaney
CEO, The IAPMO Group

For additional information about this evaluation report please visit www.uniform-es.org or email at info@uniform-es.org



or



IAPMO ER #263



TABLE 1 – AT-XP Adhesive Anchor Installation Information – Threaded Rod Anchors

Characteristic	Symbol	Units	Nominal Rod Diameter d_o (inch)						
			3/8	1/2	5/8	3/4	7/8	1	1 1/4
Drill Bit Diameter	d_o	in.	7/16	9/16	11/16	13/16	1	1 1/8	1 3/8
Maximum Tightening Torque	T_{inst}	ft-lbs.	10	20	30	45	60	80	125
Minimum Embedment Depth	$h_{ef,min}$	in.	2 3/8	2 3/4	3 1/8	3 1/2	3 3/4	4	5
Maximum Embedment Depth	$h_{ef,max}$	in.	7 1/2	10	12 1/2	15	17 1/2	20	25
Minimum Concrete Thickness	h_{min}	in.	$h_{ef} + 1 1/4$			$h_{ef} + 2d_o$			
Critical Edge Distance	c_{ac}	in.	See Section 4.1.4.2 of this report.						
Minimum Edge Distance	c_{min}	in.	1 3/4						2 3/4
Minimum Anchor Spacing	s_{min}	in.	3						6

For SI units: 1 inch = 25.4 mm, 1 ft-lbs. = 1.356 Nm.

TABLE 2 – AT-XP Adhesive Anchor Installation Information – Reinforcing Bar (Rebar)

Characteristic	Symbol	Units	Bar Size						
			#3	#4	#5	#6	#7	#8	#10
Drill Bit Diameter	d_o	in.	1/2	5/8	3/4	7/8	1	1 1/8	1 3/8
Minimum Embedment Depth	$h_{ef,min}$	in.	2 3/8	2 3/4	3 1/8	3 1/2	3 3/4	4	5
Maximum Embedment Depth	$h_{ef,max}$	in.	7 1/2	10	12 1/2	15	17 1/2	20	25
Minimum Concrete Thickness	h_{min}	in.	$h_{ef} + 1 1/4$			$h_{ef} + 2d_o$			
Critical Edge Distance	c_{ac}	in.	See Section 4.1.4.2 of this report.						
Minimum Edge Distance	c_{min}	in.	1 3/4						2 3/4
Minimum Anchor Spacing	s_{min}	in.	3						6

For SI units: 1 inch = 25.4 mm, 1 ft-lbs. = 1.356 Nm.

TABLE 3 – Steel Design Information – Threaded Rod Anchors

Characteristic	Symbol	Units	Nominal Rod Diameter (inch)						
			3/8	1/2	5/8	3/4	7/8	1	1 1/4
Nominal Diameter	d_a	in.	0.375	0.5	0.625	0.75	0.875	1	1.25
Minimum Tensile Stress Area	A_{se}	in. ²	0.078	0.142	0.226	0.334	0.462	0.606	0.969
Tension Resistance of Steel - ASTM F1554, Grade 36 ²	N_{sa}	lbs.	4525	8235	13110	19370	26795	35150	56200
Tension Resistance of Steel - ASTM A193, Grade B7 ²			9750	17750	28250	41750	57750	75750	121125
Tension Resistance of Steel - Stainless Steel ASTM A193, Grade B6 (Type 410) ²			8580	15620	24860	36740	50820	66660	106590
Tension Resistance of Steel - Stainless Steel ASTM A193, Grade B8 & B8M (Types 304 & 316) ^{2,3}			4445	8095	12880	19040	26335	34540	55235
Strength Reduction Factor for Tension - Steel Failure ¹	Φ		0.75						
Minimum Shear Stress Area	A_{se}	in. ²	0.078	0.142	0.226	0.334	0.462	0.606	0.969
Shear Resistance of Steel - ASTM F1554, Grade 36 ²	V_{sa}	lbs.	2260	4940	7865	11625	16080	21090	33720
Shear Resistance of Steel - ASTM A193, Grade B7 ²			4875	10650	16950	25050	34650	45450	72675
Shear Resistance of Steel - Stainless Steel ASTM A193, Grade B6 (Type 410) ²			4290	9370	14910	22040	30490	40000	63955
Shear Resistance of Steel - Stainless Steel ASTM A193, Grade B8 & B8M (Types 304 & 316) ^{2,3}			2225	4855	7730	11425	15800	20725	33140
Reduction for Seismic Shear - ASTM F1554, Grade 36	$\alpha_{v,seis}$		0.85						
Reduction for Seismic Shear - ASTM A193, Grade B7			0.85						
Reduction for Seismic Shear - Stainless Steel ASTM A193, Grade B6 (Type 410)			0.85	0.75					0.85
Reduction for Seismic Shear - Stainless Steel ASTM A193, Grade B8 & B8M (Types 304 & 316)			0.85	0.75					0.85
Strength Reduction Factor for Shear - Steel Failure ¹	Φ		0.65						

¹The tabulated value of Φ applies when the load combinations of Section 1605.2 of the IBC, ACI 318-14 5.3, or ACI 318 Section 9.2 are used.

If the load combinations of ACI 318 Appendix C are used, the appropriate value of Φ must be determined in accordance with ACI 318-11 D.4.4.

²Bars are considered ductile steel elements in accordance with Section 3.2.4.3 of this report.

³Class 2 B8 bars 3/4 inch diameter and smaller are considered brittle elements in accordance with Section 3.2.4.3 of this report. The corresponding value of Φ shall be 0.65 for tension, 0.60 for shear.



TABLE 4 – Steel Design Information – Reinforcing Bar (Rebar)

Characteristic	Symbol	Units	Bar Size						
			#3	#4	#5	#6	#7	#8	#10
Nominal Diameter	d_b	in.	0.375	0.5	0.625	0.75	0.875	1	1.25
Minimum Tensile Stress Area	A_{se}	in. ²	0.11	0.20	0.31	0.44	0.60	0.79	1.27
Tension Resistance of Steel - Rebar (ASTM A615, Grade 60) ²	N_{sb}	lbs.	9900	18000	27900	39600	54000	71100	114000
Tension Resistance of Steel - Rebar (ASTM A706, Grade 60) ³			8800	16000	24800	35200	48000	63200	101600
Strength Reduction Factor for Tension - Steel Failure ¹	Φ		0.75						
Minimum Shear Stress Area	A_{se}	in. ²	0.11	0.20	0.31	0.44	0.60	0.79	1.27
Shear Resistance of Steel - Rebar (ASTM A615, Grade 60) ²	V_{sb}	lbs.	4950	10800	16740	23760	32400	42660	68580
Shear Resistance of Steel - Rebar (ASTM A706, Grade 60) ³			4400	9600	14880	21120	28800	37920	60960
Reduction for Seismic Shear - Rebar (ASTM A615, Grade 60) ²	$\alpha_{v,seis}$		0.56			0.80			
Reduction for Seismic Shear - Rebar (ASTM A706, Grade 60) ³									
Strength Reduction Factor for Shear - Steel Failure ¹	Φ		0.65						

¹The tabulated value of Φ applies when the load combinations of Section 1605.2 of the IBC, ACI 318-14 5.3, or ACI 318-11 Section 9.2 are used.

If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of Φ must be determined in accordance with ACI 318-11 D.4.4.

TABLE 5 – Concrete Breakout and Pryout Design Information – Threaded Rod Anchors and Reinforcing Bar

Characteristic	Symbol	Units	Nominal Rod/Rebar Diameter						
			3/8" or #3	1/2" or #4	5/8" or #5	3/4" or #6	7/8" or #7	1" or #8	1-1/4" or #10
Nominal Diameter	d_o	in.	0.375	0.5	0.625	0.75	0.875	1	1.25
Minimum Embedment Depth	$h_{ef,min}$	in.	2 3/8	2 3/4	3 1/8	3 1/2	3 3/4	4	5
Maximum Embedment Depth	$h_{ef,max}$	in.	7 1/2	10	12 1/2	15	17 1/2	20	25
Minimum Concrete Thickness	h_{min}	in.	$h_{ef} + 1 1/4$		$h_{ef} + 2d_o$				
Critical Edge Distance	c_{ac}	in.	See Section 4.1.4.2 of this report.						
Minimum Edge Distance	c_{min}	in.	1 3/4						2 3/4
Minimum Anchor Spacing	s_{min}	in.	3						6
Effectiveness Factor for Uncracked Concrete	$k_{c,uncr}$		24						
Effectiveness Factor for Cracked Concrete	$k_{c,cr}$		17						
Strength Reduction Factor - Concrete Breakout Failure in Tension ¹	Φ		0.65						
Strength Reduction Factor - Concrete Breakout Failure in Shear ¹	Φ		0.70						
Strength Reduction Factor - Pryout Failure ¹	Φ		0.70						

¹The tabulated values of Φ applies when both the load combinations of Section 1605.2.1 of the IBC, ACI 318-14 Section 5.3, or ACI 318-11 Section 9.2 are used and the requirements of ACI 318-14 17.3.3 or ACI 318-11 D.4.3 for Condition B are met. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of Φ must be determined in accordance with ACI 318-11 D.4.4 for Condition B.



TABLE 6 – AT-XP Adhesive Anchor Bond Strength Design Information – Threaded Rod Anchors

Condition	Characteristic		Symbol	Units	Nominal Rod Diameter d_o (inch)						
					3/8	1/2	5/8	3/4	7/8	1	1 1/4
Uncracked Concrete ^{2,3}	Characteristic Bond Strength ¹		$\tau_{k,uncr}$	psi	1390	1590	1715	1770	1750	1655	1250
	Permitted Embedment Depth Range	Minimum	$h_{ef,min}$	in.	2 3/8	2 3/4	3 1/8	3 1/2	3 3/4	4	5
		Maximum	$h_{ef,max}$		7 1/2	10	12 1/2	15	17 1/2	20	25
Cracked Concrete ^{2,3}	Characteristic Bond Strength ^{1,4,5,6}		$\tau_{k,cr}$	psi	1085	1035	980	950	815	800	700
	Permitted Embedment Depth Range	Minimum	$h_{ef,min}$	in.	3	3	3 1/8	3 1/2	3 3/4	4	5
		Maximum	$h_{ef,max}$		7 1/2	10	12 1/2	15	17 1/2	20	25
Continuous Inspection	Strength Reduction Factor - Dry Concrete ⁷		$\Phi_{dry,ci}$		0.65					0.55	
	Strength Reduction Factor - Water-Saturated Concrete ⁷		$\Phi_{sat,ci}$		0.45						
	Additional Factor - Water-Saturated Concrete		$K_{sat,ci}$		0.54		0.77		0.96		
Periodic Inspection	Strength Reduction Factor - Dry Concrete ⁷		$\Phi_{dry,pi}$		0.55					0.45	
	Strength Reduction Factor - Water-Saturated Concrete ⁷		$\Phi_{sat,pi}$		0.45						
	Additional Factor - Water-Saturated Concrete		$K_{sat,pi}$		0.46		0.65		0.81		

¹Bond strength values correspond to concrete compressive strength $f_c = 2,500$ psi. Bond strength values shall not be increased for concrete compressive strength.

²Maximum short term temperature of 180°F. Maximum long term temperature of 110°F.

³Short term concrete temperatures are those that occur over short intervals (diurnal cycling). Long term temperatures are constant over a significant time period.

⁴As detailed in Section 4.1.10 of this report, bond strength values for 1/2", 5/8", 3/4" and 1" anchors must be multiplied by $\alpha_{N,seis} = 0.85$.

⁵As detailed in Section 4.1.10 of this report, bond strength values for 1-1/4" anchors must be multiplied by $\alpha_{N,seis} = 0.75$.

⁶As detailed in Section 4.1.10 of this report, bond strength values for 7/8" anchors must be multiplied by $\alpha_{N,seis} = 0.59$.

⁷The tabulated value of Φ applies when load combinations of Section 1605.2 of the IBC, ACI 318-14 Section 5.3, or ACI 318-11 Section 9.2, are used in accordance with ACI 318-14 17.3.3 or ACI 318-11 D.4.3.

If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of Φ shall be determined in accordance with ACI 318 D.4.4.

The Φ values correspond to Condition B as described in Section 17.3.3 of ACI 318-14 or Section D.4.3 of ACI 318-11 and the anchor categories in Section 4.1.1 of this report for post-installed anchors.

TABLE 7 – AT-XP Adhesive Anchor Bond Strength Design Information – Reinforcing Bar (Rebar)

Condition	Characteristic		Symbol	Units	Bar Size						
					#3	#4	#5	#6	#7	#8	#10
Uncracked Concrete ^{2,3}	Characteristic Bond Strength ¹		$\tau_{k,uncr}$	psi	1010	990	970	955	935	915	875
	Permitted Embedment Depth Range	Minimum	$h_{ef,min}$	in.	2 3/8	2 3/4	3 1/8	3 1/2	3 3/4	4	5
		Maximum	$h_{ef,max}$		7 1/2	10	12 1/2	15	17 1/2	20	25
Cracked Concrete ^{2,3}	Characteristic Bond Strength ¹		$\tau_{k,cr}$	psi	340	770	780	790	795	795	820
	Permitted Embedment Depth Range	Minimum	$h_{ef,min}$	in.	3	3	3 1/8	3 1/2	3 3/4	4	5
		Maximum	$h_{ef,max}$		7 1/2	10	12 1/2	15	17 1/2	20	25
Continuous Inspection	Strength Reduction Factor - Dry Concrete ⁴		$\Phi_{dry,ci}$		0.65					0.55	
	Strength Reduction Factor - Water-Saturated Concrete ⁴		$\Phi_{sat,ci}$		0.45						
	Additional Factor - Water-Saturated Concrete		$K_{sat,ci}$		0.54		0.77		0.96		
Periodic Inspection	Strength Reduction Factor - Dry Concrete ⁴		$\Phi_{dry,pi}$		0.55					0.45	
	Strength Reduction Factor - Water-Saturated Concrete ⁴		$\Phi_{sat,pi}$		0.45						
	Additional Factor - Water-Saturated Concrete		$K_{sat,pi}$		0.46		0.65		0.81		

¹Bond strength values correspond to concrete compressive strength $f'_c = 2,500$ psi. Bond strength values shall not be increased for concrete compressive strength.

²Maximum short term temperature of 180°F. Maximum long term temperature of 110°F.

³Short term concrete temperatures are those that occur over short intervals (diurnal cycling). Long term temperatures are constant over a significant time period.

⁴The tabulated value of Φ applies when load combinations of Section 1605.2 of the IBC, ACI 318-14 Section 5.3, or ACI 318-11 Section 9.2 are used in accordance with ACI 318-11 D.4.3.

If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of Φ shall be determined in accordance with ACI 318-11 D.4.4.

The Φ values correspond to Condition B as described in Section 17.3.3 of ACI 318-14 or Section D.4.3 of ACI 318-11 and the anchor categories in Section 4.1.1 of this report for post-installed anchors.



TABLE 8– Installation Details – Threaded Rod Anchors

Anchor Diameter (in)	Drill Bit Diameter ^{1,2} (in)	Brush Part Number	Nozzle Part Number	Dispensing Tool Part Number	Adhesive Retaining Cap Part Number ³	Adhesive Tubing Part Number ^{3,4}	Adhesive Piston Plug Part Number ^{3,4}
3/8	7/16 ⁶	ETB6 ⁶	AMN19Q	ADT13S, ADT30S, ADTA30P, ADT30CKT, CDT10S	ARC37A-RP25	PPFT25	Not Available
1/2	9/16 ⁶	ETB6 ⁶			ARC50A-RP25		PP56-RP10
5/8	11/16	ETB6 ⁵			ARC62A-RP25		PP68-RP10
3/4	13/16	ETB8 ⁵			ARC75A-RP25		PP81-RP10
7/8	1	ETB10 ⁵			ARC87-RP25		PP100-RP10
1	1-1/8	ETB10 ⁵			ARC100-RP25		PP112-RP10
1-1/4	1-3/8	ETB12 ⁵			ARC125-RP25		PP137-RP10

For SI units: 1 inch = 25.4 mm, 1 ft-lbs. = 1.356 N-m.

¹Rotary Hammer shall be used to drill all holes.

²Drill bits shall comply with the requirements of ANSI B212.15.

⁴ For 3/8 inch diameter wall and ceiling installation (horizontally and upwardly inclined) orientations, adhesive shall be directly injected to the back of the hole using the Adhesive Tubing only.

⁵ Hole cleaning brushes are not needed when using the vacuum dust extraction system and the Bosch®/Simpson Strong-Tie DXS hollow carbide drill bits described in Section 3.2.3.2 of this report to drill and clean holes.

⁶ Hole cleaning brushes are always needed, since the 7/16 and 9/16 inch drill bit diameters have not been evaluated for use with the vacuum dust extraction system.

TABLE 9 – Installation Details – Reinforcing Bar (Rebar) Anchors

Bar Designation No.	Drill Bit Diameter ^{1,2} (in)	Brush Part Number	Nozzle Part Number	Dispensing Tool Part Number	Adhesive Retaining Cap Part Number ³	Adhesive Tubing Part Number ^{3,4}	Adhesive Piston Plug Part Number ^{3,4}
#3	1/2 ⁶	ETB6 ⁶	AMN19Q	ADT13S, ADT30S, ADTA30P, ADT30CKT, CDT10S	ARC37-RP25	PPFT25	Not Available
#4	5/8	ETB6 ⁵			ARC50-RP25		PP62-RP10
#5	3/4	ETB6 ⁵			ARC62-RP25		PP75-RP10
#6	7/8	ETB8 ⁵			ARC75-RP25		PP87-RP10
#7	1	ETB10 ⁵			ARC87-RP25		PP100-RP10
#8	1 1/8	ETB10 ⁵			ARC100-RP25		PP112-RP10
#10	1 3/8	ETB12 ⁵			ARC125-RP25		PP137-RP10

For SI units: 1 inch = 25.4 mm, 1 ft-lbs. = 1.356 N-m.

¹Rotary Hammer shall be used to drill all holes.

²Drill bits shall comply with the requirements of ANSI B212.15.

³ Adhesive Retaining Caps, Adhesive Piston Plugs and Adhesive Tubing are to be used for wall and ceiling (horizontally and upwardly inclined) installation orientations.

⁴ For #3 wall and ceiling installation (horizontally and upwardly inclined) orientations, adhesive shall be directly injected to the back of the hole using the Adhesive Tubing only.

⁵ Hole cleaning brushes are not needed when using the vacuum dust extraction system and the Bosch®/Simpson Strong-Tie DXS hollow carbide drill bits described in Section 3.2.3.2 of this report to drill and clean holes.

⁶ Hole cleaning brushes are always needed, since the 1/2 inch drill bit diameter has not been evaluated for use with the vacuum dust extraction system.




TABLE 10 – Cure Schedule¹


Concrete Temperature		Gel Time (minutes)	Cure Time ¹
(F°)	(C°)		
14	-10	30	24 hours
32	0	15	8 hours
50	10	7	3 hours
68	20	4	60 minutes
85	30	1.5	30 minutes
100	38	1	20 minutes

1. For water-saturated concrete, the cure times should be doubled.


1A Hole Preparation Standard Equipment – Horizontal, Vertical and Overhead Applications




1. Drill.
Drill hole to specified diameter and depth.



2. Blow.
Remove dust from hole with oil-free compressed air for a minimum of four (4) seconds. Compressed air nozzle must reach the bottom of the hole.




3. Brush.
Clean with a nylon brush for a minimum of four (4) cycles. Brush **MUST** reach the bottom of the hole. Brush should provide resistance to insertion. If no resistance is felt, the brush is worn and must be replaced.



4. Blow.
Remove dust from hole with oil-free compressed air for a minimum of four (4) seconds. Compressed air nozzle must reach the bottom of the hole.

Note: Refer to Tables A and B for proper drill bit size and brush part number.

1B Hole Preparation Vacuum Dust Extraction System with Bosch®/Simpson Strong-Tie® DXS Hollow Carbide Drill Bit – Horizontal, Vertical and Overhead Applications



1. Drill.
Drill hole to specified diameter and depth using a Bosch/Simpson Strong-Tie DXS hollow carbide drill bit and vacuum dust extraction system described in Section 3.2.3.2.




Bosch/Simpson Strong-Tie DXS drill bit used with the vacuum dust extraction system described in Section 3.2.3.2

2 Cartridge Preparation

1. Check.
Check expiration date on product label. Do not use expired product. Product is usable until end of printed expiration month.


2. Open.
Open cartridge per package instructions.



3. Attach.
Attach proper Simpson Strong-Tie® nozzle and extension to cartridge. Do not modify nozzle.



4. Insert.
Insert cartridge into dispensing tool.




5. Dispense.
Dispense adhesive to the side until properly mixed (uniform color).

Note: Review MSDS prior to use. Refer to Tables A and B for proper nozzle and dispensing tool part number. Refer to Tables C and E for proper adhesive storage temperatures, permitted concrete temperature range and adhesive gel times.


3A Filling the Hole – Vertical Anchorage

Prepare the hole per "Hole Preparation."

DRY AND DAMP HOLES:




1. Fill.
Fill hole 1/2 to 3/4 full, starting from bottom of hole to prevent air pockets. Withdraw nozzle as hole fills up.



2. Insert.
Insert clean, oil-free anchor (marked with the required embedment depth), turning slowly until the anchor contacts the bottom of the hole.

Threaded rod or rebar




3. Do not disturb.
Do not disturb anchor until fully cured. (See cure schedule for specific adhesive.)

Note: Refer to Table C for proper gel times and cure times and Table D for maximum tightening torque. Nozzle extensions may be needed for deep holes.

FIGURE 1 – INSTALLATION DETAILS

3B Filling the Hole – Horizontal and Overhead Anchorage with Adhesive Retaining Caps

Prepare the hole per "Hole Preparation."

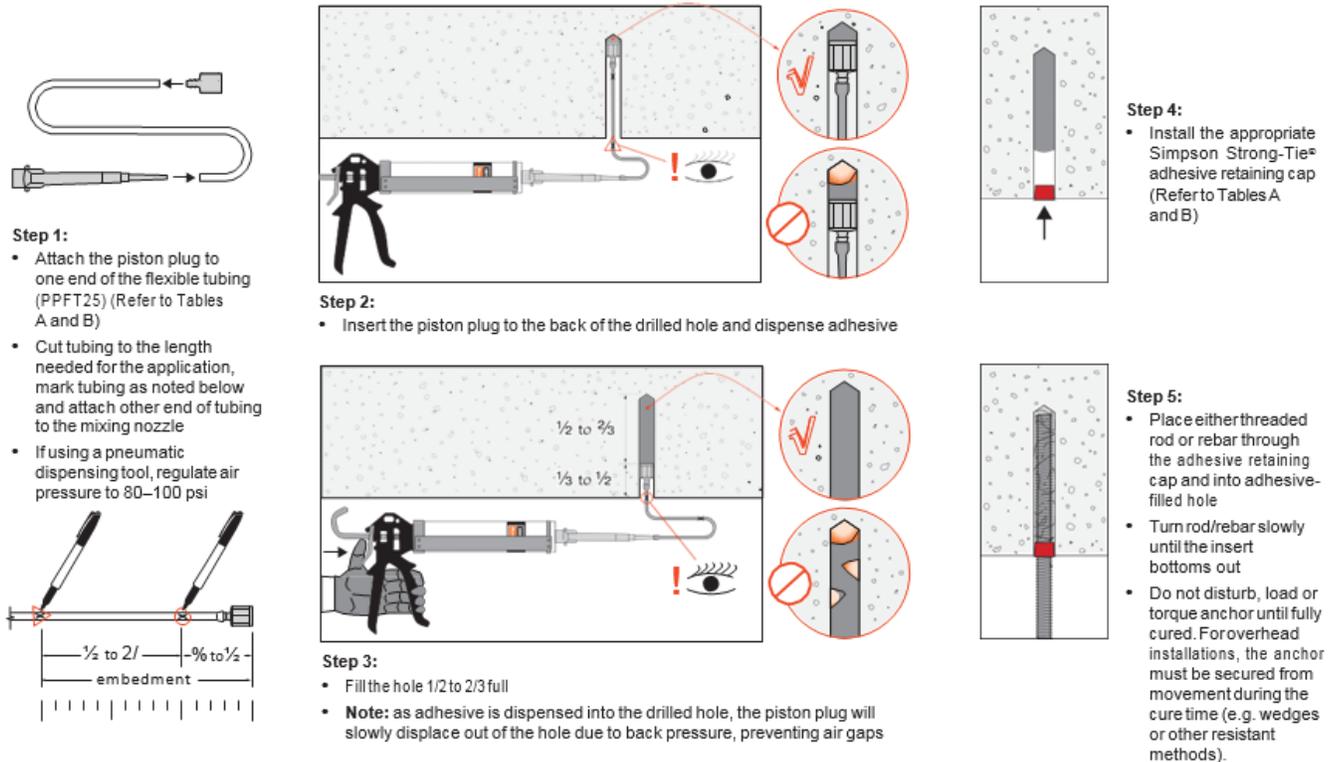

Note: Refer to Table C for proper gel times and cure times and Table D for maximum tightening torque.

Table A — Installation Details for Threaded Rod Anchors

Anchor Diameter (in)	Drill Bit Diameter ^{1,2} (in)	Brush Part Number	Nozzle Part Number	Dispensing Tool Part Number	Adhesive Retaining Cap Part Number ³	Adhesive Tubing Part Number ^{3,4}	Adhesive Piston Plug Part Number ^{3,4}
3/8	7/16 ⁶	ETB6	AMN19Q	ADT13S, ADT30S, ADTA30P, ADT30CKT, CDT10S	ARC37A-RP25	PPFT25	Not Available
1/2	9/16 ⁶	ETB6			ARC50A-RP25		PP56-RP10
5/8	11/16	ETB6 ⁵			ARC62A-RP25		PP68-RP10
3/4	13/16	ETB8 ⁹			ARC75A-RP25		PP81-RP10
7/8	1	ETB10 ⁵			ARC87-RP25		PP100-RP10
1	1-1/8	ETB10 ⁵			ARC100-RP25		PP112-RP10
1-1/4	1-3/8	ETB12 ⁵			ARC125-RP25		PP137-RP10

- Rotary Hammer must be used to drill all holes.
- Drill bits must meet the requirements of ANSI B212.15.
- Adhesive Retaining Caps Adhesing Piston Plugs and Tubing shall be used for wall and ceiling (horizontally and upwardly inclined) installation orientations.
- For 3/8-inch diameter wall and ceiling installation (horizontally and upwardly inclined) orientations, adhesive shall be directly injected to the back of the hole using the Adhesive Tubing only.
- Hole Cleaning brushes are not needed when using vacuum dust extraction system and the Bosch®/Simpson Strong-Tie DXS hollow carbide drill bits described in Section 3.2.3.2 of this report to drill and clean holes.
- The 7/16- and 9/16-inch drill bit diameters have not been evaluated for use with the vacuum dust extraction system.

FIGURE 1 – INSTALLATION DETAILS (continued)



Table B — Installation Details for Reinforcing Bar Anchors

Bar Designation No.	Drill Bit Diameter ^{1,2} (in.)	Brush Part Number	Nozzle Part Number	Dispensing Tool Part Number	Adhesive Retaining Cap Part Number ³	Adhesive Tubing Part Number ^{3,4}	Adhesive Piston Plug Part Number ^{3,4}
#3	1/2 ⁵	ETB6	AMN19Q	ADT12S, ADT30S, ADTA30P, ADT30CKT, CDT10S	ARC37-RP25	PPFT25	NotAvailable
#4	5/8	ETB6 ⁵			ARC50-RP25		PP62-RP10
#5	3/4	ETB6 ⁵			ARC62-RP25		PP75-RP10
#6	7/8	ETB8 ⁵			ARC75-RP25		PP87-RP10
#7	1	ETB10 ⁵			ARC87-RP25		PP100-RP10
#8	1-1/8	ETB10 ⁵			ARC100-RP25		PP112-RP10
#9	1-1/8	ETB10 ⁵			ARC100-RP25		PP112-RP10
#10	1-3/8	ETB12 ⁵			ARC125-RP25		PP137-RP10

- Rotary Hammer Must be used to drill all holes.
- Drill bits shall comply with the requirements of ANSI B212.15.
- Adhesive Retaining Caps, Adhesive piston Plugs and Tubing shall be used for wall and Ceiling (horizontally and upwardly inclined) installation orientations.
- For #3 wall and ceiling installation (horizontally and upwardly inclined) orientations, adhesive shall be directly injected to the back of the hole using the adhesive Tubing only.
- Hole cleaning brushes are not needed when using vacuum dust extraction system and the Bosch® / Sumpson Strong-Tie® DXS hollow carbide drill bits described in Section 3.2.3.2 of this report to drill and clean holes.
- The ½-inch drill bit has not been evaluated for use with the vacuum dust extraction system.

Table C – Cure Schedule			
Concrete Temperature		Gel Time (minutes)	Cure Time ¹
(F°)	(C°)		
14	-10	30	24 hours
32	0	15	8 hours
50	10	7	3 hours
68	20	4	60 minutes
85	30	1.5	30 minutes
100	38	1	20 minutes

1. For water-saturated concrete, the cure times should be doubled.

Table D – Anchor Tightening Torque, Embedment Depth and Placement Details						
Anchor Diameter (in.)	Maximum Tightening Torque T _{inst} (ft-lb.)	Min. Emb. Depth h _{ef,min} (in.)	Max. Emb. Depth h _{ef,max} (in.)	Min. Anchor Spacing s _{min} (in.)	Min. Edge Distance c _{min} (in.)	Min. Concrete Thickness h _{min} (in.)
3/8	10	2-3/8	7-1/2	3	1-3/4	h _{ef} +1-1/4
1/2	20	2-3/4	10			
5/8	30	3-1/8	12-1/2			
3/4	45	3-1/2	15			
7/8	60	3-3/4	17-1/2			
1	80	4	20	6	2-3/4	h _{ef} +2d _o
1-1/4	125	5	25			

Table E – Storage Information		
Storage Temperature		Shelf Life (months)
(F°)	(C°)	
32 to 80	0 to 27	12

FIGURE 1 – INSTALLATION DETAILS (continued)



CITY OF LOS ANGELES SUPPLEMENT

Simpson Strong-Tie Company Inc.

AT-XP® ADHESIVE ANCHORS FOR CRACKED AND UNCRACKED CONCRETE

CSI Section: 03 16 00—Concrete Anchors

CSI Section: 03 15 19 Cast-in Concrete Anchors

CSI Section: 05 05 19—Post-Installed Concrete
Anchors

1.0 RECOGNITION

The Simpson Strong-Tie® AT-XP Adhesive Anchors recognized in ER-263 have been evaluated for use to resist dead, live, wind, and seismic tension and shear loads. The structural performance properties of the Simpson Strong-Tie® AT-XP Adhesive Anchors were evaluated for compliance with the following codes:

- 2017 City of Los Angeles Building Code (LABC)
- 2017 City of Los Angeles Residential Code (LARC)

2.0 LIMITATIONS

The Simpson Strong-Tie® AT-XP Adhesive Anchors described in IAPMO UES ER-263 complies with the 2017 LABC Chapter 19 and LARC subject to the following limitations:

- 2.1 The design, installation, conditions of use and identification of the Simpson Strong-Tie® AT-XP adhesive anchors shall be in accordance with the 2018, 2015 or 2012 International Building Code and the 2018, 2015 or 2012 International Residential Code as noted in ER-263.
- 2.2 Prior to installation, calculations and details demonstrating compliance with this approval report and the 2017 Los Angeles Building Code or 2017 Los Angeles Residential Code shall be submitted to the structural plan check section for review and approval. The calculations and details shall be prepared by a registered engineer, licensed in the State of California.
- 2.3 The design and installation of the Simpson Strong-Tie® AT-XP adhesive anchors shall be in accordance with LABC Chapters 16 and 17 or Section 2114, as applicable.

- 2.4 The design information listed in the report and tables of ER-263 is valid for the anchorage to concrete only. Connected members also shall be analyzed for structural capacities in accordance with the applicable requirements in the LABC or LARC.
- 2.5 Periodic special inspection shall be provided by the Registered Deputy Inspector in accordance with Section 1705 of the 2017 LABC during installations of the Simpson Strong-Tie® AT-XP adhesive anchors.
- 2.6 Under the LARC a design in accordance with Section R301.1.3 shall be submitted.

This supplement expires concurrently with ER-263.

For additional information about this evaluation report please visit

www.uniform-es.org or email us at info@uniform-es.org