

**EVALUATION REPORT OF
UNION CORRUGATING COMPANY
'26 GA. ADVANTAGE-LOK II'**


**FLORIDA BUILDING CODE 5TH EDITION (2014)
FLORIDA PRODUCT APPROVAL
FL 7271.7-R3
ROOFING
METAL ROOFING**

**Prepared For:
Union Corrugating Company
P. O. Box 229
Fayetteville, NC 28302
Telephone: (910) 483-0479
Fax: (910) 483-8897**

**Prepared By:
Bala Sockalingam, Ph.D., P.E.
Florida Professional Engineer #62240
1216 N Lansing Ave., Suite C
Tulsa, OK 74106
Telephone: (918) 492-5992
FAX: (866) 366-1543**


**This report consists of
Evaluation Report (3 Pages including cover)
Installation Details (1 Page)**

**Report No. C1999-15
Date: 3.20.15**


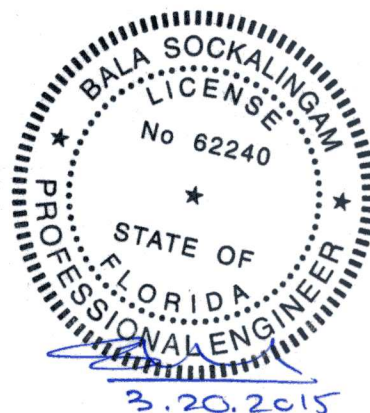


Manufacturer:	Union Corrugating Company
Product Name:	Advantage-Lok II Panel
Panel Description:	Max. 16" wide coverage with 1" high ribs
Materials:	Minimum 26 ga., 50 ksi steel. Galvanized coated steel (ASTM A653) or Galvalume coated steel (ASTM A792) or painted steel (ASTM A755).
Deck Description:	Min. 15/32" thick APA rated plywood or min. 3/4" thick wood plank (min SG of 0.42) for new and existing constructions. Designed by others and installed as per FBC 2014.
Underlayment:	Minimum underlayment as per FBC 2014 Section 1507.4.5.1
Slope:	1/2:12 or greater in accordance with FBC 2014 Section 1507.4.2
Design Uplift Pressure: (Factor of Safety = 2)	59.4 psf @ fastener spacing of 6" o.c. in 15/32" thick plywood 97.5 psf @ fastener spacing of 6" o.c. in 15/32" thick plywood with 3/16" diameter bead sealant in panel seam 107.9 psf @ fastener spacing of 4" o.c. in 19/32" thick plywood with 3/16" diameter bead sealant in panel seam
Panel Attachment: At panel seam	#10-12 x 1" long A-point pancake head screws
Seam Sealant:	Sikaflex-201 Sealant. In lieu of Sikaflex, adhesive/sealant with greater or equal tension properties may be used.
Test Standards:	Roof assembly tested in accordance with TAS 125-03 'Standard Requirements for Metal Roofing Systems'.
Code Compliance:	The product described herein has demonstrated compliance with FBC 2014 Section 1507.4
Product Limitations:	Design wind loads shall be determined for each project in accordance with FBC 2014 Section 1609 or ASCE 7-10 using allowable stress design. The maximum fastener spacing listed herein shall not be exceeded. This evaluation report is not applicable in High Velocity Hurricane Zone. Refer to current NOA for use of this product in High Velocity Hurricane Zone. Fire classification is not within scope of this Evaluation Report. Refer to FBC 2014 Section 1505 and current approved roofing materials directory or ASTM E108/UL790 report from an accredited laboratory for fire ratings of this product.

Supporting Documents: TAS 125 Test Reports
Farabaugh Engineering and Testing Inc
Project No. T185-06, Reporting Date 7/25/06

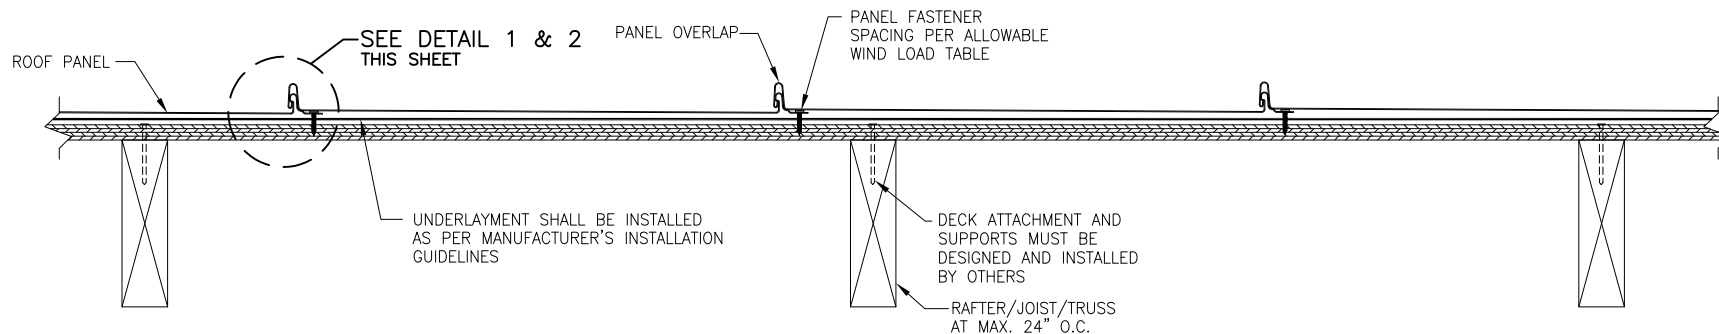

TYPICAL PANEL INSTALLATION X-SECTION

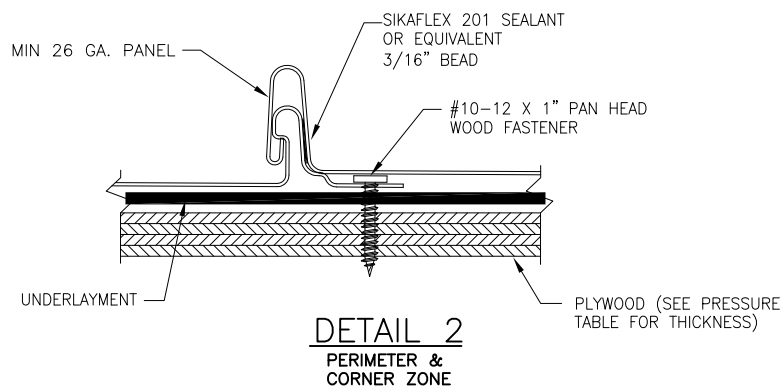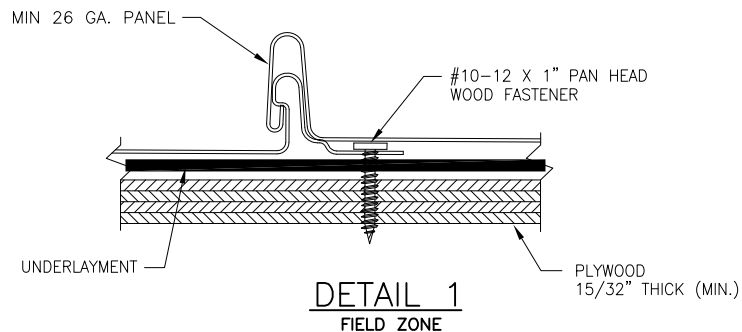

ALLOWABLE UPLIFT PRESSURE

PANEL SIDELAP FASTENER SPACING ALONG RIB	MINIMUM PLYWOOD THICKNESS	SEAM SEALANT DIAMETER	PRESSURE (PSF)
6"	15/32"	NONE	59.4
6"	15/32"	3/16"	97.5
4"	19/32"	3/16"	107.9

GENERAL NOTES:

1. ARCHITECTURAL ROOF PANEL HAS BEEN DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE (FBC).
2. ALL ROOF PANELS ARE SHALL BE 26 GA. EFFECTIVE COVERING WIDTH OF OF PANEL = 16".
3. THE ROOF PANELS SHALL BE INSTALLED OVER SHEATHING & STRUCTURE AS SPECIFIED ON THIS DRAWING.
4. REQUIRED DESIGN WIND LOADS SHALL BE DETERMINED FOR EACH PROJECT. THIS PANEL SYSTEM MAY NOT BE INSTALLED WHEN THE REQUIRED DESIGN WIND LOADS ARE GREATER THAN THE ALLOWABLE WIND LOAD TABLE.
5. ALL FASTENERS MUST BE IN ACCORDANCE WITH THIS DRAWING & THE FLORIDA BUILDING CODE. IF A DIFFERENCE OCCURS BETWEEN THE MINIMUM REQUIREMENTS OF THIS DRAWING & THE CODE, THE CODE SHALL CONTROL.
6. RAFTERS/JOISTS/TRUSSES MUST BE DESIGNED TO WITHSTAND WIND LOADS AS REQUIRED FOR EACH APPLICATION AND ARE THE RESPONSIBILITY OF OTHERS.

DRAWN BY: B.S.		CHECKED BY:	
PLOT: 1=4		DATE: 3/19/15	
NO.	REVISION	DESCRIPTION	DATE
DRAWING TITLE		ADVANTAGELOK II PANEL	
CONSULTANT	MANUFACTURER		
BALA SOCKALINGAM, PH.D., P.E.	UNION CORRUGATING CO.		
1216 N. LANSING AVE., SUITE C	701 S. KING STREET		
FAIRFAX, VA 22033	FAYETTEVILLE, NC 28301		
PHONE: 918-492-5992	FAX: 866-366-1543		
DRAWING NO.		REV.	
C1999-15			
SHEET NO.			
1 OF 1			