



ICC  
EVALUATION  
SERVICE

In Cooperation with



*Most Widely Accepted and Trusted*

# ICC-ES Evaluation Report

# ESR-4057

ICC-ES | (800) 423-6587 | (562) 699-0543 | [www.icc-es.org](http://www.icc-es.org)

Issued 04/2018

This report is subject to renewal 04/2019.

**DIVISION: 03 00 00—CONCRETE**

**SECTION: 03 16 00—CONCRETE ANCHORS**

**DIVISION: 05 00 00—METALS**

**SECTION: 05 05 19—POST-INSTALLED CONCRETE ANCHORS**

**REPORT HOLDER:**

**SIMPSON STRONG TIE COMPANY INC.**

**5956 WEST LAS POSITAS BOULEVARD  
PLEASANTON, CALIFORNIA 94588**

**EVALUATION SUBJECT:**

**SIMPSON STRONG-TIE® SET-3G EPOXY ADHESIVE ANCHORS IN CRACKED  
AND UNCRACKED CONCRETE**



*“2014 Recipient of Prestigious Western States Seismic Policy Council (WSSPC) Award in Excellence”*



A Subsidiary of

*ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.*



Copyright © 2018 ICC Evaluation Service, LLC. All rights reserved.

# ICC-ES Evaluation Report

**ESR-4057**

Issued April 2018

This report is subject to renewal April 2019.

[www.icc-es.org](http://www.icc-es.org) | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

**DIVISION: 03 00 00—CONCRETE**  
**Section: 03 16 00—Concrete Anchors**

**DIVISION: 05 00 00—METALS**  
**Section: 05 05 19—Post-Installed Concrete Anchors**

**REPORT HOLDER:**

**SIMPSON STRONG-TIE COMPANY INC.**  
5956 WEST LAS POSITAS BOULEVARD  
PLEASANTON, CALIFORNIA 94588  
(800) 999-5099  
[www.strongtie.com](http://www.strongtie.com)

**EVALUATION SUBJECT:**

**SIMPSON STRONG-TIE® SET-3G EPOXY ADHESIVE ANCHORS IN CRACKED AND UNCRACKED CONCRETE**

**1.0 EVALUATION SCOPE**

**Compliance with the following codes:**

- 2018, 2015, 2012 and 2009 *International Building Code*® (IBC)
- 2018, 2015, 2012 and 2009 *International Residential Code*® (IRC)

For evaluation for compliance with codes adopted by the Los Angeles Department of Building and Safety (LADBS), see [ESR-4057 LABC and LARC Supplement](#).

**Property evaluated:**

- Structural

**2.0 USES**

The Simpson Strong-Tie® SET-3G Epoxy Adhesive Anchors are used as anchorage in cracked and uncracked normal-weight concrete having a specified compressive strength,  $f'_c$ , of 2,500 psi to 8,500 psi (17.2 MPa to 58.6 MPa) to resist static, wind and earthquake (Seismic Design Categories A through F) tension and shear loads.

The adhesive anchors comply with anchors as described in Section 1901.3 of the 2018 and 2015 IBC, Section 1909 of the 2012 IBC and is an alternative to anchors described in Section 1908 of the 2012 IBC, and Sections 1911 and 1912 of the 2009 IBC. The anchors may also be used where an engineering design is submitted in accordance with Section R301.1.3 of the IRC.

**3.0 DESCRIPTION**

**3.1 General:**

The SET-3G Epoxy Adhesive Anchor System is comprised of the following components:

- SET-3G epoxy adhesive packaged in cartridges
- Adhesive mixing and dispensing equipment
- Equipment for hole cleaning and adhesive injection
- A steel anchoring element

SET-3G epoxy adhesive is used with continuously threaded steel rods or deformed steel reinforcing bars. The manufacturer's printed installation instructions (MPII) are included with each adhesive unit package as shown in Figure 1 of this report.

**3.2 Material:**

**3.2.1 SET-3G Epoxy Adhesive:** SET-3G epoxy adhesive is an injectable, two-component, 100 percent solids, epoxy-based adhesive mixed as a 1-to-1 volume ratio of hardener-to-resin. SET-3G is available in 8.5-ounce (251 mL), 22-ounce (650 mL), and 56-ounce (1656 mL) cartridges. The two components combine and react when dispensed through a static mixing nozzle attached to the cartridge. The shelf life of SET-3G in unopened cartridges is two years from the date of manufacture when stored at temperatures between 45°F and 90°F (7°C and 32°C) in accordance with the MPII.

**3.2.2 Dispensing Equipment:** SET-3G epoxy adhesive must be dispensed using Simpson Strong-Tie manual dispensing tools, battery-powered dispensing tools or pneumatic dispensing tools as listed in Tables 7 and 8 of this report.

**3.2.3 Hole Cleaning Equipment:**

**3.2.3.1 Standard Equipment:** Hole cleaning equipment consists of hole-cleaning brushes and air nozzles. Brushes must be Simpson Strong-Tie hole cleaning brushes, identified by Simpson Strong-Tie catalog number series ETBS. See Tables 7 and 8 in this report, and the installation instructions shown in Figure 1, for additional information. Air nozzles must be equipped with an extension capable of reaching the bottom of the drilled hole.

**3.2.3.2 Vacuum Dust Extraction System with Bosch®/Simpson Strong-Tie DXS Hollow Carbide Drill Bits:** For threaded steel rods and steel reinforcing bars described in Section 3.2.4 of this report, the Bosch/Simpson Strong-Tie DXS hollow carbide drill bits with carbide drilling head conforming to ANSI B212.15 must be used. The vacuum dust extraction system must also include a vacuum equipped with an automatic filter cleaning system that has a minimum airflow rating of 129 cfm. The vacuum dust extraction system removes the

drilling dust during the drilling operation, eliminating the need for additional hole cleaning.

**3.2.4 Anchor Materials:**

**3.2.4.1 Threaded Steel Rods:** Threaded anchor rods, having diameters from 3/8 inch to 1 1/4 inch (9.5 mm to 31.7 mm), must be carbon steel conforming to ASTM F1554, Grade 36 or 55, or ASTM A193, Grade B7; or stainless steel conforming to ASTM A193, Grade B6, B8, or B8M or ASTM F593 CW. Table 3 in this report provides additional details. Threaded rods must be clean, straight and free of indentations or other defects along their lengths.

**3.2.4.2 Steel Reinforcing Bars:** Steel reinforcing bars are deformed reinforcing bars (rebar), having sizes from No. 3 to No. 8, and No. 10, must conform to ASTM A615 Grade 60 or ASTM A706 Grade 60. Table 4 in this report provides additional details for anchor applications. The embedded portions of reinforcing bars must be straight, and free of mill scale, rust, mud, oil, and other coatings that may impair the bond with adhesive. Reinforcing bars must not be bent after installation except as set forth in ACI 318-14 Section 26.6.3.1 (b) or ACI 318-11 Section 7.3.2, as applicable, with the additional condition that the bars must be bent cold, and heating of reinforcing bars to facilitate field bending is not permitted.

**3.2.4.3 Ductility:** In accordance with ACI 318-14 2.3 or ACI 318-11 D.1, as applicable, in order for a steel element to be considered ductile, the tested elongation must be at least 14 percent and reduction of area must be at least 30 percent. Steel elements with a tested elongation of less than 14 percent or a reduction of area less than 30 percent, or both, are considered brittle. Where values are nonconforming or unstated, the steel must be considered brittle.

**3.2.5 Concrete:** Normal-weight concrete must comply with Sections 1903 and 1905 of the IBC. The specified compressive strength of the concrete must be from 2,500 psi to 8,500 psi (17.2 MPa to 58.6 MPa).

**4.0 DESIGN AND INSTALLATION**

**4.1 Strength Design of Post-Installed Anchors:**

**4.1.1 General:** The design strength of anchors under the 2018 and 2015 IBC, as well as the 2018 and 2015 IRC must be determined in accordance with ACI 318-14 and this report. The design strength of anchors under the 2012 and 2009 IBC, as well as the 2012 and 2009 IRC must be determined in accordance with ACI 318-11 and this report.

Design parameters are based on ACI 318-14 for use with the 2018 and 2015 IBC, and ACI 318-11 for use with the 2012 and 2009 IBC unless noted otherwise in Section 4.1.1 through 4.1.11 of this report.

The strength design of anchors must comply with ACI 318-14 17.3.1 or ACI 318-11 D.4.1, as applicable, except as required in ACI 318-14 17.2.3 or ACI 318-11 D.3.3, as applicable.

Design parameters are provided in Tables 2, 3, 4, 5 and 6 of this report. Strength reduction factors,  $\phi$ , as given in ACI 318-14 17.3.3 or ACI 318-11 D.4.3, as applicable, and noted in Tables 2, 3, 4, 5 and 6 of this report, must be used for load combinations calculated in accordance with Section 1605.2 of the IBC or ACI 318-14 5.3 or ACI 318-11 9.2, as applicable. Strength reductions factors,  $\phi$ , described in ACI 318-11 D.4.4 must be used for load combinations calculated in accordance with ACI 318-11 Appendix C.

**4.1.2 Static Steel Strength in Tension:** The nominal steel strength of a single anchor in tension,  $N_{sa}$ , in accordance with ACI 318-14 17.4.1.2 or ACI 318-11 D.5.1.2, as applicable, and the associated strength reduction factors,  $\phi$ , in accordance with ACI 318-14 17.3.3 or ACI 318-11 D.4.3, as applicable, are provided in Tables 3 and 4 of this report for the anchor element types included in this report.

**4.1.3 Static Concrete Breakout Strength in Tension:** The nominal static concrete breakout strength of a single anchor or group of anchors in tension,  $N_{cb}$  or  $N_{cbg}$ , must be calculated in accordance with ACI 318-14 17.4.2 or ACI 318-11 D.5.2, as applicable, with the following addition:

The basic concrete breakout strength of a single anchor in tension,  $N_b$ , must be calculated in accordance with ACI 318-14 17.4.2.2 or ACI 318-11 D.5.2.2, as applicable, using the values of  $K_{c,cr}$  and  $K_{c,uncr}$ , as described in Table 2 of this report. Where analysis indicates no cracking in accordance with ACI 318-14 17.4.2.6 or ACI 318-11 D.5.2.6, as applicable,  $N_b$  must be calculated using  $k_{c,uncr}$  and  $\Psi_{c,N} = 1.0$ . For anchors in lightweight concrete see ACI 318-14 17.2.6 or ACI 318-11 D.3.6, as applicable. The value of  $f'_c$  used for calculation must be limited to 8,000 psi (55.1 MPa) in accordance with ACI 318-14 17.2.7 or ACI 318-11 D.3.7, as applicable.

**4.1.4 Static Bond Strength in Tension:** The nominal static bond strength of a single adhesive anchor or group of adhesive anchors in tension,  $N_a$  or  $N_{ag}$ , must be calculated in accordance with ACI 318-14 17.4.5 or ACI 318-11 D.5.5, as applicable. Bond strength values are a function of the concrete condition (cracked or uncracked), the concrete temperature range, the installation conditions (dry or water saturated concrete), and the special inspection level provided. Strength reduction factors,  $\phi$ , listed below and in Tables 5 and 6 are utilized for anchors installed in dry or saturated concrete in accordance with the level of inspection provided (periodic or continuous), as applicable.

SPECIAL INSPECTION LEVEL	PERMISSIBLE INSTALLATION CONDITION	BOND STRENGTH	ASSOCIATED STRENGTH REDUCTION FACTOR
Continuous	Dry concrete	$\tau_k$	$\phi_{dry,ci}$
Continuous	Water-saturated, or Water-filled	$\tau_k$	$\phi_{wet,ci}$
Periodic	Dry concrete	$\tau_k$	$\phi_{dry,pi}$
Periodic	Water-saturated, Or Water filled	$\tau_k$	$\phi_{wet,pi}$

$\tau_k$  in the table above refers to  $\tau_{k,cr}$  or  $\tau_{k,uncr}$ .

**4.1.5 Static Steel Strength in Shear:** The nominal static steel strength of a single anchor in shear as governed by the steel,  $V_{sa}$ , in accordance with ACI 318-14 17.5.1.2 or ACI 318-11 D.6.1.2, as applicable, and strength reduction factors,  $\phi$ , in accordance with ACI 318-14 17.3.3 or ACI 318-11 D.4.3, as applicable, are given in Tables 3 and 4 of this report for the anchor element types included in this report.

**4.1.6 Static Concrete Breakout Strength in Shear:** The nominal static concrete breakout strength of a single anchor or group of anchors in shear,  $V_{cb}$  or  $V_{cbg}$ , must be calculated in accordance with ACI 318-14 17.5.2 or ACI 318-11 D.6.2, as applicable, based on information given in Table 2. The basic concrete breakout strength of a single anchor in shear,  $V_b$ , must be calculated in accordance with ACI 318-14 17.5.2.2 or ACI 318-11 D.6.2.2, as applicable, using the values of  $d$  as described in Table 2 of this report.

for the corresponding anchor steel in lieu of  $d_a$  (2018, 2015, 2012 and 2009 IBC). In addition,  $h_{ef}$  must be substituted for  $\ell_e$ . In no case shall  $\ell_e$  exceed  $8d$ . The value of  $f_c$  must be limited to 8,000 psi (55.1 MPa), in accordance with ACI 318-14 17.2.7 or ACI 318-11 D.3.7, as applicable.

**4.1.7 Static Concrete Pryout Strength in Shear:** The nominal static pryout strength of a single anchor or group of anchors in shear,  $V_{cp}$  or  $V_{cp,g}$ , shall be calculated in accordance with ACI 318-14 17.5.3 or ACI 318-11 D.6.3, as applicable.

**4.1.8 Interaction of Tensile and Shear Forces:** For designs that include combined tension and shear, the interaction of tension and shear loads must be calculated in accordance with ACI 318-14 17.6 or ACI 318-11 D.7, as applicable.

**4.1.9 Minimum Member Thickness,  $h_{min}$ , Anchor Spacing,  $s_{min}$ , and Edge Distance,  $c_{min}$ :** In lieu of ACI 318-14 17.7.1 and 17.7.3 or ACI 318-11 D.8.1 and D.8.3, as applicable, values of  $s_{min}$  and  $c_{min}$  provided in Table 1 of this report must be observed for anchor design and installation. The minimum member thicknesses,  $h_{min}$ , described in Table 1 of this report, must be observed for anchor design and installation. For adhesive anchors that will remain untorqued, ACI 318-14 17.7.4 or ACI 318-11 D.8.4, as applicable, applies.

**4.1.10 Critical Edge Distance  $c_{ac}$  and  $\psi_{cp,Na}$ :** The modification factor  $\psi_{cp,Na}$ , must be determined in accordance with ACI 318-14 17.4.5.5 or ACI 318-11 D.5.5.5, as applicable, except as noted below:

For all cases where  $c_{Na}/c_{ac} < 1.0$ ,  $\psi_{cp,Na}$  determined from ACI 318-14 Eq. 17.4.5.5b or ACI 318-11 Eq. D-27, as applicable, need not be taken less than  $c_{Na}/c_{ac}$ . For all other cases,  $\psi_{cp,Na}$  shall be taken as 1.0.

The critical edge distance,  $c_{ac}$ , must be calculated according to Eq. 17.4.5.5c for ACI 318-14 or Eq. D-27a for ACI 318-11, in lieu of ACI 318-14 17.7.6 or ACI 318-11 D.8.6, as applicable.

$$c_{ac} = h_{ef} \left( \frac{\tau_{k,uncr}}{1160} \right)^{0.4} \cdot \left[ 3.1 - 0.7 \frac{h}{h_{ef}} \right]$$

(Eq. 17.4.5.5c for ACI 318-14 or Eq. D-27a for ACI 318-11)

where

$\left[ \frac{h}{h_{ef}} \right]$  need not be taken as larger than 2.4; and

$\tau_{k,uncr}$  = the characteristic bond strength stated in the tables of this report whereby  $\tau_{k,uncr}$  need not be taken as larger than:

$$\tau_{k,uncr} = \frac{k_{uncr} \sqrt{h_{ef} f'_c}}{\pi d_a} \quad \text{Eq. (4-1)}$$

**4.1.11 Design Strength in Seismic Design Categories C, D, E and F:** In structures assigned to Seismic Design Category C, D, E or F under the IBC or IRC, anchors must be designed in accordance with ACI 318-14 17.2.3 or ACI 318-11 D.3.3, as applicable, except as described below. Modifications to ACI 318-14 17.2.3 shall be applied under Section 1905.1.8 of the 2018 and 2015 IBC. For the 2012 IBC, Section 1905.1.9 shall be omitted. The nominal steel shear strength,  $V_{sa}$ , must be adjusted by  $\alpha_{V,seis}$  as given in Tables 3 and 4 of this report for the anchor element types included in this report. The nominal bond strength  $\tau_{k,cr}$  in Table 5 must be adjusted by  $\alpha_{N,seis}$ . For Table 6, no adjustment to the bond strength  $\tau_{k,cr}$  is required.

As an exception to ACI 318-11 D.3.3.4.2: Anchors designed to resist wall out-of-plane forces with design

strengths equal to or greater than the force determined in accordance with ASCE 7 Equation 12.11-1 or 12.14-10 shall be deemed to satisfy ACI 318-11 D.3.3.4.3(d).

Under ACI 318-11 D.3.3.4.3(d), in lieu of requiring the anchor design tensile strength to satisfy the tensile strength requirements of ACI 318-11 D.4.1.1, the anchor design tensile strength shall be calculated from ACI 318-11 D.3.3.4.4.

The following exceptions apply to ACI 318-11 D.3.3.5.2:

1. For the calculation of the in-plane shear strength of anchor bolts attaching wood sill plates of bearing or non-bearing walls of light-frame wood structures to foundations or foundation stem walls, the in-plane shear strength in accordance with ACI 318-11 D.6.2 and D.6.3 need not be computed and ACI 318-11 D.3.3.5.3 need not apply provided all of the following are satisfied:

1.1. The allowable in-plane shear strength of the anchor is determined in accordance with AF&PA NDS Table 11E for lateral design values parallel to grain.

1.2. The maximum anchor nominal diameter is  $\frac{5}{8}$  inch (16 mm).

1.3. Anchor bolts are embedded into concrete a minimum of 7 inches (178 mm).

1.4. Anchor bolts are located a minimum of  $1\frac{3}{4}$  inches (45 mm) from the edge of the concrete parallel to the length of the wood sill plate.

1.5. Anchor bolts are located a minimum of 15 anchor diameters from the edge of the concrete perpendicular to the length of the wood sill plate.

1.6. The sill plate is 2-inch or 3-inch nominal thickness.

2. For the calculation of the in-plane shear strength of anchor bolts attaching cold-formed steel track of bearing or non-bearing walls of light-frame construction to foundations or foundation stem walls, the in-plane shear strength in accordance with ACI 318-11 D.6.2 and D.6.3 need not be computed and ACI 318-11 D.3.3.5.3 need not apply provided all of the following are satisfied:

2.1. The maximum anchor nominal diameter is  $\frac{5}{8}$  inch (16 mm).

2.2. Anchors are embedded into concrete a minimum of 7 inches (178 mm).

2.3. Anchors are located a minimum of  $1\frac{3}{4}$  inches (45 mm) from the edge of the concrete parallel to the length of the track.

2.4. Anchors are located a minimum of 15 anchor diameters from the edge of the concrete perpendicular to the length of the track.

2.5. The track is 33 to 68 mil designation thickness. Allowable in-plane shear strength of exempt anchors, parallel to the edge of concrete shall be permitted to be determined in accordance with AISI S100 Section E3.3.1.

3. In light-frame construction, bearing or nonbearing walls, shear strength of concrete anchors less than or equal to 1 inch [25 mm] in diameter attaching a sill plate or track to foundation or foundation stem wall need not satisfy ACI 318-11 D.3.3.5.3(a) through (c) when the design strength of the anchors is determined in accordance with ACI 318-11 D.6.2.1(c).

## 4.2 Allowable Stress Design (ASD):

**4.2.1 General:** For anchors designed using load combinations in accordance with IBC Section 1605.3 (Allowable Stress Design), allowable loads shall be established using Eq. (4-2) or Eq. (4-3):

$$T_{allowable,ASD} = \phi N_n / \alpha \quad \text{Eq. (4-2)}$$

and

$$V_{allowable,ASD} = \phi V_n / \alpha \quad \text{Eq. (4-3)}$$

where:

$T_{allowable,ASD}$  = Allowable tension load (lbf or kN)

$V_{allowable,ASD}$  = Allowable shear load (lbf or kN)

$\phi N_n$  = The lowest design strength of an anchor or anchor group in tension as determined in accordance with ACI 318-14 Chapter 17 and IBC (2018 and 2015) Section 1905.1.8, ACI 318-11 Appendix D, ACI 318-08 Appendix D and 2009 IBC Sections 1908.1.9 and 1908.1.10, and Section 4.1 of this report, as applicable.

$\phi V_n$  = The lowest design strength of an anchor or anchor group in shear as determined in accordance with ACI 318-14 Chapter 17 and IBC (2018 and 2015) Section 1905.1.8, ACI 318-11 Appendix D, ACI 318-08 Appendix D and 2009 IBC Sections 1908.1.9 and 1908.1.10, and Section 4.1 of this report, as applicable.

$\alpha$  = Conversion factor calculated as a weighted average of the load factors for the controlling load combination. In addition,  $\alpha$  must include all applicable factors to account for non-ductile failure modes and required over-strength.

The requirements for member thickness, edge distance and spacing, described in Table 1 of this report, must apply.

**4.2.2 Interaction of Tensile and Shear Forces:** In lieu of ACI 318-14 17.6.1, 17.6.2, and 17.6.3 or ACI 318-11 D.7.1, D.7.2 and D.7.3, as applicable, interaction of tension and shear loads must be calculated as follows:

If  $T_{applied} \leq 0.2 T_{allowable,ASD}$ , then the full allowable strength in shear,  $V_{allowable,ASD}$ , shall be permitted.

If  $V_{applied} \leq 0.2 V_{allowable,ASD}$ , then the full allowable strength in tension,  $T_{allowable,ASD}$ , must be permitted.

For all other cases:

$$\frac{T_{applied}}{T_{allowable,ASD}} + \frac{V_{applied}}{V_{allowable,ASD}} \leq 1.2 \quad \text{Eq. (4-4)}$$

## 4.3 Installation:

Installation parameters are provided in Tables 1, 7, 8 and 9 and in Figure 1. Installation must be in accordance with ACI 318-14 17.8.1 and 17.8.2 or ACI 318-11 D.9.1 and D.9.2, as applicable. Anchor locations must comply with this report and the plans and specifications approved by the building official. Installation of the SET-3G Epoxy Adhesive Anchors must conform to the manufacturer's printed installation instructions included in each package unit and as described in Figure 1. The nozzles, brushes, dispensing tools, adhesive piston plugs, adhesive tubing and adhesive retaining caps listed in Tables 7 and 8, supplied by the manufacturer, must be used along with the adhesive cartridges. The anchors may be used for floor

(vertically down), wall (horizontal), and overhead applications. For horizontal and overhead applications with  $\frac{3}{8}$ -inch anchors and #3 reinforcing bars, inject the adhesive directly to the back of the hole using the adhesive tubing as described in Tables 7 and 8 cut to convenient lengths. For horizontal and overhead applications with  $\frac{1}{2}$ -inch through  $1\frac{1}{4}$ -inch anchors and #4 through #10 reinforcing bars, inject the adhesive directly to the back of the hole using the adhesive piston plugs and adhesive tubing cut to convenient lengths, as described in Tables 7 and 8.

Installation of anchors in horizontal or upwardly inclined orientations shall be fully restrained from movement throughout the specified curing period through the use of temporary wedges, external supports, or other methods. Where temporary restraint devices are used, their use shall not result in impairment of the anchor shear resistance.

## 4.4 Special Inspection:

**4.4.1 General:** Installations may be made under continuous special inspection or periodic special inspection, as determined by the registered design professional. See Section 4.1.4 and Tables 5 and 6 of this report for special inspection requirements, including strength reduction factors,  $\phi$ , corresponding to the type of inspection provided.

Continuous special inspection of adhesive anchors installed in horizontal or upwardly inclined orientations to resist sustained tension loads shall be performed in accordance with ACI 318-14 17.8.2.4 or ACI 318 D.9.2.4, as applicable.

Under the IBC, additional requirements as set forth in Sections 1705, 1706, or 1707 must be observed, where applicable.

**4.4.2 Continuous Special Inspection:** Installations made under continuous special inspection with an onsite proof loading program must be performed in accordance with Section 1705.1.1 and Table 1705.3 of the 2018, 2015 and 2012 IBC, 2009 IBC Sections 1704.4 and 1704.15, whereby continuous special inspection is defined in IBC Section 1702.1 and this report. The special inspector must be on the jobsite continuously during anchor installation to verify anchor type, adhesive identification and expiration date, anchor dimensions, concrete type, concrete compressive strength, hole drilling method, hole dimensions, hole cleaning procedures, anchor spacing, edge distances, concrete thickness, anchor embedment, tightening torque and adherence to the manufacturer's printed installation instructions.

The proof loading program must be established by the registered design professional. As a minimum, the following requirements must be addressed in the proof loading program:

1. Frequency of proof loading based on anchor type, diameter, and embedment;
2. Proof loads by anchor type, diameter, embedment and location;
3. Acceptable displacements at proof load;
4. Remedial action in the event of failure to achieve proof load or excessive displacement.

Unless otherwise directed by the registered design professional, proof loads must be applied as confined tension tests. Proof load levels must not exceed the lesser of 67 percent of the load corresponding to the nominal bond strength as calculated from the characteristic bond stress for uncracked concrete modified for edge effects

and concrete properties, or 80 percent of the minimum specified anchor element yield strength ( $A_{se,N} \cdot f_{ya}$ ). The proof load shall be maintained at the required load level for a minimum of 10 seconds.

**4.4.3 Periodic Special Inspection:** Periodic special inspection must be performed where required in accordance with Section 1705.1.1 and Table 1705.3 of the 2018, 2015 and 2012 IBC, Sections 1704.4 and 1704.15 of the 2009 IBC and this report. The special inspector must be on the jobsite initially during anchor installation to verify anchor type, anchor dimensions, concrete type, concrete compressive strength, adhesive identification and expiration date, hole dimensions, hole cleaning procedures, anchor spacing, edge distances, concrete thickness, anchor embedment, tightening torque and adherence to the manufacturer's printed installation instructions.

The special inspector must verify the initial installations of each type and size of adhesive anchor by construction personnel on site. Subsequent installations of the same anchor type and size by the same construction personnel is permitted to be performed in the absence of the special inspector. Any change in the anchor product being installed or the personnel performing the installation must require an initial inspection. For ongoing installations over an extended period, the special inspector must make regular inspections to confirm correct handling and installation of the product.

## 5.0 CONDITIONS OF USE

The Simpson Strong-Tie SET-3G Epoxy Adhesive Anchors described in this report complies with, or is a suitable alternative to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1 SET-3G epoxy adhesive anchors must be installed in accordance with the manufacturer's printed installation instructions as shown in Figure 1 of this report.
- 5.2 The anchors must be installed in cracked and uncracked normal-weight concrete having a specified compressive strength  $f'_c = 2,500$  psi to 8,500 psi (17.2 MPa to 58.6 MPa).
- 5.3 The values of  $f'_c$  used for anchor calculation purposes must not exceed 8,000 psi (55.1 MPa).
- 5.4 The concrete shall have attained its minimum compressive strength prior to the installation of the anchors.
- 5.5 Anchors must be installed in concrete base materials in holes predrilled with carbide-tipped drill bits complying with ANSI B212.15-1994 in accordance with the instructions provided in Figure 1 of this report.
- 5.6 Loads applied to the anchors must be adjusted in accordance with Section 1605.2 of the IBC for strength design and in accordance with Section 1605.3 of the IBC for allowable stress design.
- 5.7 SET-3G epoxy adhesive anchors are recognized for use to resist short- and long-term loads, including wind and earthquake loads, subject to the conditions of this report.
- 5.8 In structures assigned to Seismic Design Category C, D, E, or F under the IBC or IRC, anchor strength must be adjusted in accordance with Section 4.1.11 of this report.
- 5.9 SET-3G Epoxy Adhesive Anchors are permitted to be installed in concrete that is cracked or that may be expected to crack during the service life of the anchor, subject to the conditions of this report.
- 5.10 Strength design values shall be established in accordance with Section 4.1 of this report.
- 5.11 Allowable design values shall be established in accordance with Section 4.2 of this report.
- 5.12 Minimum anchor spacing and edge distance, as well as minimum member thickness and critical edge distance, must comply with the values described in this report.
- 5.13 Prior to installation, calculations and details demonstrating compliance with this report must be submitted to the code official. The calculations and details must be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.
- 5.14 Fire-resistive construction: Anchors and post-installed reinforcing bars are not permitted to support fire-resistive construction. Where not otherwise prohibited in the code, SET-3G epoxy adhesive anchors and post-installed reinforcing bars are permitted for installation in fire-resistive construction provided at least one of the following conditions is fulfilled:
  - Anchors and post-installed reinforcing bars are used to resist wind or seismic forces only.
  - Anchors and post-installed reinforcing bars that support gravity load-bearing structural elements are within a fire-resistive envelope or a fire resistive membrane, are protected by approved fire-resistive materials, or have been evaluated for resistance to fire exposure in accordance with recognized standards.
  - Anchors and post-installed reinforcing bars are used to support nonstructural elements.
- 5.15 Since an ICC-ES acceptance criteria for evaluating data to determine the performance of adhesive anchors subjected to fatigue or shock loading is unavailable at this time, the use of these anchors or post-installed reinforcing bars under such conditions is beyond the scope of this report.
- 5.16 Use of zinc-plated carbon steel threaded rods or steel reinforcing bars is limited to dry, interior locations.
- 5.17 Hot-dipped galvanized carbon steel threaded rods with coating weights in accordance with ASTM A153 Class C and D, or stainless steel threaded rods, are permitted for exterior exposure or damp environments.
- 5.18 Steel anchoring materials in contact with preservative-treated and fire-retardant-treated wood must be zinc-coated steel or stainless steel. The minimum coating weights for zinc-coated steel must comply with ASTM A153.
- 5.19 Special inspection must be provided in accordance with Section 4.4 of this report. Continuous special inspection for anchors installed in horizontal or upwardly inclined orientations to resist sustained tension loads must be provided in accordance with Section 4.4 of this report.
- 5.20 Installation of anchors in horizontal or upwardly inclined orientations to resist sustained tension loads shall be performed by personnel certified by an

applicable certification program in accordance with ACI 318-14 17.8.2.2 or 17.8.2.3, or ACI 318-11 D.9.2.2 or D.9.2.3, as applicable.

5.21 SET-3G epoxy adhesive is manufactured and packaged into cartridges by Simpson Strong-Tie Company Inc., in West Chicago, Illinois, under a quality-control program with inspections by ICC-ES.

6.0 EVIDENCE SUBMITTED

Data in accordance with ICC-ES Acceptance Criteria for Post-installed Adhesive Anchors in Concrete (AC308), dated October 2017 (editorially revised April 2018), which incorporates requirements in ACI 355.4-11; and quality control documentation.

7.0 IDENTIFICATION

7.1 SET-3G Epoxy Adhesive is identified in the field by labels on the cartridge or packaging, bearing the company name (Simpson Strong-Tie Company, Inc.), product name (SET-3G), the batch number, the expiration date, and the evaluation report number (ESR-4057).

7.2 Threaded rods, nuts, washers and deformed reinforcing bars are standard elements and must conform to applicable national or international specifications.

TABLE 1—SET-3G INSTALLATION INFORMATION FOR THREADED ROD/REBAR ANCHORS

Installation Information	Symbol	Units	Nominal Rod Diameter / Rebar Size						
			3/8" or #3	1/2" or #4	5/8" or #5	3/4" or #6	7/8" or #7	1" or #8	1 1/4" or #10
Drill Bit Diameter - Threaded Rod	d <sub>o</sub>	in.	7/16	9/16	11/16	7/8	1	1 1/8	1 3/8
Drill Bit Diameter - Rebar	d <sub>o</sub>	in.	1/2	5/8	3/4	7/8	1	1 1/8	1 3/8
Maximum Tightening Torque	T <sub>inst</sub>	ft-lbs.	15	30	60	100	125	150	200
Minimum Embedment Depth	h <sub>ef,min</sub>	in.	2 3/8	2 3/4	3 1/8	3 1/2	3 3/4	4	5
Maximum Embedment Depth	h <sub>ef,max</sub>	in.	7 1/2	10	12 1/2	15	17 1/2	20	25
Minimum Concrete Thickness	h <sub>min</sub>	in.	h <sub>ef</sub> + 1-1/4		h <sub>ef</sub> + 2d <sub>o</sub>				
Critical Edge Distance	C <sub>ac</sub>	in.	See Section 4.1.10 of this report						
Minimum Edge Distance	C <sub>min</sub>	in.	1 3/4						2 3/4
Minimum Anchor Spacing	S <sub>min</sub>	in.	3						6

For SI: 1 inch = 25.4 mm, 1 ft-lb = 1.356 Nm.

TABLE 2—CONCRETE BREAKOUT AND PRYOUT DESIGN INFORMATION FOR THREADED ROD/REBAR ANCHORS

Characteristic	Symbol	Units	Nominal Rod/Rebar Diameter						
			3/8" or #3	1/2" or #4	5/8" or #5	3/4" or #6	7/8" or #7	1" or #8	1 1/4" or #10
Nominal Diameter	d	in.	0.375	0.5	0.625	0.75	0.875	1	1.25
Permitted Embedment Depth Range Min. / Max.	h <sub>ef,min</sub>	in.	2 3/8	2 3/4	3 1/8	3 1/2	3 3/4	4	5
	h <sub>ef,max</sub>	in.	7 1/2	10	12 1/2	15	17 1/2	20	25
Minimum Concrete Thickness	h <sub>min</sub>	in.	h <sub>ef</sub> + 1 1/4		h <sub>ef</sub> + 2d <sub>o</sub>				
Critical Edge Distance	C <sub>ac</sub>	in.	See Section 4.1.10 of this report.						
Minimum Edge Distance	C <sub>min</sub>	in.	1 3/4						2 3/4
Minimum Anchor Spacing	S <sub>min</sub>	in.	3						6
Effectiveness Factor for Uncracked Concrete	k <sub>c,cr</sub>	-	17						
Effectiveness Factor for Uncracked Concrete	k <sub>c,un-cr</sub>	-	24						
Strength Reduction Factor - Concrete Breakout Failure in Tension <sup>1</sup>	φ	-	0.65						
Strength Reduction Factor - Concrete Breakout Failure in Shear <sup>1</sup>	φ	-	0.70						
Strength Reduction Factor - Pryout Failure <sup>1</sup>	φ	-	0.70						

For SI: 1 inch = 25.4 mm, 1 ft-lb = 1.356 Nm.

<sup>1</sup>The tabulated values of φ applies when both the load combinations of Section 1605.2 of the IBC, ACI 318-14 5.3, or ACI 318-11 9.2 are used and the requirements of ACI 318-14 17.3.3 (c) or ACI 318-11 D.4.3(c), as applicable, for Condition B are met. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of φ must be determined in accordance with ACI 318-11 D.4.4(c) for Condition B.

TABLE 3—STEEL DESIGN INFORMATION FOR THREADED ROD

Characteristic	Symbol	Units	Nominal Rod Diameter (inch)						
			3/8	1/2	5/8	3/4	7/8	1	1 1/4
Nominal Diameter	d	in.	0.375	0.5	0.625	0.75	0.875	1	1.25
Minimum Tensile Stress Area	A <sub>se</sub>	in. <sup>2</sup>	0.078	0.142	0.226	0.334	0.462	0.606	0.969
Tension Resistance of Steel - ASTM F1554, Grade 36	N <sub>sa</sub>	lb.	4525	8235	13110	19370	26795	35150	56200
Tension Resistance of Steel - ASTM F1554, Grade 55			5850	10650	16950	25050	34650	45450	72675
Tension Resistance of Steel - ASTM A193, Grade B7			9750	17750	28250	41750	57750	75750	121125
Tension Resistance of Steel - Stainless Steel ASTM A193, Grade B8 and B8M (Types 304 and 316)			4445	8095	12880	19040	26335	34540	55235
Tension Resistance of Steel - Stainless Steel ASTM A593 CW (Types 304 & 316)			7800	14200	22600	28390	39270	51510	82365
Tension Resistance of Steel - Stainless Steel ASTM A193, Grade B6 (Type 410)			8580	15620	24860	36740	50820	66660	106590
Strength Reduction Factor for Tension - Steel Failure <sup>1</sup>			φ	-	0.75				
Minimum Shear Stress Area	A <sub>se</sub>	in. <sup>2</sup>	0.078	0.142	0.226	0.334	0.462	0.606	0.969
Shear Resistance of Steel - ASTM F1554, Grade 36	V <sub>sa</sub>	lb.	2715	4940	7865	11625	16080	21090	33720
Shear Resistance of Steel - ASTM F1554, Grade 55			3510	6390	10170	15030	20790	27270	43605
Shear Resistance of Steel - ASTM A193, Grade B7			5850	10650	16950	25050	34650	45450	72675
Reduction for Seismic Shear - Carbon Steel	α <sub>v,seis</sub>	-	0.75					1.0	
Shear Resistance of Steel - Stainless Steel ASTM A193, Grade B8 & B8M (Types 304 & 316)	V <sub>sa</sub>	lb.	2665	4855	7730	11425	15800	20725	33140
Shear Resistance of Steel - Stainless Steel ASTM A593 CW (Types 304 & 316)			4680	8520	13560	17035	23560	30905	49420
Shear Resistance of Steel - Stainless Steel ASTM A193, Grade B6 (Type 410)			5150	9370	14915	22040	30490	40000	63955
Reduction for Seismic Shear - Stainless Steel	α <sub>v,seis</sub>	-	0.80		0.75			1.0	
Strength Reduction Factor for Shear - Steel Failure <sup>1</sup>	φ	-	0.65						

For SI: 1 inch = 25.4 mm, 1 ft-lb = 1.356 Nm.

<sup>1</sup>The tabulated value of φ applies when the load combinations of Section 1605.2 of the IBC, ACI 318-14 5.3, or ACI 318-11 9.2 are used. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of φ must be determined in accordance with ACI 318-11 D.4.4.

TABLE 4—STEEL DESIGN INFORMATION FOR REINFORCING BAR (REBAR)

Characteristic	Symbol	Units	Bar Size						
			#3	#4	#5	#6	#7	#8	#10
Nominal Diameter	d	in.	0.375	0.5	0.625	0.75	0.875	1	1.25
Minimum Tensile Stress Area	A <sub>se</sub>	in. <sup>2</sup>	0.11	0.20	0.31	0.44	0.6	0.79	1.27
Tension Resistance of Steel - Rebar (ASTM A615 Gr.60)	N <sub>sa</sub>	lb.	9900	18000	27900	39600	54000	71100	114300
Tension Resistance of Steel - Rebar (ASTM A706 Gr.60)			8800	16000	24800	35200	48000	63200	101600
Strength Reduction Factor for Tension - Steel Failure <sup>1</sup>	φ	-	0.75						
Minimum Shear Stress Area	A <sub>se</sub>	in. <sup>2</sup>	0.11	0.20	0.31	0.44	0.60	0.79	1.27
Shear Resistance of Steel - Rebar (ASTM A615 Gr. 60)	V <sub>sa</sub>	lb.	5940	10800	16740	23760	32400	42660	68580
Shear Resistance of Steel - Rebar (ASTM A706 Gr. 60)			5280	9600	14880	21120	28800	37920	60960
Reduction for Seismic Shear	α <sub>v,seis</sub>	-	0.60					0.80	
Strength Reduction Factor for Shear - Steel Failure <sup>1</sup>	φ	-	0.65						

For SI: = 1 inch = 25.4 mm, 1 ft-lb = 1.356 Nm.

<sup>1</sup>The tabulated value of φ applies when the load combinations of Section 1605.2 of the IBC, ACI 318-14 5.3, or ACI 318-11 9.2 are used. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of φ must be determined in accordance with ACI 318-11 D.4.4.



TABLE 5—SET-3G EPOXY ANCHOR BOND STRENGTH DESIGN INFORMATION FOR THREADED ROD ANCHORS<sup>1,2,3</sup>

DESIGN INFORMATION			Symbol	Units	Nominal Rod Diameter								
					<sup>3</sup> / <sub>8</sub> "	<sup>1</sup> / <sub>2</sub> "	<sup>5</sup> / <sub>8</sub> "	<sup>3</sup> / <sub>4</sub> "	<sup>7</sup> / <sub>8</sub> "	1"	<sup>1</sup> / <sub>4</sub> "		
Minimum Embedment			$h_{ef,min}$	In.	2 <sup>3</sup> / <sub>8</sub>	2 <sup>3</sup> / <sub>4</sub>	3 <sup>1</sup> / <sub>8</sub>	3 <sup>1</sup> / <sub>2</sub>	3 <sup>3</sup> / <sub>4</sub>	4	5		
Maximum Embedment			$h_{ef,max}$	In.	7 <sup>1</sup> / <sub>2</sub>	10	12 <sup>1</sup> / <sub>2</sub>	15	17 <sup>1</sup> / <sub>2</sub>	20	25		
Continuous Inspection	Temperature Range A <sup>4,6</sup>	Characteristic Bond Strength in cracked concrete	$\tau_{k,cr}$	psi	1448	1402	1356	1310	1265	1219	1128		
		Characteristic Bond Strength in uncracked concrete	$\tau_{k,uncr}$		2357	2260	2162	2064	1967	1868	1672		
	Temperature Range B <sup>5,6</sup>	Characteristic Bond Strength in cracked concrete	$\tau_{k,cr}$		1201	1163	1125	1087	1050	1012	936		
		Characteristic Bond Strength in uncracked concrete	$\tau_{k,uncr}$		1957	1876	1795	1713	1632	1551	1388		
	Anchor Category		Dry Concrete		-	-	1						
	Strength Reduction Factor <sup>7</sup>		Dry Concrete		$\phi_{dry,ci}$	-	0.65						
	Anchor Category		Water-saturated concrete, or Water-filled hole		-	-	3		2				
	Strength Reduction Factor <sup>7</sup>		Water-saturated concrete, or Water-filled hole		$\phi_{wet,ci}$	-	0.45		0.55				
Periodic Inspection	Temperature Range A <sup>4,6</sup>	Characteristic Bond Strength in cracked concrete	$\tau_{k,cr}$	psi	1346	1304	1356	1310	1265	1219	1128		
		Characteristic Bond Strength in uncracked concrete	$\tau_{k,uncr}$		2192	2102	2162	2064	1967	1868	1672		
	Temperature Range B <sup>5,6</sup>	Characteristic Bond Strength in cracked concrete	$\tau_{k,cr}$		1117	1082	1125	1087	1050	1012	936		
		Characteristic Bond Strength in uncracked concrete	$\tau_{k,uncr}$		1820	1744	1795	1713	1632	1551	1388		
	Anchor Category		Dry Concrete		-	-	2		1				
	Strength Reduction Factor <sup>7</sup>		Dry Concrete		$\phi_{dry,ci}$	-	0.55		0.65				
	Anchor Category		Water-saturated concrete, or Water-filled hole		-	-	3						
	Strength Reduction Factor <sup>7</sup>		Water-saturated concrete, or Water-filled hole		$\phi_{wet,ci}$	-	0.45						
Strength Reduction Factor for Seismic Tension <sup>8</sup>			$\alpha_{N,seis}$	-	1.0	0.9	1.0	1.0	1.0	1.0	1.0		

For SI: 1 inch = 25.4 mm, 1 ft-lb = 1.356 Nm.

<sup>1</sup>Bond strength values shown are for normal-weight concrete having a compressive strength of  $f'_c = 2,500$ psi. For higher compressive strengths up to 8,000 psi, the tabulated characteristic bond strength may be by a factor of  $(f'_c/2,500)^{0.35}$  for uncracked concrete and factor of  $(f'_c/2,500)^{0.24}$  for cracked concrete.

<sup>2</sup>For lightweight concrete, the modification factor for bond strength shall be given in ACI 318-14 17.2.6 or ACI 318-11 D.3.6, as applicable, where applicable.

<sup>3</sup>Characteristic bond strength values are for sustained loads, including dead and live loads.

<sup>4</sup>Temperature Range A: Maximum short term temperature = 160°F, Maximum long term temperature = 110°F.

<sup>5</sup>Temperature Range B: Maximum short term temperature = 176°F, Maximum long term temperature = 110°F.

<sup>6</sup>Short term concrete temperatures are those that occur over short intervals (diurnal cycling). Long term temperatures are roughly constant over significant periods of time.

<sup>7</sup>The tabulated values of  $\phi$ , applies when both the load combinations of ACI 318-14 5.3, or ACI 318-11 9.2 are used and the requirements of ACI 318-14 17.3.3(c) or ACI 318-11 D.4.3(c), as applicable, for Condition B are met. If the load combinations of ACI 318-11 Appendix C are used, refer to ACI 318-11 D.4.4(c) for Condition B to determine the appropriate value of  $\phi$ .

<sup>8</sup>For anchors installed in regions assigned to Seismic Design Category C, D, E or F, the bond strength values must be multiplied by  $\alpha_{N,seis}$ .

TABLE 6—SET-3G EPOXY ANCHOR BOND STRENGTH DESIGN INFORMATION FOR REBAR ANCHORS<sup>1,2,3</sup>

DESIGN INFORMATION			Symbol	Units	Nominal Rebar Size							
					#3	#4	#5	#6	#7	#8	#10	
Minimum Embedment			$h_{ef,min}$	In.	2 <sup>3</sup> / <sub>8</sub>	2 <sup>3</sup> / <sub>4</sub>	3 <sup>1</sup> / <sub>8</sub>	3 <sup>1</sup> / <sub>2</sub>	3 <sup>3</sup> / <sub>4</sub>	4	5	
Maximum Embedment			$h_{ef,max}$	In.	7 <sup>1</sup> / <sub>2</sub>	10	12 <sup>1</sup> / <sub>2</sub>	15	17 <sup>1</sup> / <sub>2</sub>	20	25	
Continuous Inspection	Temperature Range A <sup>4,6</sup>	Characteristic Bond Strength in cracked concrete	$\tau_{k,cr}$	psi	1448	1402	1356	1310	1265	1219	1128	
		Characteristic Bond Strength in uncracked concrete	$\tau_{k,uncr}$		2269	2145	2022	1898	1774	1651	1403	
	Temperature Range B <sup>5,6</sup>	Characteristic Bond Strength in cracked concrete	$\tau_{k,cr}$		1201	1163	1125	1087	1050	1012	936	
		Characteristic Bond Strength in uncracked concrete	$\tau_{k,uncr}$		1883	1781	1678	1575	1473	1370	1165	
	Anchor Category	Dry Concrete	-		-	1						
	Strength Reduction Factor <sup>7</sup>	Dry Concrete	$\phi_{dry,ci}$		-	0.65						
	Anchor Category	Water-saturated concrete, or Water-filled hole	-		-	3			2			
	Strength Reduction Factor <sup>7</sup>	Water-saturated concrete, or Water-filled hole	$\phi_{wet,ci}$		-	0.45			0.55			
Periodic Inspection	Temperature Range A <sup>4,6</sup>	Characteristic Bond Strength in cracked concrete	$\tau_{k,cr}$	psi	1346	1304	1356	1310	1265	1219	1128	
		Characteristic Bond Strength in uncracked concrete	$\tau_{k,uncr}$		2110	1995	2022	1898	1774	1651	1403	
	Temperature Range B <sup>5,6</sup>	Characteristic Bond Strength in cracked concrete	$\tau_{k,cr}$		1117	1082	1125	1087	1050	1012	936	
		Characteristic Bond Strength in uncracked concrete	$\tau_{k,uncr}$		1751	1656	1678	1575	1473	1370	1165	
	Anchor Category	Dry Concrete	-		-	2			1			
	Strength Reduction Factor <sup>7</sup>	Dry Concrete	$\phi_{dry,ci}$		-	0.55			0.65			
	Anchor Category	Water-saturated concrete, or Water-filled hole	-		-	3						
	Strength Reduction Factor <sup>7</sup>	Water-saturated concrete, or Water-filled hole	$\phi_{wet,ci}$		-	0.45						
Strength Reduction Factor for Seismic Tension <sup>8</sup>			$\alpha_{N,seis}$	-	1.0							

For SI: 1 inch = 25.4 mm, 1 ft-lb = 1.356 Nm.

<sup>1</sup>Bond strength values shown are for normal-weight concrete having a compressive strength of  $f'_c = 2,500$ psi. For high compressive strengths up to 8,000 psi, the tabulated characteristic bond strength may be by a factor of  $(f'_c/2,500)^{0.36}$  for uncracked concrete and factor of  $(f'_c/2,500)^{0.25}$  for cracked concrete.

<sup>2</sup>For lightweight concrete, the modification factor for bond strength shall be given in ACI 318-14 17.2.6 or ACI 318-11 D.3.6, as applicable, where applicable.

<sup>3</sup>Characteristic bond strength values are for sustained loads, including dead and live loads.

<sup>4</sup>Temperature Range A: Maximum short term temperature = 160°F, Maximum long term temperature = 110°F.

<sup>5</sup>Temperature Range B: Maximum short term temperature = 176°F, Maximum long term temperature = 110°F.

<sup>6</sup>Short term concrete temperatures are those that occur over short intervals (diurnal cycling). Long term temperatures are roughly constant over significant periods of time.

<sup>7</sup>The tabulated values of  $\phi$ , applies when both the load combinations of ACI 318-14 5.3, or ACI 318-11 9.2 are used and the requirements of ACI 318-14 17.3.3(c) or ACI 318-11 D.4.3(c), as applicable, for Condition B are met. If the load combinations of ACI 318-11 Appendix C are used, refer to ACI 318-11 D.4.4(c) for Condition B to determine the appropriate value of  $\phi$ .

<sup>8</sup>For anchors installed in regions assigned to Seismic Design Category C, D, E or F, the bond strength values must be multiplied by  $\alpha_{N,seis}$ .

TABLE 7—INSTALLATION DETAILS FOR THREADED ROD ANCHORS

Anchor Diameter (in)	Drill Bit Diameter <sup>1,2</sup> (in)	Brush Part Number <sup>7</sup>	T-Handle Part Number <sup>3</sup>	Handle Extension Number <sup>4</sup>	Nozzle Part Number	Dispensing Tool Part Number	Adhesive Retaining Cap Part Number <sup>5</sup>	Adhesive Tubing Part Number <sup>5</sup>	Adhesive Piston Plug Part Number <sup>5</sup>
3/8	7/16	ETB43S	ETBS-TH	ETBS-EXT	EMN22i	CDT10S, EDT22S, EDTA22P, EDTA22CKT, EDTA56P	ARC37A-RP25	PPFT25	Not Available <sup>6</sup>
1/2	9/16	ETB56S					ARC50A-RP25		PP56-RP10
5/8	11/16	ETB68S					ARC62A-RP25		PP68-RP10
3/4	7/8	ETB87S					ARC75-RP25		PP87-RP10
7/8	1	ETB100S					ARC87-RP25		PP100-RP10
1	1 1/8	ETB112S					ARC100-RP25		PP112-RP10
1 1/4	1 3/8	ETB137S					ARC125-RP25		PP137-RP10

For SI: 1 inch = 25.4 mm.

<sup>1</sup>Rotary Hammer must be used to drill all holes.

<sup>2</sup>Drill bits must meet the requirements of [ANSI B212.15](#).

<sup>3</sup>Wire brush must be assembled to T-Handle for proper usage.

<sup>4</sup>Extension is used with T-Handle for holes exceeding 12" deep.

<sup>5</sup>Adhesive Retaining Caps, Adhesive Piston Plugs and Adhesive Tubing are to be used for all horizontal and overhead installations.

<sup>6</sup>For 3/8" horizontal and overhead installations, inject adhesive directly to the back of the hole using the Adhesive Tubing only.

<sup>7</sup>Hole cleaning brushes are not needed when using the vacuum dust extraction system and the Bosch®/Simpson Strong-Tie DXS hollow carbide drill bits described in Section 3.2.3.2 to drill and clean holes.

TABLE 8—INSTALLATION DETAILS FOR THREADED ROD ANCHORS

Anchor Diameter (in)	Drill Bit Diameter <sup>1,2</sup> (in)	Brush Part Number <sup>7</sup>	T-Handle Part Number <sup>3</sup>	Extension Number <sup>4</sup>	Nozzle Part Number	Dispensing Tool Part Number	Adhesive Retaining Cap Part Number <sup>5</sup>	Adhesive Tubing Part Number <sup>5</sup>	Adhesive Piston Plug Part Number <sup>5</sup>
#3	1/2	ETB50S	ETBS-TH	ETBS-EXT	EMN22i	CDT10S, EDT22S, EDTA22P, EDTA22CKT, EDTA56P	ARC37-RP25	PPFT25	Not Available <sup>6</sup>
#4	5/8	ETB62S					ARC50-RP25		PP56-RP10
#5	3/4	ETB75S					ARC62-RP25		PP68-RP10
#6	7/8	ETB87S					ARC75-RP25		PP87-RP10
#7	1	ETB100S					ARC87-RP25		PP100-RP10
#8	1 1/8	ETB112S					ARC100-RP25		PP112-RP10
#10	1 3/8	ETB137S					ARC125-RP25		PP137-RP10

For SI: 1 inch = 25.4 mm.

<sup>1</sup>Rotary Hammer must be used to drill all holes.

<sup>2</sup>Drill bits must meet the requirements of [ANSI B212.15](#).

<sup>3</sup>Wire brush must be assembled to T-Handle for proper usage.

<sup>4</sup>Extension is used with T-Handle for holes exceeding 12" deep.

<sup>5</sup>Adhesive Retaining Caps, Adhesive Piston Plugs and Adhesive Tubing are to be used for all horizontal and overhead installations.

<sup>6</sup>For #3" horizontal and overhead installations, inject adhesive directly to the back of the hole using the Adhesive Tubing only.

<sup>7</sup>Hole cleaning brushes are not needed when using the vacuum dust extraction system and the Bosch®/Simpson Strong-Tie DXS hollow carbide drill bits described in Section 3.2.3.2 to drill and clean holes.

TABLE 9—CURE SCHEDULE<sup>1,2</sup>


Concrete Temperature		Gel Time (minutes)	Cure Time <sup>1</sup> (hours)
(°F)	(°C)		
40	5	120	192
50	10	75	72
60	16	50	48
70	21	35	24
90	32	25	24
100	38	15	24

For SI: 1°F = (c x 9/5) + 32.


<sup>1</sup>For water-saturated concrete, the cure times must be doubled.

<sup>2</sup>For installation of anchors in concrete where the temperature is below 70°F (21°C), the adhesive must be conditioned to a minimum temperature of 70°F (21°C).


**1A Hole Preparation Standard Equipment —**  
Horizontal, Vertical and Overhead Applications




**1. Drill.**  
Drill hole to specified diameter and depth.



**2. Blow.**  
Remove dust from hole with oil-free compressed air for a minimum of two (2) seconds. Compressed air nozzle must reach the bottom of the hole.




**3. Brush.**  
Clean with a steel wire brush for a minimum of two (2) cycles. Brush MUST reach the bottom of the hole. Brush should provide resistance to insertion. If no resistance is felt, the brush is worn and must be replaced.



**4. Blow.**  
Remove dust from hole with oil-free compressed air for a minimum of two (2) seconds. Compressed air nozzle must reach the bottom of the hole.

**Note:** Refer to tables A and B for proper drill bit size and brush part number.

**1B Hole Preparation Vacuum Dust Extraction System with Bosch® / Simpson Strong-Tie® DXS Hollow Carbide Drill Bit —** Horizontal, Vertical and Overhead Applications



**1. Drill.**  
Drill hole to specified diameter and depth using a Bosch / Simpson Strong-Tie DXS hollow carbide drill bit and vacuum dust extraction system described in Section 3.2.3.2.




**Bosch / Simpson Strong-Tie DXS drill bit used with the vacuum dust extraction system described in Section 3.2.3.2**

**Note:** Refer to tables A and B for proper drill bit size.

**2 Cartridge Preparation**

**1. Check.**  
Check expiration date on product label. **Do not use expired product.** Product is usable until end of printed expiration month.


**2. Open.**  
Open cartridge per package instructions.



**3. Attach.**  
Attach proper Simpson Strong-Tie nozzle and extension to cartridge. Do not modify nozzle.



**4. Insert.**  
Insert cartridge into dispensing tool.



**5. Dispense.**  
Dispense adhesive to the side until properly mixed (uniform color).


**Note:** Review MSDS prior to use. Refer to tables A and B for proper nozzle and dispensing tool part numbers. Refer to tables C and E for proper adhesive storage temperatures, permitted concrete temperature range, and adhesive gel times.

**FIGURE 1 — INSTALLATION DETAILS**


**3A Filling the Hole — Vertical Anchorage**

Prepare the hole per "Hole Preparation."


**DRY AND DAMP HOLES:**



**1. Fill.**  
Fill hole 1/2 to 3/4 full, starting from bottom of hole to prevent air pockets. Withdraw nozzle as hole fills up.




**2. Insert.**  
Insert clean, oil-free anchor, (marked with the required embedment depth), turning slowly until the anchor contacts the bottom of the hole.  
*Threaded rod or rebar*




**3. Do not disturb.**  
Do not disturb load or torque anchor until fully cured.


**WATER-FILLED HOLES:**



**1. Fill.**  
Fill holes completely full, starting from bottom of hole to prevent water pockets. Withdraw nozzle as hole fills up.



**2. Insert.**  
Insert clean, oil-free anchor, (marked with the required embedment depth), turning slowly until the anchor contacts the bottom of the hole.  
*Threaded rod or rebar*



**3. Do not disturb.**  
Do not disturb load or torque anchor until fully cured.

**Note:** Refer to Table C for proper gel times and cure times and to Table D for maximum tightening torque. Nozzle extensions (PPFT25) may be needed for deep holes.



**3B Filling the Hole — Horizontal and Overhead Anchorage with Piston Plug System.**

Prepare the hole per "Hole Preparation."




**Step 1:**

- Attach the piston plug to one end of the flexible tubing (PPFT25). (Refer to tables A, B and C.)
- Cut tubing to the length needed for the application, mark tubing as noted below, and attach other end of tubing to the mixing nozzle.
- If using a pneumatic dispensing tool, regulate air pressure to 80–100 psi.

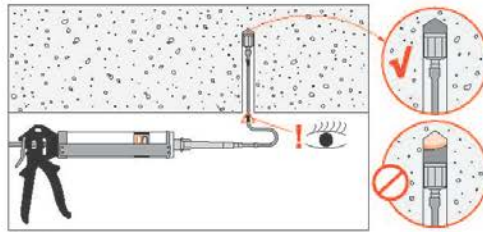


**Step 2:**

- Insert the piston plug to the back of the drilled hole and dispense adhesive.

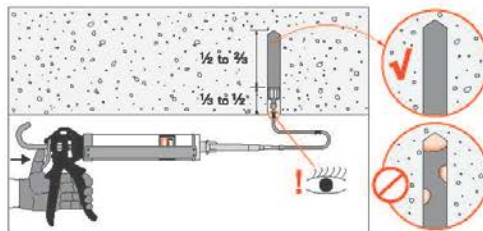

**Step 3:**

- Fill the hole 1/2 to 3/4 full.
- **Note:** As adhesive is dispensed into the drilled hole, the piston plug will slowly displace out of the hole due to back pressure, preventing air gaps.



**Step 4:**

- Install the appropriate Simpson Strong-Tie® adhesive retaining cap. (Refer to tables A, B and C.)



**Step 5:**

- Place either threaded rod or rebar through the adhesive retaining cap and into adhesive-filled hole.
- Turn rod/rebar (marked with the required embedment depth) slowly until the insert bottoms out.
- Do not disturb load or torque anchor until fully cured. For overhead installations, the anchor must be secured from movement during the cure time. (e.g., wedges or other restraint methods).

**Note:** Refer to Table C for proper gel times and cure times, and to Table D for maximum tightening torque.

**FIGURE 1 — INSTALLATION DETAILS (CONTINUED)**

**Table A — Installation Details for Threaded Rod Anchors**

Anchor Diameter (in.)	Drill Bit Diameter <sup>1,2</sup> (in.)	Wire Brush Part Number <sup>7</sup>	T-Handle Part Number <sup>3</sup>	Handle Extension Part Number <sup>4</sup>	Nozzle Part Number	Dispensing Tool Part Number	Adhesive Retaining Cap Part Number <sup>5</sup>	Adhesive Tubing Part Number <sup>5</sup>	Adhesive Piston Plug Part Number <sup>5</sup>
3/8	7/16	ETB43S	ETBS-TH	ETBS-EXT	EMN22i	CDT10S, EDT22S, EDTA22P, EDTA22CKT, EDTA56P	ARC37A-RP25	PPFT25	Not Available <sup>6</sup>
1/2	9/16	ETB56S					ARC50A-RP25		PP56-RP10
5/8	11/16	ETB68S					ARC62A-RP25		PP68-RP10
3/4	7/8	ETB87S					ARC75-RP25		PP87-RP10
7/8	1	ETB100S					ARC87-RP25		PP100-RP10
1	1 1/8	ETB112S					ARC100-RP25		PP112-RP10
1 1/4	1 3/8	ETB137S					ARC125-RP25		PP137-RP10

1. A rotary hammer must be used to drill all holes.
2. Drill bits must meet the requirements of ANSI B212.15.
3. Wire brush must be assembled with T-handle for proper usage.
4. Extension is used with T-handle for holes exceeding 12" deep.
5. Adhesive retaining caps, adhesive piston plugs, and tubing are to be used for horizontal and overhead anchor installations.
6. For 3/4" horizontal and overhead installations, inject adhesive directly to the back of the hole using the adhesive tubing only.
7. Hole-cleaning brushes are not needed when using the vacuum dust extraction system and Bosch / Simpson Strong-Tie® DXS hollow carbide drill bits described in Section 3.2.3.2 to drill and clean holes.

**Table B — Installation Details for Reinforcing Bar Anchors**

Anchor Diameter	Drill Bit Diameter <sup>1,2</sup> (in.)	Wire Brush Part Number <sup>7</sup>	T-Handle Part Number <sup>3</sup>	Handle Extension Part Number <sup>4</sup>	Nozzle Part Number	Dispensing Tool Part Number	Adhesive Retaining Cap Part Number <sup>5</sup>	Adhesive Tubing Part Number <sup>5</sup>	Adhesive Piston Plug Part Number <sup>5</sup>
#3	1/2	ETB50S	ETBS-TH	ETBS-EXT	EMN22i	CDT10S, EDT22S, EDTA22P, EDTA22CKT, EDTA56P	ARC37-RP25	PPFT25	Not Available <sup>6</sup>
#4	5/8	ETB62S					ARC50-RP25		PP62-RP10
#5	3/4	ETB75S					ARC62-RP25		PP75-RP10
#6	7/8	ETB87S					ARC75-RP25		PP87-RP10
#7	1	ETB100S					ARC87-RP25		PP100-RP10
#8	1 1/8	ETB112S					ARC100-RP25		PP112-RP10
#10	1 3/8	ETB137S					ARC125-RP25		PP137-RP10

1. A rotary hammer must be used to drill all holes.
2. Drill bits must meet the requirements of ANSI B212.15.
3. Wire brush must be assembled with T-handle for proper usage.
4. Extension is used with T-handle for holes exceeding 12" deep.
5. Adhesive retaining caps, adhesive piston plugs, and tubing are to be used for horizontal and overhead anchor installations.
6. For #3 horizontal and overhead installations, inject adhesive directly to the back of the hole using the adhesive tubing only.
7. Hole-cleaning brushes are not needed when using the vacuum dust extraction system and Bosch / Simpson Strong-Tie® DXS hollow carbide drill bits described in Section 3.2.3.2 to drill and clean holes.

**Table C — Cure Schedule<sup>2</sup>**

Concrete Temperature		Gel Time (min.)	Cure Time <sup>1</sup> (hr.)
(F°)	(C°)		
40	5	120	192
50	10	75	72
60	16	50	48
70	21	35	24
90	32	25	24
100	38	15	24

1. For water-saturated concrete and water-filled holes, the cure times should be doubled.
2. For installation of anchors in concrete where the temperature is below 70°F (21°C), the adhesive must be conditioned to a minimum temperature of 70°F (21°C).

**FIGURE 1 — INSTALLATION DETAILS (CONTINUED)**

**Table D — Anchor Tightening Torque, Embedment Depth and Placement Details for Threaded Rod and Reinforcing Bar Anchors**

Anchor Diameter (in.)	Maximum Tightening Torque $T_{inst}$ (ft.-lb.)	Min. Emb. Depth $h_{ef,min}$ (in.)	Max. Emb. Depth $h_{ef,max}$ (in.)	Min. Anchor Spacing $s_{min}$ (in.)	Min. Edge Distance $c_{min}$ (in.)	Min. Concrete Thickness $h_{min}$ (in.)
3/8	15	2 3/8	7 1/2	3	1 3/4	$h_{ef} + 1 1/4$
1/2	30	2 3/4	10			
5/8	60	3 1/8	12 1/2			
3/4	100	3 1/2	15			
7/8	125	3 3/4	17 1/2			
1	150	4	20	6	2 3/4	$h_{ef} + 2d_o$
1 1/4	200	5	25			

**Table E — Storage Information**

Storage Temperature		Shelf Life (months)
(F°)	(C°)	
45 to 90	7 to 32	24

**FIGURE 1 — INSTALLATION DETAILS (CONTINUED)**

## ICC-ES Evaluation Report

## ESR-4057 LABC and LARC Supplement

Issued April 2018

This report is subject to renewal April 2019.

[www.icc-es.org](http://www.icc-es.org) | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

**DIVISION: 03 00 00—CONCRETE**  
**Section: 03 16 00—Concrete Anchors**  
**DIVISION: 05 00 00—METALS**  
**Section: 05 05 19—Post-Installed Concrete Anchors**

### REPORT HOLDER:

**SIMPSON STRONG-TIE COMPANY INC.**  
5956 WEST LAS POSITAS BOULEVARD  
PLEASANTON, CALIFORNIA 94588  
(800) 999-5099  
[www.strongtie.com](http://www.strongtie.com)

### EVALUATION SUBJECT:

**SIMPSON STRONG-TIE® SET-3G EPOXY ADHESIVE ANCHORS IN CRACKED AND UNCRACKED CONCRETE**

### 1.0 REPORT PURPOSE AND SCOPE

#### Purpose:

The purpose of this evaluation report supplement is to indicate that Simpson Strong-Tie SET-3G Epoxy Adhesive Anchors in cracked and uncracked concrete, described in ICC-ES master evaluation report [ESR-4057](#), have also been evaluated for compliance with the codes noted below as adopted by the Los Angeles Department of Building and Safety (LADBS).

#### Applicable code editions:

- 2017 *City of Los Angeles Building Code* (LABC)
- 2017 *City of Los Angeles Residential Code* (LARC)

### 2.0 CONCLUSIONS

The Simpson Strong-Tie SET-3G Epoxy Adhesive Anchors in cracked and uncracked concrete, described in Sections 2.0 through 7.0 of the master evaluation report [ESR-4057](#), comply with the LABC Chapter 19, and the LARC, and are subject to the conditions of use described in this supplement.

### 3.0 CONDITIONS OF USE

The Simpson Strong-Tie SET-3G Epoxy Adhesive Anchors in cracked and uncracked concrete described in this evaluation report must comply with all of the following conditions:

- All applicable sections in the master evaluation report [ESR-4057](#).
- The design, installation, conditions of use and labeling of the anchors are in accordance with the 2015 *International Building Code*® (2015 IBC) provisions noted in the master evaluation report [ESR-4057](#).
- The design, installation and inspection are in accordance with additional requirements of LABC Chapters 16 and 17, as applicable.
- Under the LARC, an engineered design in accordance with LARC Section R301.1.3 must be submitted.
- The allowable and strength design values listed in the master evaluation report and tables are for the connection of the anchors or reinforcing bars to the concrete. The connection between the anchors or the reinforcing bars and the connected members shall be checked for capacity (which may govern).

This supplement expires concurrently with the master report, issued April 2018.