

Manufacturer: US Aluminum
Division of C.R. Laurence Co., Inc.
2503 E. Vernon Ave.
Los Angeles, CA 90058


Product Line: Storm Wall XL Hurricane Resistant Curtain Wall – Wet Glazed – SMI - HVHZ

Compliance:

The above mentioned product has been evaluated for compliance with the requirements of the Florida Department of Business and Professional Regulation for Statewide Acceptance per Rule 61G20-3.005 method 1(d). The product listed herein complies with requirements of the current Florida Building Code.

Supporting Technical Documentation:

1. Approval document: drawing number 08-03021, prepared, signed and sealed by Luis Roberto Lomas P.E.
2. Test report No.: A8744.04-801-18 signed and sealed by Tyler Westerling P.E.
Architectural Testing Inc, Southlake, TX
Single Span Wall; AAMA 501-05 and ASTM E1886-05 and ASTM E1996-05
Design pressure: +70.0/80.0psf (60"x101" panels)
Design pressure: ±100.0psf (60"x101" panels)
Design pressure: ±65.0psf (45 ½"x105 ½" panels)
Design pressure: ±70.0psf (48"x101" panels)
Water penetration resistance 20.0psf
Large Missile Impact, Level D, Wind Zone 4
3. Test report No.: CCLI-11-226 signed by Jeffrey Crump.
Construction Consulting Laboratory International, Carrollton, TX
Twin Span Wall; AAMA 501-05 and ASTM E1886-05 and ASTM E1996-09
Design pressure: ±100.0psf
Water penetration resistance 20.0psf
Large Missile Impact, Level D, Wind Zone 4
4. Test report No.: A8744.01-801-18 signed and sealed by Shawn G. Collins P.E.
Architectural Testing Inc, Southlake, TX
Single Span Wall; TAS 201-94, TAS 202 -94 and TAS 203-94
Design pressure: +70.0/80.0psf (60"x101" panels)
Design pressure: ±100.0psf (60"x101" panels)
Design pressure: ±65.0psf (45 ½"x105 ½" panels)
Design pressure: ±70.0psf (48"x101" panels)
Water penetration resistance 20.0psf
Large Missile Impact, Level D, Wind Zone 4
5. Test report No.: A8744.03-801-18 signed and sealed by Shawn G. Collins P.E.
Architectural Testing Inc, Southlake, TX
Single Span Wall; TAS 201-94, TAS 202 -94 and TAS 203-94
Design pressure: ±100.0psf (60"x101" panels)
Water penetration resistance 20.0psf
Large Missile Impact, Level D, Wind Zone 4
6. Test report No.: CCLI-11-201 signed and sealed by Abdol Rezadad P.E.
Construction Consulting Laboratory International, Carrollton, TX
Twin Span Wall; TAS 201-94, TAS 202 -94 and TAS 203-94
Design pressure: ±100.0psf
Water penetration resistance 20.0psf
Large Missile Impact, Level D, Wind Zone 4
7. Comparative analysis, report number 513888-1, prepared, signed and sealed by Luis Roberto Lomas P.E.
8. Anchor calculations, report number 513888-2, prepared, signed and sealed by Luis Roberto Lomas P.E.

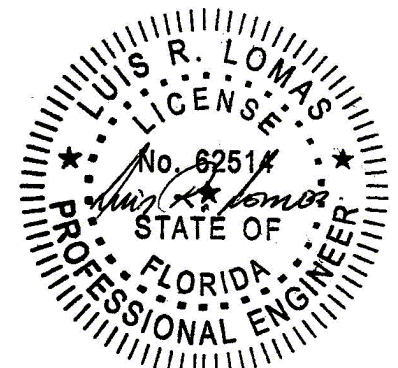

L. Roberto Lomas P.E.

1432 Woodford Rd.

Lewisville, NC 27023

434-688-0609

rlomas@lrlomaspe.com

Engineering Evaluation Report

Report No.: 513888

Limitations and Conditions of use:

- Maximum design pressure: Refer to approval drawing
- Units must be glazed per ASTM E 1300-04/09, see installation instructions for glass details.
- This product is rated to be used in the HVHZ.
- This product is impact resistant and does not require impact protection in wind borne debris regions when installed at 30 ft or higher above ground level.
- Frame material to be extruded aluminum 6063-T6

Installation:

Units must be installed in accordance with manufacturer's installation instructions and approval document 08-03021

Certification of Independence:

Please note that I don't have nor will acquire a financial interest in any company manufacturing or distributing the product(s) for which this report is being issued. Also, I don't have nor will acquire a financial interest in any other entity involved in the approval process of the listed product(s).

