



Steel Rib Panel on Steel Framing



Imperial Rib

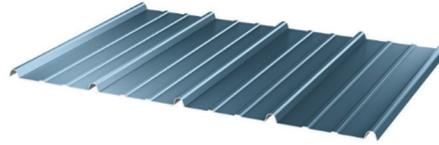

Stormproof



Residential



Master Rib

Product Description

Rib panel with nominal 0.75" rib height, and panel coverage of 36"

Product Material

29ga or 26ga steel

Comply with FBC 1405.2 where required.

Fastener

#12 fastener with sealing washer

Substrate/Deck

16ga or 18ga steel

50ksi (min)

Evaluated by:


David Eng, PE

Timberlake Cove, LLC

1317 Edgewater Dr, Ste 2339 | Orlando FL

FL PE 81377 | FL CA 33344

www.TimberLakeCove.com

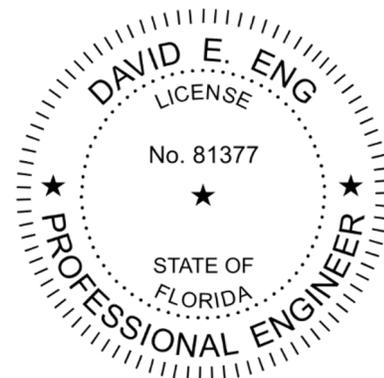

This item has been digitally signed and sealed by D.E. Eng, PE, on the date indicated. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

Maximum Allowable Loads & Installation Requirements:

This product approval covers 2 installation configurations. A factor of safety of 2 has been applied to all allowable uplift pressures shown.

29ga (min) on 18ga (min) steel framing

¼"x7/8" lap fastener at 24" o.c.

Interior supports: #12x1" fasteners in 9"-9" pattern (1 per rib)

Panel ends: #12x1" fasteners in 3.5"-5.5"-3.5" pattern (2 per rib);

See table on page 3.

48" fastener spacing, 3 span condition: +45.35 / -37.7 PSF


26ga (min) on 16ga (min) steel framing

Optional ¼"x7/8" lap fastener at 24" o.c.


Fastener Pattern: #12x2" fasteners in 9"-9" pattern (1 per rib)

See table on page 3


29GA (MIN) ON 18GA (MIN) STEEL FRAMING
INTERIOR SUPPORTS

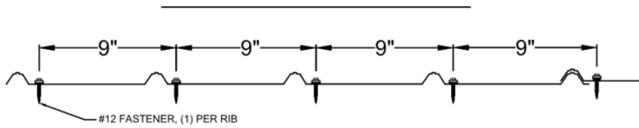

26GA (MIN) ON 16GA (MIN) STEEL FRAMING

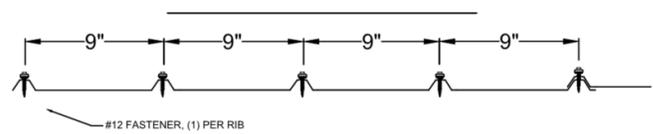

29GA (MIN) ON 18GA (MIN) STEEL FRAMING
PANEL ENDS



Technical Documentation:

This product has been tested by ENCON Technology (TST6485) to the ASTM E1592 standard, report C1514-1 (1 and 3), as referenced in FL 9557.3-R5.

This product has been tested by ENCON Technology (TST6485) to the ASTM E1592 standard, report C2461-1, as referenced in FL 38458.2-R0.

ASTM E1592-01 is materially similar to ASTM E1592-05 (2012).

ASTM E1592-05 (2017) is materially similar to ASTM E1592-05 (2012).

Compliance Statement:

This product as described has demonstrated compliance with Florida Building Code 2023, Section 1403.3 (wind loading only, **non-HVHZ**), as required by FL Rule 61G20-3, method 1D.

This product as described has been tested and demonstrated compliance with:

- ASTM E1592 – Test Method for Structural Performance of Sheet Metal Roof and Siding Systems by Uniform Static Air Pressure Difference

Design Process:

Compare the maximum allowable loads on page 2 or page 3 to the ASD uplift pressures for the project to determine sufficiency and installation requirements.

Engineering analysis may be completed by other licensed engineers for project specific approval by local authorities having jurisdiction.

29ga (min) on 18ga (min) purlins

Span Condition	Loading Type	Allowable Load (psf)								
		Support Spacing (ft)								
		1.50	1.75	2.00	2.25	2.50	2.75	3.00	3.50	4.00
Two Span	Positive	106.4	91.2	79.8	70.9	63.9	58.0	53.2	45.6	36.3
	Negative	88.5	75.8	66.4	59.0	53.1	48.3	44.2	37.9	30.2
Three Span	Positive	120.9	103.7	90.7	80.6	72.6	66.0	60.5	51.8	45.4
	Negative	100.5	86.2	75.4	67.0	60.3	54.8	50.3	43.1	37.7
Four or More Spans	Positive	116.4	99.8	87.3	77.6	69.8	63.5	58.2	49.9	42.4
	Negative	96.8	82.9	72.6	64.5	58.1	52.8	48.4	41.5	35.2

26ga (min) on 16ga (min) purlins

Span Condition	Loading Type	Allowable Load (psf)											
		Support Spacing (ft)											
		2.0	2.5	3.0	3.5	4.0	4.5	5.0	5.5	6.0	6.5	7.0	7.75
Two Span	Positive	101.9	81.5	67.9	53.6	41.0	32.4	26.3	21.7	18.2	15.5	13.4	10.9
	Negative	101.9	81.5	67.9	56.4	43.2	34.1	27.6	22.8	19.2	16.3	14.1	11.5
Three Span	Positive	112.5	91.9	63.8	46.9	35.9	28.4	23.0	19.0	16.0	13.6	11.7	9.6
	Negative	112.5	92.6	67.2	49.3	37.8	29.8	24.2	20.0	16.8	14.3	12.3	10.1
Four or More Spans	Positive	111.4	89.1	66.3	48.7	37.3	29.5	23.9	19.7	16.6	14.1	12.2	9.9
	Negative	111.4	89.1	69.8	51.3	39.2	31.0	25.1	20.8	17.4	14.9	12.8	10.5

Locations and Trade Names

This product is manufactured by Cornerstone Building Brands by one or more of the following brands, and is distributed under one or more the trade names shown below. Each brand maintains a variety of manufacturing facilities and trade names, to include the ones noted here. Contact the manufacturers listed for the most up-to-date list of locations serving the Florida market.



Corporate Headquarters
5020 Weston Parkway | Cary, NC 27513



Imperial Rib

1601 Rogers Road | Adel, GA 31620



Residential

4020 SW 449 St | Horseshoe Beach, Florida 32648
6461 Topaz Court | Fort Myers, Florida 33966



Stormproof

1601 Rogers Rd | Adel, GA 31620



Master Rib

490 Oak Rd. | Ocala, FL 34472
3365 US Hwy. 41 South | Tifton, GA 31794

Certification of Independence:

David Eng, PE and Timberlake Cove, LLC do not have, nor will acquire a financial interest in any company manufacturing or distributing products under this evaluation. The same entities do not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

Exclusions and Limitations:

Design of deck and roof structure (to include attachment of plywood or wood plank) shall be completed by others. Fire classification and shear diaphragm design are outside the scope of this evaluation. Accelerated weathering/salt spray is outside the scope of this evaluation. This report is limited to compliance with structural wind load requirements of FBC 1504.3.2, as required by Rule 61G20-3. Neither Timberlake Cove nor the manufacturer shall be responsible for any conclusions, interpretations, or designs made by others based on this evaluation report. This report is limited solely to documenting compliance with Rule 61G20-3, and makes no express or implied warranty regarding performance of this product. Installation shall be subject to the local building code and authority having jurisdiction; this report shall not be construed to supersede local codes in force.