


# SL150; 1-1/2" SNAP LOCK 24 GA., 16" WIDE LOAD TABLE OVER 19/32" SEALED PLYWOOD




Buildings having a Roof Mean Height  $\leq$  20'-0"; Roof Slope: 3"/12" -6"/12" Gable Roof  
Wind Speeds 110-140 mph, Exp C, I = 1.0, based on FLORIDA BUILDING CODE 2007

1-1/2" 24 GA. SNAP LOCK, 16" WIDE CLIP SPACING						
ZONE	FASTENER	SUBSTRATE	WIND SPEED ZONE			
			110	120	130	140
			ON CENTER SPACING	ON CENTER SPACING	ON CENTER SPACING	ON CENTER SPACING
ZONE 1	(2) #10-12 x 1"	19/32" CDX SEALED	36"	36"	36"	36"
ZONE 2	(2) #10-12 x 1"	19/32" CDX SEALED	36"	36"	36"	36"
ZONE 3	(2) #10-12 x 1"	19/32" CDX SEALED	36"	36"	36"	36"

**PANEL DESCRIPTION:** 1-1/2" SNAP LOCK, MIN. 24 GA. MSG COATED STEEL, 16" MAX WIDTH, 1-1/2" TALL RIB.  
**PANEL ROLLFORMER:** SCHLEBACH QUADRO-PLUS ROLLFORMER BY METALFORMING, INC.  
**PANEL FASTENER:** (2) #10-12 x 1", #2 PHILLIPS DRIVE, PANCAKE HEAD PER CLIP.  
**PANEL CLIP:** "1500SNS", ONE PIECE ASSEMBLY, 3.75" LONG @ 36" O.C. MAX.  
**MAXIMUM ALLOWABLE PANEL UPLIFT PRESSURE:** 112.5 PSF, PRESSURE BASED ON UL 580/UL 1897 TESTING, UL CONST. # 589  
**PLYWOOD DECKING:** MIN. 19/32" THICK, APA RATED PLYWOOD, GRADE C-D, **ALL JOINTS TO BE SEALED WITH ONE PART URETHANE SEALANT FEATHERED OUT FROM THE JOINT.** PLYWOOD MUST BE DESIGNED IN ACCORDANCE WITH FBC 2007.

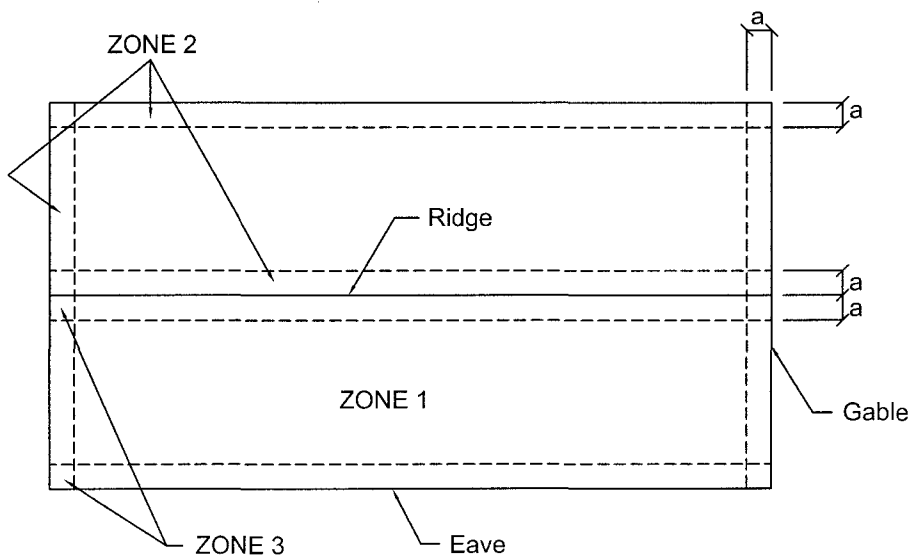

Note: Dimension (a) is defined as 10% of the minimum width of the building or 40% of the mean height of the roof, whichever is smaller, however, (a) cannot be less than either 4% of the minimum width of the building or 3 feet.

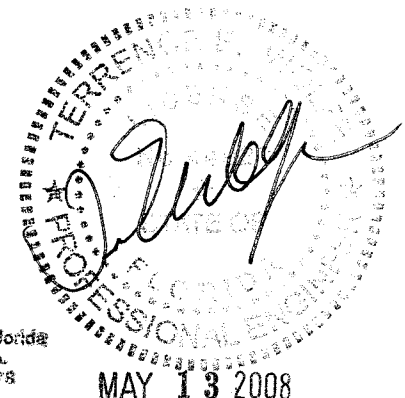

State of Florida  
C.O.A.  
# 26778