
#### FIRE SEALANT BOTH SIDES OF PARTITION WALL. ↓ +-14'-11" +-14'-11" DRYWALL CEILING DRYWALL CEILING 20 GA. CONT. TOP TRACK SECURED W/ HILTI NO DN24P8 SHOT PIN OR EQUAL AT 24" OC AND2" FROM END OF EACH TRACK SECTION SUSPENDED ACOUSTICAL CEILING SEE DETAILS SHEET A-3. 5/8" DRYWALL TO 6" ABOVE DROPPED CEILING. SUSPENDED ACOUSTICAL CEILING SEE DETAILS 10'-0" DROPPED CEILING 5/8" DRYWALL TO 6" ABOVE DROPPED CEILING OR WALLBOARD CEILING. SEE INTERIOR DESIGN PLANS FOR CEILING TYPES AND HEIGHTS. 3-5/8" 20 GA. METAL STUD SOFFIT WITH 5/8" - 3-5/8" (20 GA.) STIFFENERS @ MID SPAN ATTACH TO STUDS W/ 2 #12 TEK SCREWS EA 3/4" PYLWOOD TOP. SURFACE MATERIAL BY NOTE: REFER TO INTERIOR DESIGN PLANS - 3-5/8" (20 GA.) STIFFENERS @ MID SPAN ATTACH TO STUDS W/ 2 #12 TEK SCREWS EA. BY OTHERS FOR SURFACES AND DOUBLE 3-5/8" 20 GA. CONT. MATERIAL FINISHES. METAL WALL CAP FRAME ATTACHED TO END WALL METAL FRAMING W/ 2- #12 TEK SCREWS 3-5/8" 20 GA. METAL STUDS AT 16" O.C. WITH 5/8" DRYWALL ON EACH SIDE OF THE PARTITION. - 3-5/8" 20 GA. METAL STUDS AT 16" O.C. WITH 5/8" TYPE 'X' DRYWALL ON EACH SIDE OF THE - 3-5/8" 20 GA. METAL STUDS AT 16" O.C. WITH 5/8" DRYWALL PARTITION. ATTACHEMENT AND BACKING IN ON EACH SIDE OF THE PARTITION. ACCORDANCE WITH UL ASSEMBLY LISTING. − 3−5/8" (20 GA.) STIFFENERS @ MID SPAN ATTACH TO STUDS W/ 2 #12 TEK SCREWS EA. 3-5/8" BOTTOM TRACK 20 GA. SECURED WITH/ HILTI NO DN24P8 SHOT PIN OR EQUAL AT 16" DRYWALL SCREWS @ 8" O.C. TO DRYWALL SCREWS @ 8" O.C. TO OC AND 2" FROM END OF EACH TRACK VERTICAL EDGES, TOP AND BOTTOM -AND 12" O.C. AT RUNNERS VERTICAL EDGES, TOP AND BOTTOM -AND 12" O.C. AT RUNNERS 3-5/8" BOTTOM TRACK 20 GA. SECURED WITH/ -3-5/8" BOTTOM TRACK (25 GA. OR 20 GA. FOR HILTI NO DN24P8 SHOT PIN OR EQUAL AT 16" OC AND 2" FROM END OF EACH TRACK FIXTURE BACKING WALLS) SECURED WITH / HILTI NO DN24P8 SHOT PIN OR EQUAL AT 16" OC FIRE SEALANT BOTH SIDES OF AND 2" FROM END OF EACH TRACK SECTION PARTITION WALL. -EXISTING CONCRETE SLAB. EXISTING CONCRETE SLAB. -EXISTING CONCRETE SLAB. EXIST. SLAB ON GRADE EXIST. SLAB ON GRADE 1-HOUR RATED WALL

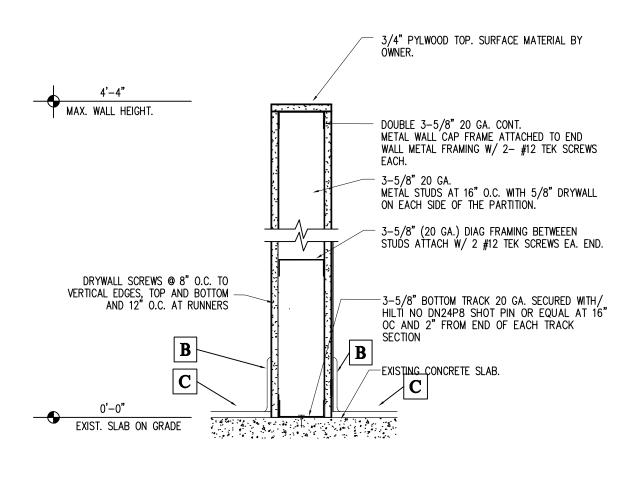

### **WALL SECTION** SCALE:

+-14'-11"

DRYWALL CEILING

EXIST. DRYWALL PARTITION TO DECK

10'-0"

DROPPED CEILING

DINING

COUNTER HEIGHT.


EXIST. SLAB ON GRADE

DRYWALL SCREWS @ 8" O.C. TO VERTICAL EDGES, TOP AND BOTTOM — AND 12" O.C. AT RUNNERS

# SCALE:

ASSEMBLY UL #U419

## **WALL SECTION** SCALE:

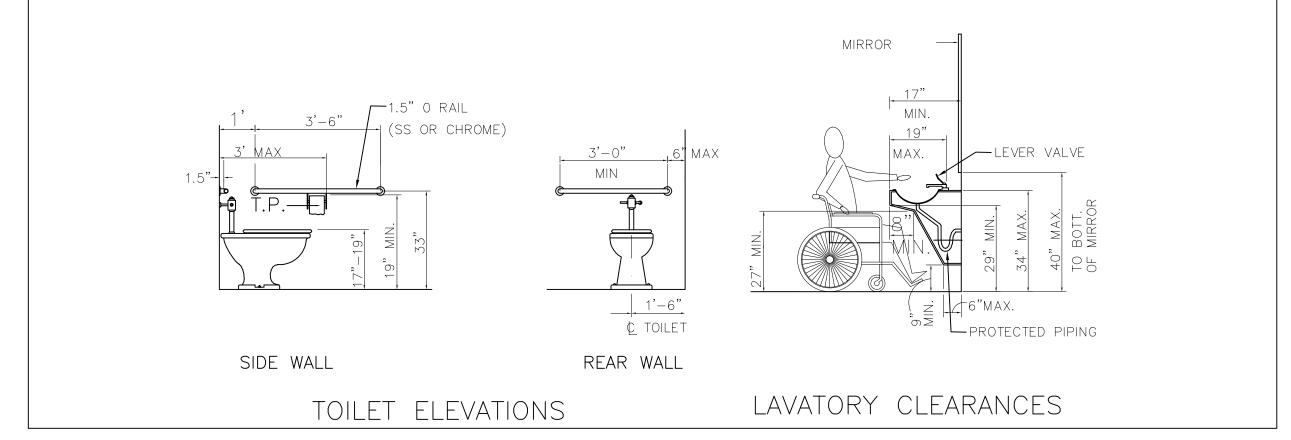


### **ACCESSIBLE FIXTURES DIAGRAMS** 1/2" = 1'-0" SCALE:


## **ACCESSIBILITY NOTES**

- 1. BUILDING ENTRANCE SHALL BE ON AN ACCESSIBLE ROUTE WITH NO CHANGE IN LEVEL OF MORE THAN 1/2" ALONG ROUTE AND MAX LEVEL CHANGE OF 1/2" AT ENTRY DOORS OR THRESHOLDS. 2. ALL DOORS IN ACCESSIBLE ROOMS SHALL PROVIDE A CLEAR OPENING OF 32 INCHES WHEN DOOR IS OPEN 90 DEGREES (A STANDARD 34 INCH DOOR PROVIDES AN ACCEPTABLE NOMINAL
- 3. LIGHT SWITCHES, ELECTRICAL OUTLETS, THERMOSTATS AND OTHER ENVIRONMENTAL CONTROLS ARE TO BE LOCATED WITH OPERABLE PARTS NO HIGHER THAN 48 INCHES AND NO LOWER THAN 15 INCHES ABOVE THE FLOOR. IF REACH IS OVER AN OBSTRUCTION SUCH AS A CABINET HEIGHT SHALL BE 44" FOR FORWARD APPROACH AND 46" FOR PARALLEL APPROACH. (NOTE: OBSTRUCTIONS MAY NOT EXTEND MORE THAN 25" FROM WALL).
- 4. RESTROOMS SHALL BE PROVIDED WITH GRAB BARS AROUND TOILETS, INSTALLED ACCORDING TO THE ILLUSTRATIONS SHOWN. TOILETS SHALL BE INSTALLED SO AS TO ALLOW A GRAB BAR TO BE INSTALLED ON ONE SIDE OF FIXTURE AND MINIMUM CLEARANCE BETWEEN TOILET AND ADJACENT FIXTURES OR WALLS SHALL BE 18". GRAB BARS SHALL BE MOUNTED @ 33" AFF. TOILET HEIGHT SHALL BE 19" TO 20" AS SHOWN, FLOOR MTD AND 30" IN DEPTH. VANITIES AND LAVATORIES SHALL BE A MIN OF 19" WIDE X 17" DEEP AND BE INSTALLED W/ A CLEARANCE OF 5 1\2" DIVIDING LAVATORY AND ADJOINING WALL. FIXTURE RIM SHALL BE A MAXIMUM OF 2'-10" ABOVE FINISHED FLOOR. EXPOSED PIPES SHALL BE INSULATED OR OTHERWISE CONFIGURED TO PROTECT AGAINST CONTACT. FAUCETS SHALL BE LEVER OPERATED, PUSH-TYPE OR ELECTRONIC CONTROLLED.
- 5. N/A

32 INCH OPENING)

- 6. DOOR HARDWARE SHALL HAVE A SHAPE EASY TO GRASP WITHOUT TIGHT GRASPING. ACCEPTABLE DOOR MECHANISMS ARE: LEVER HANDLES, PUSH TYPE HARDWARE, AND U-SHAPED HANDLES.
- THESE SHALL BE MOUNTED NO HIGHER THAN 48" AFF. 7. TOILET STALL DOOR SWINGS OUT AND SHALL BE SELF CLOSING (553.504(12)(a)). DOOR CAN BE HINGED ON EITHER SIDE.
- 8. TOILET STALL DOOR WIDTH TO BE A MINIMUM OF 32 INCHES (553.504(12)(d)).
- 9. ACCESSIBILITY TO TOILET STALL DOOR SHALL BE IN COMPLIANCE WITH ADA GUIDELINES.
- 10. STANDARD TOILET ACCESSORIES TO BE PROVIDED.

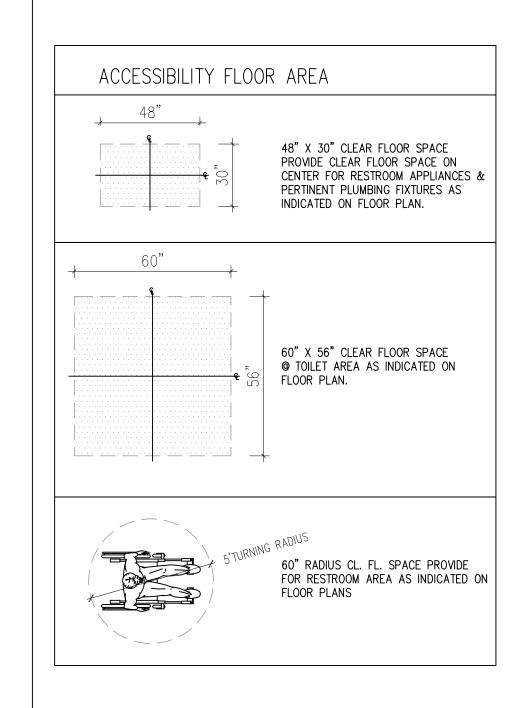

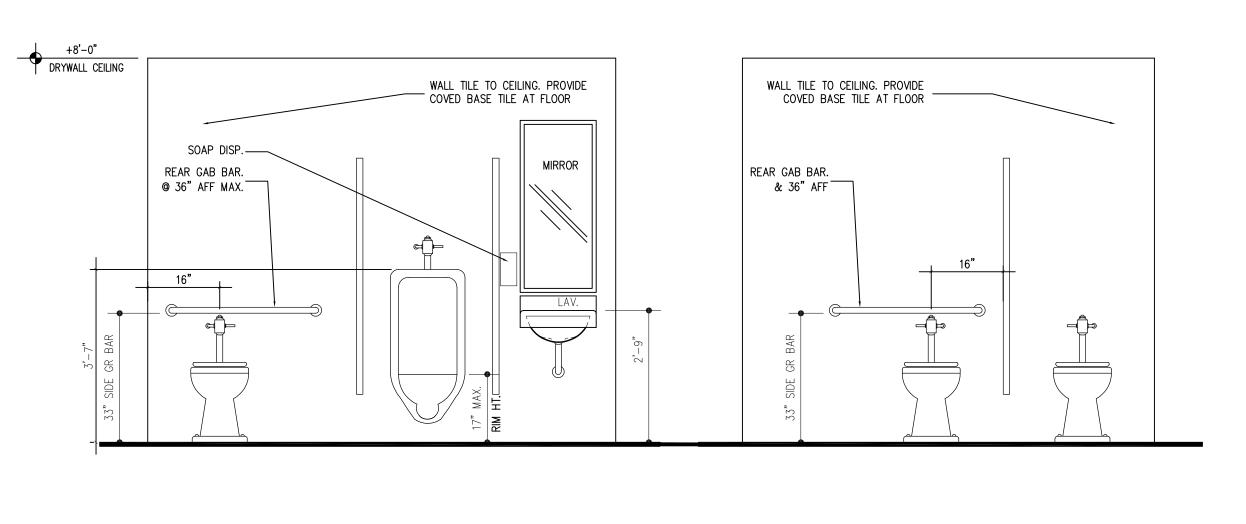

**ELEVATION A** NOTE: TYP. ACCESSIBLE TOILET ROOM COMPLYING WITH THE REQUIREMENTS OF THE FLORIDA LAW AND THE A.D.A. GUIDELINES FOR NEW CONSTRUCTION.


**ELEVATION B** 

**ELEVATION C** 

SOAP DISP.—

MIRROR

**RESTROOM ELEVATIONS** 

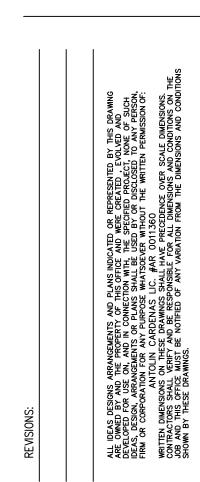

7