

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

Roof Deck Constructions


[See General Information for Roof Deck Constructions](#)

Construction No. 54

September 22, 2026

Uplift — Class 90 or 60 (See Items 2 and 4)

Fire — Not Investigated

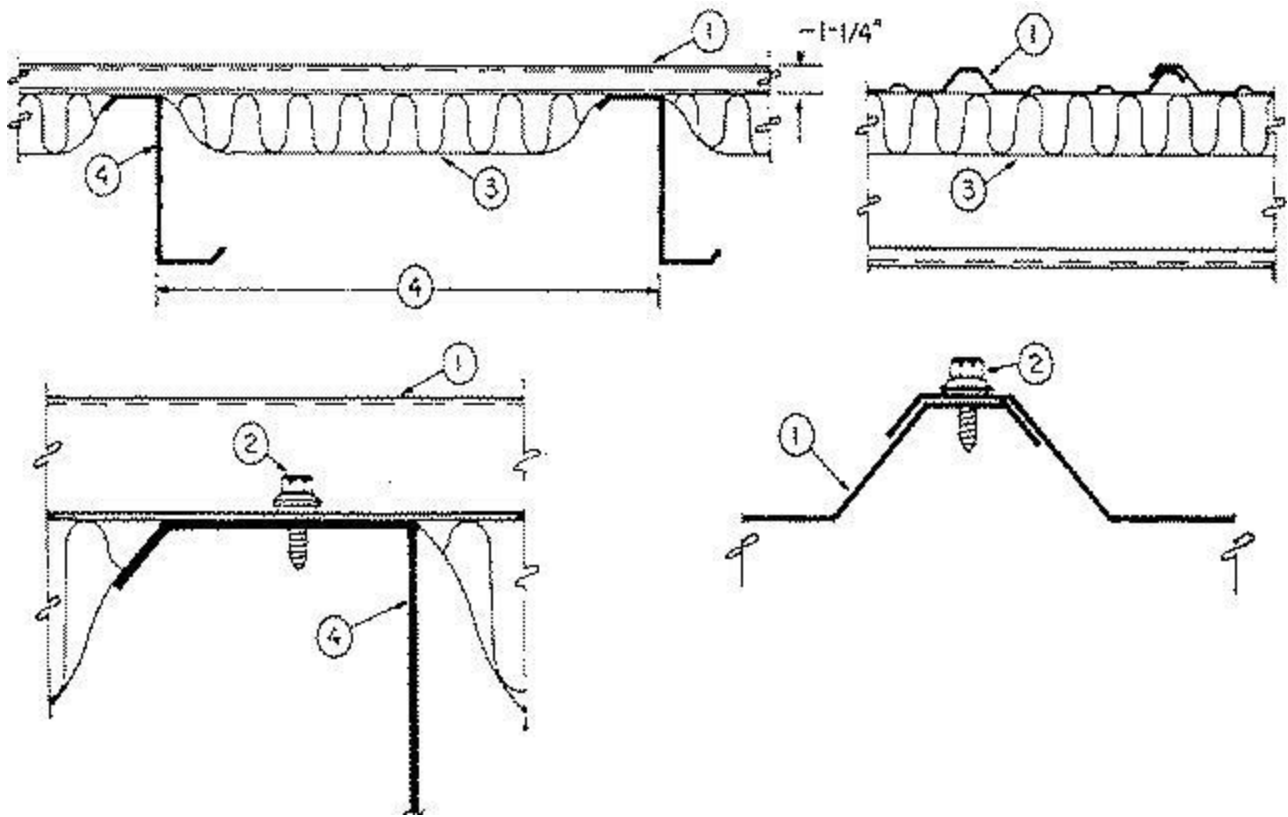

1. Metal Roof Deck Panels* — No. 26 MSG min gauge coated steel panels continuous over two or more spans. End laps to occur over purlins with panels overlapped 3 in. min., 6 in. max with lap beginning 3 in. from purlin web and extending across purlin upper flange. A bead of sealant may be used at panel end and side laps.

ALFORD METALS INC. — ([View Classification](#)) "PBR Panel"

ALLIED STEEL BUILDINGS — ([View Classification](#)) "PBR"

ALLSOUTH PRE-ENGINEERED COMPONENTS L L C ([View Classification](#)) — "R" or "PBR" Panel

ALL STEEL BUILDINGS & COMPONENTS TUBULAR DIVISION INC ([View Classification](#)) — "R or PBR panel"

AMERICAN BUILDING COMPONENTS ([View Classification](#)) — "R or PBR Panel"

B C STEEL BUILDINGS INC ([View Classification](#)) — "R/PBR"

BORGA STEEL INC ([View Classification](#)) — "BSP"

BRIDGER STEEL ([View Classification](#)) — "PBR Panel"

BBM STEEL BUILDINGS INC ([View Classification](#)) — "R-Panel"

CENTRAL TEXAS METAL ROLLFORMING INC ([View Classification](#)) — "R-Panel" or "PBR-Panel"

CREGO METAL SYSTEMS ([View Classification](#)) — "CMR"

DELTA METALS LLC ([View Classification](#)) — "PBR"

EAST TEXAS ARCHITECTURAL SHEETMETAL L L C, DBA ETAS INC ([View Classification](#)) — "R Panel"

ECONOMY METALS INC ([View Classification](#)) — "R Panel"

ENCORE STEEL BUILDING COMPANY ([View Classification](#)) — "PBR"

FLATIRON STEEL ([View Classification](#)) — "PBR"

GUTTERMANS SUPPLY CORPORATION OF AMERICA ([View Classification](#)) — "RCPBR125"

H&H METAL PRODUCTS INC ([View Classification](#)) — "PBR Panel"

HIXWOOD METAL LLC ([View Classification](#)) — "PBR 12" panel"

HPM BUILDING SUPPLY ([View Classification](#)) — "Custom 4-Rib"

IRON BROTHERS Metals ([View Classification](#)) — "R" or "PBR"

IOWA STEEL MASTERS ([View Classification](#)) — "PBR Panel"

JAG METALS LLC ([View Classification](#)) — "PBR Panel"

JNL STEEL COMPONENTS INC ([View Classification](#)) — "R-PANEL" or "PBR-PANEL"

LEGACY METAL CENTER ([View Classification](#)) — "PBR"

MARLYN METALS INC ([View Classification](#)) — "R" or "PBR"

MBCI ([View Classification](#)) — "R" or "PBR"

METAL EXTERIORS LLC ([View Classification](#)) — "PBR Panel"

METAL ROOFING SUPPLY & MFG ([View Classification](#)) — "PBR Panel"

METAL WHOLESALE L.L.C ([View Classification](#)) — "PBR Panel"

NCI BUILDING SYSTEMS L P ([View Classification](#)) — "R" or "PBR"

NORTHLAND STEEL AND TRIM ([View Classification](#)) — "R-Panel"

NORTH STAR METALS INC. ([View Classification](#)) — "PBR Panel"

OAKLAND METAL BUILDINGS INC ([View Classification](#)) — "PBR"

PINNACLE STRUCTURES INC ([View Classification](#)) — "PBR"

PRIME BUILDING COMPONENTS L L C ([View Classification](#)) — "R Panel" or "PBR Panel"

RIGID GLOBAL BUILDINGS L L C ([View Classification](#)) — "R" or "PBR"

SCHULTE BUILDING SYSTEMS INC ([View Classification](#)) — "R" or "PBR" Panel

SOUTHWEST METAL COMPONENTS AND SUPPLY LP ([View Classification](#)) — "R-Panel" or "PBR"

TAYLOR METAL INC, DBA TAYLOR METAL PRODUCTS ([View Classification](#)) — " PBR"

TERRY BUILDING CO INC ([View Classification](#)) — "R" Panel

TEXAR METALS INC ([View Classification](#)) — "PBR Panel"

TEXAS BUILDING AND ROOFING SUPPLIES INC ([View Classification](#)) — "R" or "PBR" Panel

TSB INDUSTRIAL INC ([View Classification](#)) — "R" Panel.

WEST TEXAS STEEL & SUPPLY ([View Classification](#)) — "R" or "PBR"

XTREME METALS LLC ([View Classification](#)) — "PBR Panel"

2. **Panel Fasteners** — For panel to purlin connections to be No. 12-14 self-drilling, self-tapping, hex-head, plated steel screws with a separate 1/2 in. OD formed steel washer and a separate neoprene sealing washer. The heads may have a nylon cover. Length to be 1 in. for up to 3 in. max thick insulation and 1 1/4 in. for insulation greater than 3 in.

Spacing: For Class 90 to be 6 in. OC located 3 in. from center line on both sides of each major rib. Spacing at end laps to be the same.

For Class 60 to be 12 in. OC beginning 2 1/2 in. from the center line on one side of each major rib. Spacing at end laps to be 6 in. OC beginning 3 in. from center line on both sides of each major rib.

For panel to panel connections — for Class 90 or 60 — to be same type 1 in. long. Spacing to be 18 in. OC with a fastener located over the purlins.

As an Alternate Fastener: For panel to purlin connections No. 14 by 3/4 in. Type A, self-tapping, plated steel screws with a separate 5/8 in. OD domed steel washer and a bonded neoprene sealing washer may be used. Length to be 3/4 in. for up to 3 in. max thickness insulation and 1 in. for insulation greater than 3 in.

For Panel to panel connections to be same type 3/4 in. long.

Pilot holes: For panel to purlin to be a No. 8 bit.

For panel to panel to be 1/8 in. diam.

3. **Insulation** — (Optional) — Any compressible blanket insulation 4 in. max thickness before compression.

4. **Purlin** — No. 16 MSG min gauge coated steel.

Spacing — For Class 90 to be 60-3/16 in. OC.

For Class 60 to be 63 1/4 in. OC.

No. 13 MSG min gauge coated steel.

Spacing — For Class 90 to be 63 1/4 in. OC.

(Min yield strength to be 55000 psi.)

Refer to General Information, Roof Deck Construction, (Roofing Materials and Systems Directory) for Items not evaluated.

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2026-09-22