



FGIA
Fenestration & Glazing
Industry Alliance

AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program

AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATION	RECORD OF PRODUCT TESTED			
AAMA/WDMA/CSA 101/I.S. 2/A440-11 LC-PG35-1829x1524 (72x60)-HS				
COMPANY AND CODE	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
MI Windows & Doors, LLC Code: MTL	14892	1685 HS (FIN) (PVC)(XX)(OG)(INS GL) (REINF)(ASTM)	<u>FRAME</u> 1829 mm x 1524 mm (72" x 60")	<u>SASH</u> 897 mm x 1441 mm (35" x 57")

This Certification will expire **November 19, 2030 (extended from November 19, 2025 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

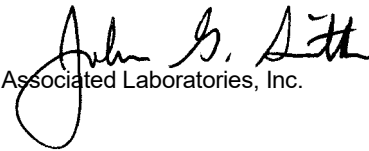
Product Tested and Reported by: **Intertek-ATI**

Report No.: **F2807.01-109-47**

Date of Report: **December 18, 2015 (Revised February 4, 2016)**

Date Test Completed: **November 19, 2015**

Evaluated for Certification: **October 16, 2025**


Associated Laboratories, Inc.

Authorized for Certification: **October 16, 2025**


Fenestration and Glazing Industry Alliance
1900 East Golf Road Schaumburg, IL 60173



(Validator / Operations Administrator)

ACP-04 (Rev. 5/24)



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program

AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATION	RECORD OF PRODUCT TESTED			
AAMA/WDMA/CSA 101/I.S. 2/A440-11 R-PG35-2134x1600 (84x63)-HS				
COMPANY AND CODE	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
MI Windows & Doors, LLC Code: MTL	14731	1685 HS (FINLESS) (PVC)(XX)(OG)(INS GL) (REINF)(ASTM)	<u>FRAME</u> 2134 mm x 1600 mm (84" x 63")	<u>SASH</u> 1051 mm x 1511 mm (41" x 60")

This Certification will expire **November 20, 2030 (extended from November 19, 2025 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

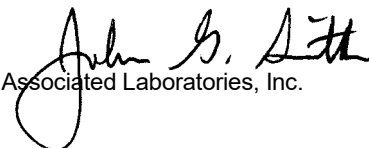
Product Tested and Reported by: **Intertek-ATI**

Report No.: **F2954.01-109-47**

Date of Report: **December 9, 2015**

Date Test Completed: **November 20, 2015**

Evaluated for Certification: **October 16, 2025**


Associated Laboratories, Inc.

Authorized for Certification: **October 16, 2025**


Fenestration and Glazing Industry Alliance
1900 East Golf Road Schaumburg, IL 60173



(Validator / Operations Administrator)



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program



AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

Attn: Rick Sawdey

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATION	RECORD OF PRODUCT TESTED			
AAMA/WDMA/CSA 101/I.S. 2/A440-17 LC-PG35*-1600x1118 (63x44)-HS Negative Design Pressure = -50 psf				
COMPANY AND CODE	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
MI Windows & Doors, LLC Code: MTL	17746	1685 HS (FIN) (PVC)(XX)(OG)(INS GL) (REINF)(ASTM)	<u>FRAME</u> 1600 mm x 1118 mm (5'3" x 3'8")	<u>SASH</u> 781 mm x 1029 mm (2'7" x 3'5")
Design Pressure (psf): +50/-50 (Pa): +2400/-2400		Water Test Pressure (psf): 5.43 (Pa): 260		

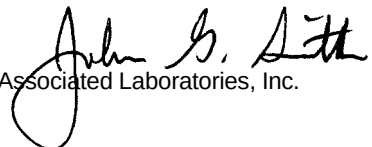
This Certification will expire **September 7, 2028 (extended from September 7, 2023 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Product Tested and Reported by: **Intertek B&C**

Report No.: **I8545.01-109-47**

Date of Report: **October 25, 2018**

Evaluated for Certification: **May 12, 2023**


Associated Laboratories, Inc.

Authorized for Certification: **May 12, 2023**


Fenestration and Glazing Industry Alliance



(Validator / Operations Administrator)



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program



AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

Attn: Rick Sawdey

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATION	RECORD OF PRODUCT TESTED			
AAMA/WDMA/CSA 101/I.S. 2/A440-17 LC-PG35*-1600x1118 (63x44)-HS Negative Design Pressure = -50 psf				
COMPANY AND CODE	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
MI Windows & Doors, LLC Code: MTL	17747	1685 HS (FINLESS) (PVC)(XX)(OG)(INS GL) (MODIF)(REINF)(ASTM)	<u>FRAME</u> 1600 mm x 1118 mm (5'3" x 3'8")	<u>SASH</u> 781 mm x 1029 mm (2'7" x 3'5")
Design Pressure (psf): +50/-50 (Pa): +2400/-2400		Water Test Pressure (psf): 5.43 (Pa): 260		

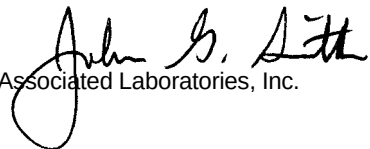
This Certification will expire **September 7, 2028 (extended from September 7, 2023 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Product Tested and Reported by: **Intertek B&C**

Report No.: **I8545.01-109-47**

Date of Report: **October 25, 2018**

Evaluated for Certification: **May 12, 2023**


Associated Laboratories, Inc.

Authorized for Certification: **May 12, 2023**


Fenestration and Glazing Industry Alliance



(Validator / Operations Administrator)

ACP-04 (Rev. 2/20)



FGIA
Fenestration & Glazing
Industry Alliance

AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program

AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATION	RECORD OF PRODUCT TESTED			
AAMA/WDMA/CSA 101/I.S.2/A440-22 R-PG30-2134x1346 (84x53)-HS				
COMPANY AND CODE	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
MI Windows & Doors, LLC Code: MTL	22296	1685 HS (FIN & FINLESS) (PVC)(XX)(OG)(INS GL) (REINF)(ASTM)	<u>FRAME</u> 2134 mm x 1346 mm (84" x 53")	<u>SASH</u> 1022 mm x 1251 mm (40" x 49")

This Certification will expire **December 18, 2029** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

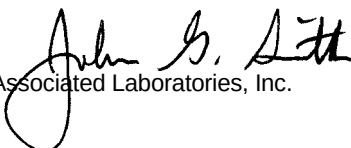
Product Tested and Reported by: **Molimo, LLC**

Report No.: **29995.01-106-12**

Date of Report: **February 7, 2025**

Date Test Completed: **December 18, 2024**

Evaluated for Certification: **February 11, 2025**


Associated Laboratories, Inc.



(Validator / Operations Administrator)

ACP-04 (Rev. 5/24)

Authorized for Certification: **February 11, 2025**


Fenestration and Glazing Industry Alliance
1900 East Golf Road Schaumburg, IL 60173