



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program



AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

Attn: Rick Sawdey

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATIONS		RECORD OF PRODUCT TESTED			
AAMA/WDMA/CSA 101/I.S.2/A440-11 LC-PG50-1324x1905 (52x75)-H	AAMA 506				
COMPANY AND CODE	Missile Level: D Rating: +50/-50, 52x75 Wind Zone: 3	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
MI Windows & Doors, LLC Code: MTL	Rating above conforms to the requirements of: ASTM E1886 and E1996	16230	1620 SH (FIN, FLANGE, & FINLESS) (PVC)(O/X)(OG) (INS 0.090" PVB LAM GL) (MODIF)(REINF)(TILT) (ASTM)	<u>FRAME (mm)</u> 1324 x 1905 (4'4" x 6'3")	<u>SASH (mm)</u> 1257 x 946 (4'2" x 3'1")

This Certification will expire **December 27, 2026 (extended from December 27, 2021 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Structural Test & Report By:

Intertek-ATI

Report No: **G1518.01-109-47**

Date of Report: **January 24, 2017 (Revised January 25, 2017)**

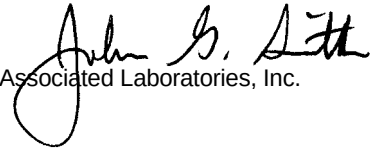
Missile Impact Test & Report By:

Intertek-ATI


Report No: **G1518.02-109-47**

Date of Report: Date of Report: **January 24, 2017**
(Revised January 25, 2017)

Evaluated for Certification: **July 19, 2021**


Associated Laboratories, Inc.

Authorized for Certification: **July 19, 2021**


Fenestration and Glazing Industry Alliance



(Validator / Operations Administrator)