



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program



AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

Attn: Rick Sawdey

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATIONS		RECORD OF PRODUCT TESTED			
AAMA/WDMA/CSA 101/I.S.2/A440-17 LC-PG50*-965x1905 (38x75)-H Negative Design Pressure = -70 psf	AAMA 506				
COMPANY AND CODE	Missile Level: D Rating: +60/-70, 38x75 Wind Zone: 3	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
MI Windows & Doors, LLC Code: MTL	Rating above conforms to the requirements of: ASTM E1886 and E1996	18143	1620 SH (FIN & FINLESS) (PVC)(O/X)(OG) (INS 0.090" PVB LAM GL) (MODIF)(REINF)(TILT)(ASTM)	<u>FRAME (mm)</u> 965 x 1905 (3'2" x 6'3")	<u>SASH (mm)</u> 899 x 946 (2'11" x 3'1")
Design Pressure (psf): +60/-70 (Pa): +2880/-3360		Water Test Pressure (psf): 7.52 (Pa): 360			

This Certification will expire **May 15, 2028 (extended from May 15, 2023 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Structural Test & Report By:

Molimo, LLC & Intertek B&C

Report No: **1820.05-106-12; ref. H9951.01-109-47**

Date of Reports: **April 15, 2019; July 11, 2018**

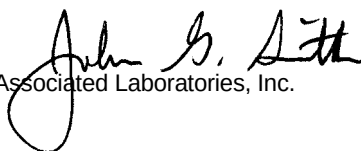
Missile Impact Test & Report By:

Molimo, LLC

Report No: **1820.05-106-12**

Date of Report: **April 12, 2019**

Evaluated for Certification: **February 27, 2023**


Associated Laboratories, Inc.

Authorized for Certification: **February 27, 2023**


Fenestration and Glazing Industry Alliance



(Validator / Operations Administrator)