



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program

AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATIONS		RECORD OF PRODUCT TESTED		
AAMA/WDMA/CSA 101/I.S.2/A440-11 LC-PG55-1854x1549 (73x61)-FW	AAMA 506			
COMPANY AND CODE	Missile Level: D Rating: +55/-55, 73x61 Wind Zone: 3	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED
MI Windows & Doors, LLC Code: MTL	Rating above conforms to the requirements of: ASTM E1886 and E1996	16389	1620/1630/1650SPI PW (FIN, FLANGE, & FINLESS) (PVC)(O)(OG) (INS 0.100" HP PVB LAM GL) (ASTM)	FRAME 1854 mm x 1549 mm (73" x 61")

This Certification will expire **February 27, 2027 (extended from February 27, 2022 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Structural Test & Report By:

Molimo, LLC

Report No: **1235.01-106-11**

Date of Report: **March 7, 2017 (Revised March 16, 2017)**

Date Test Completed: **February 27, 2017**

Missile Impact Test & Report By:

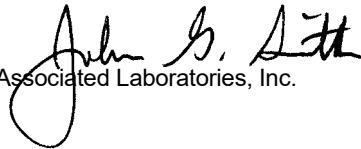
Molimo, LLC

Report No: **1235.02-106-11**


Date of Report: **March 7, 2017**

Date Test Completed: **March 1, 2017**

Evaluated for Certification: **June 9, 2025**


Associated Laboratories, Inc.

Authorized for Certification: **June 9, 2025**



Fenestration and Glazing Industry Alliance
1900 East Golf Road Schaumburg, IL 60173



(Validator / Operations Administrator)



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program

AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATIONS		RECORD OF PRODUCT TESTED		
AAMA/WDMA/CSA 101/I.S.2/A440-11 LC-PG55*-1829x1219 (72x48)-FW	AAMA 506			
COMPANY AND CODE	Missile Level: D Rating: +55/-55, 72x48 Wind Zone: 3	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED
MI Windows & Doors, LLC Code: MTL	Rating above conforms to the requirements of: ASTM E1886 and E1996	16673	1620/1630/1650SPI PW (FIN, FLANGE & FINLESS) (PVC)(O)(OG) (INS 0.090" PVB LAM GL) (ASTM)	FRAME 1829 mm x 1219 mm (72" x 48")

This Certification will expire **April 6, 2027 (extended from April 6, 2022 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Structural Test & Report By:

Intertek-ATI

Report No: **G9899.01-109-47**

Date of Report: **June 7, 2017**

Date Test Completed: **April 6, 2017**

Missile Impact Test & Report By:

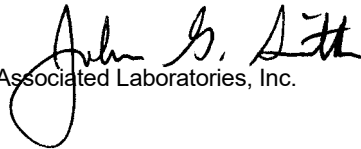
Intertek-ATI

Report No: **G9899.02-109-47**


Date of Report: **June 7, 2017**

Date Test Completed: **April 6, 2017**

Evaluated for Certification: **June 9, 2025**


Associated Laboratories, Inc.

Authorized for Certification: **June 9, 2025**



Fenestration and Glazing Industry Alliance
1900 East Golf Road Schaumburg, IL 60173



(Validator / Operations Administrator)



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program

AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATIONS		RECORD OF PRODUCT TESTED		
AAMA/WDMA/CSA 101/I.S.2/A440-11 LC-PG55*-1524x914 (60x36)-FW	AAMA 506			
COMPANY AND CODE	Missile Level: D Rating: +55/-55, 60x36 Wind Zone: 3	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED
MI Windows & Doors, LLC Code: MTL	Rating above conforms to the requirements of: ASTM E1886 and E1996	16695	1620/1630/1650SPI PW (FIN, FLANGE & FINLESS) (PVC)(O)(OG) (INS 0.090" PVB LAM GL) (ASTM)	FRAME 1524 mm x 914 mm (60" x 36")

This Certification will expire **April 7, 2027 (extended from April 7, 2022 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Structural Test & Report By:

Intertek-ATI

Report No: **G9897.01-109-47**

Date of Report: **June 9, 2017**

Date Test Completed: **April 7, 2017**

Missile Impact Test & Report By:

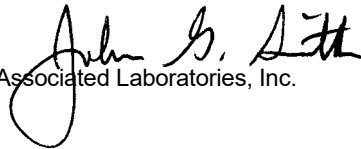
Intertek-ATI

Report No: **G9897.02-109-47**


Date of Report: **June 9, 2017**

Date Test Completed: **April 7, 2017**

Evaluated for Certification: **June 9, 2025**


Associated Laboratories, Inc.

Authorized for Certification: **June 9, 2025**



Fenestration and Glazing Industry Alliance
1900 East Golf Road Schaumburg, IL 60173



(Validator / Operations Administrator)



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program

AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATIONS		RECORD OF PRODUCT TESTED		
AAMA/WDMA/CSA 101/I.S.2/A440-17 LC-PG50*-1219x2134 (48x84)-FW	AAMA 506			
COMPANY AND CODE	Missile Level: D Rating: +50/-50, 48x84 Wind Zone: 3	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED
MI Windows & Doors, LLC Code: MTL	Rating above conforms to the requirements of: ASTM E1886 and E1996	19407	1620/1630/1650SPI PW (FIN, FLANGE & FINLESS) (PVC)(O)(OG) (INS 0.090" PVB LAM GL) (ASTM)	FRAME 1219 mm x 2134 mm (48" x 84")

This Certification will expire **June 11, 2030 (extended from June 11, 2025 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Structural Test & Report By:

Intertek B&C

Report No: **L0841.01-109-47**

Date of Report: **July 6, 2020**

Date Test Completed: **June 11, 2020**

Missile Impact Test & Report By:

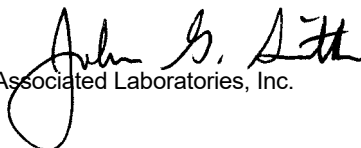
Intertek B&C

Report No: **L0842.01-109-47**


Date of Report: **January 4, 2021**

Date Test Completed: **November 25, 2020**

Evaluated for Certification: **June 9, 2025**


Associated Laboratories, Inc.

Authorized for Certification: **June 9, 2025**


Fenestration and Glazing Industry Alliance
1900 East Golf Road Schaumburg, IL 60173



(Validator / Operations Administrator)



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program

AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATIONS		RECORD OF PRODUCT TESTED		
AAMA/WDMA/CSA 101/I.S.2/A440-11 LC-PG55-1857x1905 (73x75)-FW	AAMA 506			
COMPANY AND CODE	Missile Level: D Rating: +55/-55, 73x75 Wind Zone: 3	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED
MI Windows & Doors, LLC Code: MTL	Rating above conforms to the requirements of: ASTM E1886 and E1996	15955	1620/1630/1650SPI PW (FIN, FLANGE, & FINLESS) (PVC)(O)(OG) (INS 0.100" PVB LAM GL) (ASTM)	<u>FRAME</u> 1857 mm x 1905 mm (73" x 75")

This Certification will expire **August 15, 2026 (extended from August 15, 2021 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Structural Test & Report By:

Intertek-ATI

Report No: **G1769.01-109-47**

Date of Report: **October 17, 2016**
(Revised January 16, 2018)

Date Test Completed: **August 15, 2016**

Missile Impact Test & Report By:

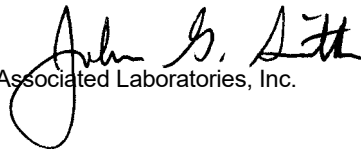
Intertek-ATI

Report No: **G1769.02 & G1769.03-109-47**

Date of Reports: **October 17, 2016, & February 7, 2017**
(Revised January 16, 2018)

Date Tests Completed: **August 19, and October 28, 2016**

Evaluated for Certification: **June 9, 2025**


Associated Laboratories, Inc.

Authorized for Certification: **June 9, 2025**


Fenestration and Glazing Industry Alliance
1900 East Golf Road Schaumburg, IL 60173



(Validator / Operations Administrator)