



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program



AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

Attn: Rick Sawdey

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATIONS		RECORD OF PRODUCT TESTED			
AAMA/WDMA/CSA 101/I.S.2/A440-11 LC-PG55-4842x2438 (191x96)-SD	AAMA 506				
COMPANY AND CODE	Missile Level: D Rating: +55/-55, 191x96 Wind Zone: 3	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
MI Windows & Doors, LLC Code: MTL	Rating above conforms to the requirements of: ASTM E1886 and E1996	20556	120/130/140 SGD (AL)(OXXO)(OG) (INS TEMP/0.090" PVB LAM GL)(MODIF) (REINF)(ASTM)	<u>FRAME (mm)</u> 4842 x 2438 (15'11" x 8'0")	<u>PANEL (mm)</u> 1235 x 2375 (4'1" x 7'10")

This Certification will expire **November 29, 2026** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Structural Test & Report By:

Molimo, LLC

Report No: **Waiver; ref. 1196.01-106-11; ref. 1223.03-106-12**

Date of Reports: **March 7, 2017; March 3, 2017**

Missile Impact Test & Report By:

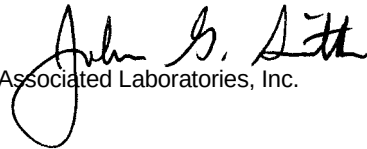
Molimo, LLC

Report No: **Waiver; ref. 11311.01-106-11-R2; ref. 1196.02-106-11**


Date of Reports: **Sept. 7, 2022 (Rev. Oct. 7, 2022); March 3, 2017**

NOTE: ALL CERTIFIED DOORS MUST USE A 3.5" FRAME SILL RISER.

Evaluated for Certification: **February 10, 2023**


Associated Laboratories, Inc.

Authorized for Certification: **February 10, 2023**


Fenestration and Glazing Industry Alliance



(Validator / Operations Administrator)

ACP-04 (Rev. 2/20)