

**AAMA
CERTIFICATION PROGRAM**



AUTHORIZATION FOR PRODUCT CERTIFICATION

**Simonton Windows
1 Cochrane Dr.
Pennsboro, WV 26415**

Attn: Tina Seese

The product described below is hereby approved for listing in the next issue of the AAMA Certified Products Directory. The approval is based successful completion of tests, and the reporting to the Administrator of the results of tests, accompanied by related drawings, by an AAMA Accredited Laboratory.

1. The listing below will be added to the next published AAMA Certified Products Directory.

SPECIFICATIONS		RECORD OF PRODUCT TESTED		
AAMA/WDMA/CSA 101/I.S.2/A440-08 R-PG55-1880x1600 (74x63)-FW	AAMA 506			
COMPANY AND CODE	Missile Level: D Rating: +55/-55, 74x63 Wind Zone: 4	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED
Simonton Windows Code: SIM	Rating above conforms to the requirements of: ASTM E1886 and E1996	5793	07-09/07-20 STORMBREAKER PLUS PW (PVC)(O)(IG) (INS TEMP/PVB LAM GL) (ASTM)	FRAME 1880 mm x 1600 mm (6'2" x 5'3")

2. This Certification will expire **November 1, 2019 (extended from November 1, 2016 per AAMA 103-15)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

3. Structural Test & Report By:

Farabaugh Engineering & Testing, Inc.

Report No: **T261-10**

Date of Report: **November 3, 2010**

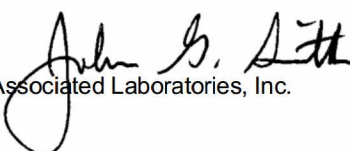
Missile Impact Test & Report By:

Architectural Testing, Inc.

Report No: **A4999.01-501-47**

Date of Report: **Jan. 5, 2011 (Revised April 4, 2011 and May 30, 2012)**

Validated for Certification


Associated Laboratories, Inc.

Authorized for Certification


American Architectural Manufacturers Association

Date: **May 20, 2016**

Cc: AAMA

JGS

ACP-14 (Rev. 1/11)