



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program



AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

Attn: Rick Sawdey

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATION	RECORD OF PRODUCT TESTED		
AAMA/WDMA/CSA 101/I.S. 2/A440-11 LC-PG50-1829x2134 (72x84)-FW Negative Design Pressure = -60 psf			
COMPANY AND CODE	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED
MI Windows & Doors, LLC Code: MTL	16873	3540 PW (FIN) (PVC)(O)(IG) (INS TEMP GL)(ASTM)	<u>FRAME</u> 1829 mm x 2134 mm (6'0" x 7'0")
Design Pressure (psf): +60/-60 (Pa): +2880/-2880		Water Test Pressure (psf): 7.52 (Pa): 360	

This Certification will expire **June 8, 2027 (extended from June 8, 2022 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

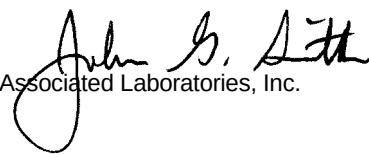
Product Tested and Reported by: **Intertek-ATI**

Report No.: **H2313.01-109-47**

**NOTE: ALL CERTIFIED WINDOWS MUST BE GLAZED WITH
TEMPERED GLASS.**

Date of Report: **September 19, 2017**

Evaluated for Certification: **April 18, 2022**


Associated Laboratories, Inc.

Authorized for Certification: **April 18, 2022**


Fenestration and Glazing Industry Alliance



(Validator / Operations Administrator)