



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program



AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

Attn: Rick Sawdey

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATIONS		RECORD OF PRODUCT TESTED			
AAMA/WDMA/CSA 101/I.S.2/A440-08 LC-PG55*-1346x1575 (53x62)-H Negative Design Pressure = -63 psf	PA 201, 202, 203				
COMPANY AND CODE	Rating: +55/-63, 53x62 Missile Level: Large	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
MI Windows & Doors, LLC Code: MTL	Rating above conforms to the requirements of: TAS 201, 202, 203	18968	185MD SH (FIN, FLANGE, & FINLESS) (AL)(O/X)(OG) (INS 0.100" PVB LAM GL) (MODIF)(ASTM)	<u>FRAME (mm)</u> 1346 x 1575 (4'5" x 5'2")	<u>SASH (mm)</u> 1295 x 792 (4'3" x 2'7")

This Certification will expire **December 23, 2024** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Structural Test & Report By:

Molimo, LLC

Report No: **2358.01-106-11**

Date of Report: **April 7, 2020 (Revised May 8, 2020)**

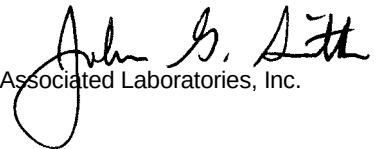
Missile Impact Test & Report By:

Molimo, LLC


Report No: **2037.03-106-11**

Date of Report: **March 11, 2020 (Revised May 1, May 4,
and May 8, 2020)**

Evaluated for Certification: **June 5, 2020**


Associated Laboratories, Inc.

Authorized for Certification: **June 5, 2020**


Fenestration and Glazing Industry Alliance



(Validator / Operations Administrator)