



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program



AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

Attn: Rick Sawdey

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATION	RECORD OF PRODUCT TESTED			
AAMA/WDMA/CSA 101/I.S. 2/A440-11 LC-PG35*-911x1867 (36x74)-H Negative Design Pressure = -50 psf				
COMPANY AND CODE	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
MI Windows & Doors, LLC Code: MTL	11355	3540 SH (FIN) (PVC)(O/X)(IG)(INS GL) (REINF)(TILT)(ASTM)	<u>FRAME</u> 911 mm x 1867 mm (3'0" x 6'2")	<u>SASH</u> 860 mm x 919 mm (2'10" x 3'0")
Design Pressure (psf): +50/-50 (Pa): +2400/-2400		Water Test Pressure (psf): 5.43 (Pa): 260		

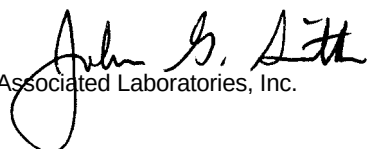
This Certification will expire **April 12, 2027 (extended from April 12, 2022 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Product Tested and Reported by: **Architectural Testing, Inc.**

Report No.: **C7327.01-109-47**

Date of Report: **May 7, 2013**

Evaluated for Certification: **April 11, 2022**


Associated Laboratories, Inc.

Authorized for Certification: **April 11, 2022**


Fenestration and Glazing Industry Alliance



(Validator / Operations Administrator)

ACP-04 (Rev. 2/20)