



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program



AUTHORIZATION FOR PRODUCT CERTIFICATION

Winco Window Company
6200 Maple Ave.
St. Louis, MO 63130

Attn: Lothar Erkens

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATIONS		RECORD OF PRODUCT TESTED			
AAMA/WDMA/CSA 101/I.S.2/A440-08 AW-PG65*-2749x1849 (108x73)-HS	AAMA 506				
COMPANY AND CODE	Missile Level: D Rating: +65/-65, 108x73 Wind Zone: 3	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
Winco Window Company Code: WWC	Rating above conforms to the requirements of: ASTM E1886 and E1996	16761	3410 HS W/SUB-SILL (AL)(OX)(IG) (INS H.S./0.090" SGP LAM GL)(ASTM)	<u>FRAME (mm)</u> 2749 x 1849 (9'0" x 6'1")	<u>SASH (mm)</u> 1378 x 1705 (4'6" x 5'7")

This Certification will expire **June 8, 2026 (extended from June 8, 2021 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Structural Test & Report By:

Mid America Testing Laboratory, Inc. & UL, LLC

Report No: **17018I-C & SV30610-20160608 Rev.**

Date of Report: **June 2, 2017; July 5, 2016 (Revised July 20, 2017)**

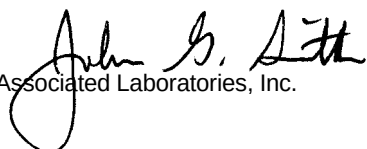
Missile Impact Test & Report By:

UL, LLC

Report No: **SV30610-20160608 Rev.**

Date of Report: **July 5, 2016 (Revised July 20, 2017)**

Evaluated for Certification: **June 2, 2022**


Associated Laboratories, Inc.

Authorized for Certification: **June 2, 2022**


Fenestration and Glazing Industry Alliance



(Validator / Operations Administrator)