

KAWNEER TRIFAB 451UT CENTER – PREGLAZE


GENERAL NOTES

1. THIS STOREFRONT SYSTEM HAS BEEN TESTED TO ASTM E283, ASTM E330, ASTM E331, ASTM E547, AND AAMA 501, AND MEETS THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC), CURRENT EDITION, OUTSIDE THE HIGH VELOCITY HURRICANE ZONE. PRODUCT WAS TESTED WITH AND WITHOUT INTERIOR PERIMETER SEAL, BY OTHERS. WITHOUT INTERIOR PERIMETER SEAL, PRODUCT PASSED AIR INFILTRATION TESTING AT 1.56 PSF AND WATER PENETRATION RESISTANCE TEST OF 10.44 PSF. WITH INTERIOR PERIMETER SEAL, PRODUCT PASSED AIR INFILTRATION TESTING AT 6.24 PSF AND WATER PENETRATION RESISTANCE TEST OF 12 PSF.
2. A FLORIDA LICENSED ENGINEER FAMILIAR WITH STOREFRONT DESIGN SHALL APPROVE SHOP DRAWINGS FOR EACH PROJECT, AND THIS ENGINEER OF RECORD SHALL TAKE FULL RESPONSIBILITY FOR THE INSTALLED SYSTEM DESIGN AS A WHOLE WHILE MAKING SURE THAT THE LIMITATIONS INDICATED IN THIS DRAWING HAVE NOT BEEN EXCEEDED. THE INSTALLED STOREFRONT SYSTEM SHALL BE FABRICATED, GLAZED, AND ANCHORED IN ACCORDANCE WITH THIS DRAWING AND KAWNEER INSTALLATION INSTRUCTIONS, AS WELL AS THE APPLICABLE TEST REPORTS, OR AS INDICATED BY THE ENGINEER OF RECORD IN APPROVED SHOP DRAWINGS.
3. THIS DRAWING INDICATES VARIOUS APPROVED GLAZING METHODS AND FRAMING TYPES WHICH MAY BE USED SINGLY OR IN COMBINATION FOR EACH PROJECT. ANY NUMBER OF PANELS MAY BE USED HORIZONTALLY PROVIDED THE MAXIMUM DLO SIZES AS INDICATED IN THIS DRAWING ARE NOT EXCEEDED.
4. THIS PRODUCT IS NON-IMPACT AND REQUIRES THE USE OF APPROVED SHUTTERS IN WINDBORNE DEBRIS AREAS.
5. REQUIRED DESIGN PRESSURES SHALL BE DETERMINED FOR EACH PROJECT IN ACCORDANCE WITH APPLICABLE CODE REQUIREMENTS AND GOVERNING WIND SPEEDS FOR THE PROJECT LOCATION.
6. THE ALLOWABLE DESIGN PRESSURES AND LOAD CAPACITIES SHOWN IN THIS DRAWING ARE ALLOWABLE STRESS DESIGN (ASD) BASIS AND ARE AS LIMITED BY ASTM E-1300 GLASS TABLES, TESTED PRESSURES, AND MULLION CALCULATIONS. ALTERNATE COMPARATIVE OR RATIONAL ANALYSIS CALCULATIONS AS DEEMED APPROPRIATE ON A PROJECT BASIS BY THE ENGINEER OF RECORD IS ACCEPTABLE.
7. DISSIMILAR MATERIALS THAT COME INTO CONTACT, INCLUDING BUT NOT LIMITED TO FASTENERS IN CONTACT WITH PRESSURE TREATED WOOD SUBSTRATES OR ALUMINUM, SHALL BE COATED OR OTHERWISE PROTECTED PER FBC REQUIREMENTS TO PREVENT CORROSION OR GALVANIC REACTIONS.
8. SEALING AND FLASHING STRATEGIES FOR OVERALL WATER INFILTRATION RESISTANCE OF THE INSTALLED PRODUCT IS NOT WITHIN THE SCOPE OF THIS APPROVAL AND SHALL BE THE RESPONSIBILITY OF OTHERS.
9. THE 4/3 ALLOWABLE STRESS INCREASE HAS NOT BEEN USED IN THE ANCHOR ANALYSIS FOR THIS SYSTEM. THE 1.6 Cd FACTOR WAS USED IN THE ANALYSIS OF WOOD SUBSTRATE.
10. STRUCTURAL INTEGRITY OF SUBSTRATE MATERIALS TO RECEIVE THE LOADS FROM THIS PRODUCT, AND INSTALLATION OF WOOD BUCKS OR OTHER ACCESSORIES TO THE SUBSTRATE, TO BE ENGINEERED BY OTHERS OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION.
11. THIS PRODUCT SHALL BE INSTALLED USING ONE OF THE APPROVED FASTENING OR WELDING METHODS INDICATED IN THIS DRAWING, AS APPROPRIATE FOR THE SUBSTRATE TYPE, OR AS INDICATED BY THE ENGINEER OF RECORD IN APPROVED SHOP DRAWINGS. ANCHOR SIZE, EMBEDMENT, EDGE DISTANCE, AND LOCATIONS, SHALL BE IN ACCORDANCE WITH THESE DRAWINGS OR AS INDICATED IN APPROVED SHOP DRAWINGS. THE ASSEMBLY AND INSTALLATION FASTENERS INDICATED IN THIS DRAWING ARE APPLICABLE FOR NON-COASTAL APPLICATIONS. IF THE PROJECT IS WITHIN 3000 FT OF A SALTWATER COASTLINE, THE FASTENERS SHALL BE EVALUATED FOR COMPLIANCE WITH FBC SECTION 1711. SEE EVALUATION REPORT FOR THIS APPROVAL FOR ADDITIONAL INFORMATION.
12. MINIMUM ANCHOR EMBEDMENTS LISTED IN THIS DRAWING SHALL BE BEYOND WALL DRESSING OR STUCCO AND FULLY INTO SUBSTRATE. LOAD-BEARING SHIMS SHALL BE USED AT ALL ANCHOR LOCATIONS WHERE A GAP OF MORE THAN 1/16” EXISTS BETWEEN THE PRODUCT AND OPENING SUBSTRATE. MAXIMUM SHIM GAP IS AS INDICATED IN THESE DRAWINGS.
13. SUBSTRATES SHALL MEET THE MINIMUM STRENGTH REQUIREMENTS AS SHOWN IN ANCHOR DETAILS IN SECTION 6. CONCRETE OR MASONRY SUBSTRATES SHALL NOT BE CRACKED. FOR INSTALLATION TO METAL SUBSTRATES, ANCHORS SHALL BE LONG ENOUGH TO BE FULLY THREADED THROUGH THE METAL THICKNESS WITH AN ADDITIONAL 3/16” MIN. OF THREADS BEYOND.
14. CONSTRUCTION NOTES: THE VERITICAL FRAME MEMBERS RUN THROUGH WHILE THE HORIZONTAL MEMBERS ARE SQUARE CUT & BUTTED TO THE VERTICAL FRAME MEMBER. THE VERTICAL MEMBERS ARE FASTENED TO THE HORIZONTAL MEMBERS WITH ANCHORS INTO SCREW SPLINES. ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH KAWNEER INSTALLATION INSTRUCTIONS. APPLY SEALANT TO END DAM AND OVER END DAM FASTENERS PER INSTALLATION INSTRUCTIONS. SEAL OVER ALL PERIMETER ANCHORS. APPLY SEALANT TO PROFILE ENDS OF ALL HORIZONTAL MEMBERS AT ASSEMBLY PER INSTALLATION INSTRUCTIONS. SEAL BETWEEN SILL AND SILL FLASHING PER INSTALLATION INSTRUCTIONS. APPLY SEALANT IN GASKET REGLETS AND ON VERTICAL MULLION UNDER GLASS STOPS PER INSTALLATION INSTRUCTIONS. SEAL BETWEEN SILL FLASHING/HEAD RECEPTOR END DAMS AND JAMB FILLERS. SEAL ALL GASKET JOINTS PER INSTALLATION INSTRUCTIONS.

TABLE OF CONTENTS

SHEET	DESCRIPTION
01	SECTION 1 – GENERAL NOTES
02	SECTION 2 – SAMPLE ELEVATION, STRAP ANCHOR AT HEAD
03	SECTION 2 – SAMPLE ELEVATION, HEAD RECEPTOR
04	SECTION 3 – VERTICAL FRAMING DETAILS
05	SECTION 3 – HORIZONTAL FRAMING DETAILS
06	SECTIONS 4 AND 5 – MULLION LOAD TABLE, TYP. GLAZING DETAIL
07	SECTION 6 – PERIMETER ANCHOR DETAILS
08	SECTIONS 7 AND 8 – EXTRUSION PROFILES, BOM

KAWNEER
555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PH. 770-449-5555
WWW.KAWNEER.COM

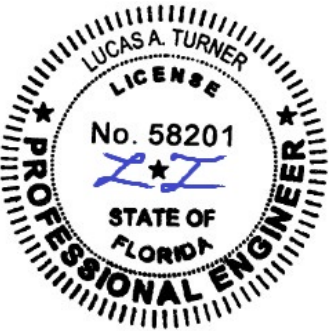

8/18/2026
LUCAS A. TURNER
FL P.E. #58201

TURNER ENGINEERING &
CONSULTING, INC.
2428 OLD NATCHEZ TRACE TRL.
CAMDEN, TN 38320
PH. 941-380-1574





DRAWING NO. 451UT-Cntr-PreGlaze	PRODUCT TRIFAB 451UT
FPA # FL10008	SECTION 01
DATE 02/11/2021	SHEET 01 OF 08
SCALE NTS	

SILICONE REQUIREMENTS:


DOW CORNING 791 – WEATHER SEALS

PERIMETER SEALS (BY OTHERS)



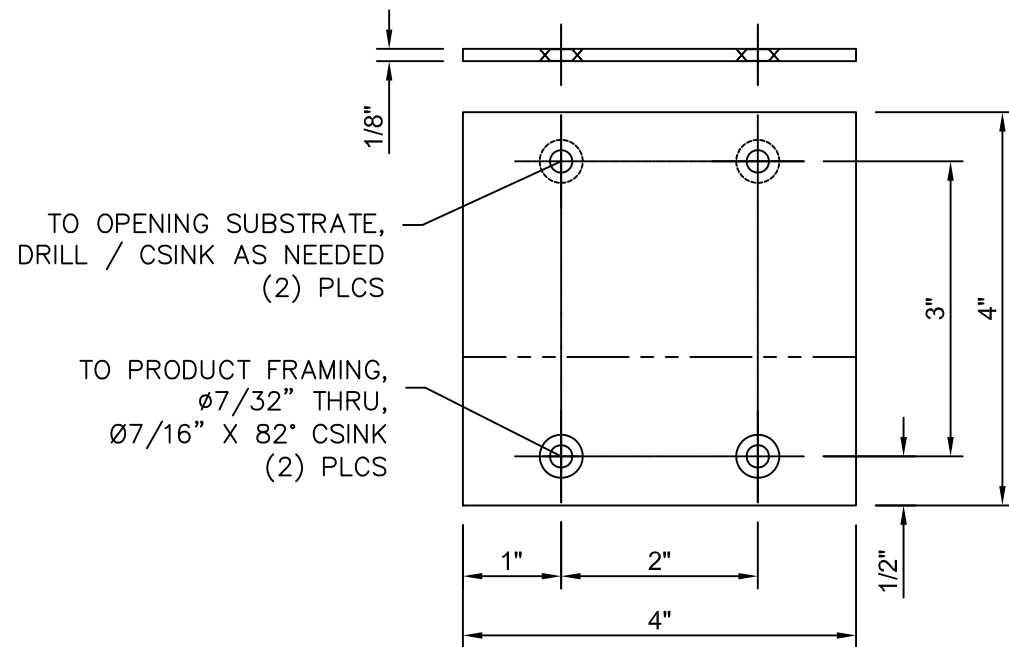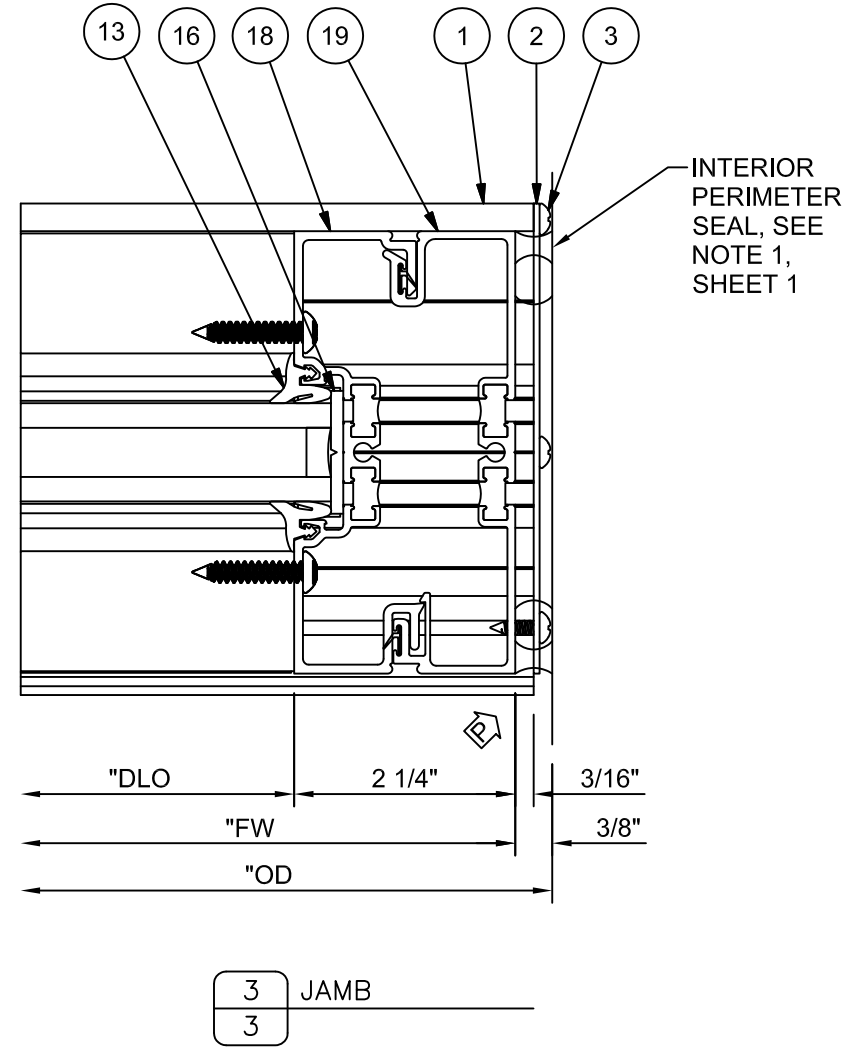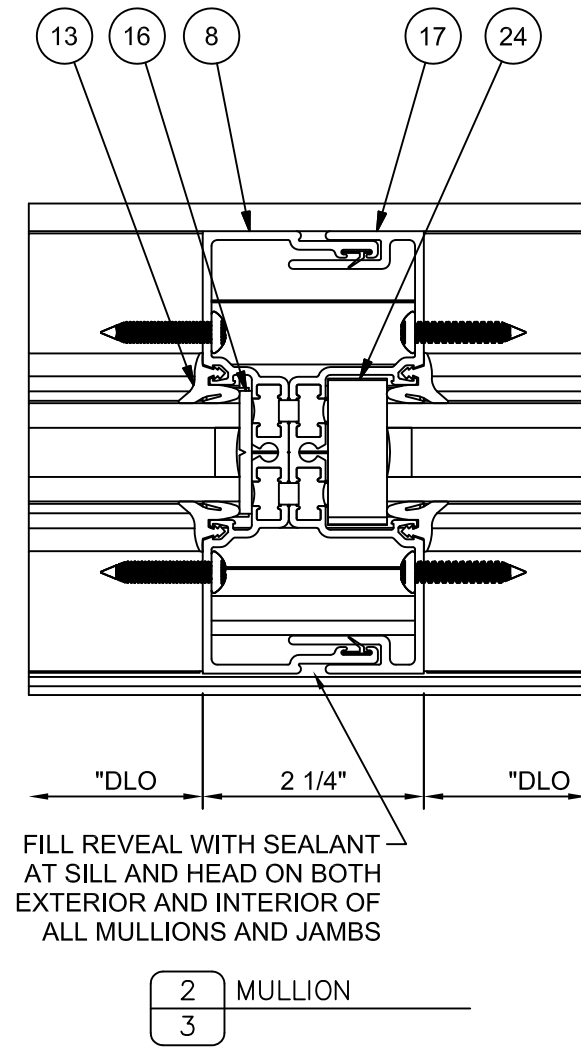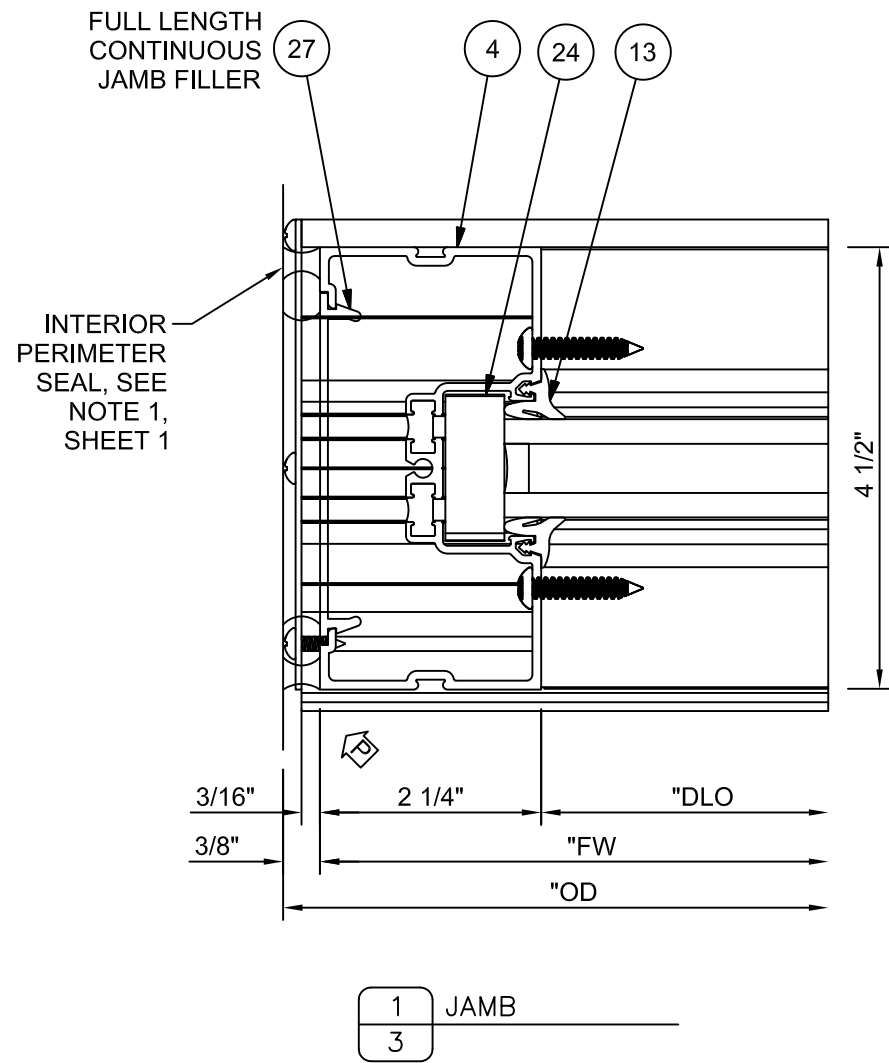


20 STRAP ANCHOR TO WOOD OR METAL SUBSTRATES
MATL: ALUM BRAKE MTL

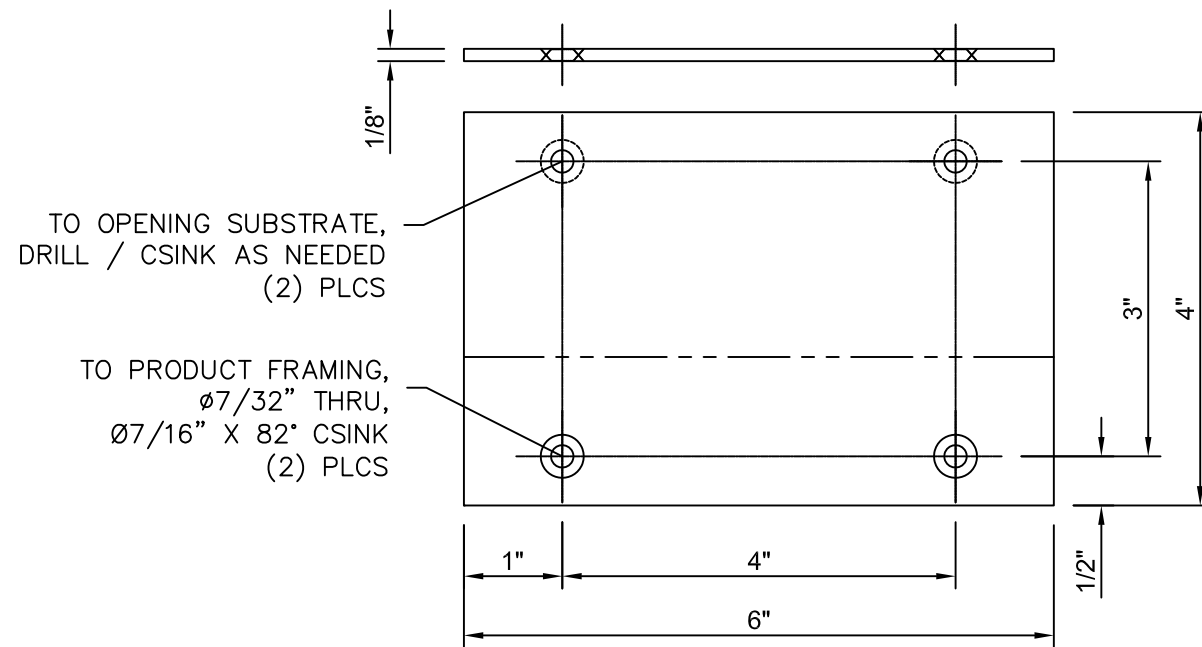

20 STRAP ANCHOR TO CONCRETE OR MASONRY SUBSTRATES
MATL: ALUM BRAKE MTL






KAWNEER
555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PH. 770-449-5555
WWW.KAWNEER.COM

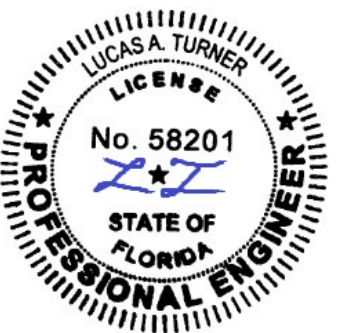


8/18/2026
LUCAS A. TURNER
FL P.E. #58201
TURNER ENGINEERING & CONSULTING, INC.
2428 OLD NATCHEZ TRACE TRL.
CAMDEN, TN 38320
PH. 941-380-1574

DRAWING NO. 451UT-Cntr-PreGlaze	PRODUCT TRIFAB 451UT
FPA # FL10008	SECTION 03
DATE 02/11/2021	SHEET 04 OF 08
SCALE NTS	

REV. #	DATE	PRINTS ISSUED FOR
2	8/18/2026	2026 FBC UPDATE
1	8/17/2023	2023 FBC UPDATE
-	02/11/2021	INITIAL RELEASE

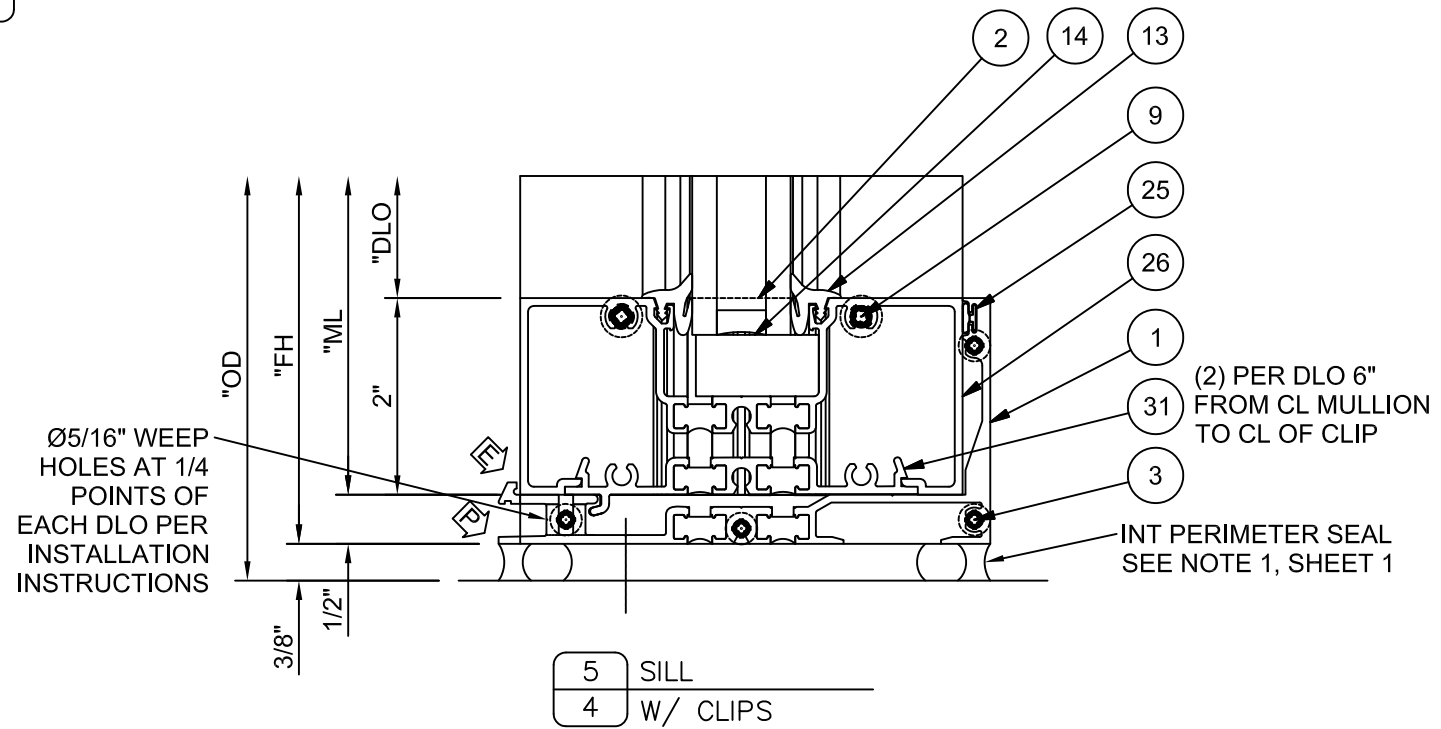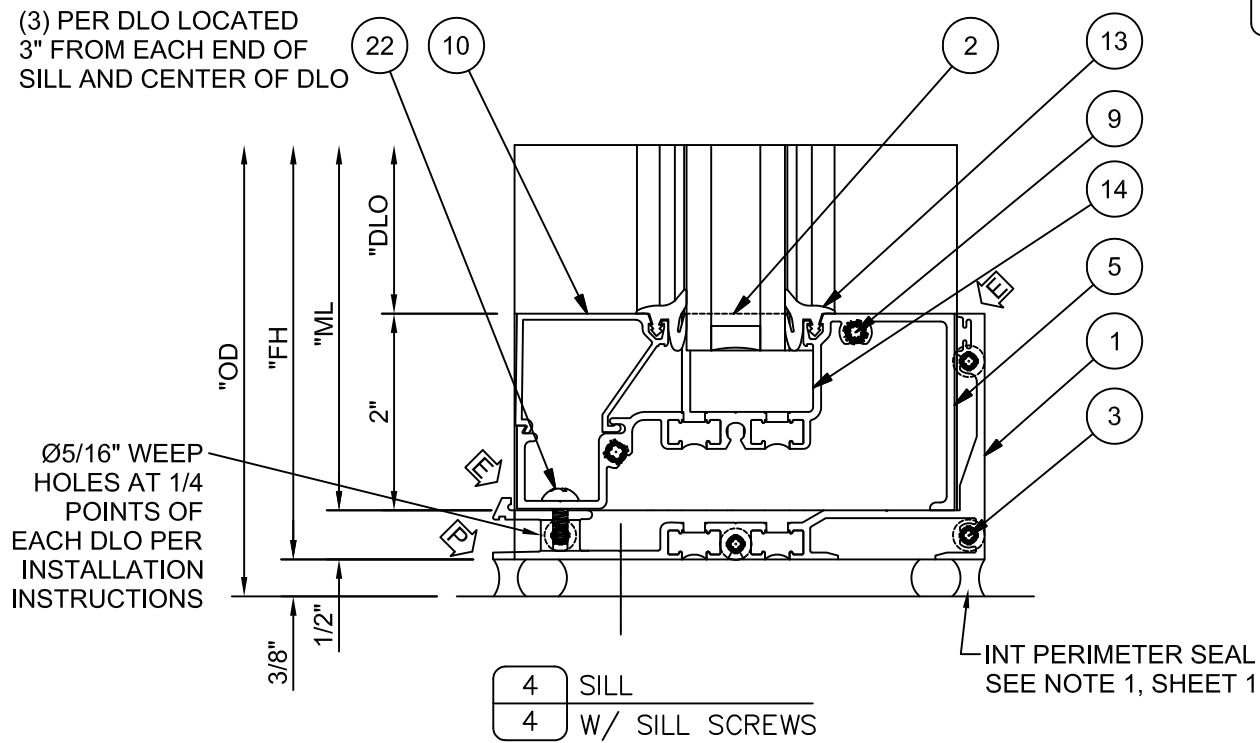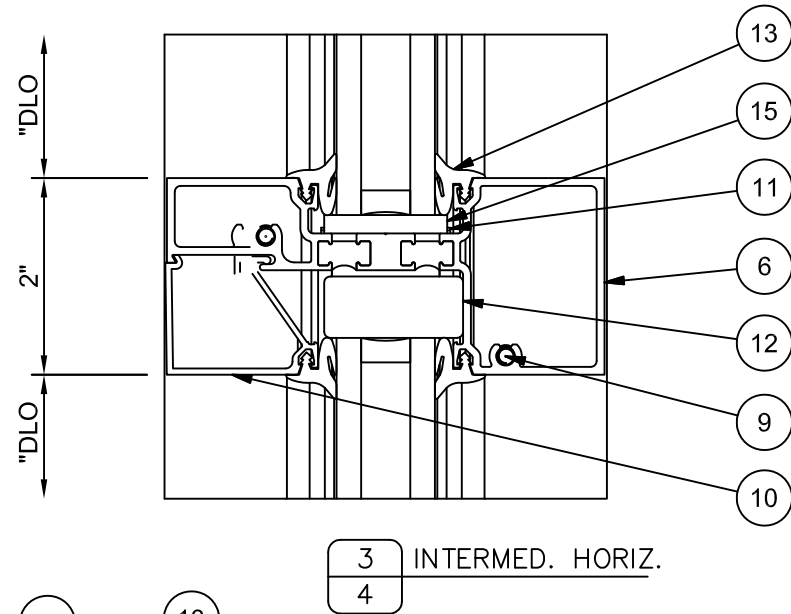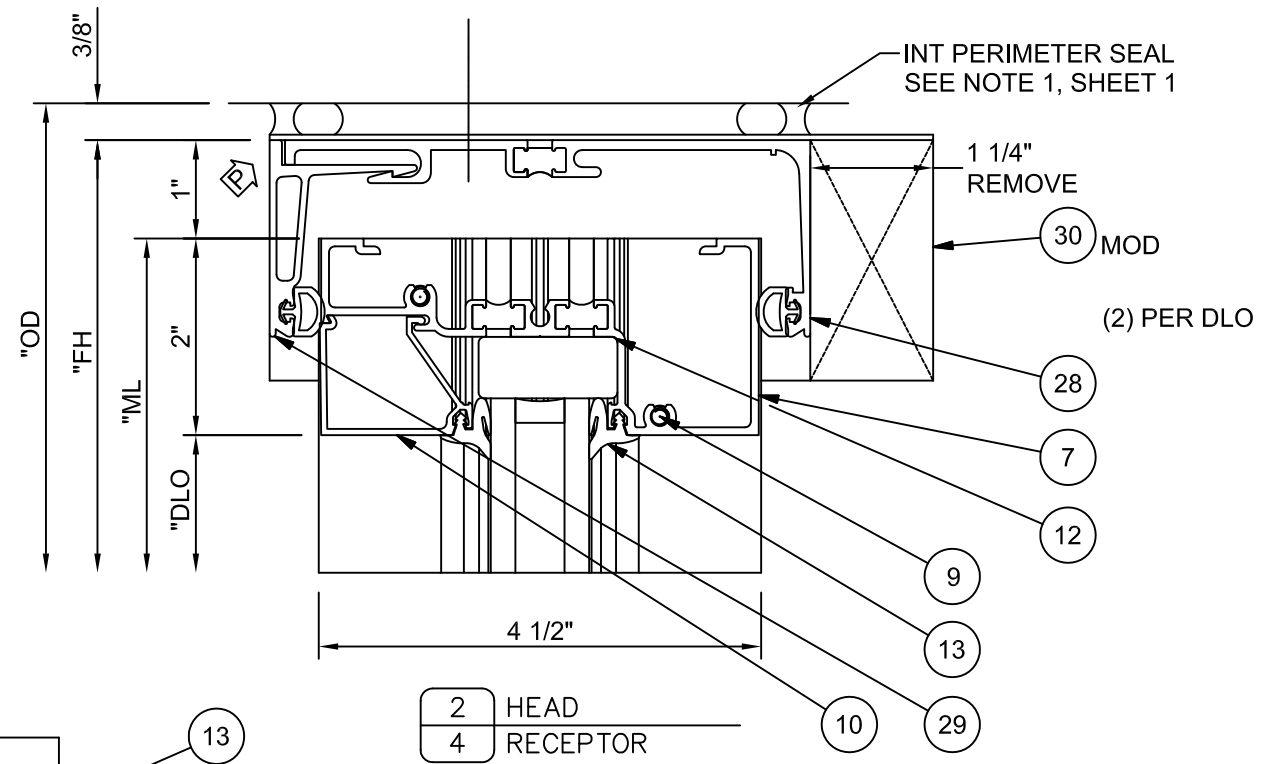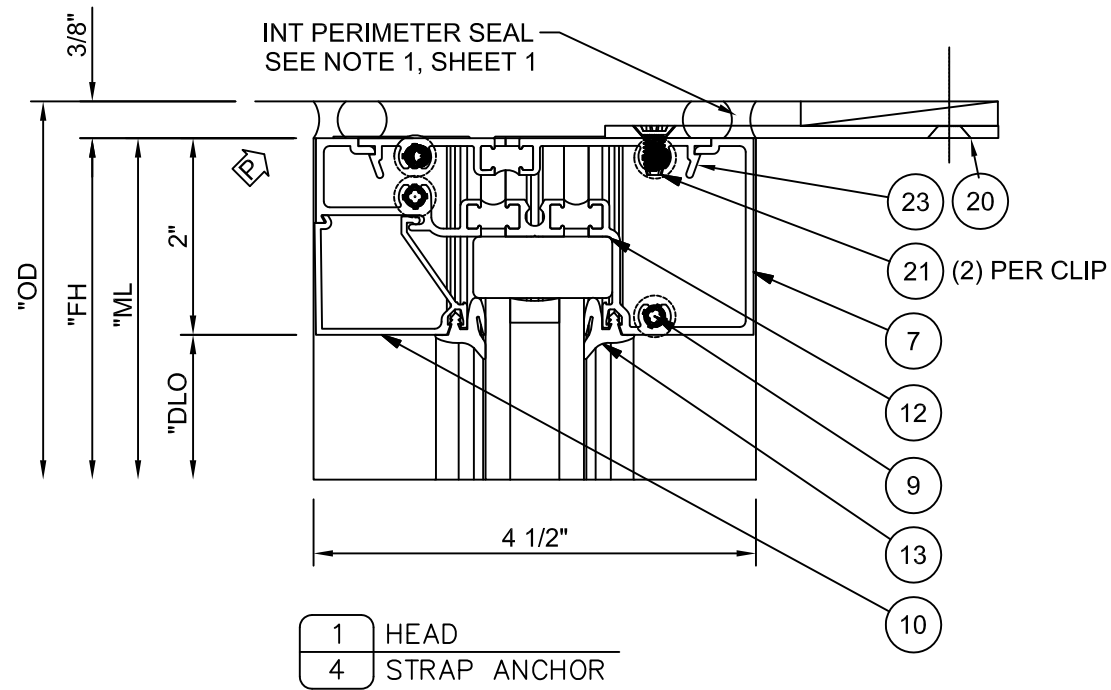

555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PH. 770-449-5555
WWW.KAWNEER.COM

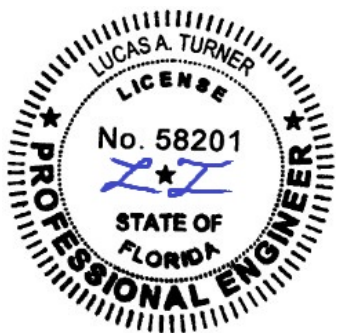


8/18/2026
LUCAS A. TURNER
FL P.E. #58201

TURNER ENGINEERING &
CONSULTING, INC.
2428 OLD NATCHEZ TRACE TRL.
CAMDEN, TN 38320
PH. 941-380-1574


DRAWING NO. 451UT-Cntr-PreGlaze	PRODUCT TRIFAB 451UT
FPA # FL10008	SECTION 03
DATE 02/11/2021	SHEET 05 OF 08
SCALE NTS	

REV. #	DATE	PRINTS ISSUED FOR
2	8/18/2026	2026 FBC UPDATE
1	8/17/2023	2023 FBC UPDATE
-	02/11/2021	INITIAL RELEASE

JAMB AND MULLION LOAD CAPACITY					
DIMENSION			JAMB "J1"	MULLION "M1"	JAMB "J2"
WIDTH "W" (in.)	MULL HEIGHT "H" (in.)	MAX. DLO (in.)	(+/- psf)	(+/- psf)	(+/- psf)
25 1/8	71 1/2	32 1/2	52.5	52.5	52.5
31 1/8			52.5	52.5	52.5
37 1/8			48.9	48.9	48.9
43 7/8			35.0	35.0	35.0
49 1/8			22.3	22.3	22.3
55 1/8			14.0	14.0	14.0
25 1/8	83 1/2	38	52.5	52.5	52.5
31 1/8			52.5	52.5	52.5
37 1/8			46.8	46.8	46.8
43 7/8			35.0	35.0	35.0
49 1/8			22.3	22.3	22.3
25 1/8			52.5	52.5	52.5
31 1/8	95 1/2	43 1/2	45.4	45.4	45.4
37 1/8			39.6	39.6	39.6
43 7/8			35.0	35.0	35.0
25 1/8	107 1/2	49	40.3	40.3	40.3
31 1/8			32.9	32.9	32.9
37 1/8			28.0	28.0	28.0
25 1/8	119 1/2	54 1/2	29.2	29.2	29.2
31 1/8			23.8	23.8	23.8

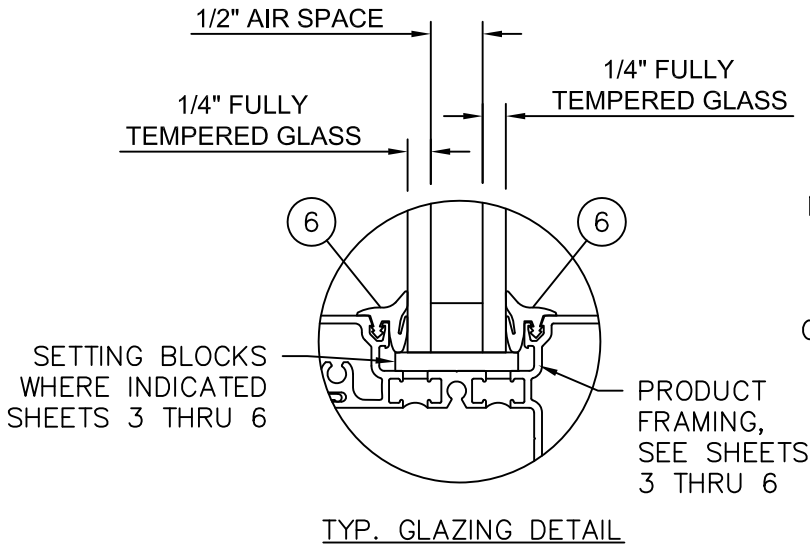


NOTE: GLAZING MEETS
OR EXCEEDS MULLION
DESIGN PRESSURES
INDICATED IN LOAD
CAPACITY TABLE ABOVE,
IN ALL SIZES.

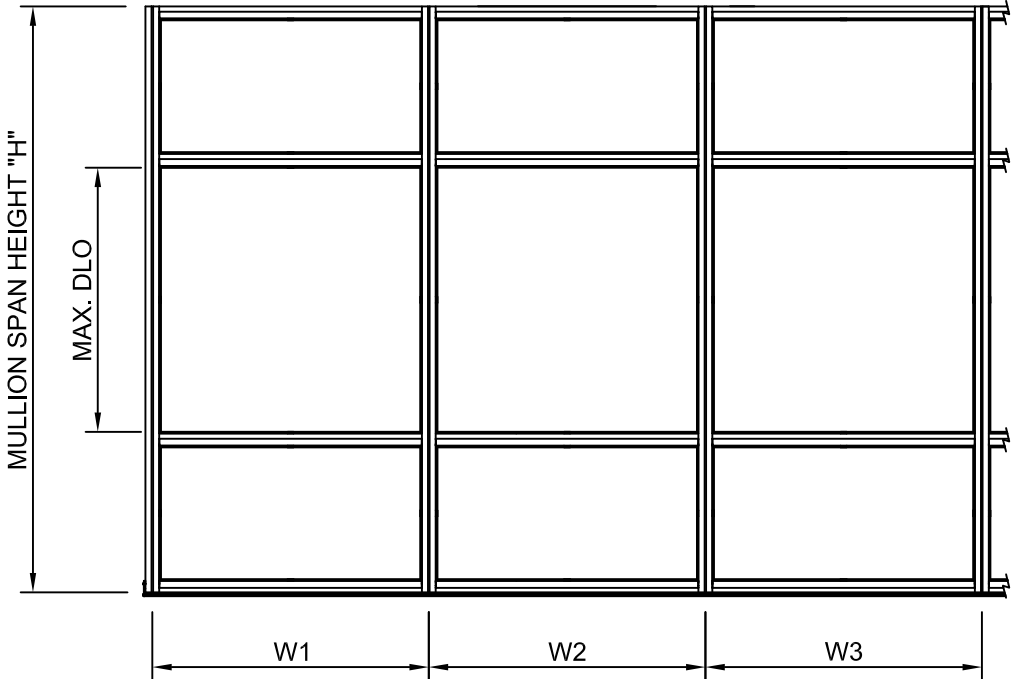

WIDTH "W" = W1 (JAMB)

WIDTH "W" = $\frac{W2 + W3}{2}$ (MULLION)

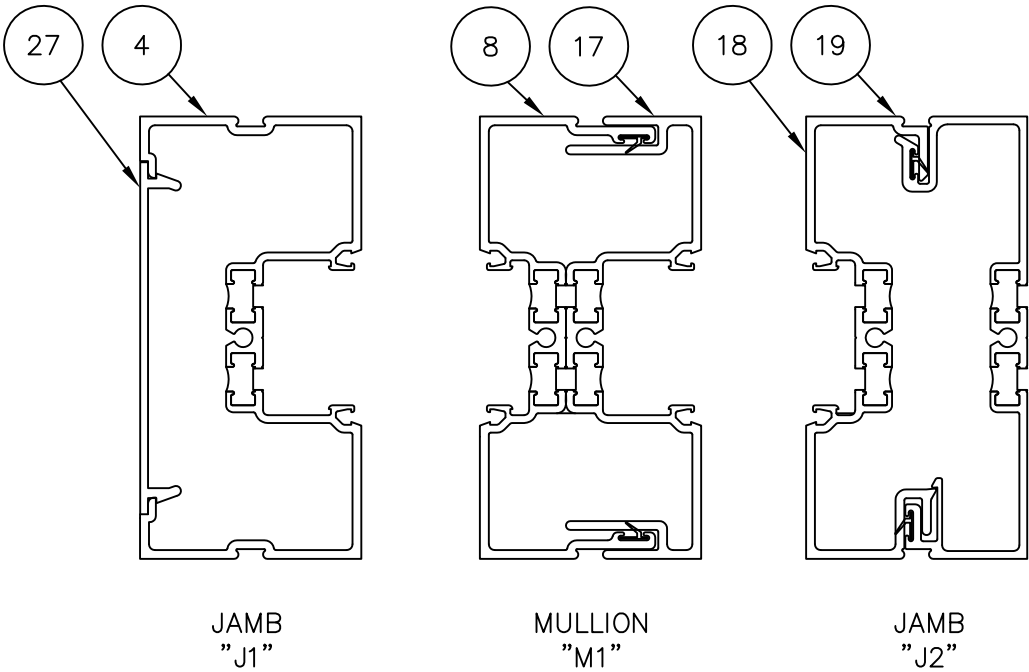

8/18/2026
LUCAS A. TURNER
FL P.E. #58201

TURNER ENGINEERING &
CONSULTING, INC.
2428 OLD NACHEZ TRACE TRL.
CAMDEN, TN 38320
PH. 941-380-1574

DRAWING NO. 451UT-Cntr-PreGlaze	PRODUCT TRIFAB 451UT
FPA # FL10008	SECTIONS 04/05
DATE 02/11/2021	SHEET 06 OF 08
SCALE NTS	


					8/18/2026		
					2	2026 FBC UPDATE	
					1	2023 FBC UPDATE	
					-	INITIAL RELEASE	
						PRINTS ISSUED FOR	
					REV. #		DATE

TABLE 1. QUALIFIED ANCHOR INFORMATION

ID	SUBSTRATE	ANCHOR	MIN. EMBEDMENT	MIN. EDGE DISTANCE
A	SOLID UNCRACKED CONCRETE (3050 PSI MIN.)	1/4" DEWALT COATED CARBON STEEL ULTRACON+	1 3/4"	2 1/2"
B	CMU (ASTM C-90) (JAMBS ONLY)	1/4" DEWALT COATED CARBON STEEL ULTRACON+	1 3/4"	2 1/2"
C	SOLID UNCRACKED CONCRETE (3350 PSI MIN.)	1/4" DEWALT CRETE-FLEX SS4 MASONRY SCREW	1 3/4"	1"
D	CMU (ASTM C-90) (JAMBS ONLY)	1/4" DEWALT CRETE-FLEX SS4 MASONRY SCREW	1 1/4"	2 1/2"
E	SOLID UNCRACKED CONCRETE (2000 PSI MIN.)	1/4" ITW COATED CARBON STEEL TAPCON	1 1/2"	1 1/2"
F	CMU (DENSITY > 117 PCF) (JAMBS ONLY)	1/4" ITW COATED CARBON STEEL TAPCON	1"	2"
G	CONCRETE (3000 PSI MIN)	1/4" HILTI COATED CARBON STEEL OR STAINLESS STEEL KWIK-CON II	1"	2 1/2"
H	CMU (ASTM C-90)	1/4" HILTI COATED CARBON STEEL OR STAINLESS STEEL KWIK-CON II	1"	2 1/2"
I	2x MIN. SOUTHERN PINE WOOD (G=0.55 MIN)	#14 GRADE 5 WOOD SCREW	1 1/2"	1"
J	16 GAUGE (0.060") MIN. STEEL STUD (33 KSI YIELD MIN.) OR 1/8" MIN. ALUMINUM (6063-T5 MIN.) OR 1/8" MIN. A36 STEEL	#1/4-14 ITW TEKS SELF-DRILLING SCREW	FULL + 3 THREADS	1/2"

COASTAL COMPLIANCE NOTE:
THE ANCHORAGE INDICATED HERE IS
APPLICABLE TO NON-COASTAL
AREAS. IF PROJECT IS WITHIN 3000
FT OF A SALTWATER COASTLINE, THE
ANCHORAGE SHALL BE EVALUATED
FOR COMPLIANCE WITH FBC SECTION
1711. SEE EVALUATION REPORT FOR
THIS PRODUCT APPROVAL FOR
ADDITIONAL INFORMATION.

2026 FBC UPDATE	2	8 /18 /2026	
2023 FBC UPDATE	1	8 /17 /2023	
INITIAL RELEASE	-	02 /11 /2021	
PRINTS ISSUED FOR	REV. #	DATE	

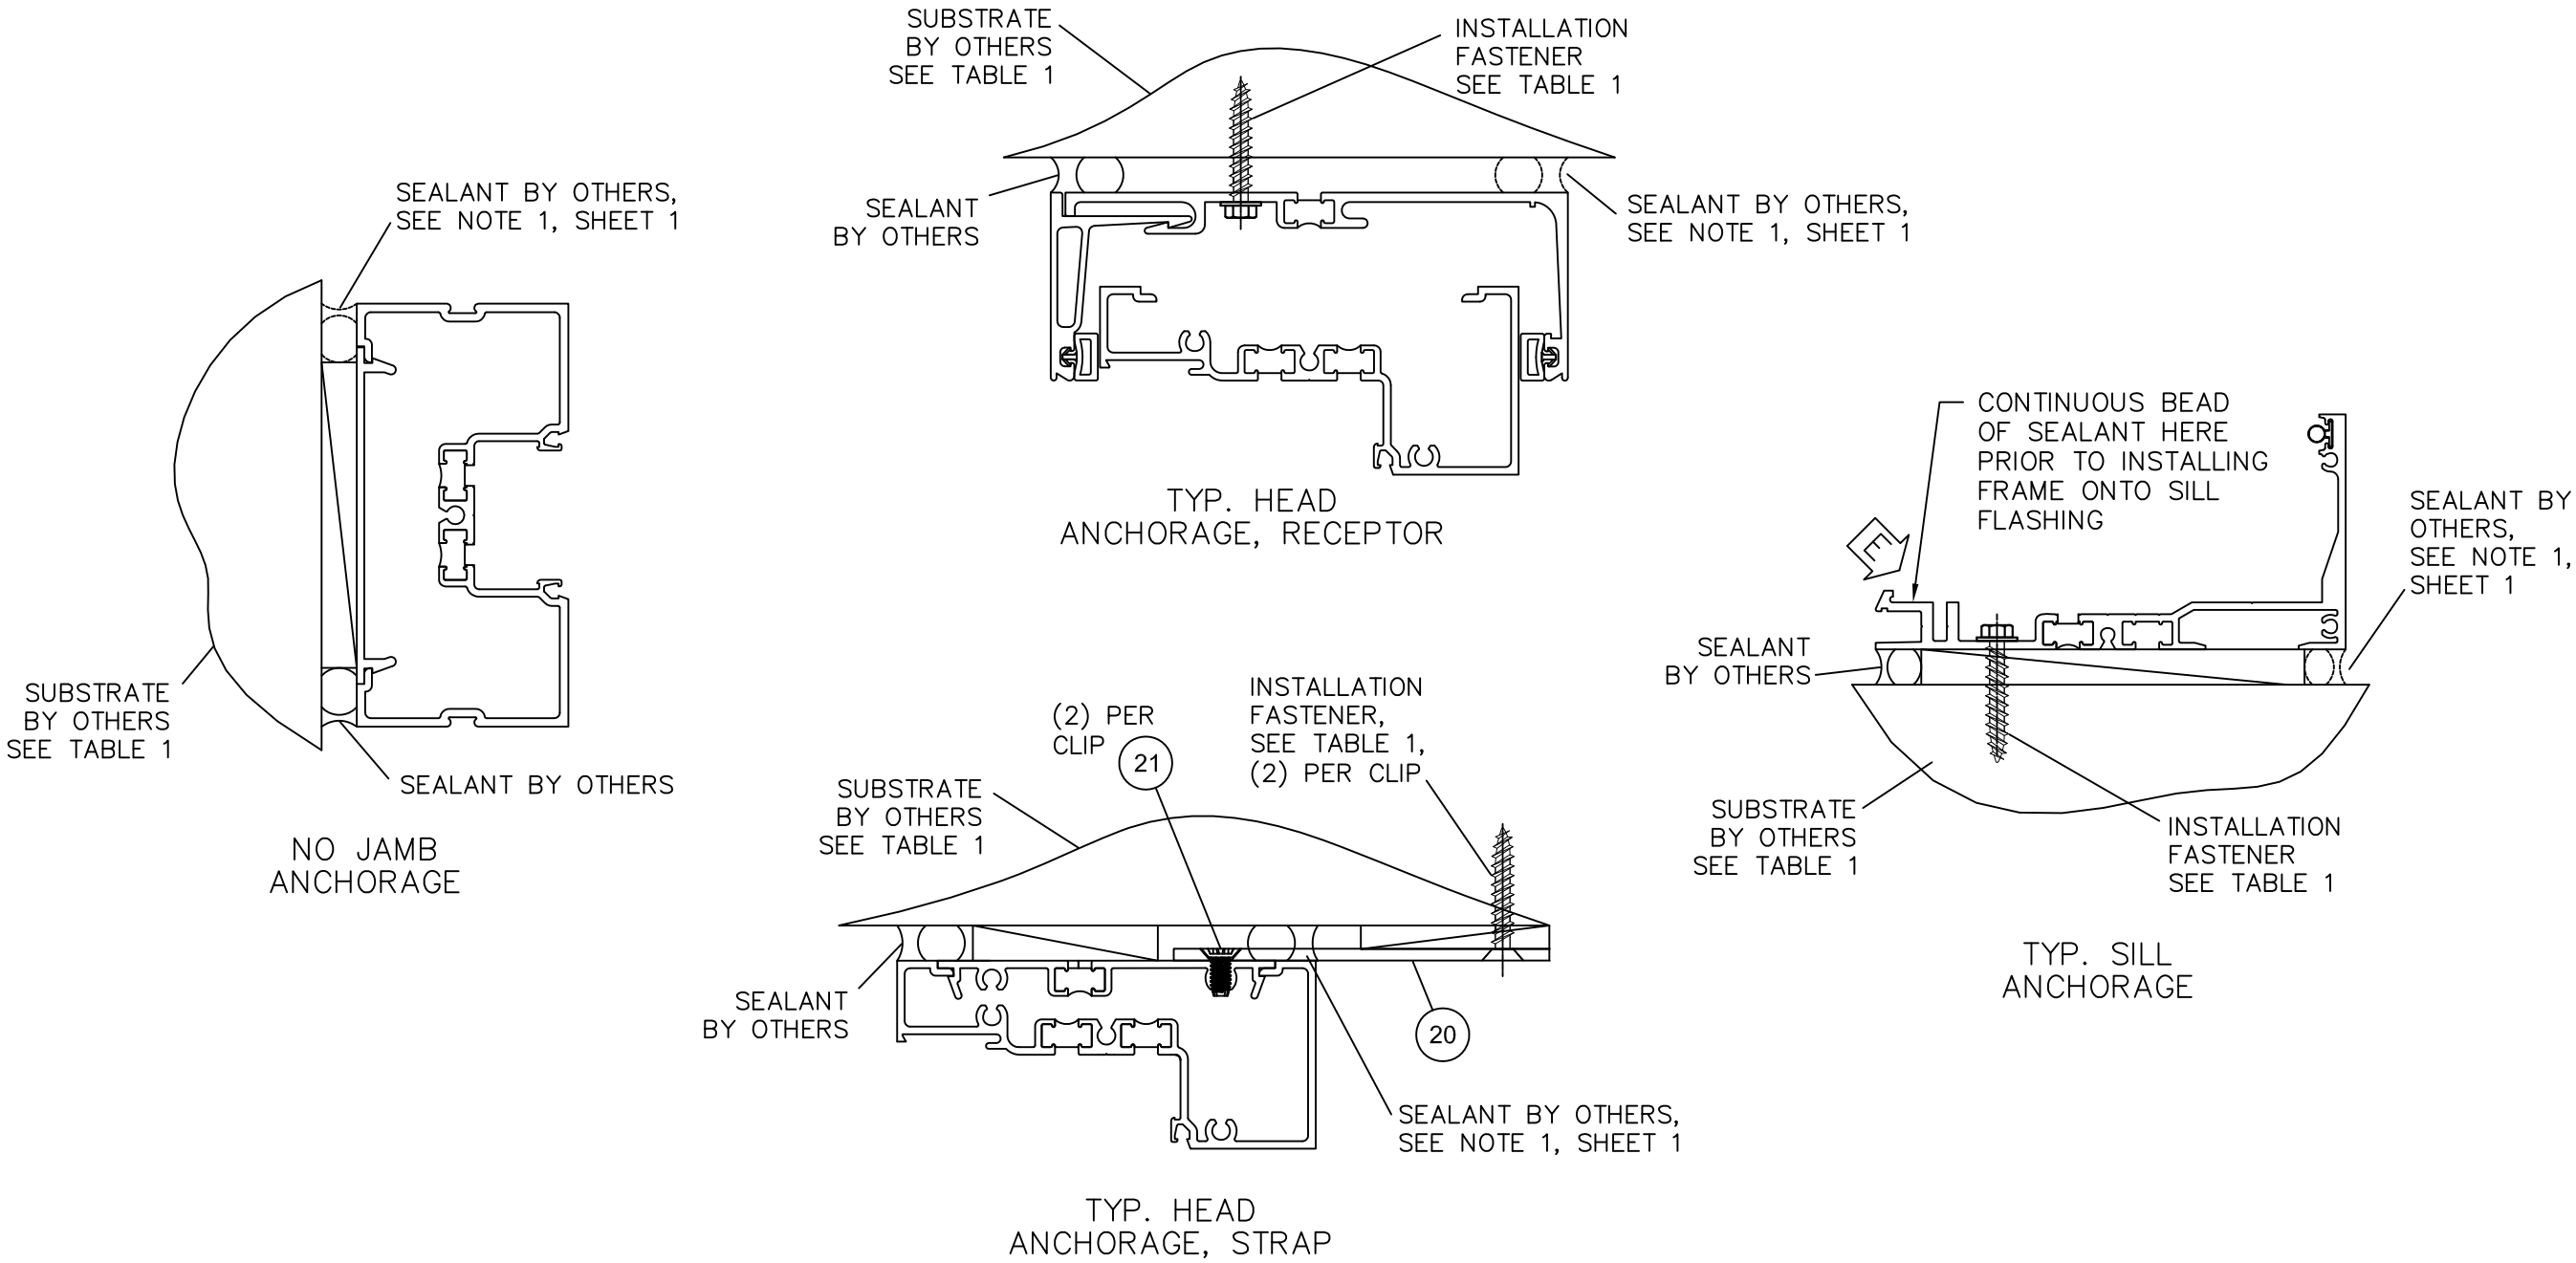



555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PH. 770-449-5555
WWW.KAWNEER.COM




8/18/2026
LUCAS A. TURNER
FL P.E. #58201

TURNER ENGINEERING &
CONSULTING, INC.
2428 OLD NATCHEZ TRACE TRL.
CAMDEN, TN 38320
PH. 941-380-1574


DRAWING NO. 451UT-Cntr-PreGlaze	PRODUCT TRIFAB 451UT
FPA # FL10008	SECTION 06
DATE 02/11/2021	SHEET 07 OF 08
SCALE NTS	

ITEM	PART NUMBER	PART DESCRIPTION
1	451UTVG037	451UT SILL FLASHING
2	451TVG316	END DAM / SCREW APPLIED / ABS
3	028808	#8 X 1/2 TYPE I CRPHTFS AB
4	451UTC080	451UT PG FIRST BAY JAMB STD
5	451UTC014	451UT SILL / CENTER
6	452TCG011	451UT HORIZONTAL / CENTER
7	452TCG003	451UT HEAD / CENTER
8	451UTC0581	451UTC081 W/ WEATHERING
9	028856	#12 X 1 1/8 TYPE I CRPHTFS AB
10	451CG004	GLASS STOP / CENTER
11	451105	WATER DEFLECTOR
12	127461	0.625 X 1.413 X 1.413 SET BLK
13	027074	WEDGE GASKET
14	027073	0.625 x 1.25 x 4.125 SET BLOCK
15	027081	SETTING BLK .1875X1.250X4.125
16	027907	SIDE BLOCK
17	451UTC082	451UT PG MULL HALF DP STD
18	451UTC083	451UT PG LAST BAY JAMB STD
19	451UTC0584	451UTC084 W/ WEATHERING
20	STRAP ANCHOR	BY INSTALLER
21	028843	#12 X 1/2 TYPE I CRFCHTFS B
22	128407	10 X 7/16 TYPE I CRPHTFS B
23	451TCG163	451T FLAT FILLER
24	027908	W - BLOCK (0.600)
25	127043	WEATHERING
26	452TCG001	451UT MULLION / CENTER
27	452145	NON-STRUCT SHIM BKR
28	451TVG570	RECEPTOR W/ WEATHERING
29	451VG573	RECEPTOR FACE W/ WEATHERING
30	601CG317	HEAD RECEPTOR END DAM
31	451UTC0365	451UT TALL SILL FILLER CLIP


ALL ALUMINUM COMPONENTS ARE 6063-T6

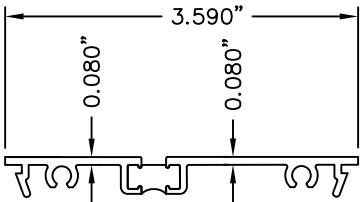


23 451TCG163

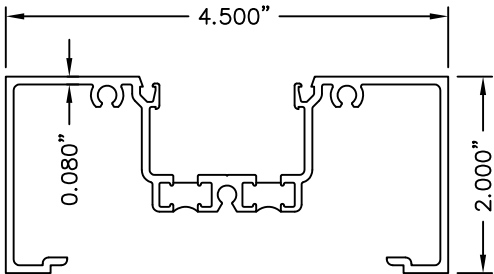


26 452TCG001

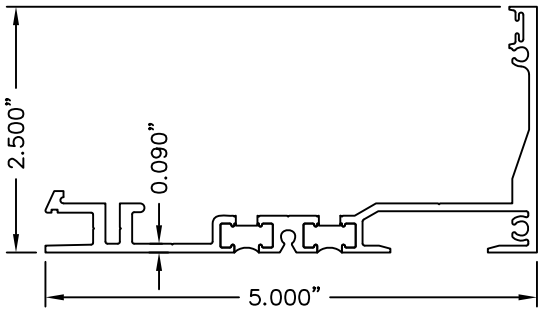

1 451UTVG037

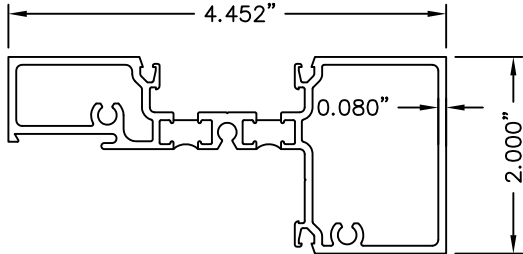


6 452TCG011

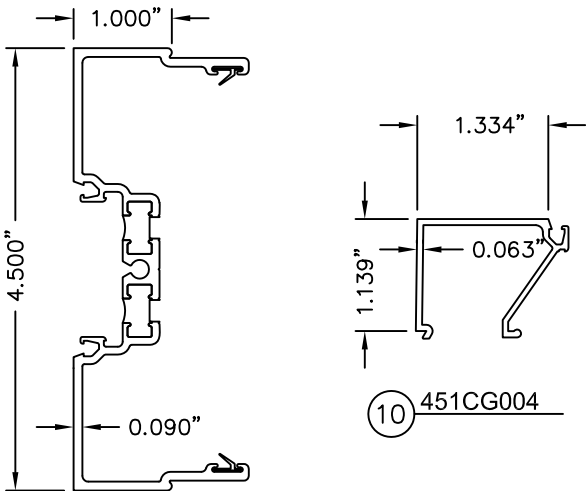


8 451UTC0581


10 451CG004

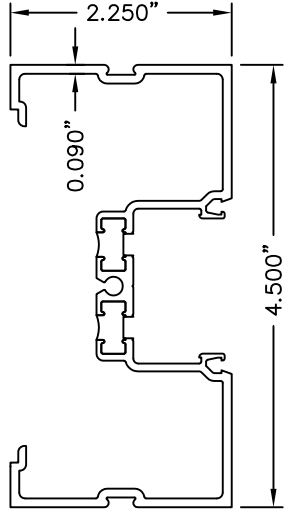


4 451UTC080

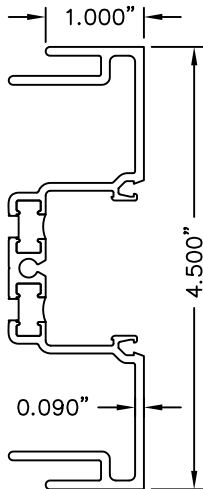


17 451UTC082

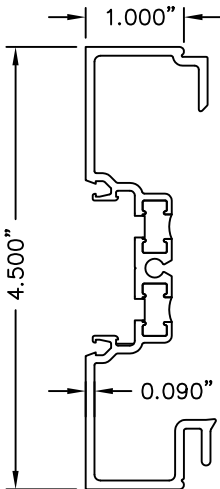


18 451UTC083

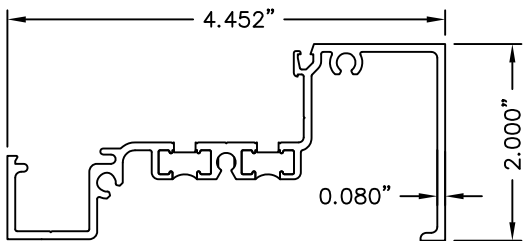


5 451UTC014

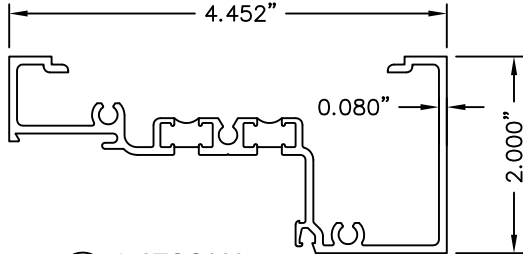


7 452TCG003

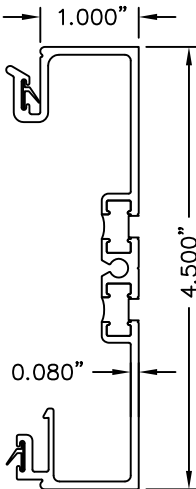

19 451UTC0584




29 451VG573

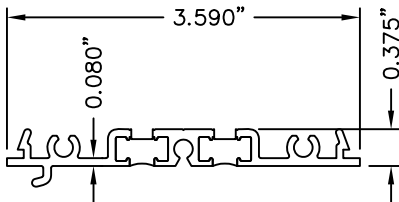

31 451UTC0365




27 452145

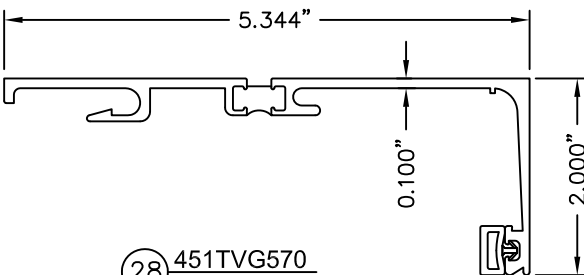

28 451TVG570



555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PH. 770-449-5555
WWW.KAWNEER.COM

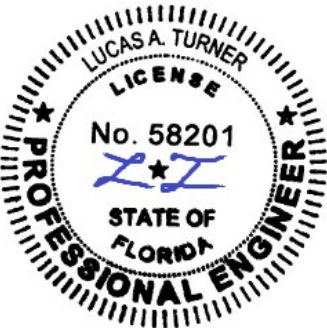

8/18/2026
LUCAS A. TURNER
FL P.E. #58201

TURNER ENGINEERING &
CONSULTING, INC.
2428 OLD NATCHEZ TRACE TRL.
CAMDEN, TN 38320
PH. 941-380-1574

DRAWING NO. 451UT-Cntr-PreGlaze	PRODUCT TRIFAB 451UT
FPA # FL10008	SECTIONS 07/08
DATE 02/11/2021	SHEET 08 OF 08
SCALE NTS	