
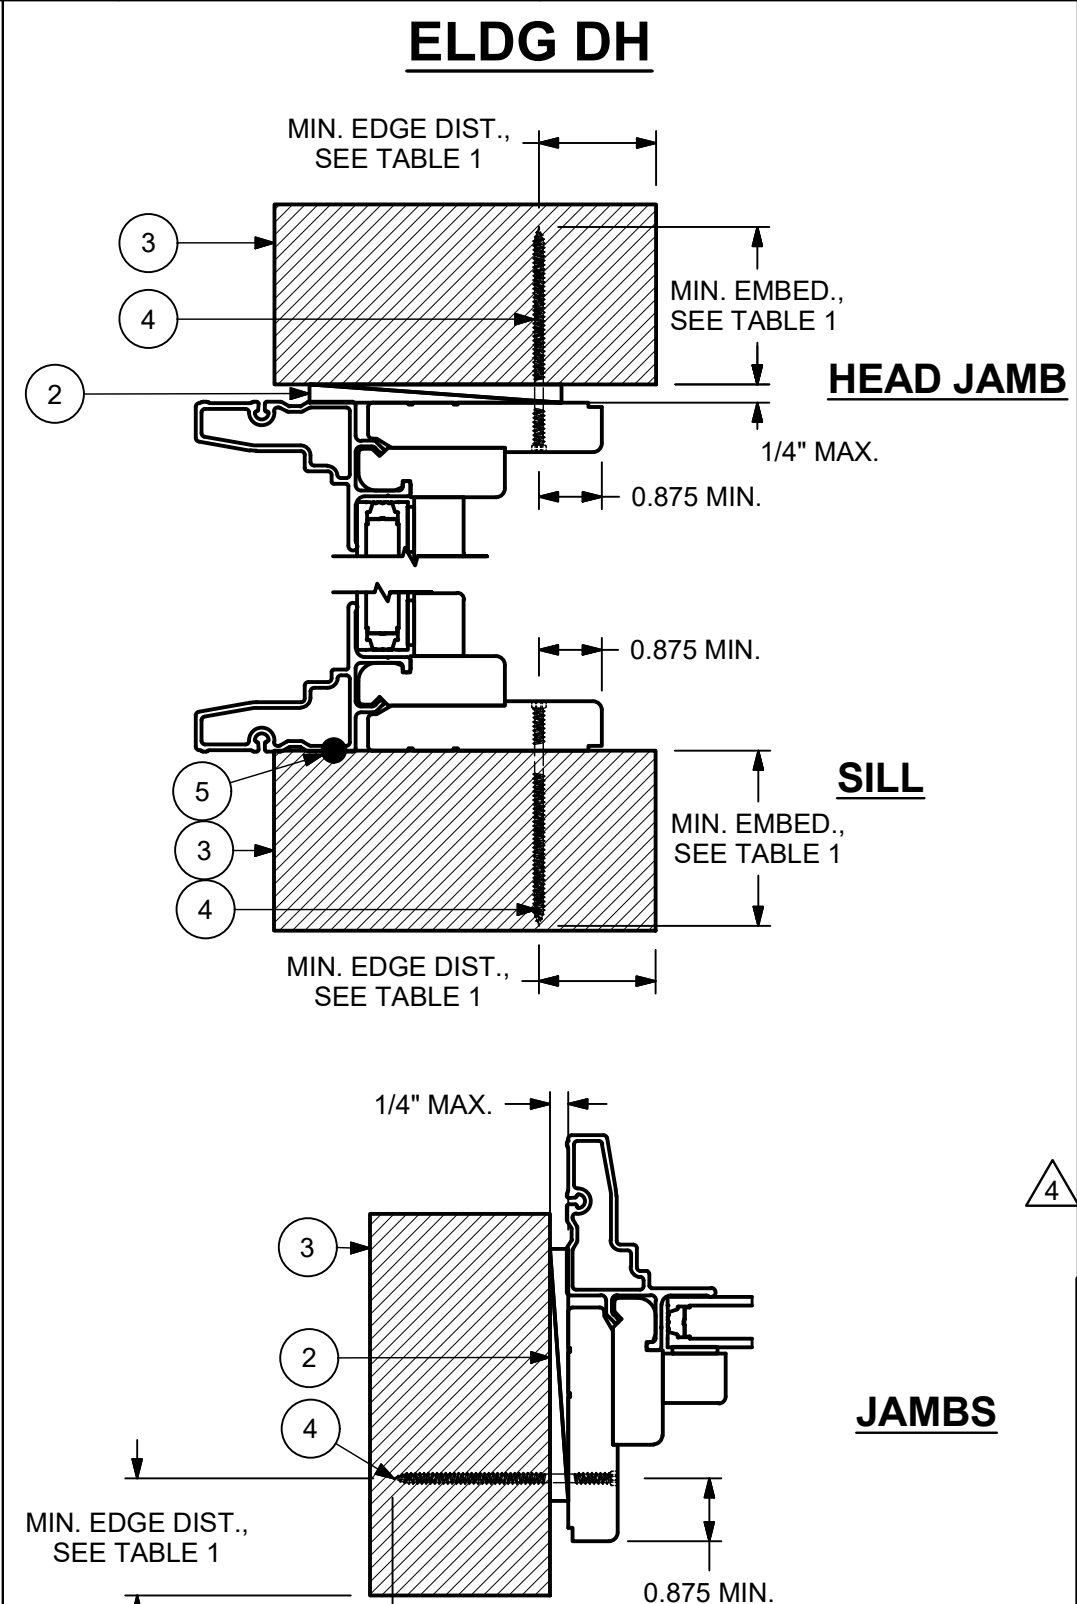



TABLE 1: FRAME INSTALLATION ANCHOR REQUIREMENTS ⁵			
SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED.	MIN. EDGE DIST.
CONCRETE (2.0 KSI MIN)	3/16" ITW TAPCON	1-1/2"	1-1/8"
HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	2"
16 GAUGE (0.060") MIN. STEEL STUD, 33 KSI YIELD MIN., OR 1/8" ALUM. 6063-T5 MIN.	#10-16 HILTI KWIK-FLEX OR ITW TEKS SELF-DRILLING SCREW	3 THREADS BEYOND METAL WALL	1/2"

ELDG CA

ELDG DH

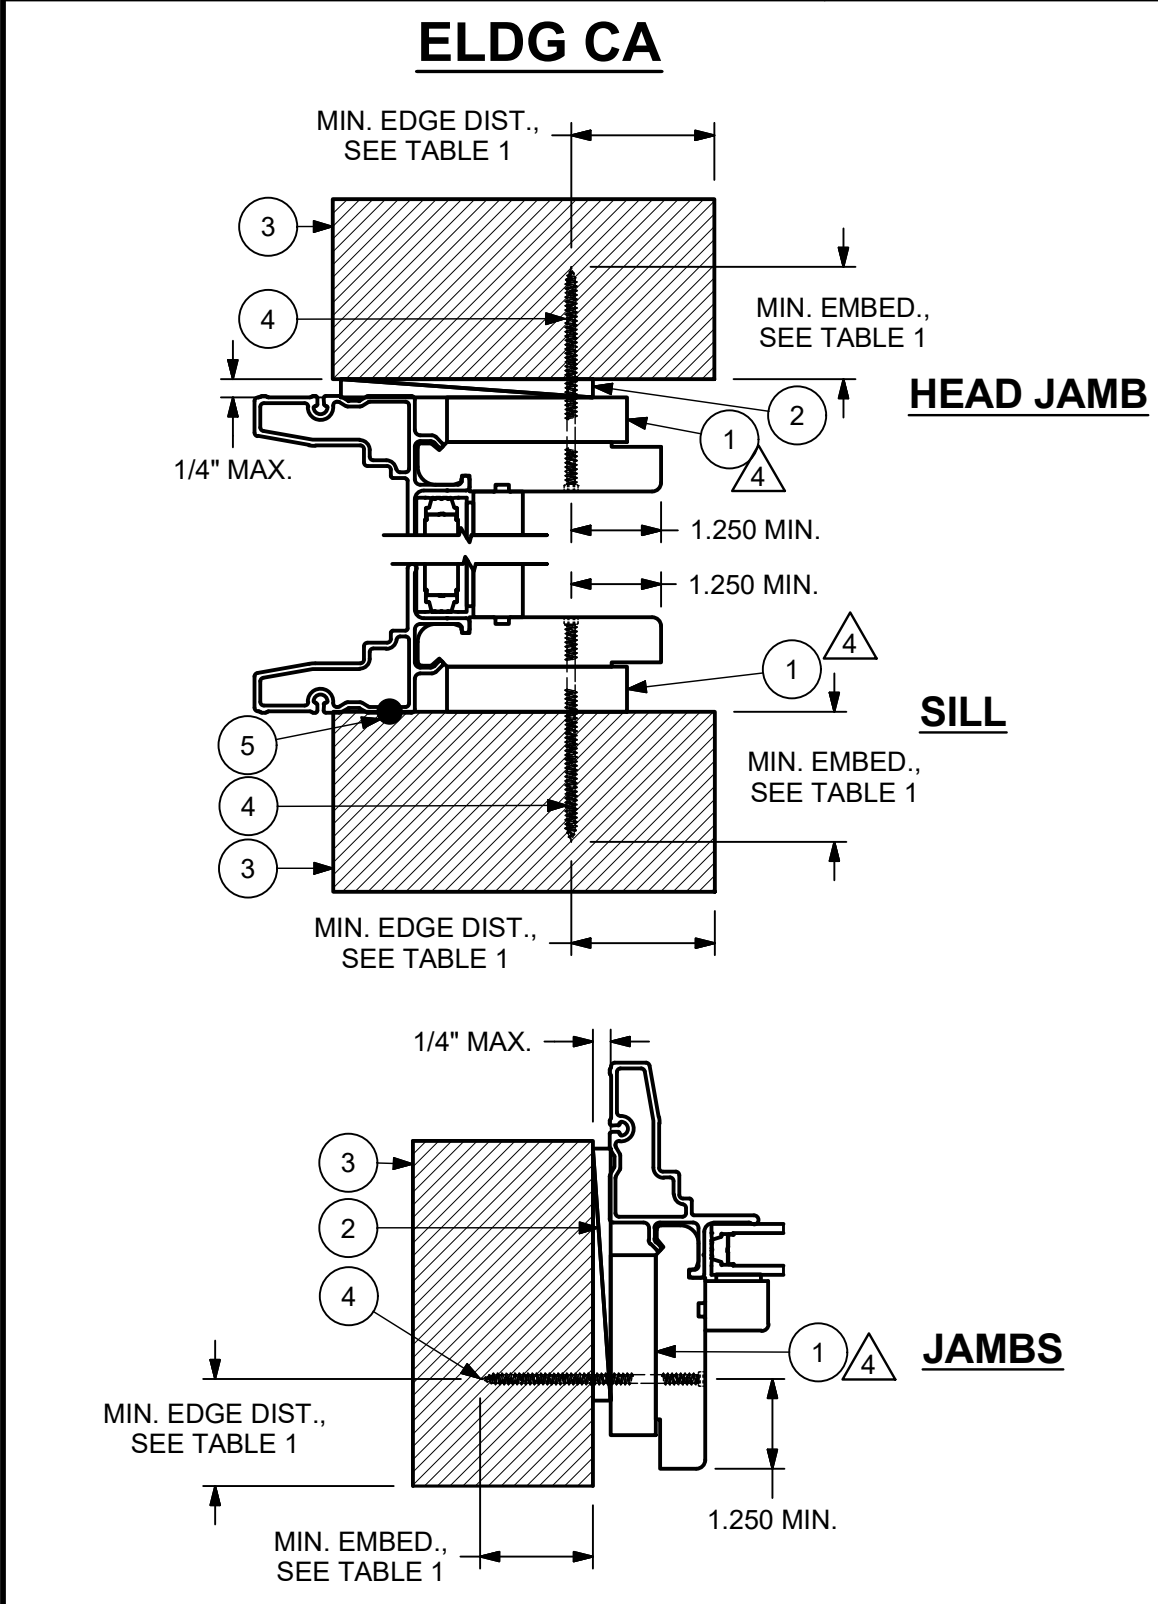

0.3	ADDED NOTES 4 AND 5 AND ASSOCIATED DELTA TRIANGLES	22832	11/28/18	JMD
REV	DESCRIPTION / REQUESTOR	ECN NO	DATE	REV BY



9/26/2023
LUCAS TURNER
FL PE 58201
TURNER ENGINEERING &
CONSULTING, INC.
2428 OLD NATCHEZ TRACE
TRL. CAMDEN, TN, 38320
PH 941-380-1574

Lucas Turner
2023.09.26
17:47:41
-05'00'

THROUGH JAMB INSTALLATION:
- SECURE UNIT TO FRAMING AT EACH LOCATION WITH ONE FASTENER PER TABLE 1. SEE ELEVATIONS (DOC 00114428) FOR SCREW LOCATIONS
- PLACE ONE NON-CONTINUOUS 5/16" DIAMETER BEAD OF ASTM C920 GRADE NS CLASS 25 SEALANT ON THE SILL FRAMING UNDER THE WINDOW

- NOTES:**
- 1. FOR GENERAL SPECIFICATIONS, REFER TO DOC 00003952
 - 2. FLORIDA PRODUCT APPROVAL: FL10172
 - 3. FOR ELEVATIONS AND ADDITIONAL REQUIREMENTS, REFER TO DOC 00114428
 - △ 4. FILLER BOARD IS SUPPLIED BY OTHERS AND NEEDS TO STRUCTURALLY SUPPORT THE WINDOW
 - △ 5. FOR ALL FRAME INSTALLATION ANCHORS, PRE-DRILLING THROUGH FRAME AND FILLER BOARD IS RECOMMENDED

5	NA	ASTM C920 GRADE NS CLASS 25 SEALANT
4	NA	INSTALLATION FASTENER, SEE TABLE 1
3	NA	FRAMING MATERIAL
2	NA	SHIMS
1	NA	FILLER BOARD 2.500" X .625"
ITEM	DWG NO	DESCRIPTION
PARTS LIST		

MARVIN Windows and Doors		RESEARCH & DEVELOPMENT WARROAD, MN, USA, (218) 386-4021	
PRODUCT CATEGORY:		ELEVATE	
UNIT TYPE:		ELDG CA, ELDG DH	
DWG TYPE:		INSTALLATION	
DESCRIPTION:		METHOD, THROUGH JAMB, NON-WOOD	
CHK:	BAJ	SIZE:	CLASS:
11/28/18		B	MISC
APP:		DWG NO:	
11/28/18		00114426	
APP:	JJJ	SCALE:	DATE:
11/28/18		3:8	08/13/18
DWG BY:		SHEET:	
SMITH, BRENDAN		1 OF 1	