




HEAD JAMB

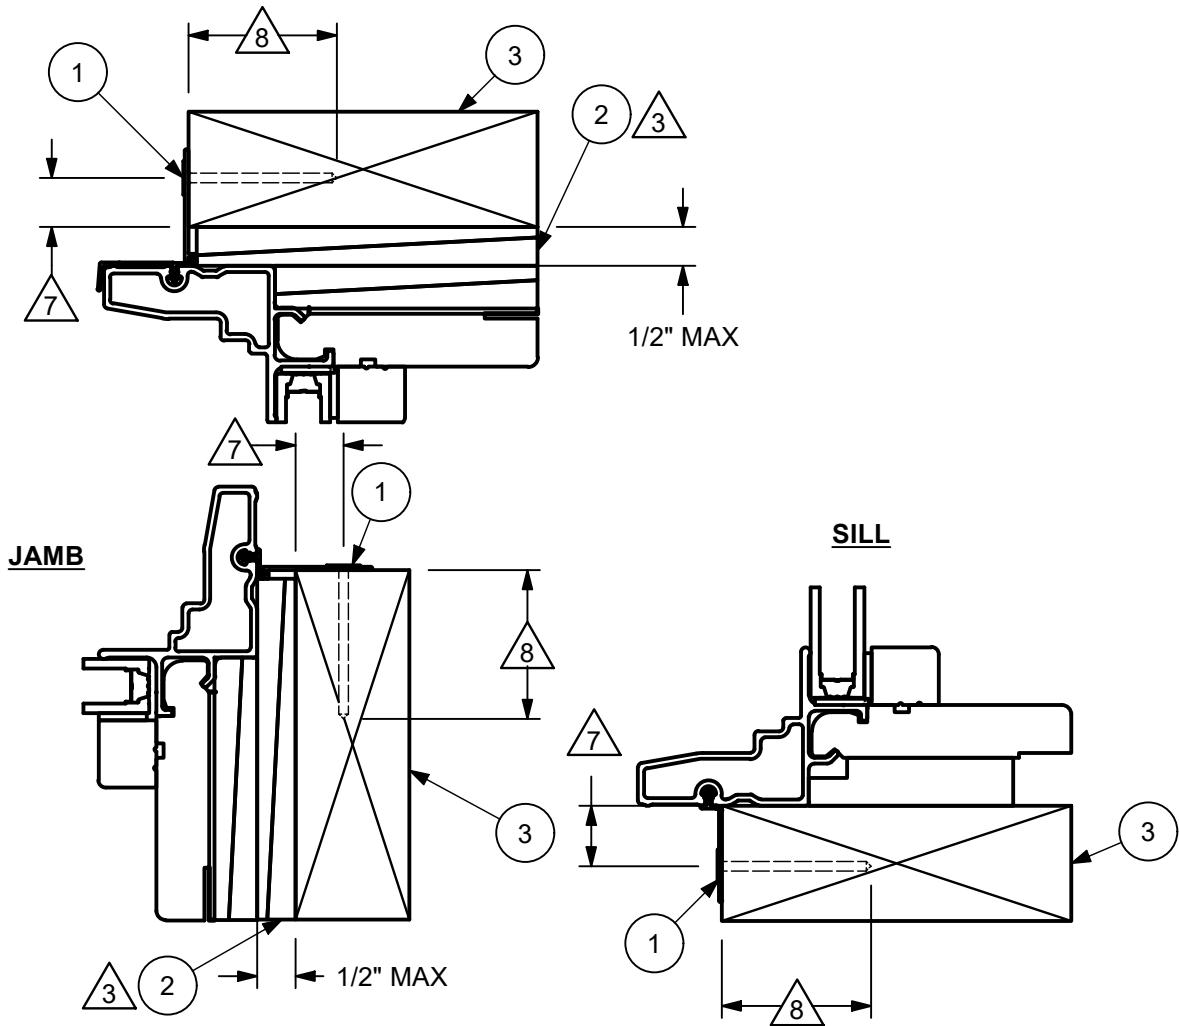

NAILING FIN INSTALLATION

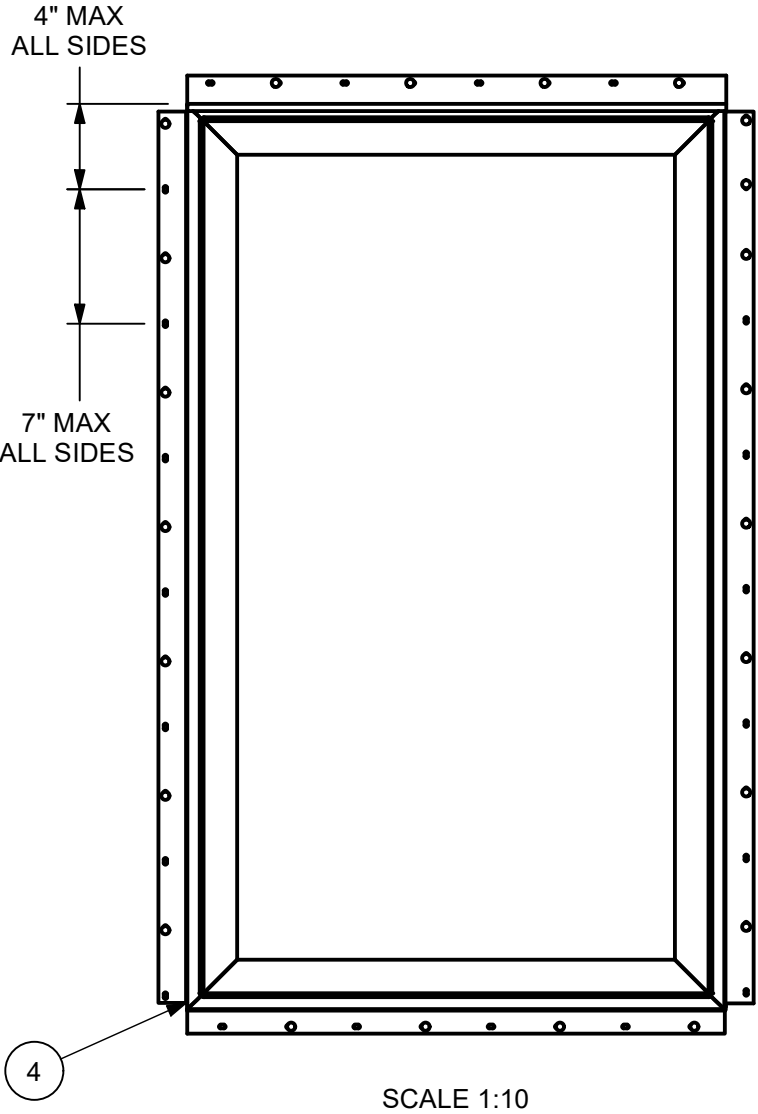

GLAZING DETAIL

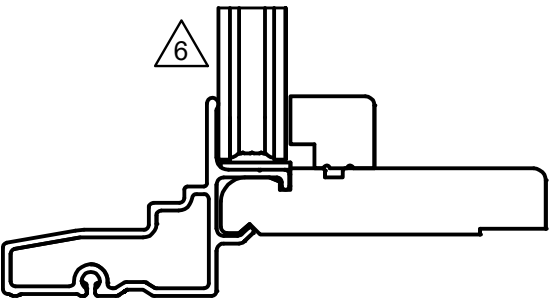

- NOTES:**
- 1. FOR GENERAL SPECIFICATIONS, REFER TO DOC 00003952
 - 2. THIS PRINT IS FOR STRUCTURAL PERFORMANCE ONLY. FOR FLASHING & SEALING INSTRUCTIONS, REFER TO THE INSTALLATION INSTRUCTIONS.
 - 3. SHIMS:
 - PLACE A SHIM WITHIN 4-6 INCHES OF EACH CORNER AND SPACE ALL OTHERS EVENLY A MAXIMUM OF 15 INCHES APART
 - 4. IF CHEMICALLY TREATED LUMBER IS USED FOR BUCK MATERIAL, FASTENERS INTO THE BUCK MUST BE A MINIMUM OF 0.90 OZ/FT^2 ZINC HOT DIPPED GALVANIZED OR STAINLESS STEEL TYPE 304 OR 316
 - 5. UNIT TYPE SHOWN: ELDG, CA FRAME TYPE
 - 6. GLASS COMPLIES WITH ASTM E1300
 - 7. MINIMUM EDGE DISTANCE: 1/2"
 - 8. MINIMUM NAIL EMBEDMENT DEPTH: 1-15/16"

NAIL FIN INSTALLATION:
- SECURE NAILING FIN WITH 2" GALVANIZED ROOFING NAILS. MINIMUM OF TWO PER SIDE. SPACE PER THE ELEVATION.

CATEGORY:
DIRECT GLAZE

UNIT TYPE:
ELDG

UNIT	MAX FRAME SIZE	DP RATING
ELDG	72 X 72	+50/-50

4	00033567	UNIT
3	-	FRAMING MATERIAL
2	-	SHIM
1	-	2" ROOFING NAIL
ITEM	DWG NO	DESCRIPTION
PARTS LIST		

MARVIN  RESEARCH & DEVELOPMENT				
COLLECTION: ELEVATE				
DWG TYPE: INSTALLATION DESCRIPTION: INSTALLATION METHODS/ELEVATIONS, NAIL FIN				
CHK: JDD 06/06/23	SIZE: B	CLASS: MISC	DWG NO: 00038197	
APP: CRR 06/05/23	SCALE: 1:10	DATE: 6/28/2005	DWG BY: SOPKOWIAK, JOHN	SHEET: 1 OF 2

6.2	ADDED MAX FRAME SIZE TABLE, UPDATED DESCRIPTION, REMOVED NOTE 7	27207	06/01/23	JH
REV	DESCRIPTION / REQUESTOR	ECN NO	DATE	REV BY