
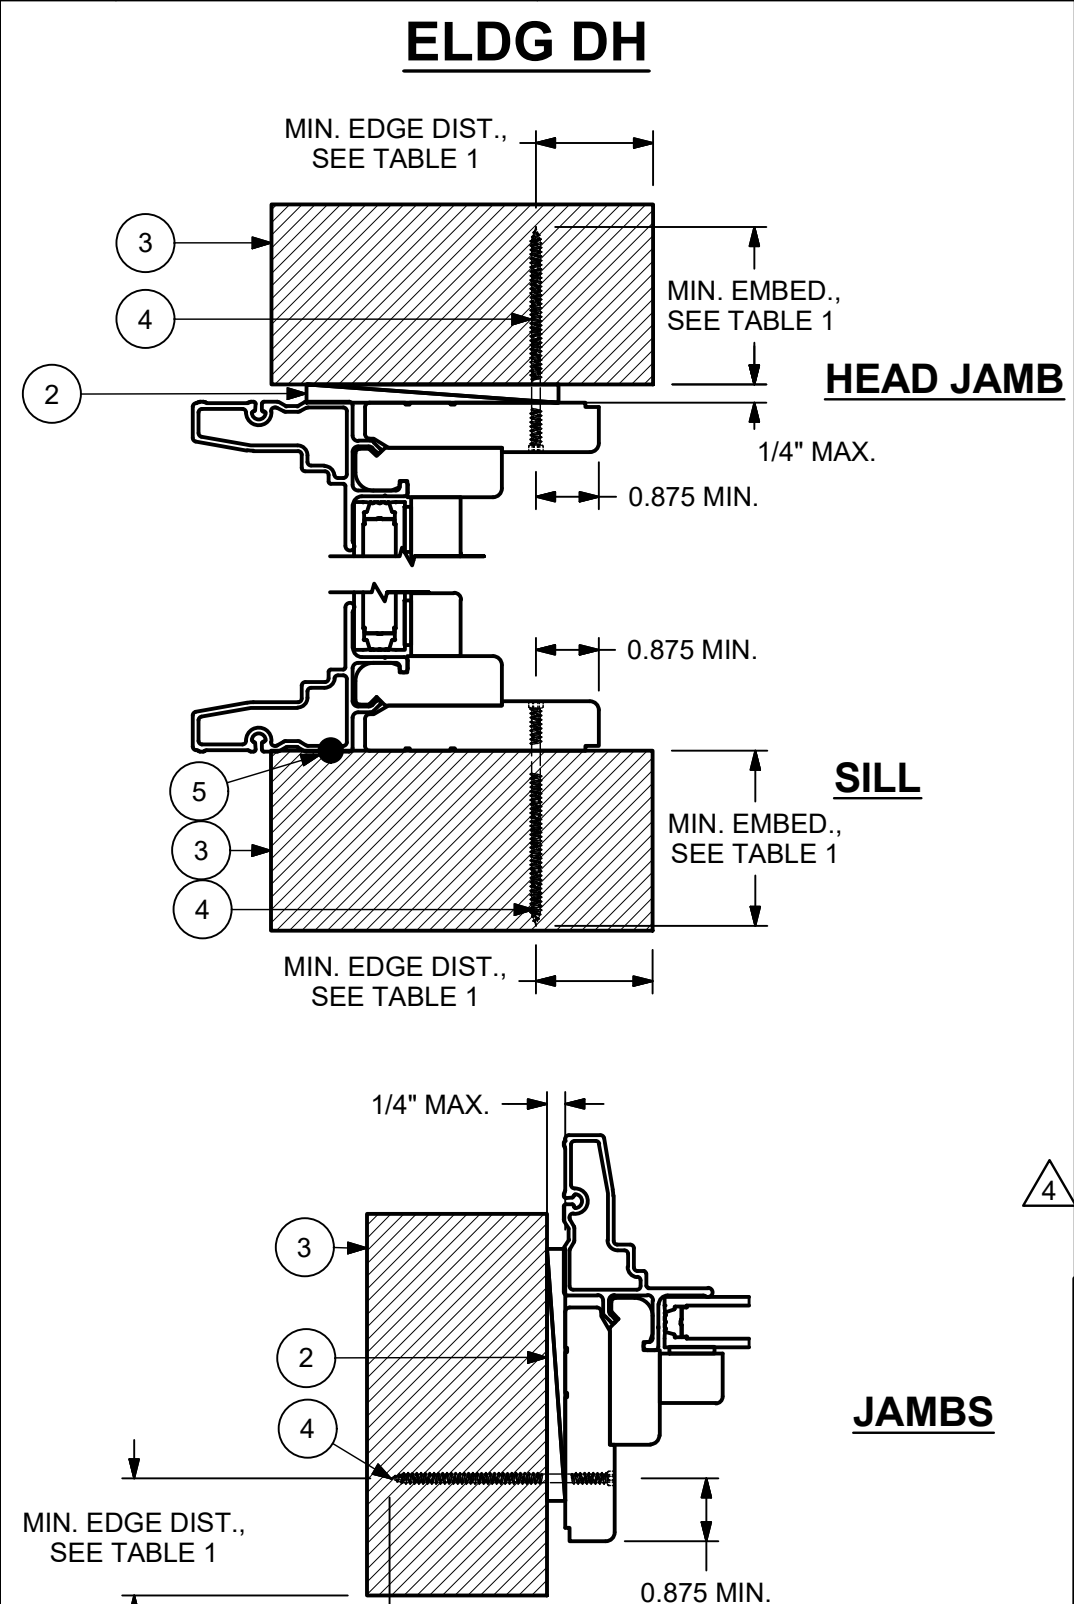


TABLE 1: FRAME INSTALLATION ANCHOR REQUIREMENTS ⁵			
SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED.	MIN. EDGE DIST.
CONCRETE (2.0 KSI MIN)	3/16" ITW TAPCON	1-1/2"	1-1/8"
HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	2"
16 GAUGE (0.060") MIN. STEEL STUD, 33 KSI YIELD MIN., OR 1/8" ALUM. 6063-T5 MIN.	#10-16 HILTI KWIK-FLEX OR ITW TEKS SELF-DRILLING SCREW	3 THREADS BEYOND METAL WALL	1/2"

ELDG CA

ELDG DH

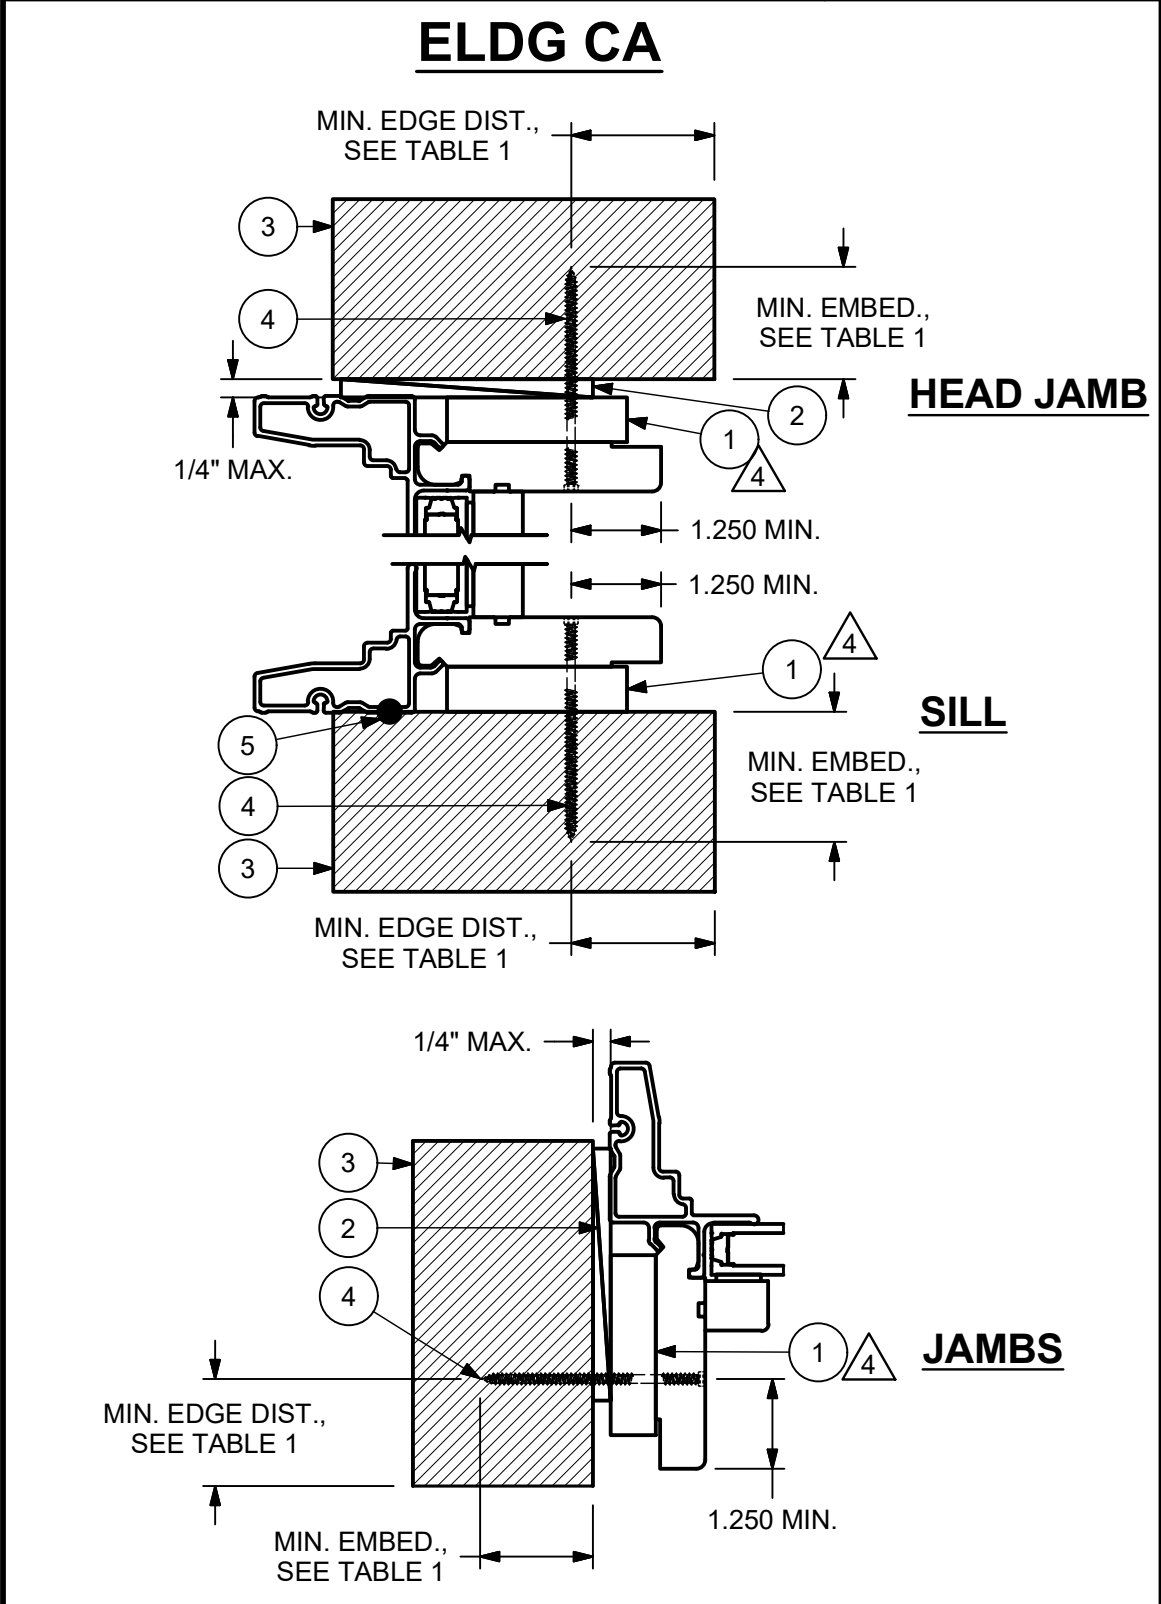

Lucas Turner
2026.09.25
11:00:34
-05'00'

9/25/2026
LUCAS TURNER
FL PE 58201
TURNER ENGINEERING & CONSULTING, INC.
2428 OLD NATCHEZ TRACE
TRL. CAMDEN, TN, 38320
PH 941-380-1574

THROUGH JAMB INSTALLATION:

- SECURE UNIT TO FRAMING AT EACH LOCATION WITH ONE FASTENER PER TABLE 1. SEE ELEVATIONS (DOC 00114428) FOR SCREW LOCATIONS
- PLACE ONE NON-CONTINUOUS 5/16" DIAMETER BEAD OF ASTM C920 GRADE NS CLASS 25 SEALANT ON THE SILL FRAMING UNDER THE WINDOW

NOTES:

1. FOR GENERAL SPECIFICATIONS, REFER TO DOC 00003952
2. FLORIDA PRODUCT APPRO113696/113282VAL: FL10172
3. FOR ELEVATIONS AND ADDITIONAL REQUIREMENTS, REFER TO DOC 00114428
- △ 4. FILLER BOARD IS SUPPLIED BY OTHERS AND NEEDS TO STRUCTURALLY SUPPORT THE WINDOW
- △ 5. FOR ALL FRAME INSTALLATION ANCHORS, PRE-DRILLING THROUGH FRAME AND FILLER BOARD IS RECOMMENDED
6. FOR FBC 1711 COASTAL COMPLIANCE, SEE EVAL. REPORT

5	NA	ASTM C920 GRADE NS CLASS 25 SEALANT
4	NA	INSTALLATION FASTENER, SEE TABLE 1
3	NA	FRAMING MATERIAL
2	NA	SHIMS
1	NA	FILLER BOARD 2.500" X .625"

ITEM	DWG NO	DESCRIPTION
PARTS LIST		

Windows and Doors

RESEARCH & DEVELOPMENT

WARROAD, MN, USA, (218) 386-4021

PRODUCT		ELEVATE	
CATEGORY:			
UNIT TYPE:		ELDG CA, ELDG DH	
DWG TYPE: INSTALLATION			
DESCRIPTION: METHOD, THROUGH JAMB, NON-WOOD			
CHK: BAJ 11/28/18	SIZE: B	CLASS: MISC	DWG NO: 00114426
APP: JJJ 11/28/18	SCALE: 3:8	DATE: 08/13/18	DWG BY: SMITH, BRENDAN
			SHEET: 1 OF 1

NOTICE - CONFIDENTIAL INFORMATION

The information in this document is privileged and strictly confidential. The information contained herein shall be used only by Marvin Windows and Doors employees and by those agents or suppliers granted official written permission. If the reader of this document is not the intended recipient, or the employee or agent of the intended recipient, please delete this document from all data storage devices, and destroy all hard copies. Any unauthorized dissemination, distribution, copying or other use of the information contained in this document is strictly prohibited.

Template Version 10.5