


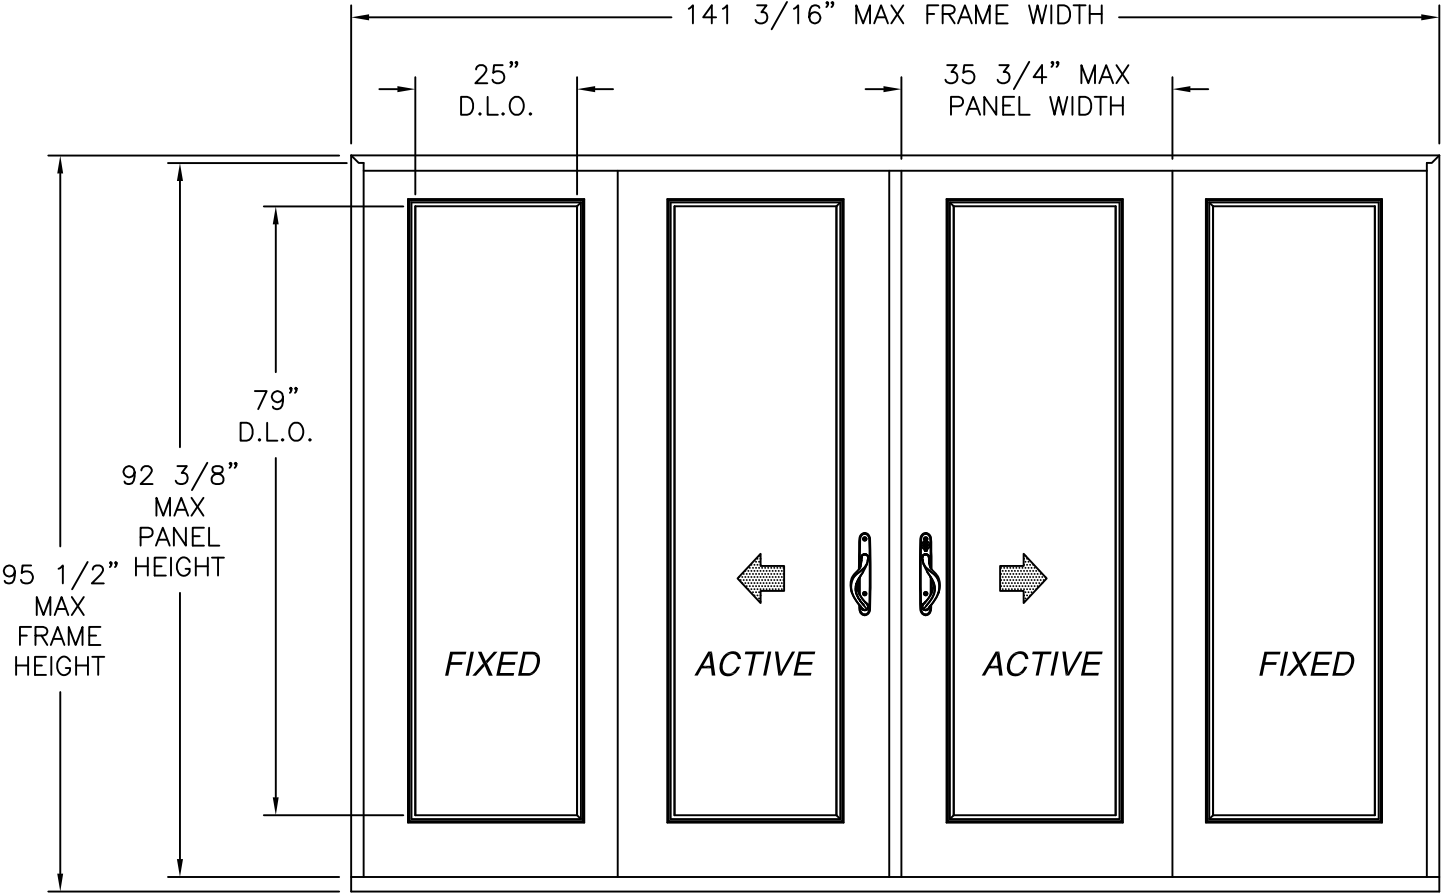

GLIDING FRENCH DOUBLE DOOR W/ SIDELITES
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
±50PSF	NONE

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED TO ADD GLAZING DETAILS	05/23/2025	R.L.

- NOTES:
1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
 2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
 3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
 4. UNITS MUST BE GLAZED PER ASTM E1300, WITH SAFETY GLAZING.
 5. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
 6. FRAME JAMB AND HEAD MATERIAL: CO-EXTRUDED PVC FOAM 1 1/2" THICK.
 7. FRAME SILL MATERIAL: CO-EXTRUDED PVC FOAM 2" THICK WITH ALUMINUM CLADDING .063" THICK.
 8. DOOR PANEL AND SIDELITE MATERIAL: PVC FOAM TOP AND BOTTOM RAILS, AND PVC FOAM VERTICAL STILES WITH PINE REINFORCEMENTS AND POLYURETHANE FOAM CORE.
 9. APPROVED CONFIGURATIONS: OX, XO, AND OXXO. SEE SHEET 2.

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	OXXO ELEVATION AND NOTES
2 – 3	ADDITIONAL CONFIGURATIONS ANCHOR LAYOUTS & HARDWARE
4	GLAZING DETAILS
5 – 7	INSTALLATION DETAILS

NAN YA PLASTICS CORP. USA

8989 NORTH LOOP EAST
HOUSTON, TX 77029

GLIDING FRENCH DOOR
VINYL SLIDING DOOR W/SIDELITE
OXXO ELEVATION AND NOTES

DRAWN:
V.L.

DWG NO.
08-01545

REV
D

SCALE
NTS


DATE
04/04/12

SHEET
1 OF 7

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com


SIGNED: 05/28/2025

Luis R. Lomas P.E.
FL No.: 62514

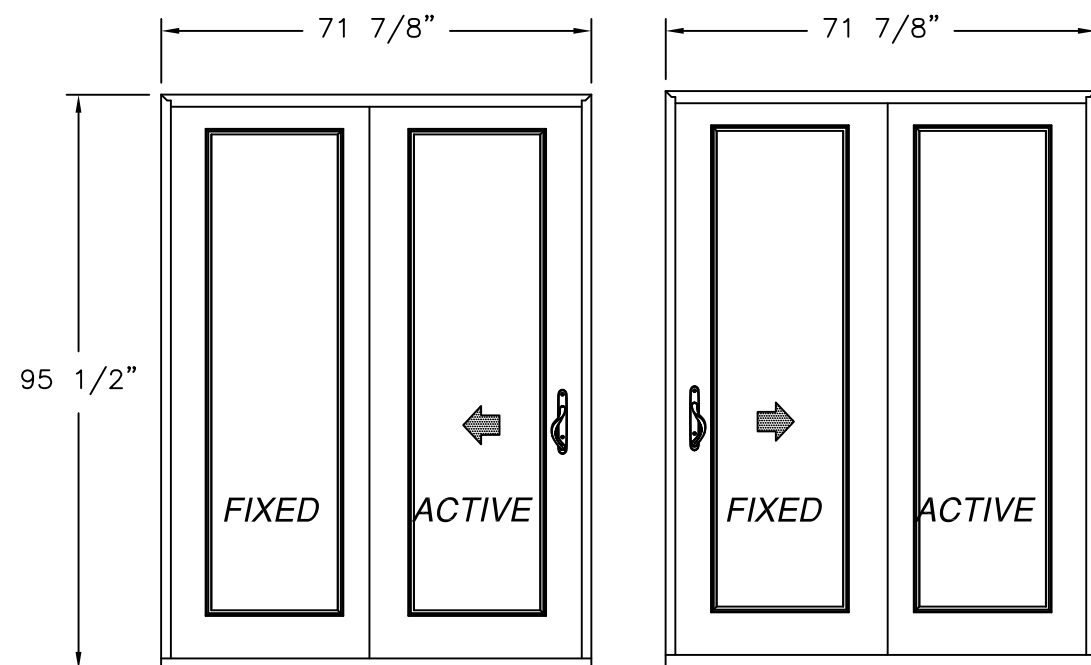


SINGLE W/SIDELITE
EXTERIOR VIEW


SINGLE W/SIDELITE
EXTERIOR VIEW

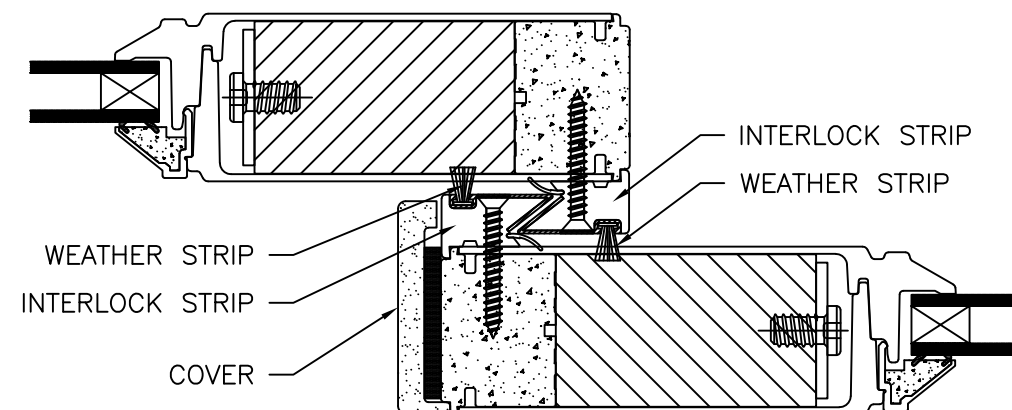

MEETING RAIL DETAIL

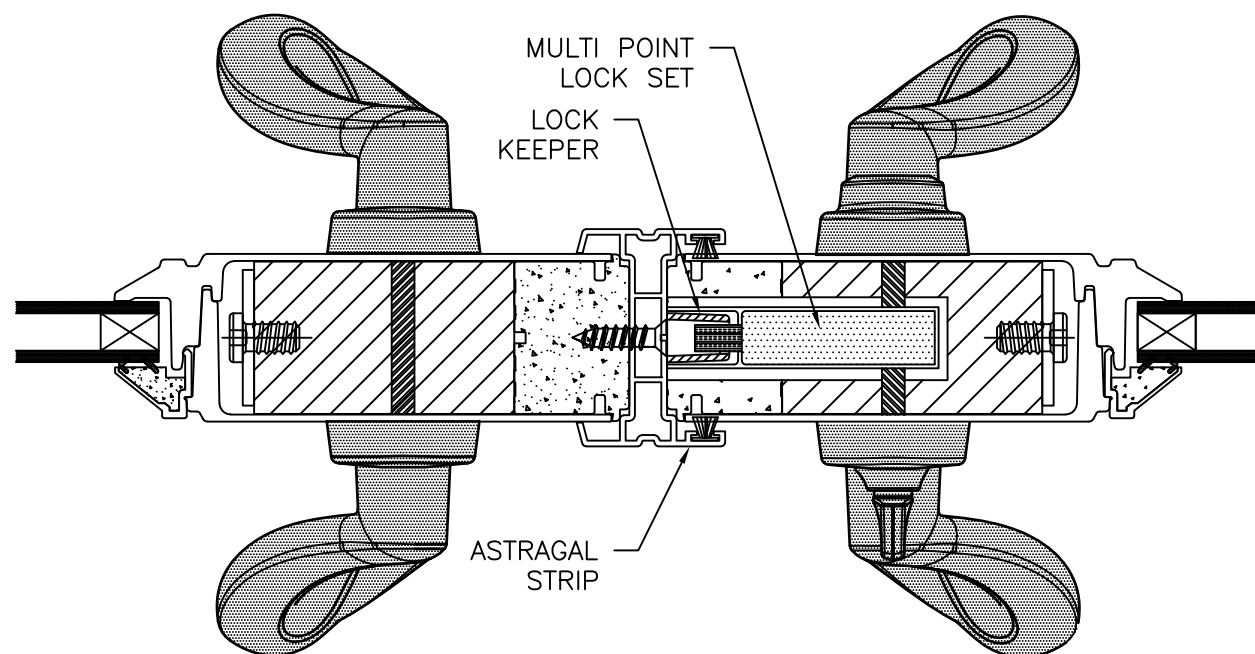

ASTRAGAL DETAIL

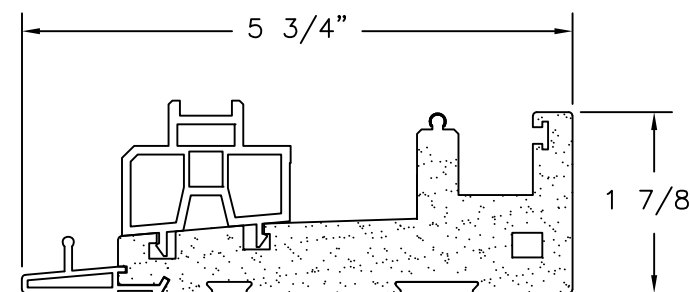


DOOR SILL

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED TO ADD GLAZING DETAILS	05/23/2025	R.L.


HARDWARE SCHEDULE	
A.	3 POINT LOCKING SYSTEM
B.	(1) DIE CAST HANDLE SET PER ACTIVE PANEL
C.	(2) STAINLESS STEEL TANDEM ROLLERS PER PANEL
D.	PVC ASTRAGAL BY NAN YA PLASTICS

NAN YA PLASTICS CORP. USA 8989 NORTH LOOP EAST HOUSTON, TX 77029		
GLIDING FRENCH DOOR VINYL SLIDING DOOR W/SIDELITE ADDITIONAL CONFIGURATIONS AND HARDWARE		
DRAWN: V.L.	DWG NO. 08-01545	REV D
SCALE NTS	DATE 04/04/12	SHEET 2 OF 7
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 05/28/2025

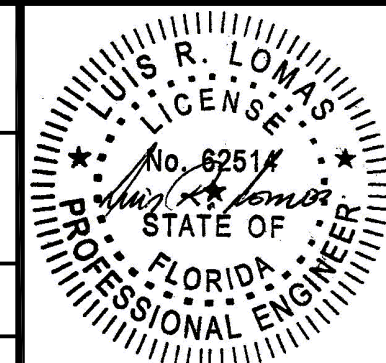

Luis R. Lomas P.E.
FL No.: 62514

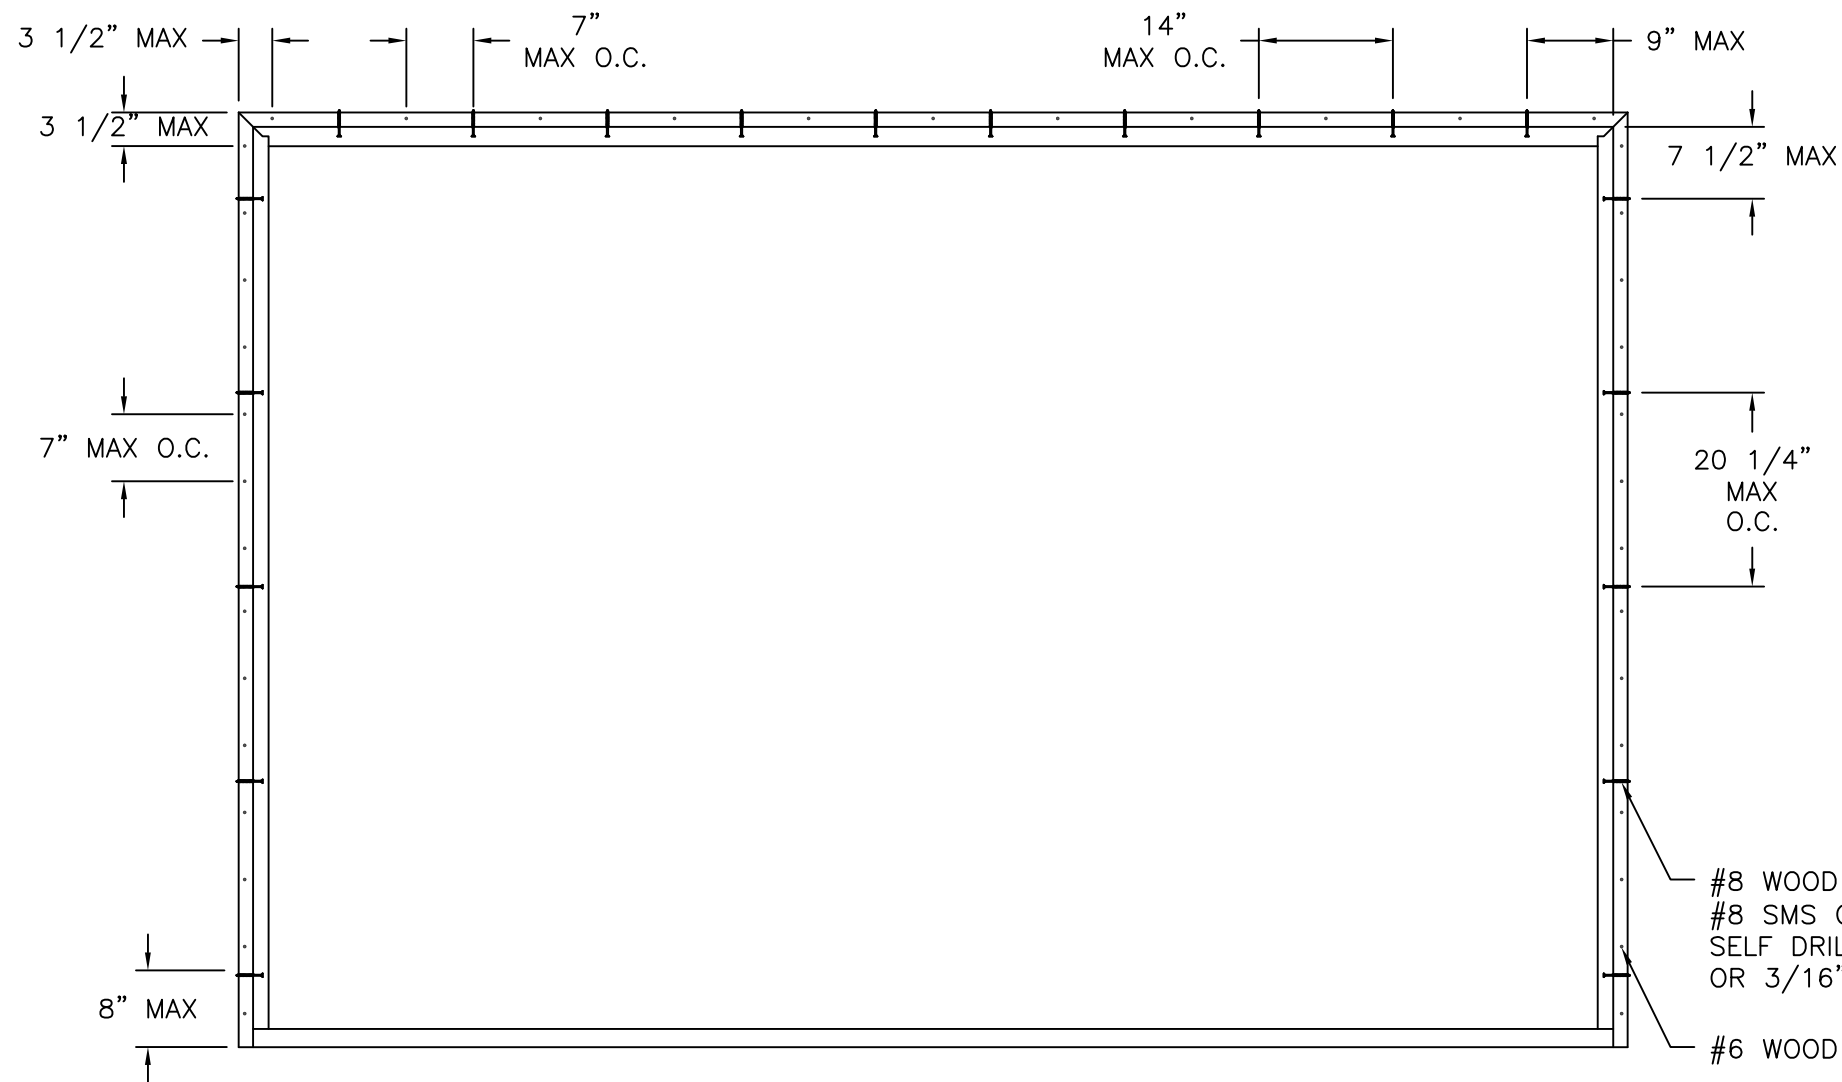


ANCHORING LAYOUT FOR DOUBLE W/SIDELITES
EXTERIOR VIEW

ANCHORING NOTES:

1. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
2. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
3. FOR ANCHORING INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
4. FOR ANCHORING INTO METAL STRUCTURE USE #8 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
5. ALL FASTENERS TO BE CORROSION RESISTANT.
6. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE – MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
 - C. MASONRY – STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
 - D. METAL STRUCTURE – STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .048" THICK MINIMUM.

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED TO ADD GLAZING DETAILS	05/23/2025	R.L.

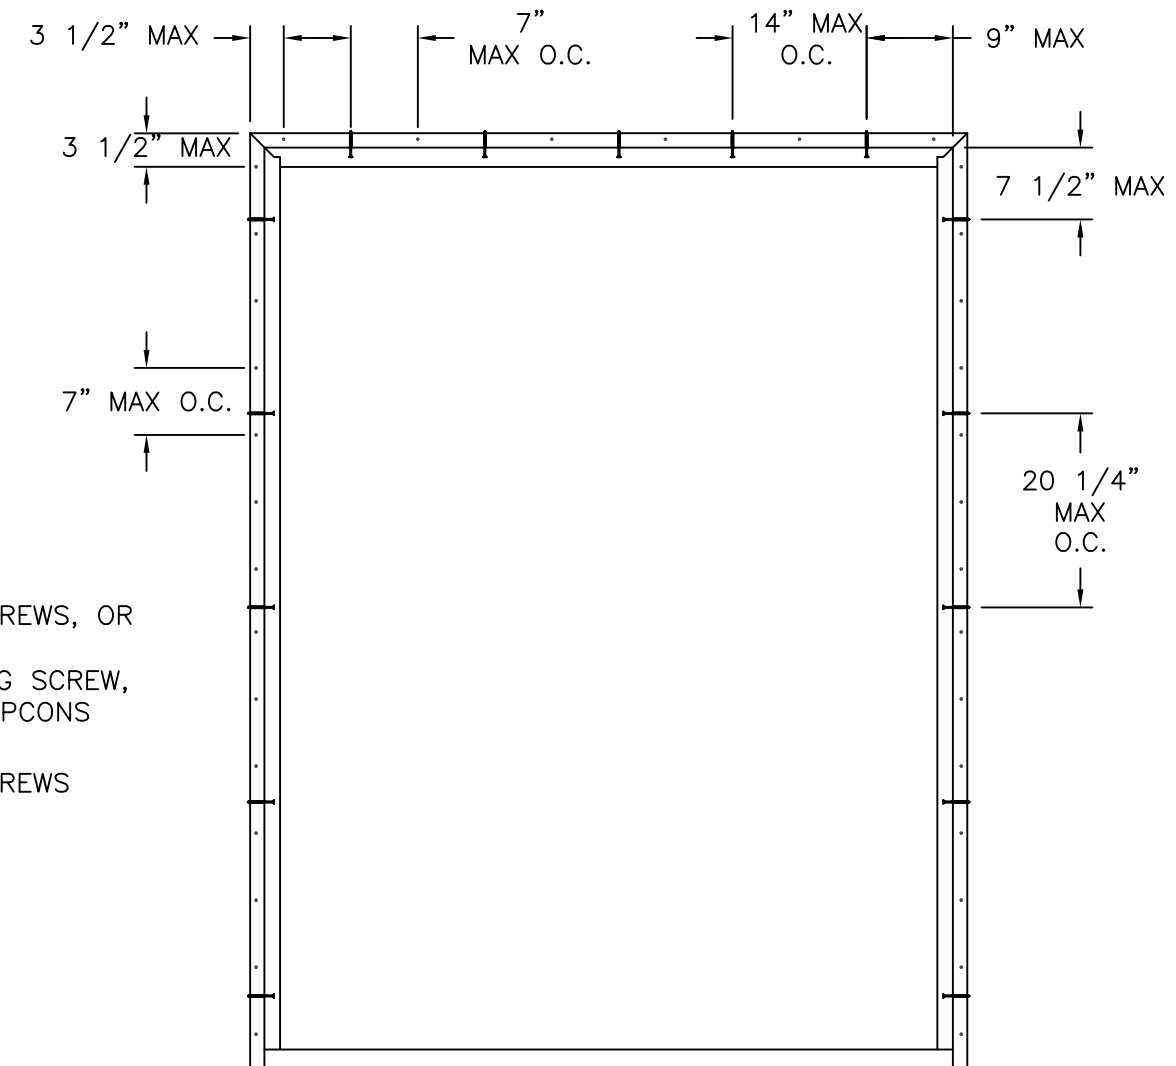

ANCHORING LAYOUT FOR SINGLE W/SIDELITE
EXTERIOR VIEW

SIGNED: 05/28/2025


NAN YA PLASTICS CORP. USA
8989 NORTH LOOP EAST
HOUSTON, TX 77029

GLIDING FRENCH DOOR
VINYL SLIDING DOOR W/SIDELITE
ANCHORING LAYOUTS

DRAWN: V.L.	DWG NO. 08-01545	REV D
----------------	---------------------	----------

SCALE NTS	DATE 04/04/12	SHEET 3 OF 7
--------------	------------------	-----------------


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

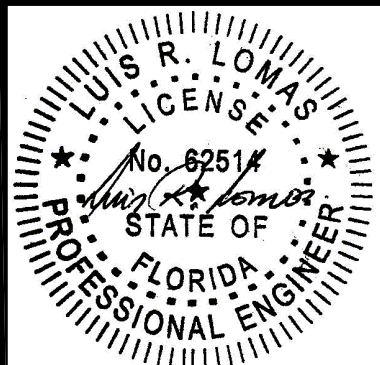

Luis R. Lomas P.E.
FL No.: 62514



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED TO ADD GLAZING DETAILS	05/23/2025	R.L.

APPROVED PANEL CONFIGURATIONS

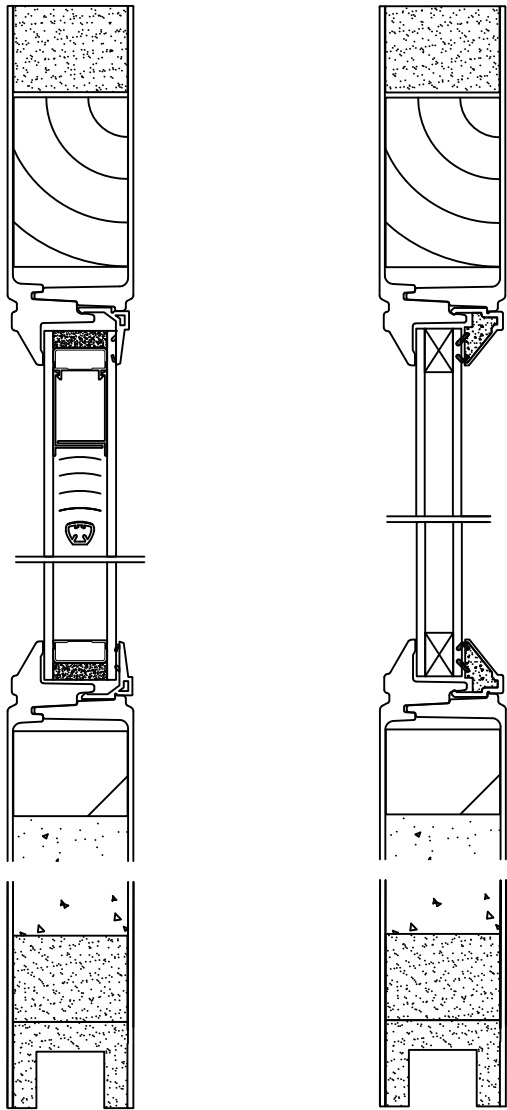

W/MINI-BLIND

STANDARD

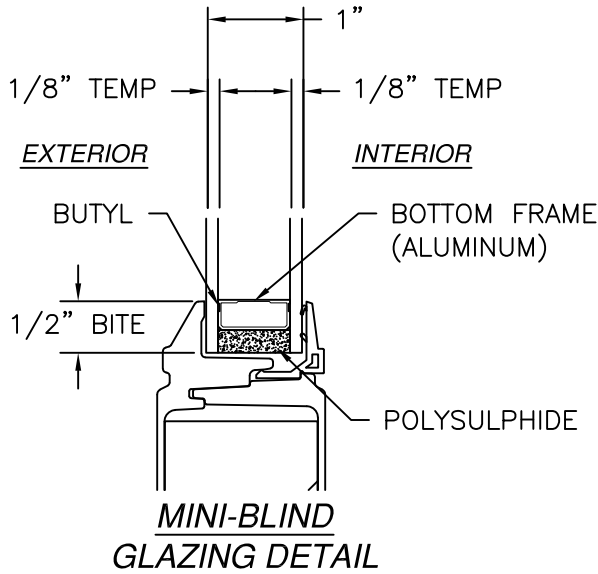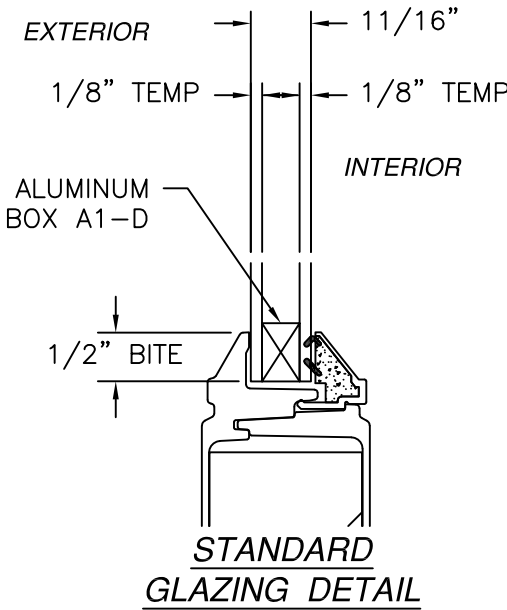

SIGNED: 05/28/2025

NAN YA PLASTICS CORP. USA

8989 NORTH LOOP EAST

HOUSTON, TX 77029

GLIDING FRENCH DOOR

VINYL SLIDING DOOR W/SIDELITE

GLAZING DETAILS

DRAWN: V.L.

DWG NO. 08-01545

REV D

SCALE NTS


DATE 04/04/12

SHEET 4 OF 7


L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

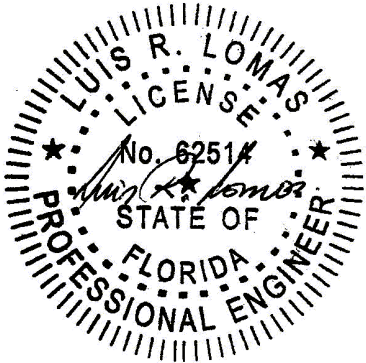


Luis R. Lomas P.E.
FL No.: 62514

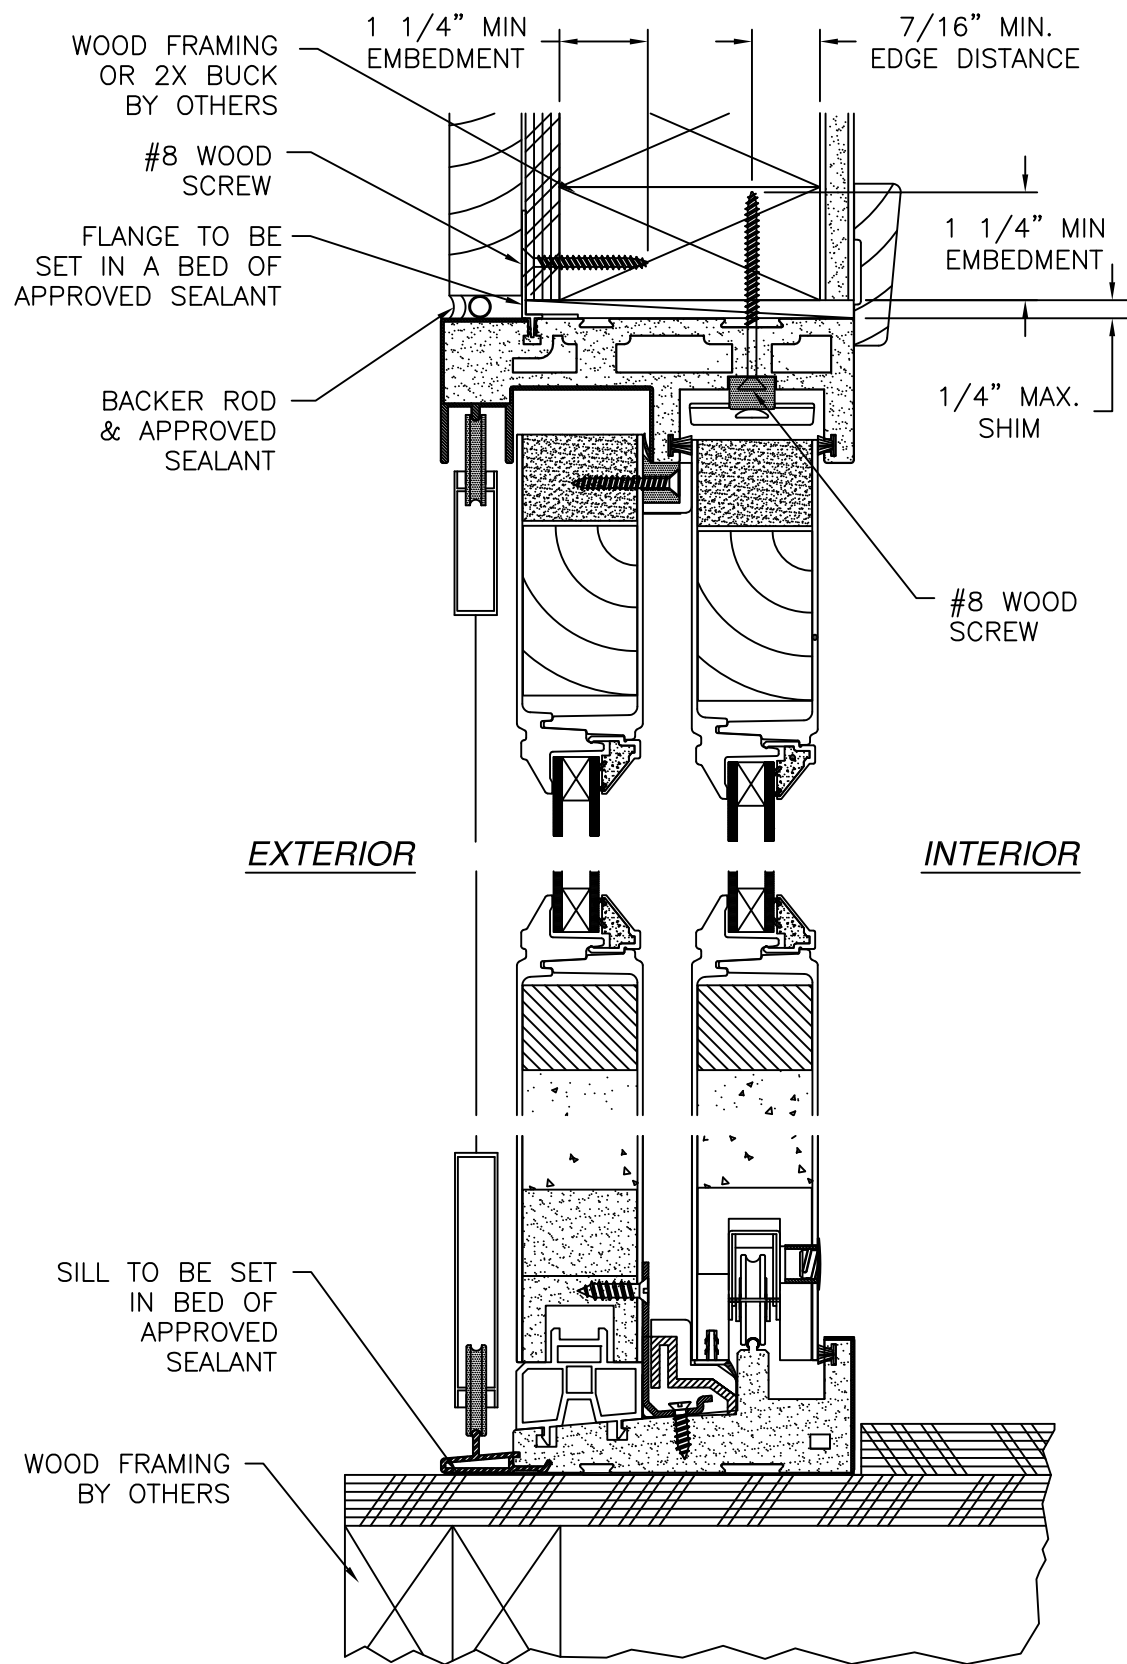

VERTICAL CROSS SECTION
DOOR SHOWN, SIDELITE SIMILAR
2X BUCK/WOOD FRAMING INSTALLATION

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED TO ADD GLAZING DETAILS	05/23/2025	R.L.

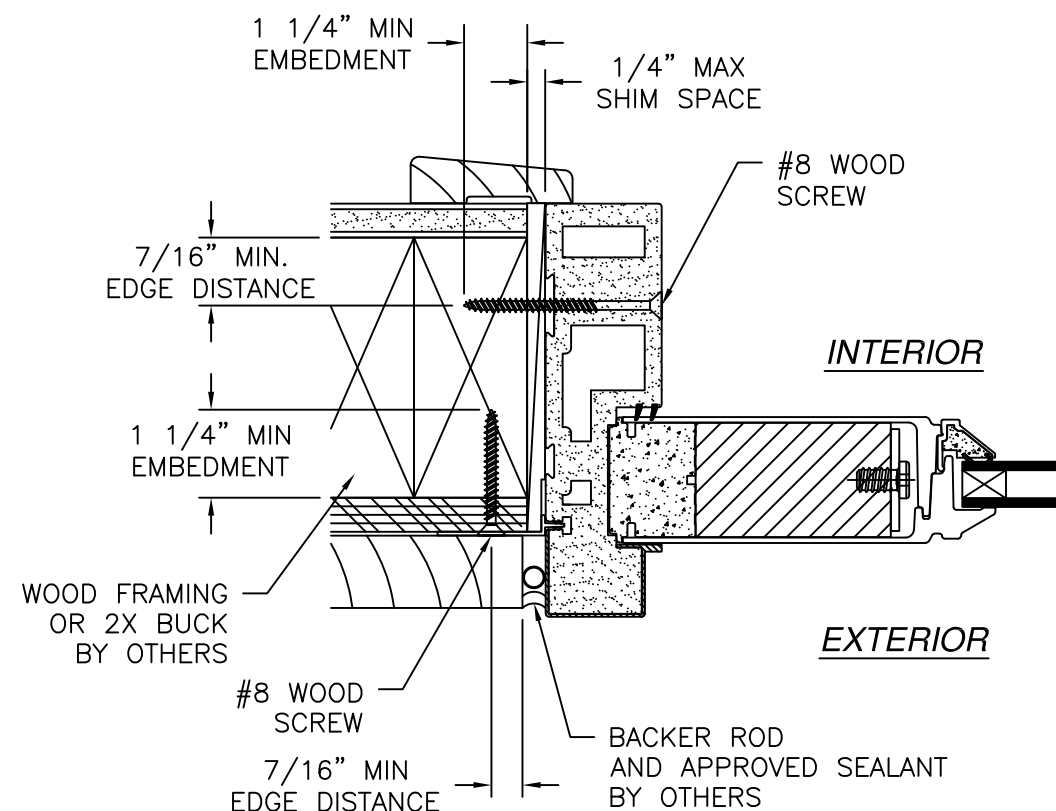

HORIZONTAL CROSS SECTION
2X BUCK/WOOD FRAMING INSTALLATION

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 05/28/2025

NAN YA PLASTICS CORP. USA
8989 NORTH LOOP EAST
HOUSTON, TX 77029


GLIDING FRENCH DOOR
VINYL SLIDING DOOR W/SIDELITE
INSTALLATION DETAILS

DRAWN: V.L.	DWG NO. 08-01545	REV D
SCALE NTS	DATE 04/04/12	SHEET 5 OF 7


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

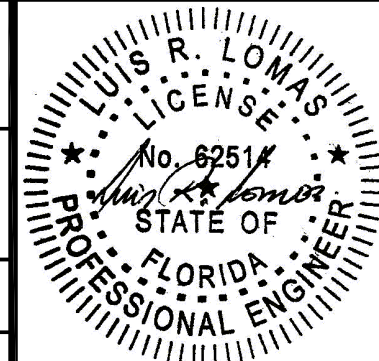

Luis R. Lomas P.E.
FL No.: 62514

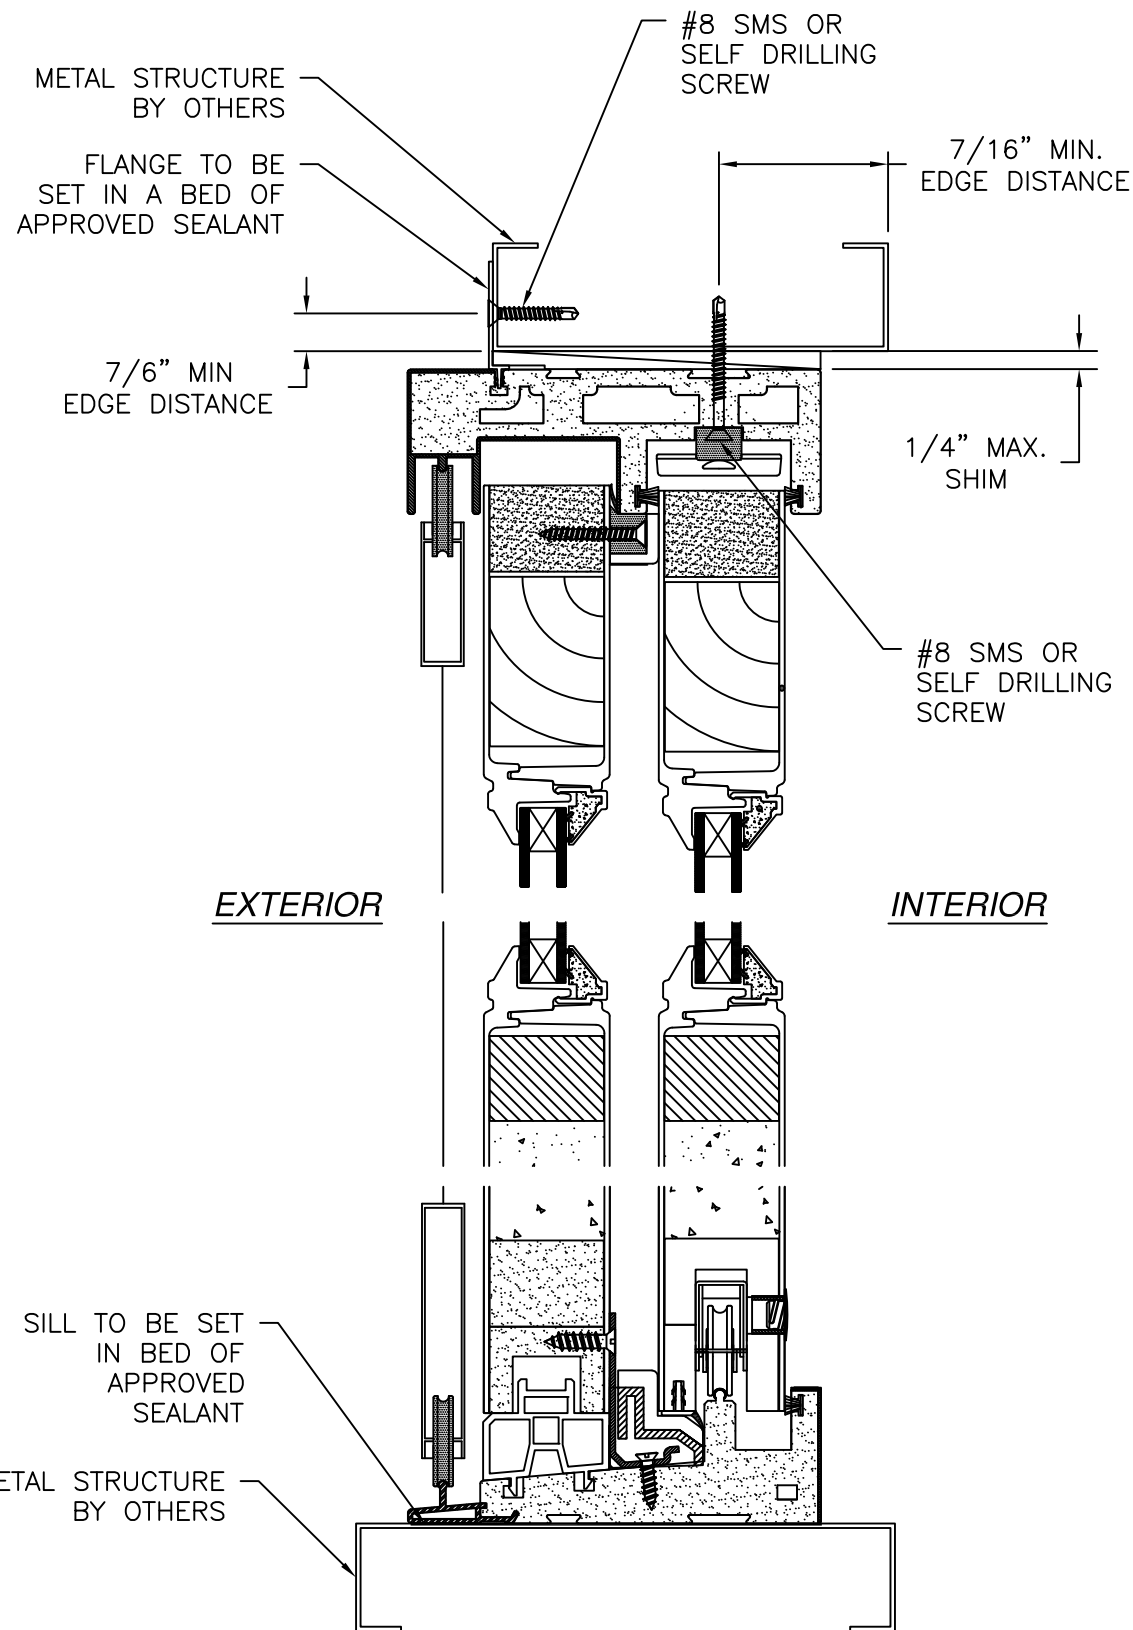

VERTICAL CROSS SECTION
DOOR SHOWN, SIDELITE SIMILAR
METAL STRUCTURE INSTALLATION

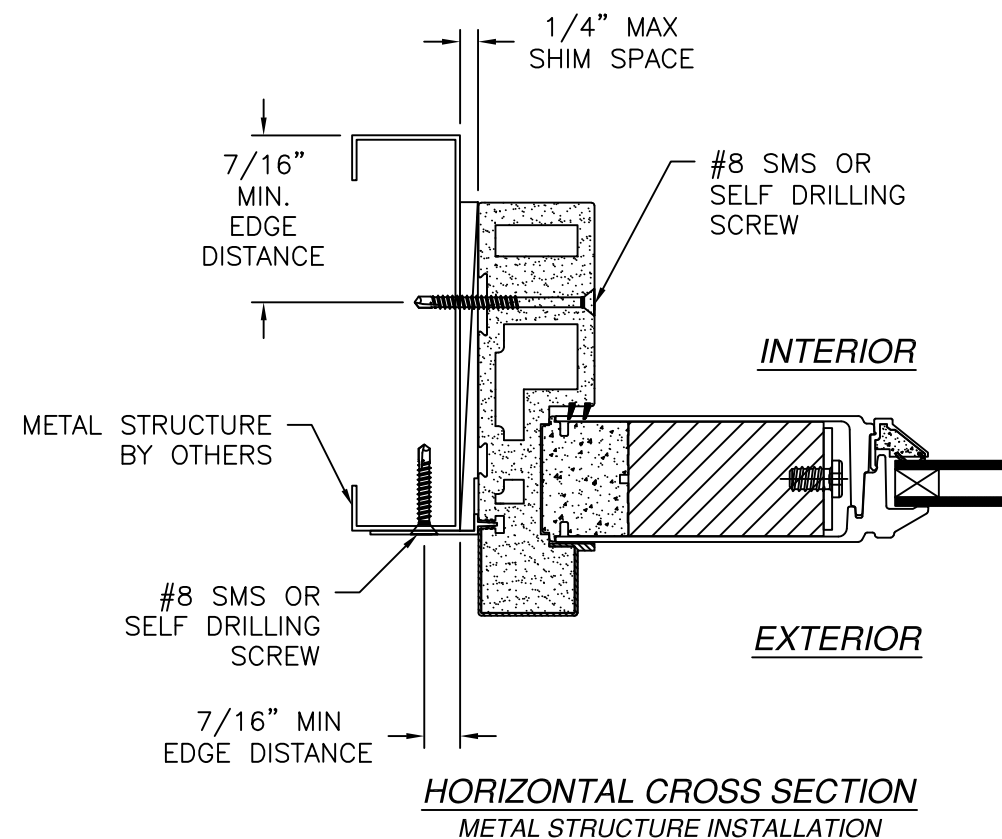

HORIZONTAL CROSS SECTION
METAL STRUCTURE INSTALLATION


NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED TO ADD GLAZING DETAILS	05/23/2025	R.L.



SIGNED: 05/28/2025

NAN YA PLASTICS CORP. USA 8989 NORTH LOOP EAST HOUSTON, TX 77029		
GLIDING FRENCH DOOR VINYL SLIDING DOOR W/SIDELITE INSTALLATION DETAILS		
DRAWN: V.L.	DWG NO. 08-01545	REV D
SCALE NTS	DATE 04/04/12	SHEET 6 OF 7
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@rlomaspe.com		

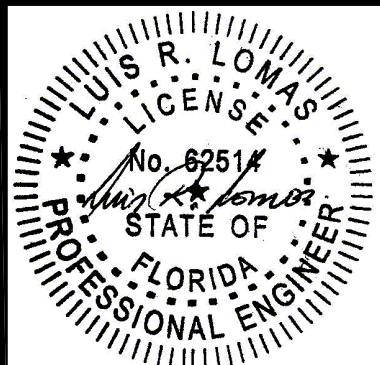

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED TO ADD GLAZING DETAILS	05/23/2025	R.L.

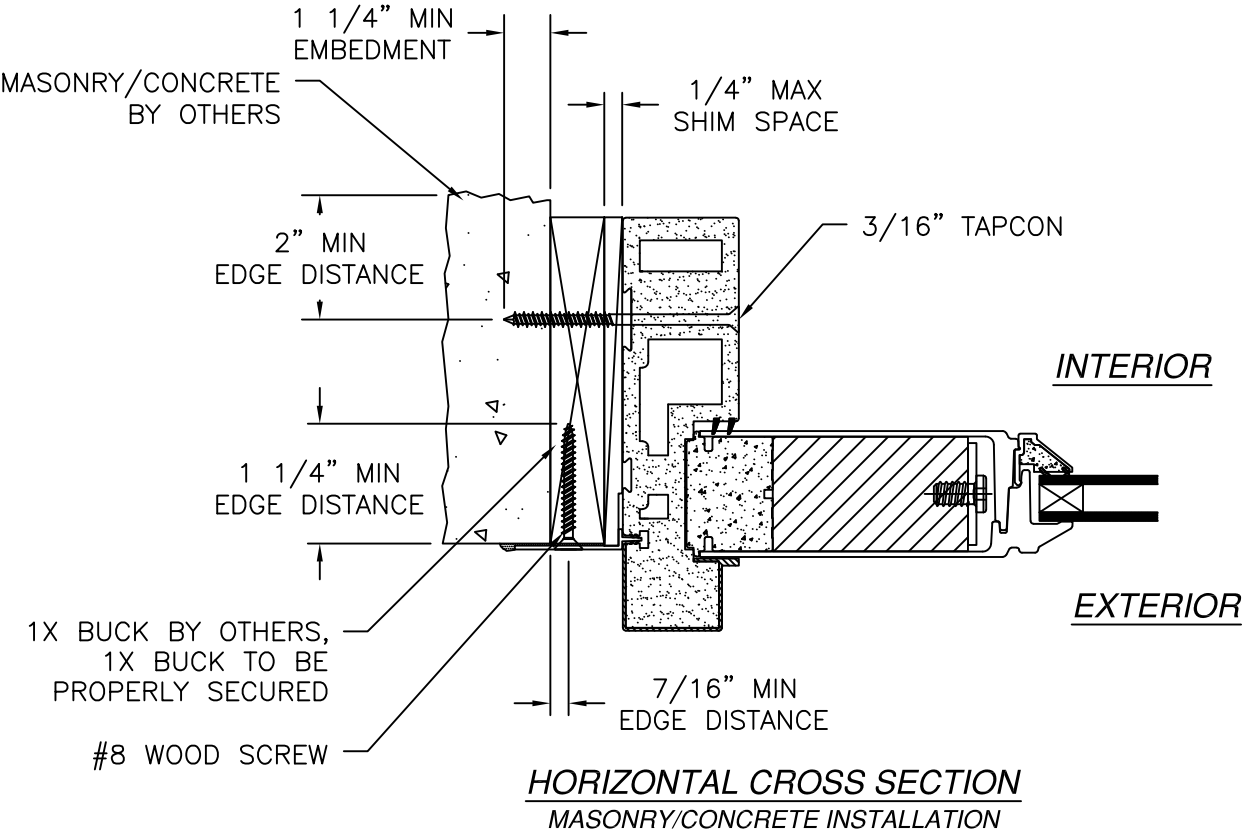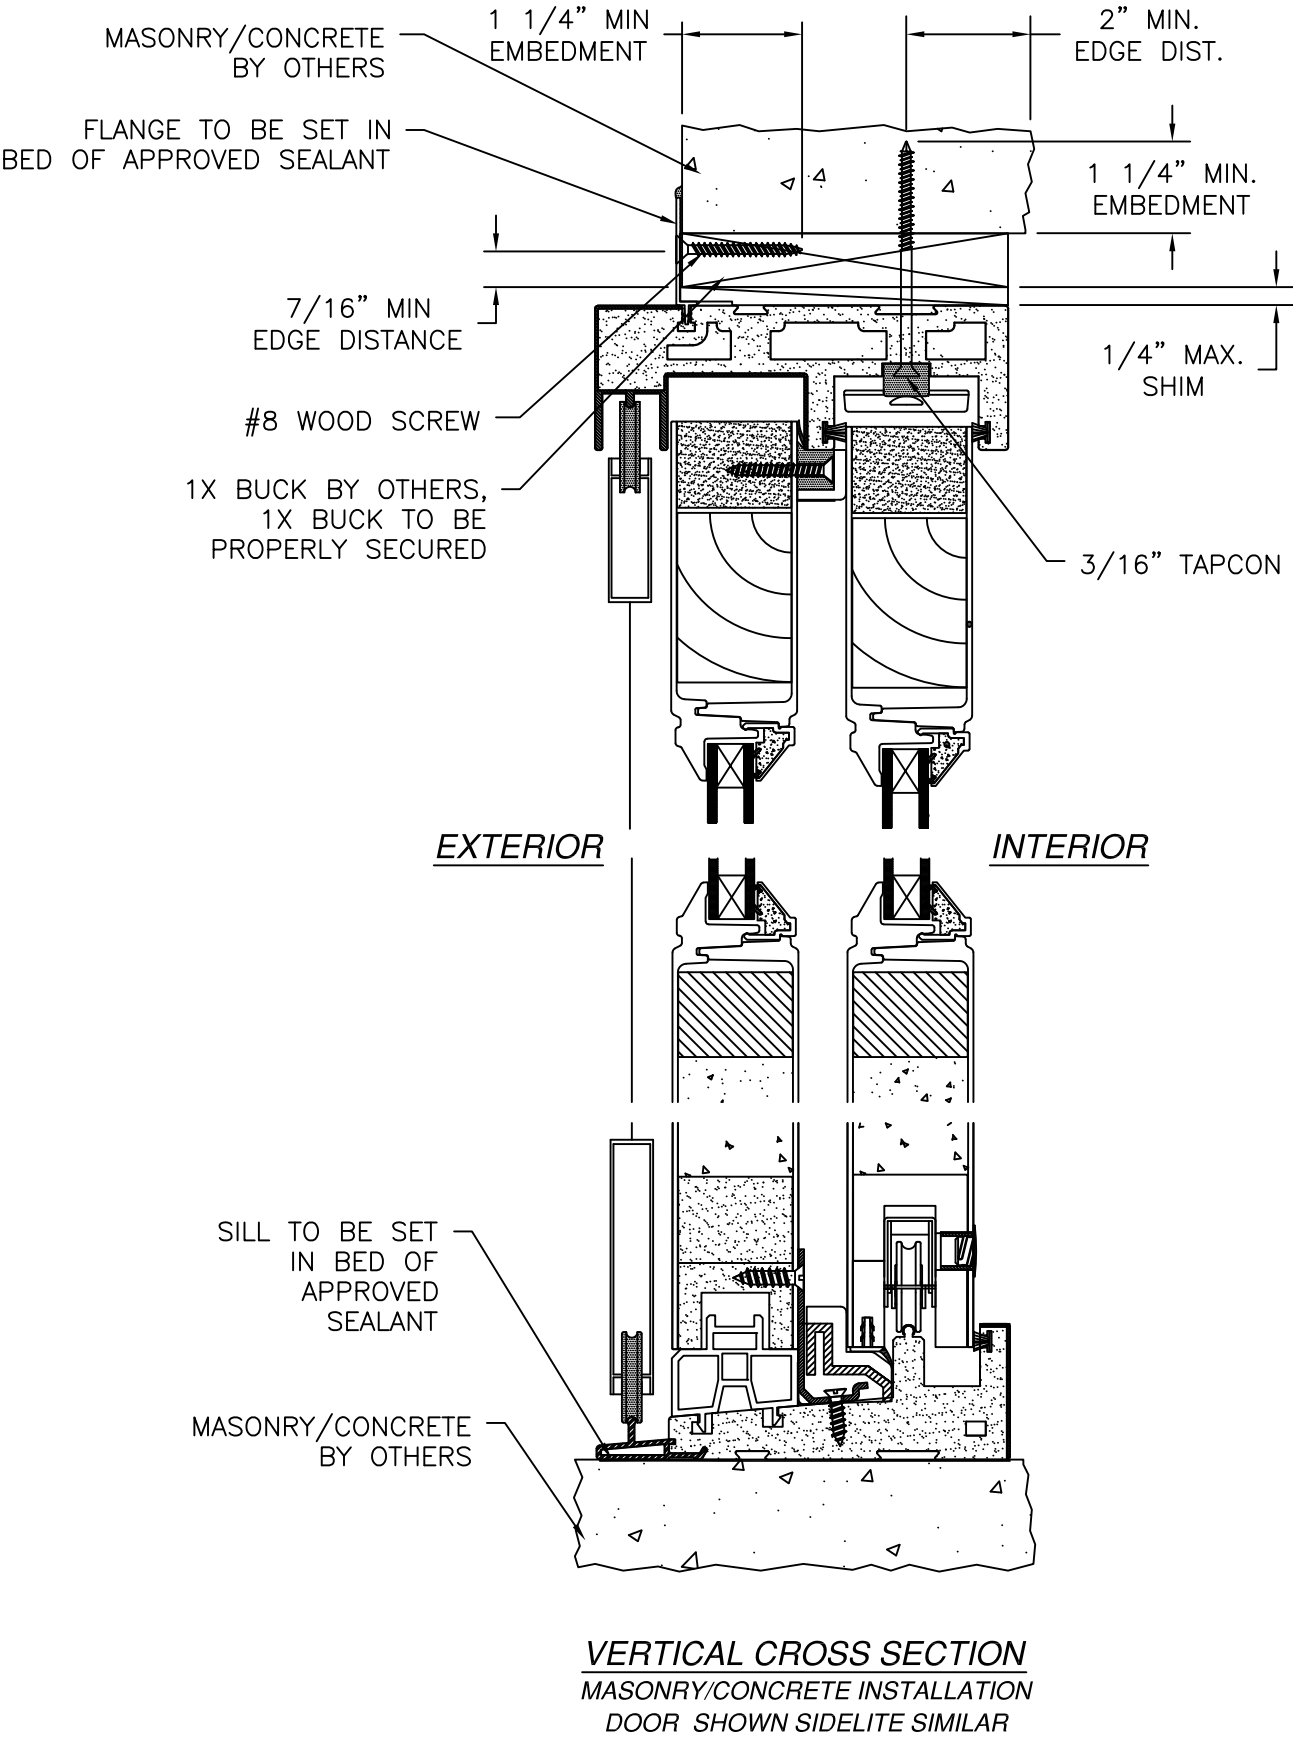

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 05/28/2025

NAN YA PLASTICS CORP. USA

8989 NORTH LOOP EAST

HOUSTON, TX 77029

GLIDING FRENCH DOOR

VINYL SLIDING DOOR W/SIDELITE

INSTALLATION DETAILS

DRAWN:

V.L.

DWG NO.

08-01545

REV

D

SCALE

NTS

DATE

04/04/12

SHEET

7


OF

7

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@rlomaspe.com

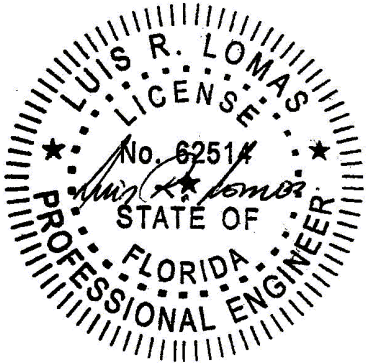

Luis R. Lomas P.E.
FL No.: 62514