

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED ADDRESS & SILL RISER	07/08/2026	R.L.

- NOTES:
1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
 2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
 3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
 4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
 5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
 6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
 7. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
 8. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
 9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
 10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
 11. FRAME JAMB AND HEAD MATERIAL: CO-EXTRUDED PVC FOAM 1 1/2" THICK.
 12. FRAME SILL MATERIAL: CO-EXTRUDED PVC FOAM 2" THICK WITH ALUMINUM CLADDING .063" THICK.
 13. DOOR PANEL AND SIDELITE MATERIAL: .075" THICK FIBERGLASS SKIN WITH PVC FOAM TOP AND BOTTOM RAILS, AND PVC FOAM VERTICAL STILES WITH PINE REINFORCEMENTS AND POLYURETHANE FOAM CORE.
 14. UNITS MUST BE GLAZED PER ASTM E1300, SEE SHEET 5 FOR GLASS DETAILS.
 15. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.

16. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. FOR ANCHORING INTO MASONRY/CONCRETE USE 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
18. FOR ANCHORING INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
19. ALL FASTENERS TO BE CORROSION RESISTANT.
20. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
 - D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .125" THICK MINIMUM
21. APPROVED CONFIGURATIONS: OX, XO AND OXO. SEE SHEET 3.

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION
3	APPROVED CONFIGURATIONS & ANCHOR LAYOUTS
4 - 8	INSTALLATION DETAILS

NAN YA PLASTICS CORP. USA

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SRS GLIDING PATIO DOOR W/FIELD MULLION

120611 IMPACT

NOTES

DRAWN:
J.L.

DWG NO.
08-01900

REV
E

SCALE NTS

DATE 01/17/13


SHEET 1 OF 8

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903


434-688-0609 rllomas@lrlomaspe.com

SIGNED: 08/11/2026

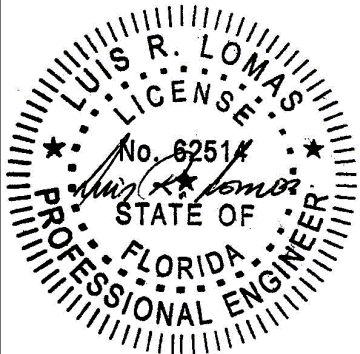

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED ADDRESS & SILL RISER	07/08/2026	R.L.

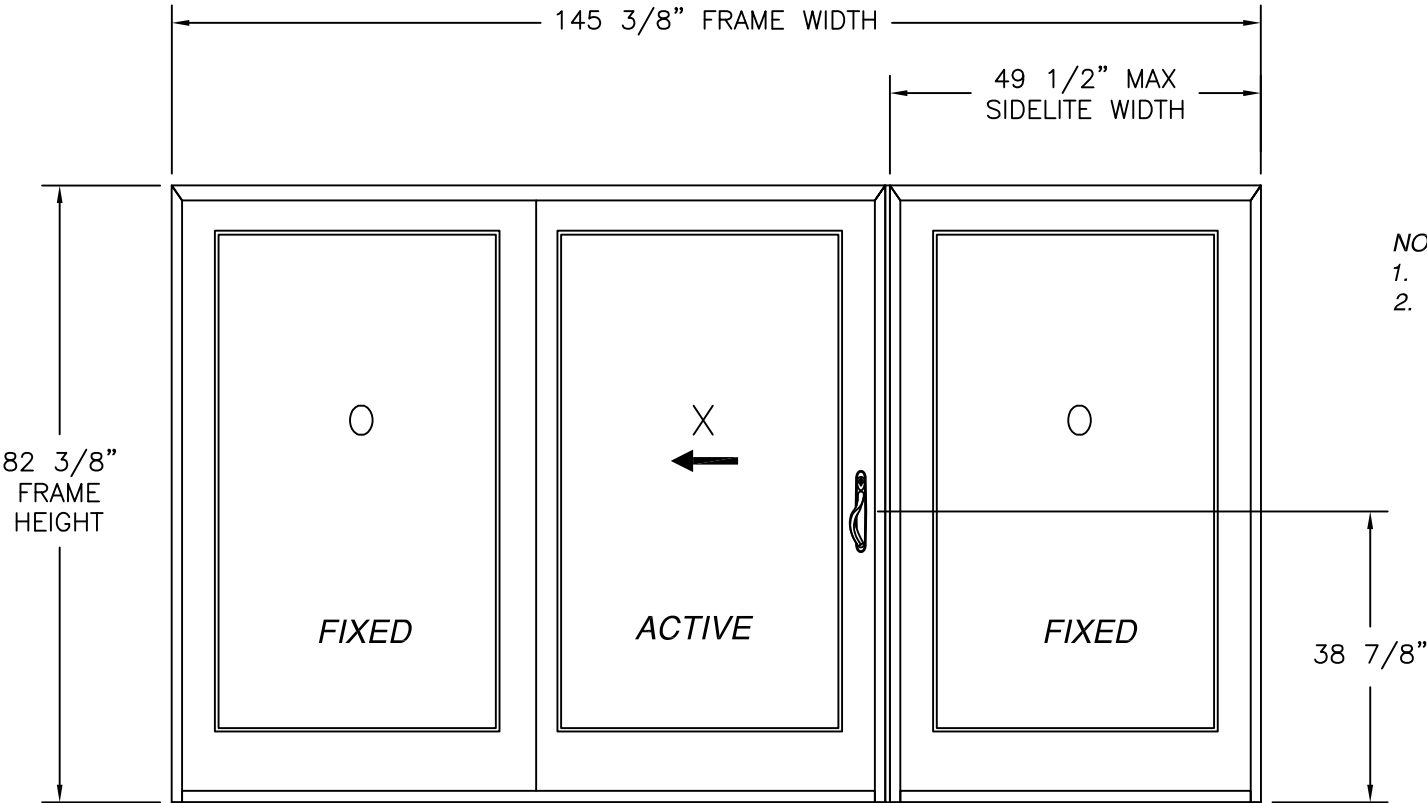

- NOTES:
- 1. PANEL SIZE: 47 3/4" X 79 1/4"
 - 2. D.L.O.: 37" X 66"

SERIES SRS GLIDING PATIO DOOR W/FIELD MULLION - 120611 IMPACT
EXTERIOR VIEW

WITH STANDARD SILL OR SILL RISER

DESIGN PRESSURE RATING	IMPACT RATING
±50.0PSF	LARGE & SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4


NOTE: STANDARD SILL WAS TESTED TO 7.5PSF WATER PENETRATION RESISTANCE,
3" SILL RISER WAS TESTED TO 15.0PSF WATER PENETRATION RESISTANCE

47 3/4" X 79 1/4" PANELS SHOWN OTHER PANEL SIZES ARE APPROVED AS
LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 26.27 FT²

<u>HARDWARE SCHEDULE</u>
A. 4 POINT LOCKING SYSTEM
B. (1) DIE CAST HANDLE SET
C. (2) STAINLESS STEEL TANDEM ROLLERS
D. ALUMINUM & PVC FOAM ASTRAGAL BY NAN YA PLASTICS
E. ALUMINUM & PVC FOAM MULLION BY NAN YA PLASTICS


SIGNED: 08/11/2026

NAN YA PLASTICS CORP. USA 4016 SHADRACK ST. HOUSTON, TX 77013		
SERIES SRS GLIDING PATIO DOOR W/FIELD MULLION 120611 IMPACT ELEVATION		
DRAWN: J.L.	DWG NO. 08-01900	REV E
SCALE NTS	DATE 01/17/13	SHEET 2 OF 8
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

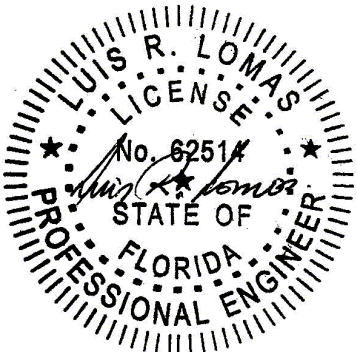


Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED ADDRESS & SILL RISER	07/08/2026	R.L.

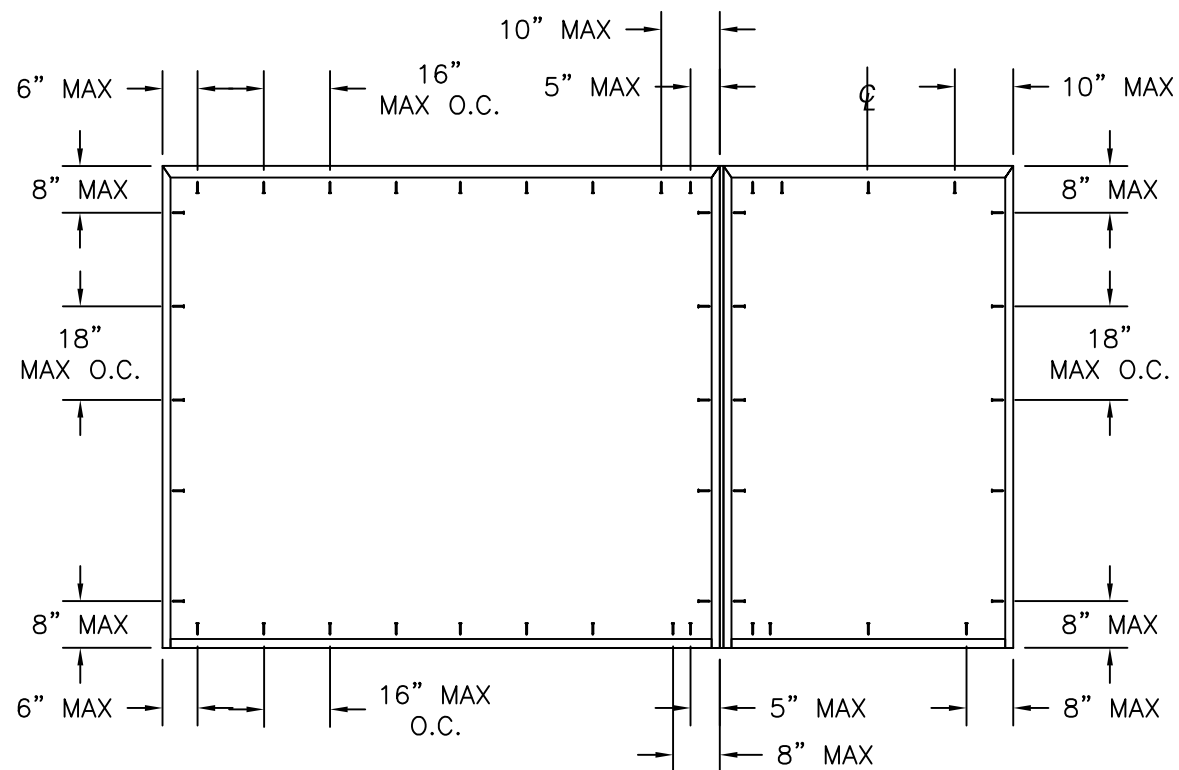


SINGLE W/SIDELITES (MULL)
EXTERIOR VIEW

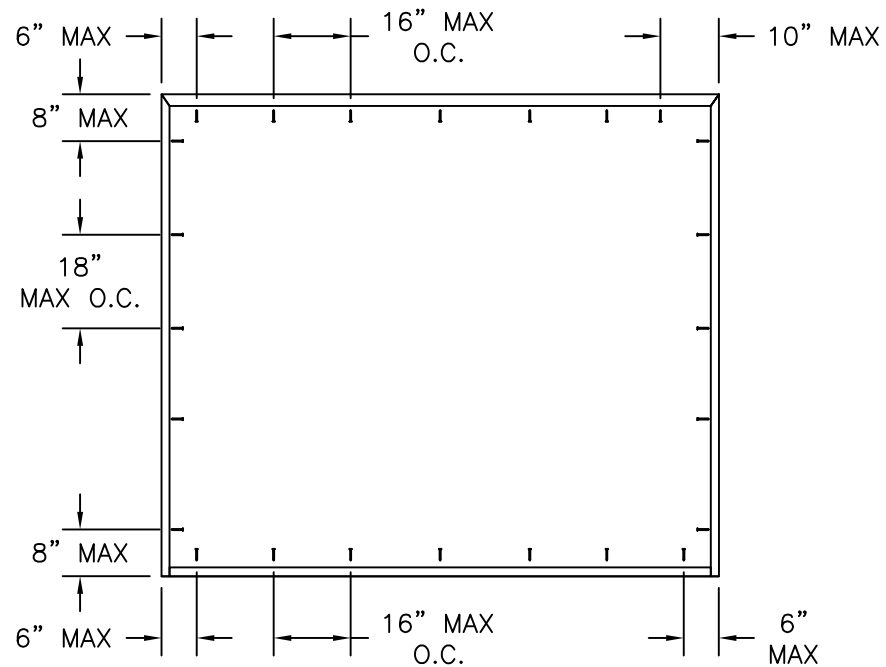

SINGLE W/SIDELITE
EXTERIOR VIEW

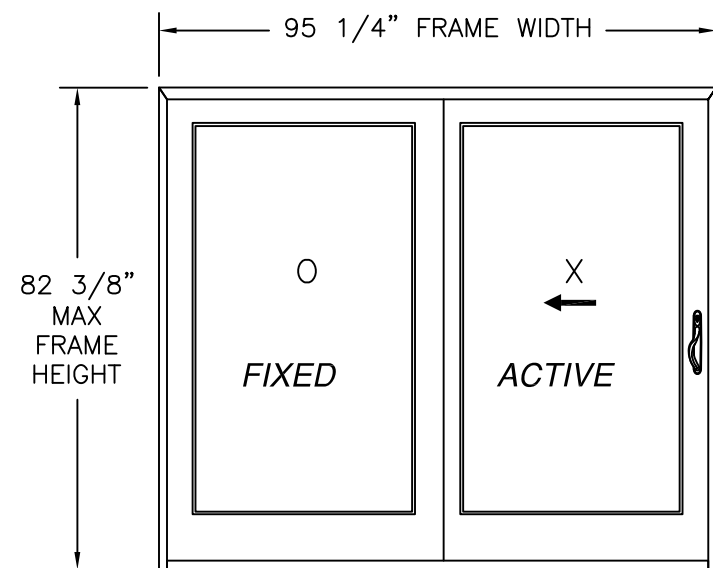

SINGLE W/SIDELITE
EXTERIOR VIEW

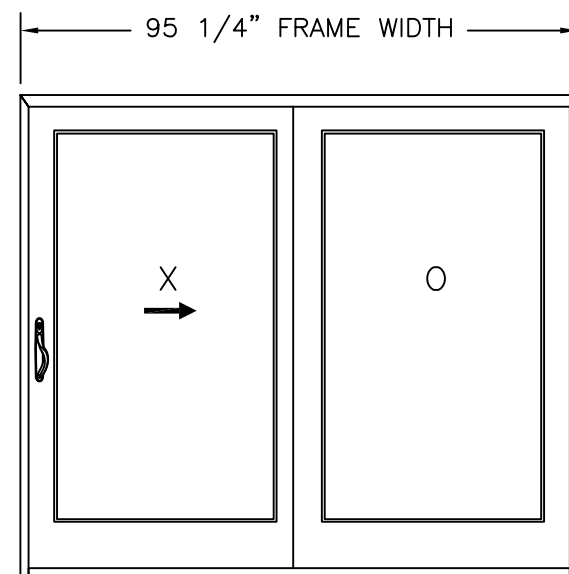

SINGLE W/SIDELITE
EXTERIOR VIEW


NAN YA PLASTICS CORP. USA
4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SRS GLIDING PATIO DOOR W/FIELD MULLION
120611 IMPACT
ADDITIONAL CONFIGURATIONS AND ANCHOR LAYOUTS

DRAWN: J.L.	DWG NO. 08-01900	REV E
SCALE NTS	DATE 01/17/13	SHEET 3 OF 8




L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 08/11/2026

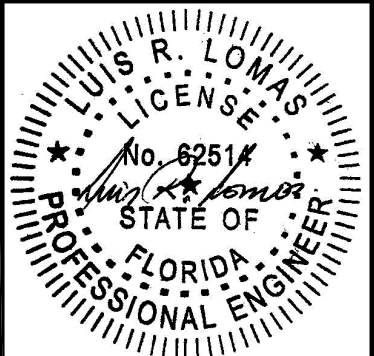

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED ADDRESS & SILL RISER	07/08/2026	R.L.

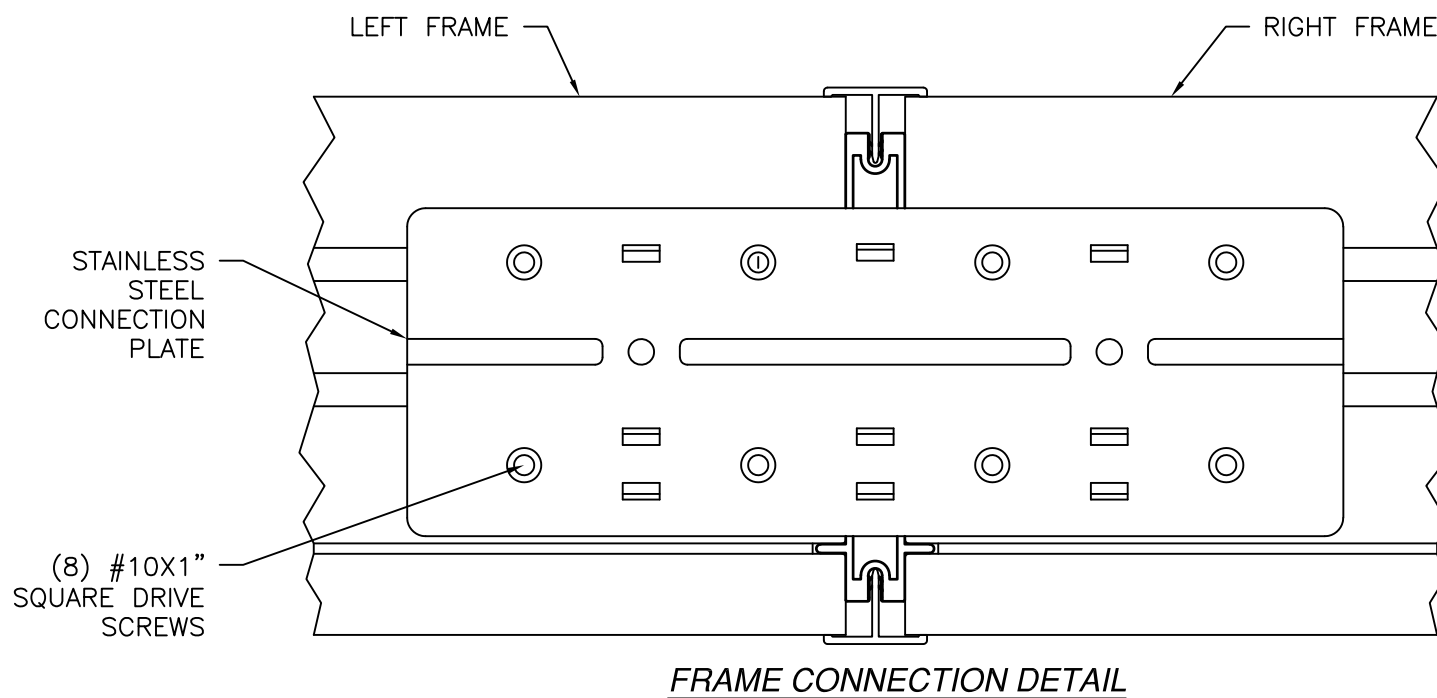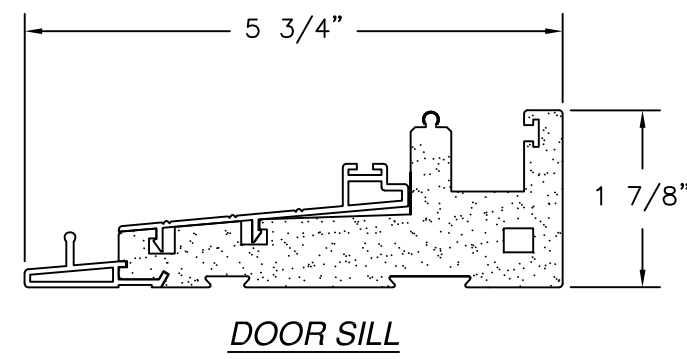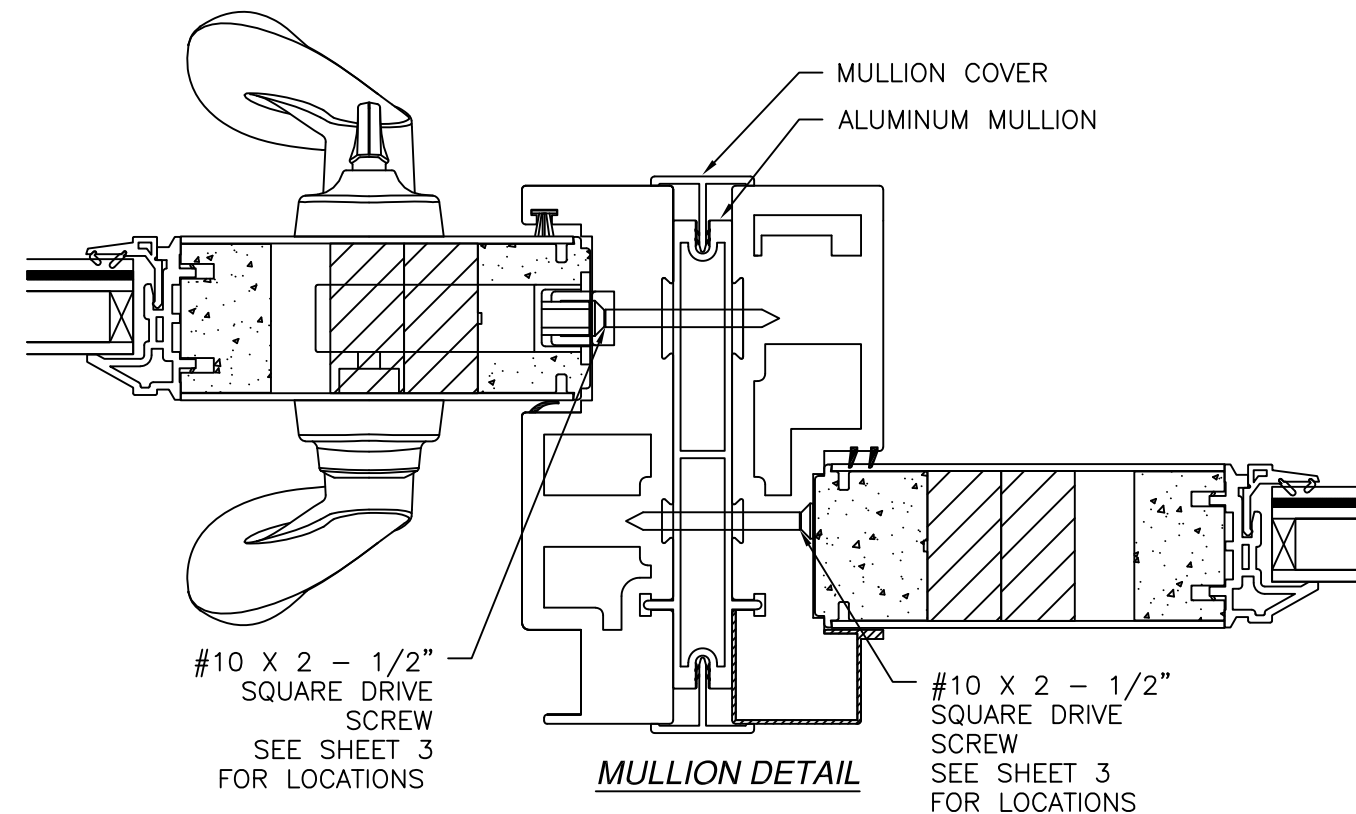

NAN YA PLASTICS CORP. USA

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SRS GLIDING PATIO DOOR W/FIELD MULLION

120611 IMPACT

INSTALLATION DETAILS

DRAWN: J.L.

DWG NO. 08-01900

REV E

SCALE NTS

DATE 01/17/13

SHEET 4 OF 8

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com


SIGNED: 08/11/2026

Luis R. Lomas P.E.

FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED ADDRESS & SILL RISER	07/08/2026	R.L.





APPROVED PANEL CONFIGURATIONS

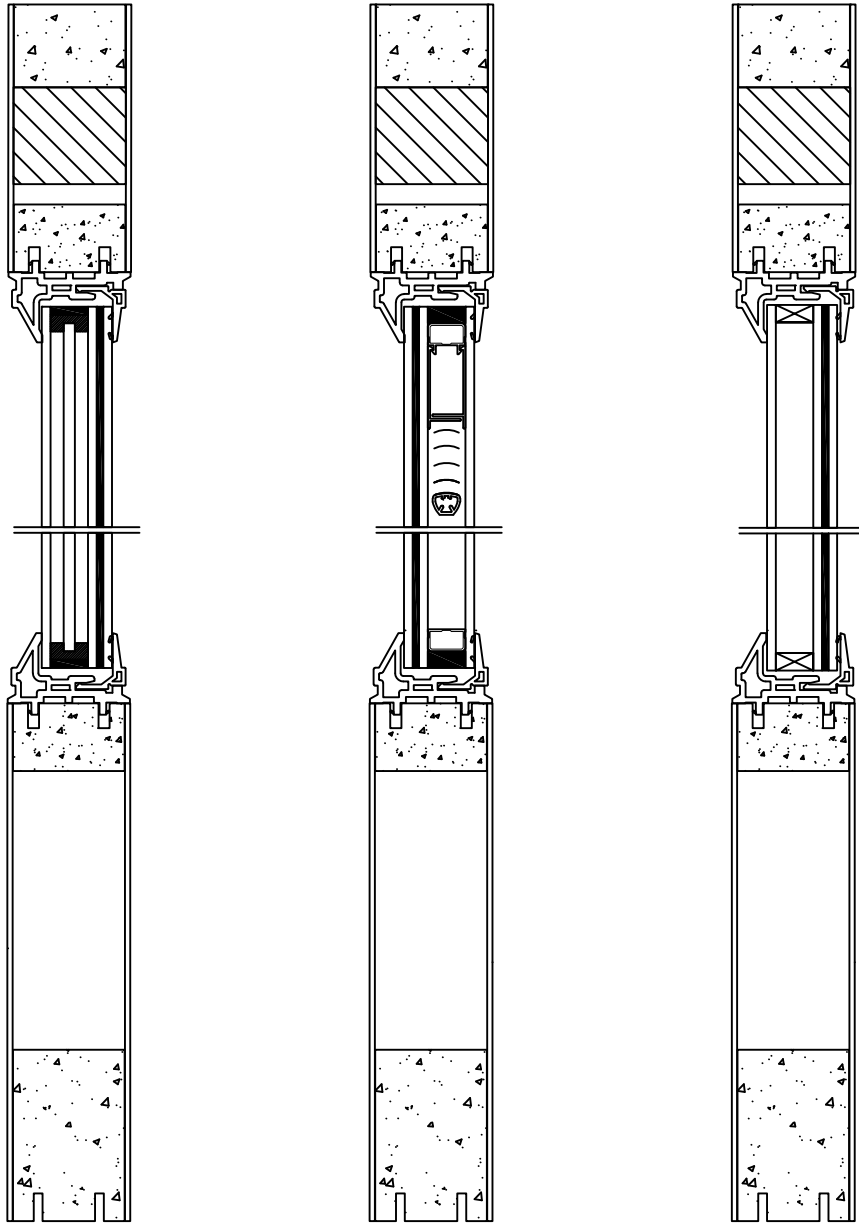

W/MATTE GLASS

W/MINI-BLIND

STANDARD

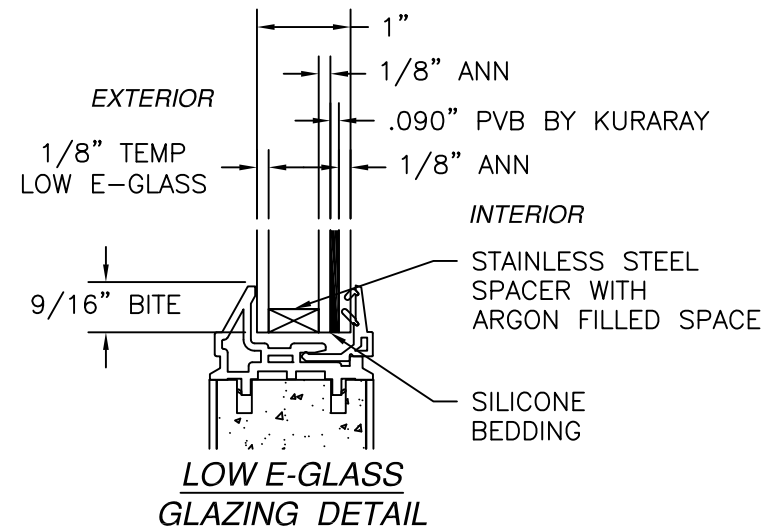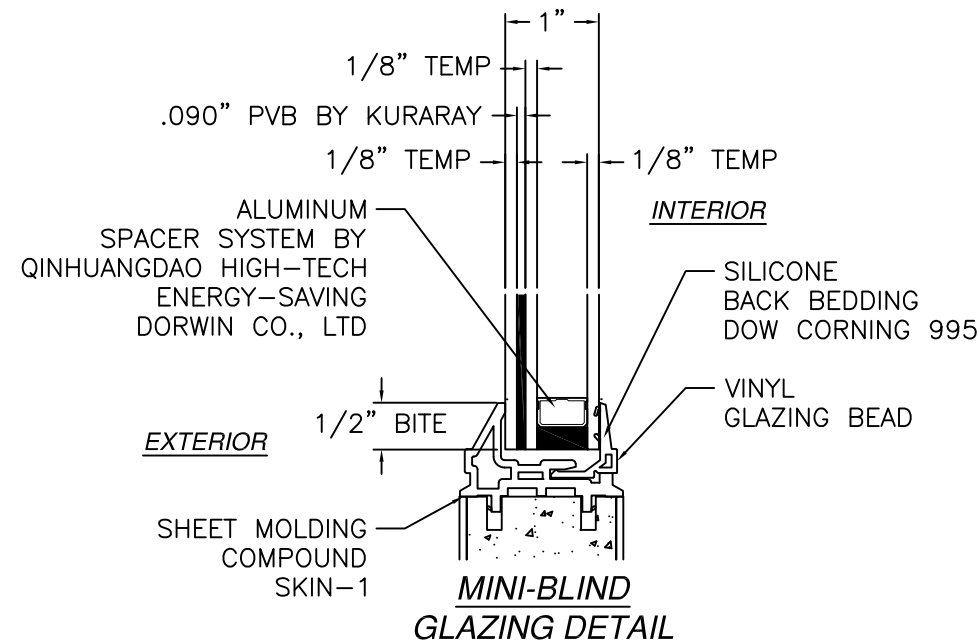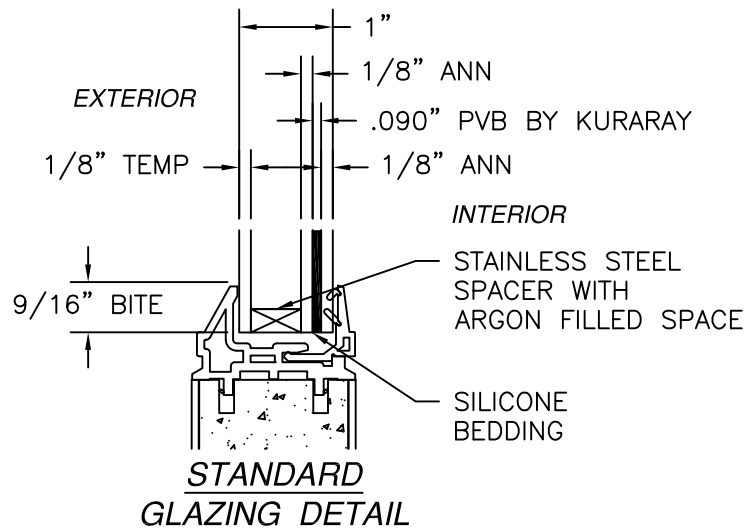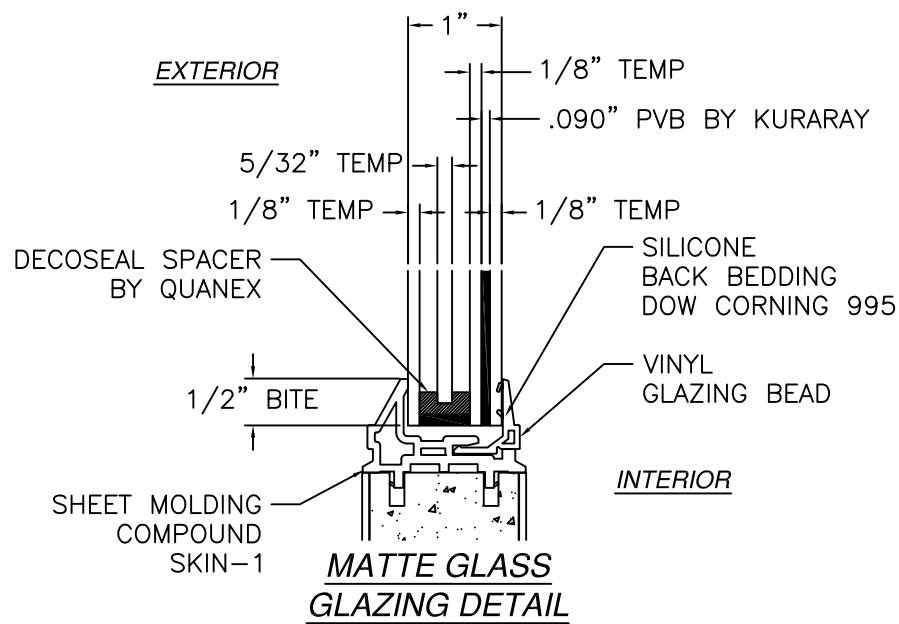

NAN YA PLASTICS CORP. USA
4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SRS GLIDING PATIO DOOR W/FIELD MULLION
120611 IMPACT
GLAZING DETAILS

DRAWN:
J.L.

DWG NO.
08-01900

REV
E


SCALE NTS

DATE 01/17/13

SHEET 5 OF 8


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 08/11/2026

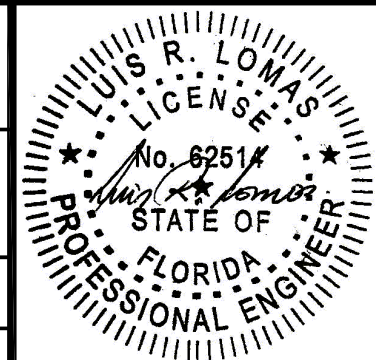


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED ADDRESS & SILL RISER	07/08/2026	R.L.

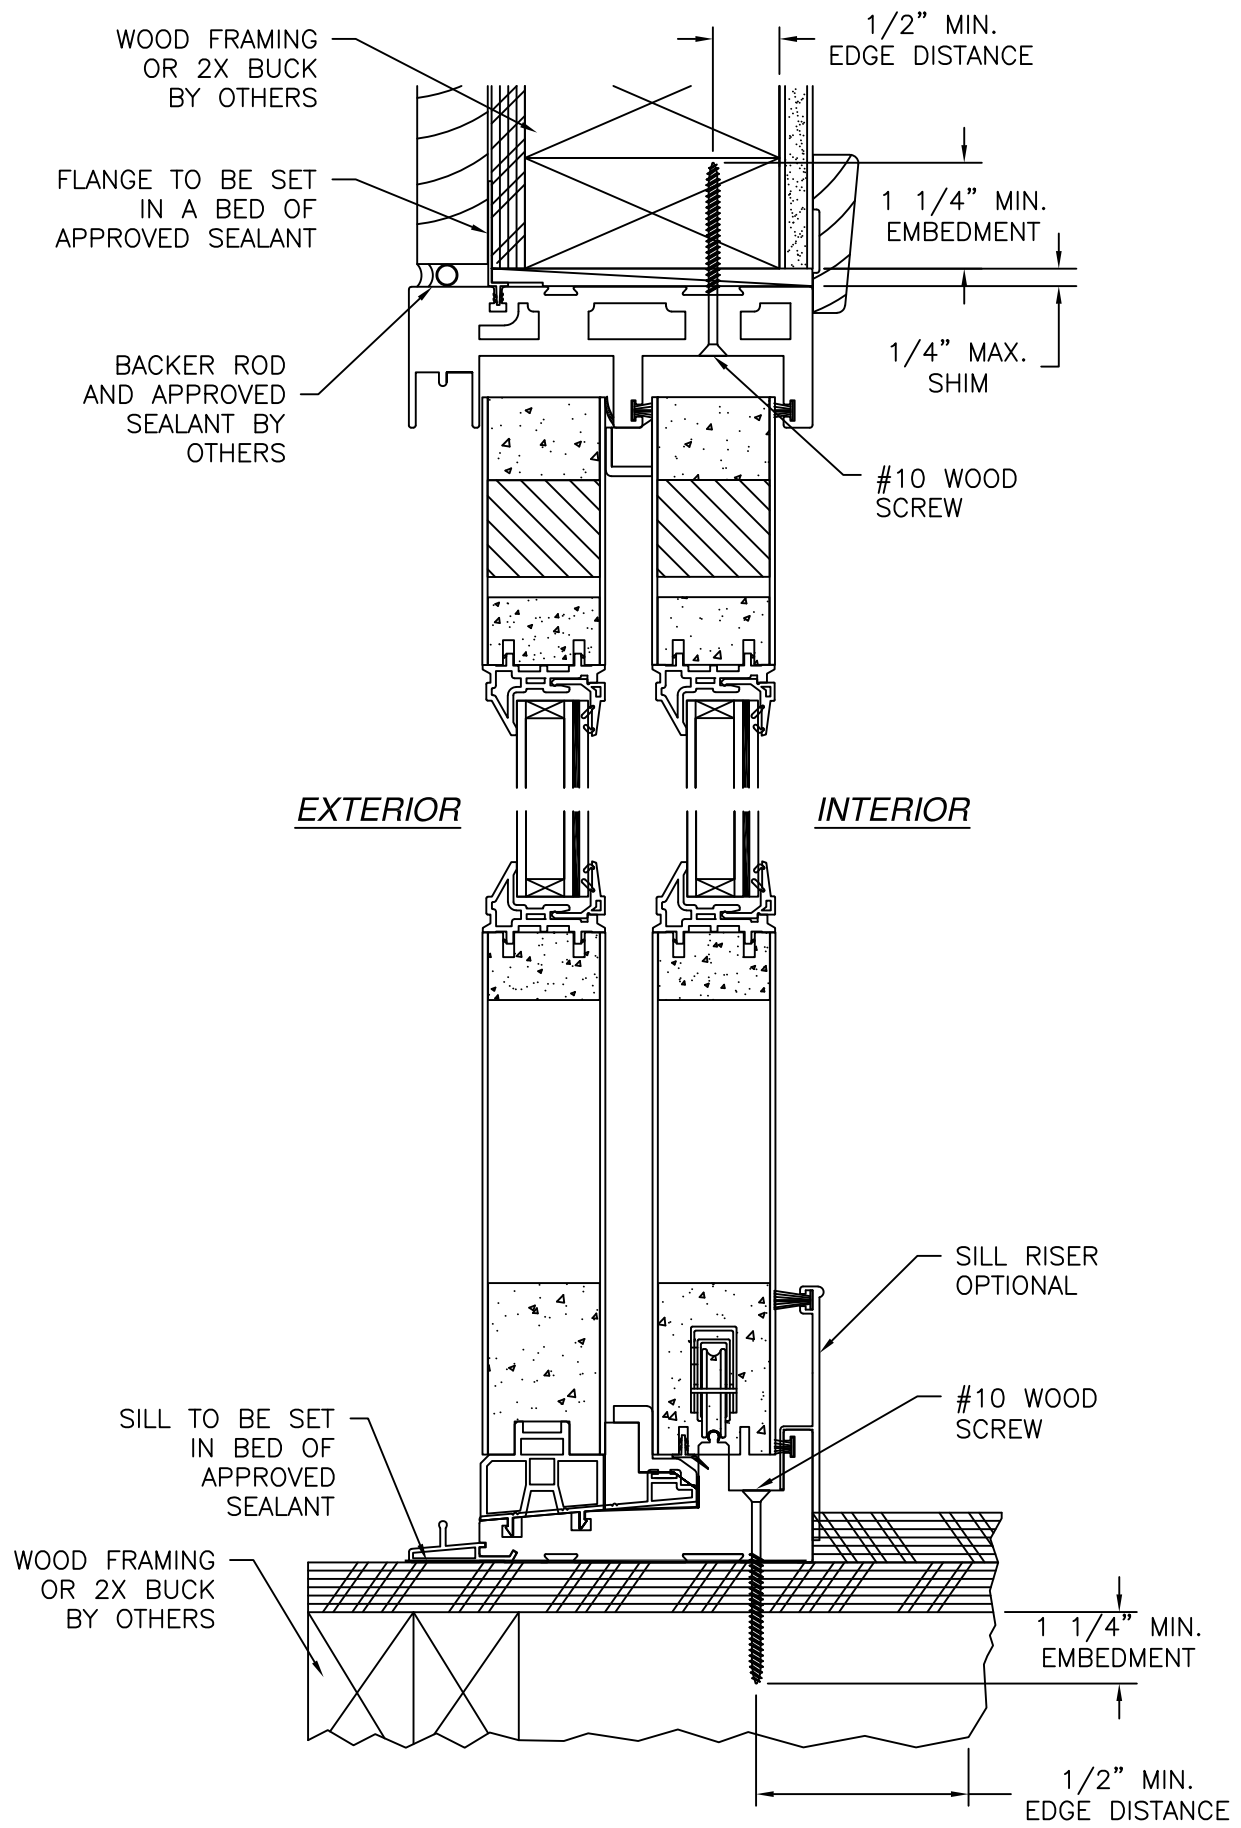

VERTICAL CROSS SECTION
 DOOR SHOWN, SIDELITE SIMILAR
 2X BUCK/WOOD FRAMING INSTALLATION

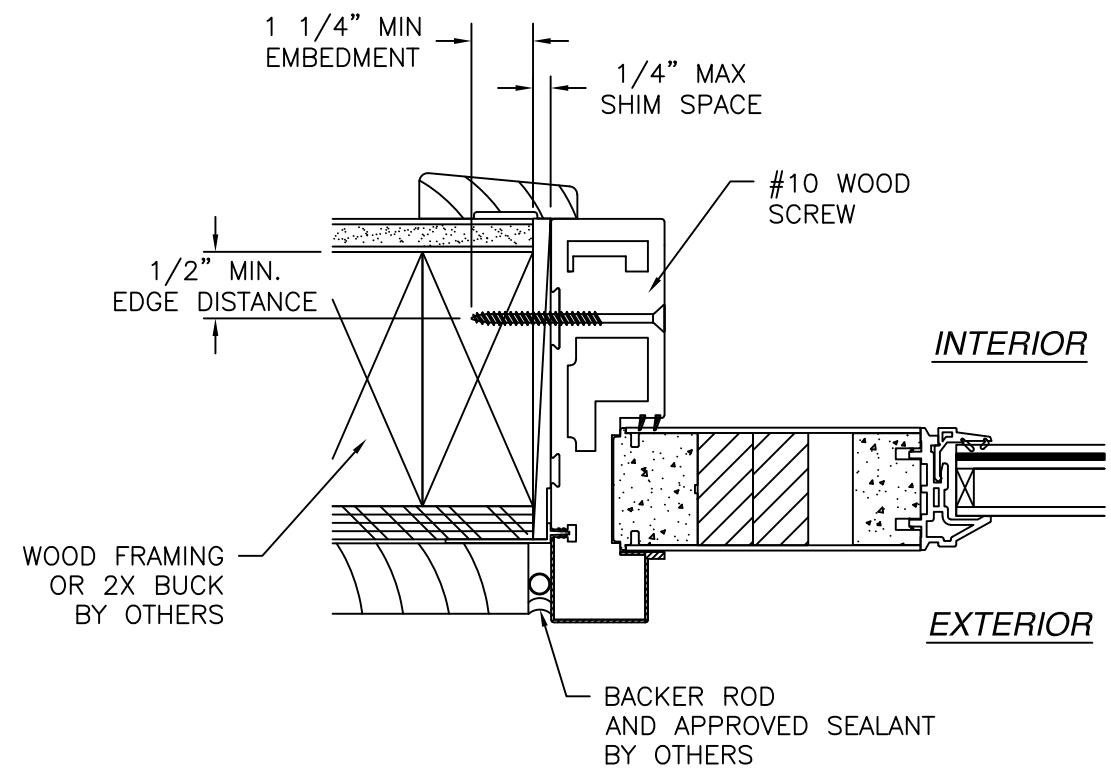

HORIZONTAL CROSS SECTION
 2X BUCK/WOOD FRAMING INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 08/11/2026

NAN YA PLASTICS CORP. USA

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SRS GLIDING PATIO DOOR W/FIELD MULLION

120611 IMPACT

INSTALLATION DETAILS

DRAWN: J.L.

DWG NO. 08-01900

REV E

SCALE NTS

DATE 01/17/13

SHEET 6 OF 8

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

LUIS R. LOMAS

LICENS. M.E.

No. 62514



STATE OF FLORIDA

PROFESSIONAL ENGINEER

Luis R. Lomas P.E.

FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED ADDRESS & SILL RISER	07/08/2026	R.L.

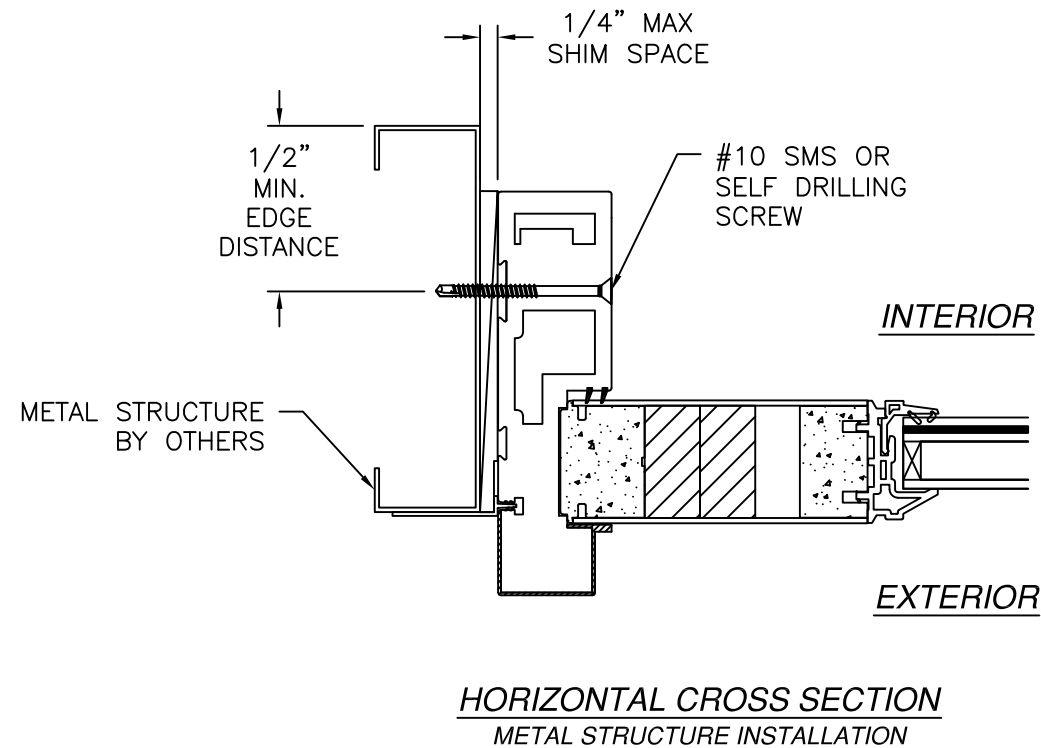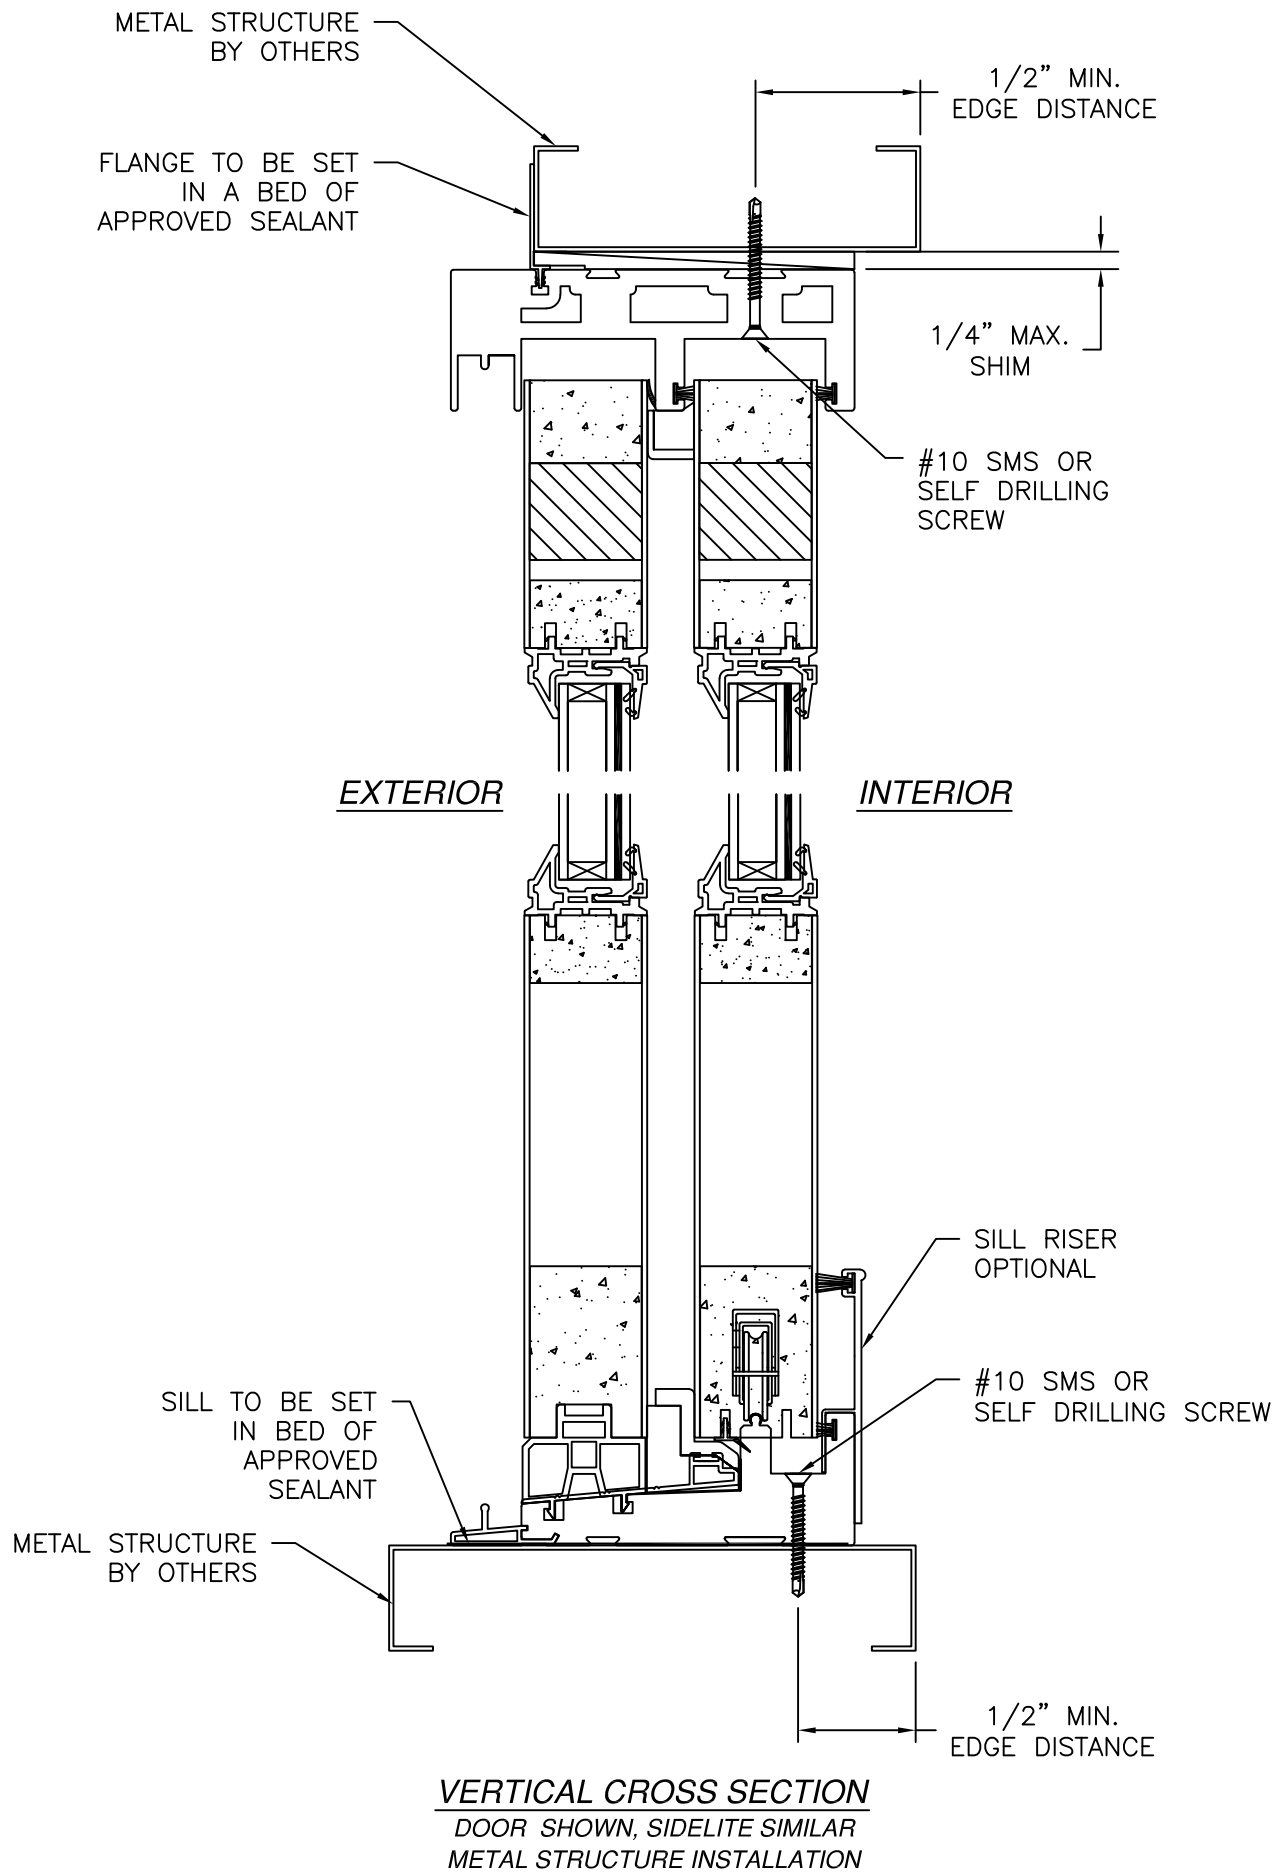


- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 08/11/2026

NAN YA PLASTICS CORP. USA 4016 SHADRACK ST. HOUSTON, TX 77013		
SERIES SRS GLIDING PATIO DOOR W/FIELD MULLION 120611 IMPACT INSTALLATION DETAILS		
DRAWN: J.L.	DWG NO. 08-01900	REV E
SCALE NTS	DATE 01/17/13	SHEET 7 OF 8
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

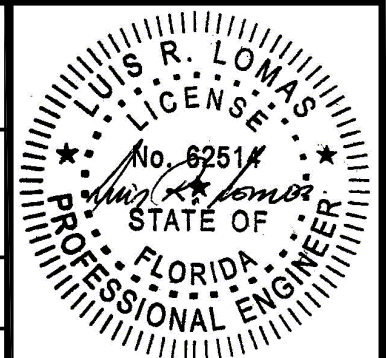


Luis R. Lomas P.E.
FL No.: 62514

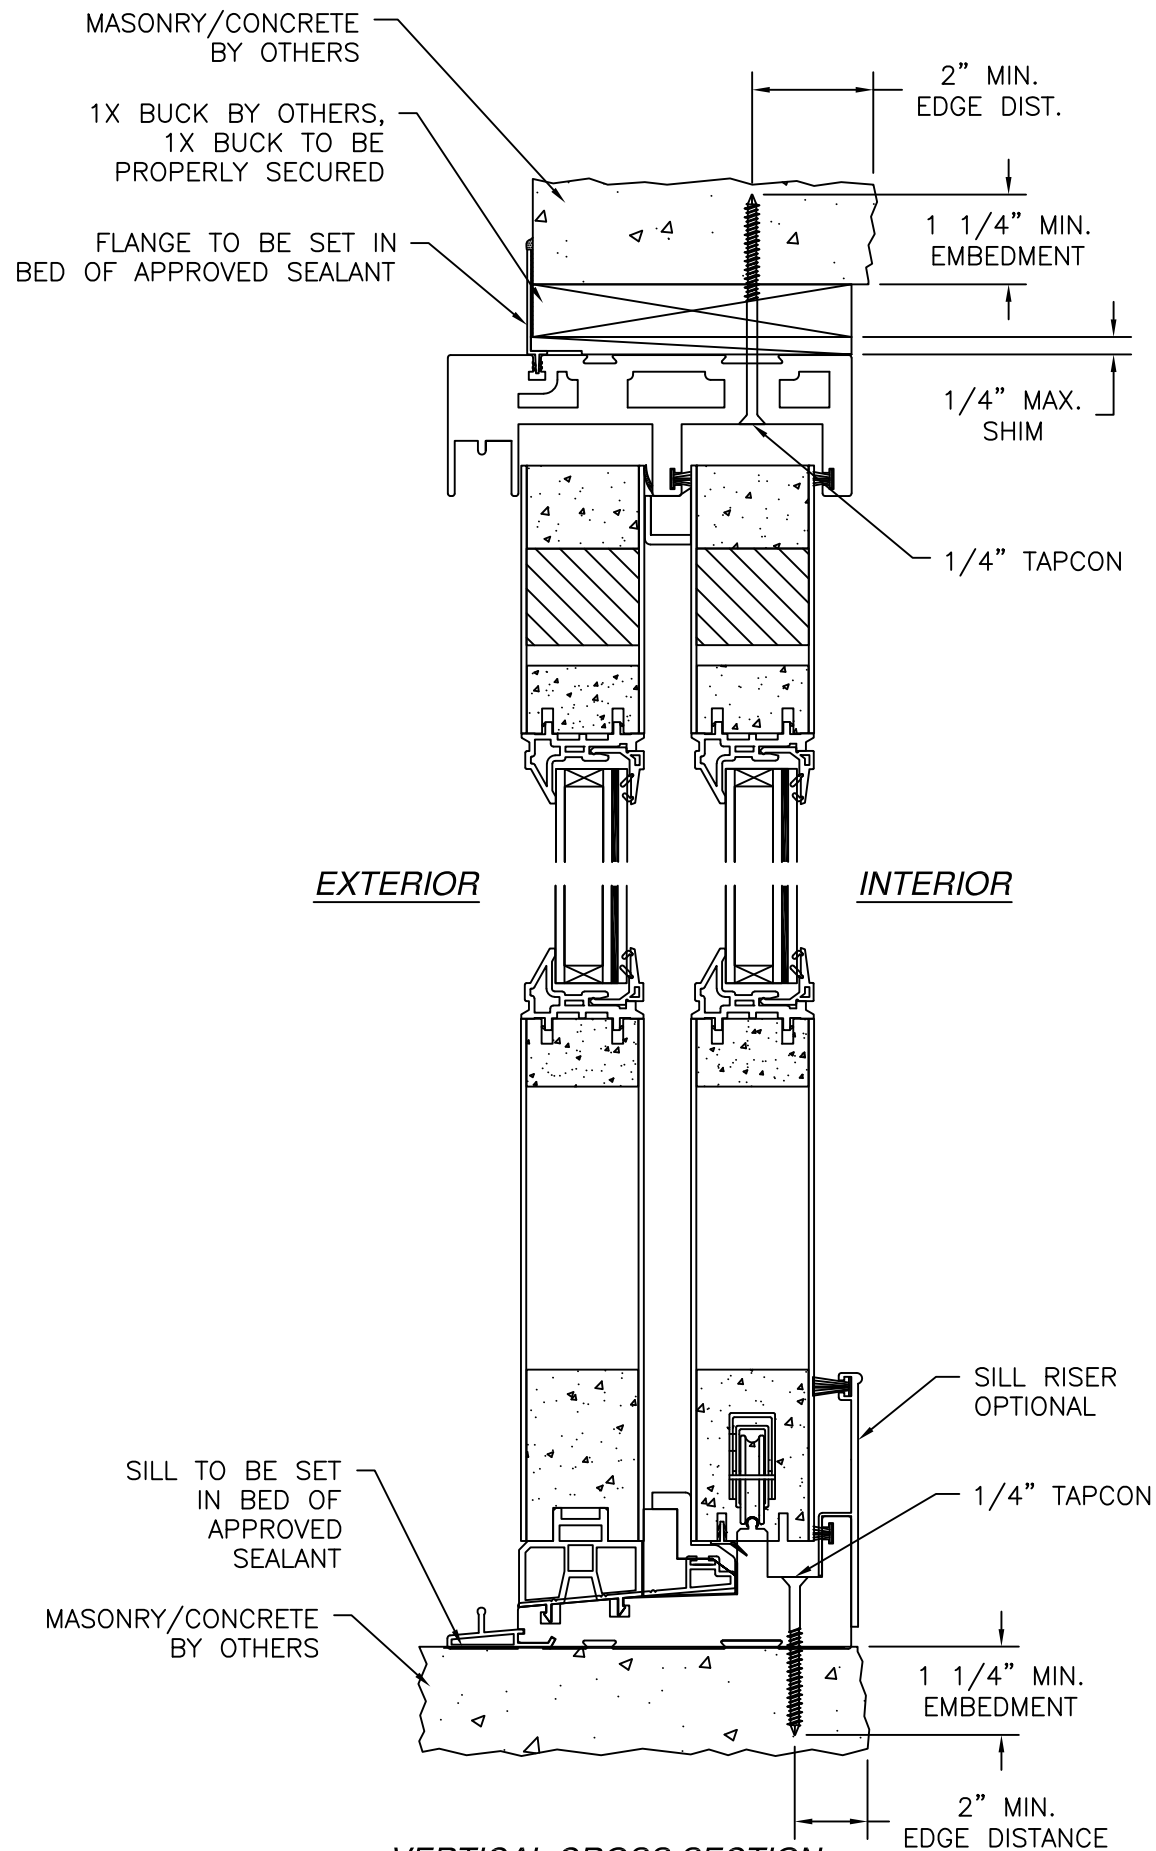

VERTICAL CROSS SECTION
MASONRY/CONCRETE INSTALLATION
DOOR SHOWN SIDELITE SIMILAR

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED ADDRESS & SILL RISER	07/08/2026	R.L.

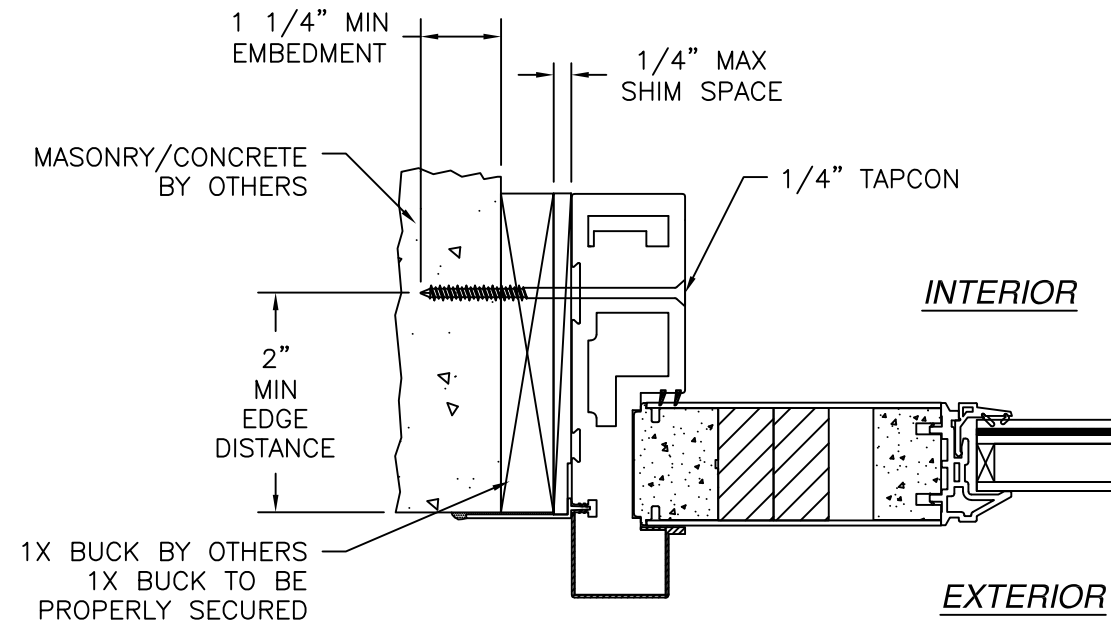


HORIZONTAL CROSS SECTION
MASONRY/CONCRETE INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 08/11/2026

NAN YA PLASTICS CORP. USA 4016 SHADRACK ST. HOUSTON, TX 77013		
SERIES SRS GLIDING PATIO DOOR W/FIELD MULLION 120611 IMPACT INSTALLATION DETAILS		
DRAWN: J.L.	DWG NO. 08-01900	REV E
SCALE NTS	DATE 01/17/13	SHEET 8 OF 8
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

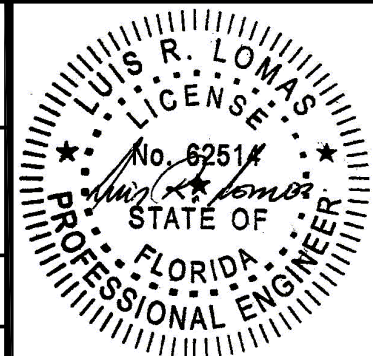

Luis R. Lomas P.E.
FL No.: 62514