


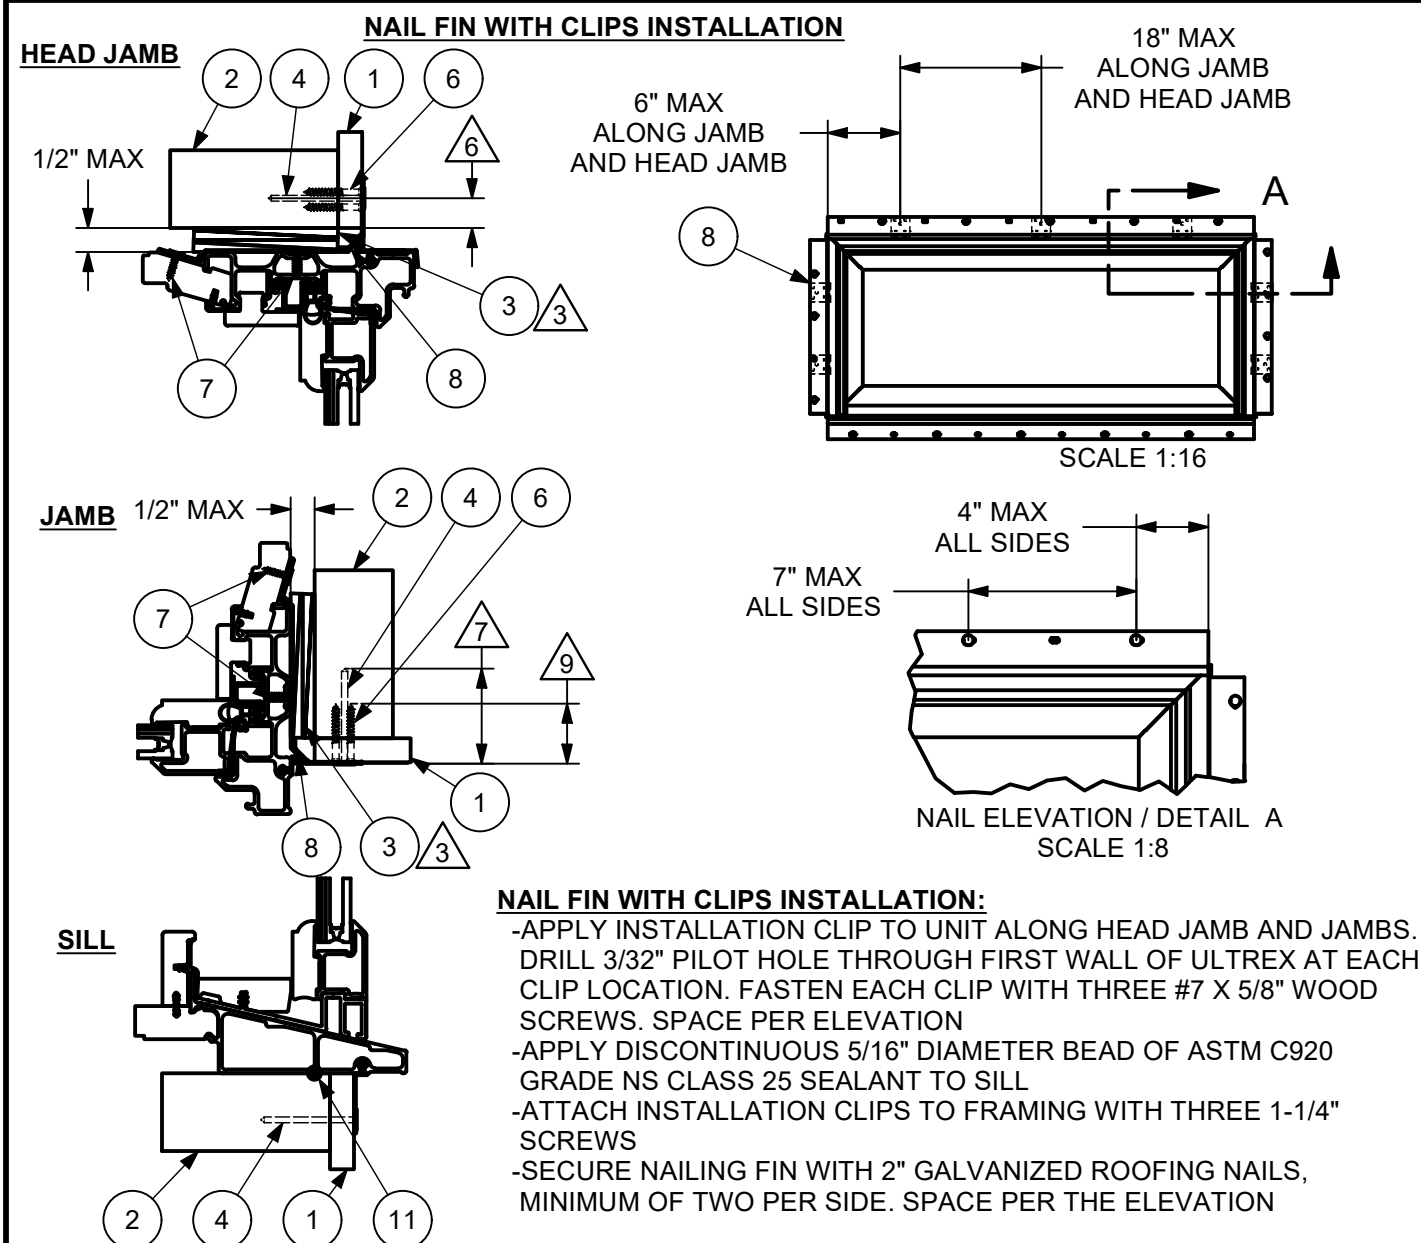


- NOTES:**
1. FOR GENERAL SPECIFICATIONS, REFER TO DOC 00003952
 2. THIS PRINT IS FOR STRUCTURAL PERFORMANCE ONLY. FOR FLASHING & SEALING INSTRUCTIONS, REFER TO THE INSTALLATION INSTRUCTIONS
 - △ 3. SHIMS: PLACE WITHIN 4" - 6" OF EACH CORNER AND SPACE ALL OTHERS EVENLY, A MAXIMUM OF 15" APART.
 4. IF CHEMICALLY TREATED LUMBER IS USED FOR FRAMING MATERIAL, FASTENERS INTO THE FRAMING MUST BE A MINIMUM OF 0.90 OZ/FT² ZINC HOT DIPPED GALVANIZED OR STAINLESS STEEL TYPE 304 OR 316
 5. #8 X 1-1/4" PAN HEAD OR WAFFLE HEAD SCREWS MAY BE SUBSTITUTED FOR 2" ROOFING NAILS
 - △ 6. MINIMUM EDGE DISTANCE: 1/2"
 - △ 7. MINIMUM NAIL EMBEDMENT DEPTH: 1-15/16"
 - △ 8. MINIMUM SCREW EMBEDMENT DEPTH: 1-7/16"
 - △ 9. MINIMUM SCREW EMBEDMENT DEPTH: 1-3/16"
 - △ 10. GLASS COMPLIES WITH ASTM E1300

12.1	ADDED GLAZING DETAIL, GLASS MAKEUP TABLE, MAX FRAME SIZE, AND NOTE 10; UPDATED DESCRIPTION; REMOVED LAST BULLETS FROM BOTH INSTALL NOTES	27575	08/10/23	JH
REV	DESCRIPTION / REQUESTOR	ECN NO	DATE	REV BY

NOTICE - CONFIDENTIAL INFORMATION

NOTICE - CONFIDENTIAL INFORMATION

The information in this document is privileged and strictly confidential. The information contained herein shall be used only by Marvin employees and by those agents or suppliers granted official written permission. If the reader of this document is not the intended recipient, or the employee or agent of the intended recipient, please delete this document from all data storage devices, and destroy all hard copies. Any unauthorized dissemination, distribution, copying or other use of the information contained in this document is strictly prohibited.

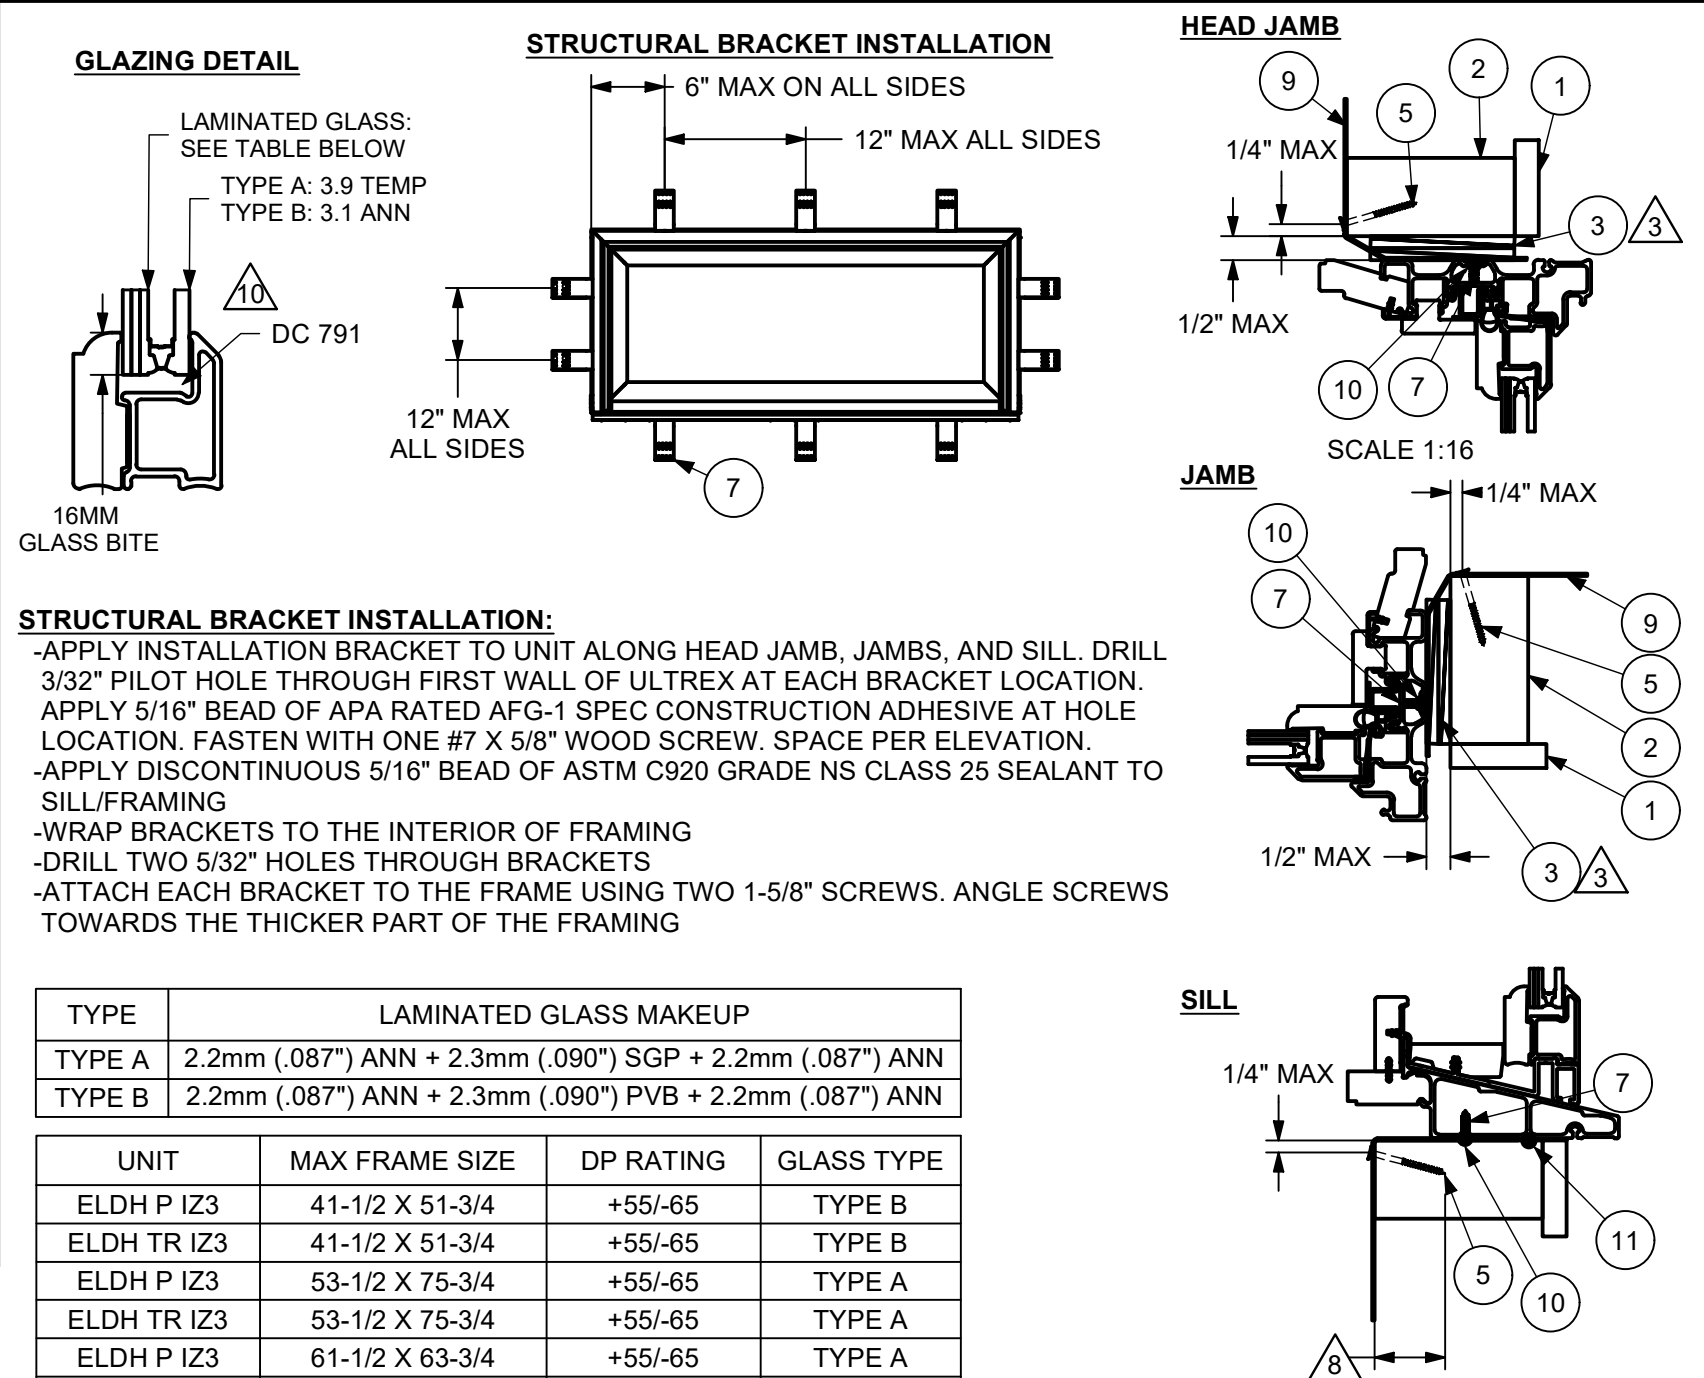

TYPE	LAMINATED GLASS MAKEUP
TYPE A	2.2mm (.087") ANN + 2.3mm (.090") SGP + 2.2mm (.087") ANN
TYPE B	2.2mm (.087") ANN + 2.3mm (.090") PVB + 2.2mm (.087") ANN

UNIT	MAX FRAME SIZE	DP RATING	GLASS TYPE
ELDH P IZ3	41-1/2 X 51-3/4	+55/-65	TYPE B
ELDH TR IZ3	41-1/2 X 51-3/4	+55/-65	TYPE B
ELDH P IZ3	53-1/2 X 75-3/4	+55/-65	TYPE A
ELDH TR IZ3	53-1/2 X 75-3/4	+55/-65	TYPE A
ELDH P IZ3	61-1/2 X 63-3/4	+55/-65	TYPE A
ELDH TR IZ3	61-1/2 X 63-3/4	+55/-65	TYPE A

11	NA	ASTM C920 GRADE NS CLASS 25 SEALANT
10	NA	APA RATED AFG-01 CONSTRUCTION ADHESIVE
9	00003778	STRUCTURAL BRACKET 6" & 10"
8	00051456	IMPACT FRAME INSTALLATION CLIP
7	00003212	#7 X 5/8" SCREW
6	NA	#8 X 1-1/4" SCREW
5	NA	#8 X 1-5/8" SCREW
4	NA	2" GALVANIZED ROOFING NAIL
3	NA	SHIMS
2	NA	FRAMING
1	NA	SHEATHING
ITEM	DWG NO	DESCRIPTION
PARTS LIST		

CATEGORY:
DOUBLE HUNG

UNIT TYPE:
ELDH P IZ3. ELDH TR IZ3

MARVIN  **RESEARCH & DEVELOPMENT**

COLLECTION: ELEVATE

DWG TYPE: INSTALLATION
DESCRIPTION: INSTALLATION METHODS/ELEVATIONS, NAIL FIN WITH CLIPS/STRUCTURAL BRACKET

CHK:	JDD	SIZE:		CLASS:		DWG NO:	
	08/30/23		B		MISC		00052704

APP:	CRR	SCALE:		DATE:		DWG BY:		SHEET:	
	08/14/23		1 / 4		11/18/2007		HEPPNER, CALEB		1 OF 2