



TABLE 1: FRAME INSTALLATION ANCHOR REQUIREMENTS TABLE			
SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED.	MIN. EDGE DIST.
CONCRETE	3/16" ITW TAPCON	1-1/2"	1-1/8"
HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	2"
16 GAUGE (0.060") MIN. STEEL STUD, 33 KSI YIELD MIN., OR 1/8" ALUM. 6063-T5 MIN.	#10-16 HILTI KWIK-FLEX OR ITW TEKS SELF-DRILLING SCREW	3 THREADS BEYOND METAL WALL	1/2"

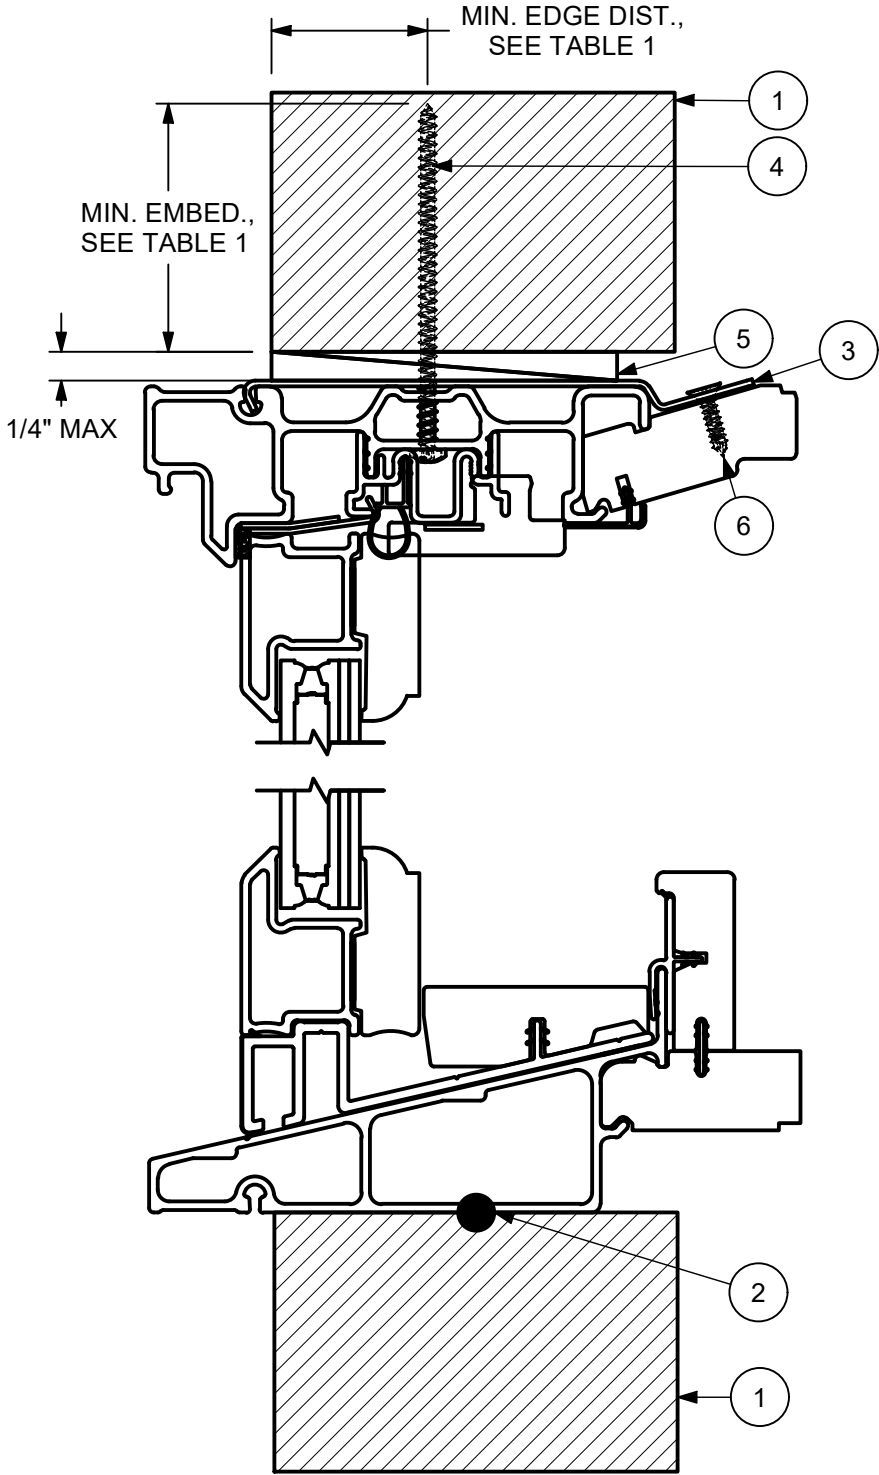

HEAD JAMB

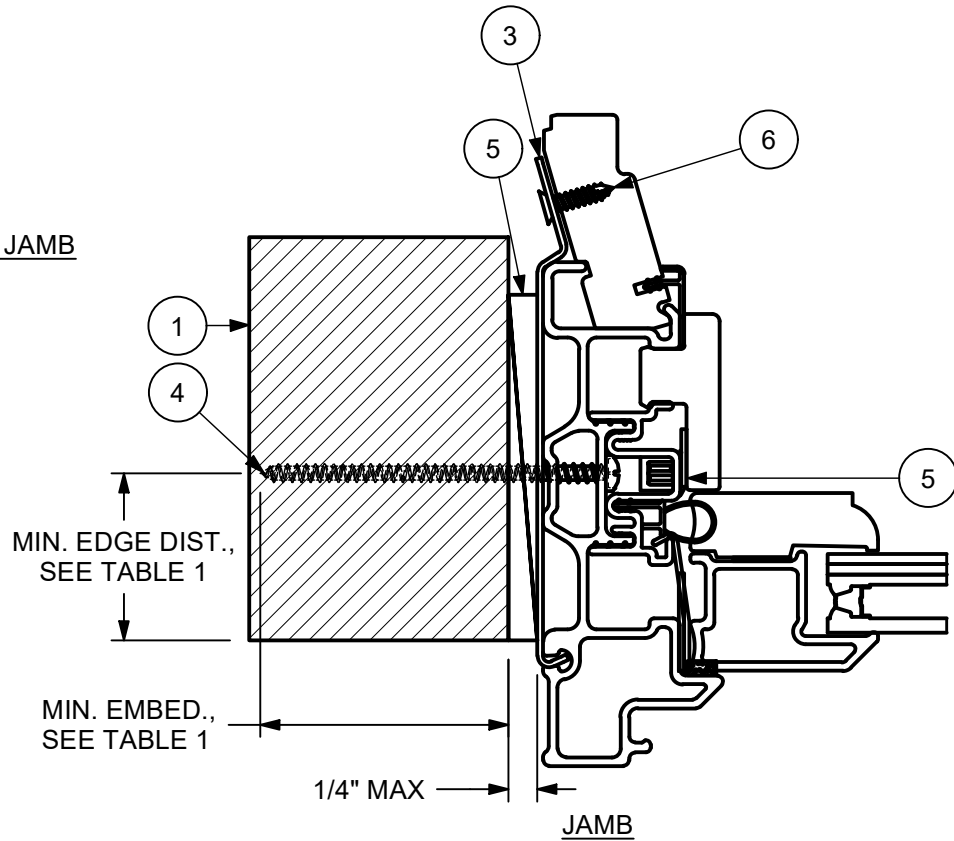


SILL

CATEGORY:
DOUBLE HUNG

UNIT TYPE:
ELDH P IZ3

Lucas Turner
2023.11.14
18:30:30
-06'00'



11/14/2023
LUCAS TURNER
FL PE 58201
TURNER ENGINEERING &
CONSULTING, INC.
2428 OLD NATCHEZ TRACE
TRL. CAMDEN, TN, 38320
PH 941-380-1574

THROUGH JAMB INSTALLATION:

- ATTACH INSTALLATION BRACKET AT EACH THROUGH JAMB HOLE LOCATION WITH TWO #7 X 5/8" SCREWS PER BRACKET
- SECURE UNIT TO FRAMING AT EACH PRE-DRILLED HOLE LOCATION WITH ONE FASTENER PER TABLE 1
- PLACE ONE NON-CONTINUOUS 5/16" DIAMETER BEAD OF ASTM C920 GRADE NS CLASS 25 SEALANT ON THE SILL FRAMING UNDER THE WINDOW

NOTES:

1. FOR GENERAL SPECIFICATIONS, REFER TO DOC 00003952
2. FLORIDA APPROVAL: FL10188
3. FOR ELEVATIONS AND ADDITIONAL REQUIREMENTS, REFER TO DOC 00115659
4. GLASS COMPLIES WITH ASTM E1300

6	00003212	#7-19 X .625" TYPE AB-17, FULL THREAD
5	NA	SHIMS
4	NA	INSTALLATION FASTENER, SEE TABLE 1
3	00070642	INSTALLATION CLIP, THROUGH JAMB
2	NA	ASTM C920 GRADE NS CLASS 25 SEALANT
1	NA	FRAMING MATERIAL
ITEM	DWG NO	DESCRIPTION

PARTS LIST

MARVIN RESEARCH & DEVELOPMENT

COLLECTION: ELEVATE

DWG TYPE: INSTALLATION
DESCRIPTION: INSTALLATION METHODS, THROUGH JAMB, NON-WOOD, FL10188

CHK:	SIZE: B	CLASS: MISC	DWG NO: 00115660
APP:	SCALE: 3:5	DATE: 10/28/2018	DWG BY: SMITH, BRENDAN
			SHEET: 1 OF 2