



HEAD JAMB

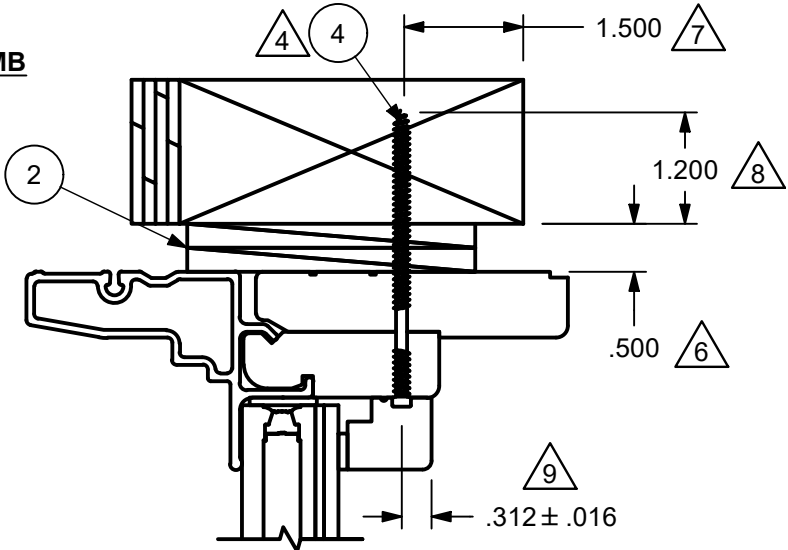




SILL

SCALE 1:2

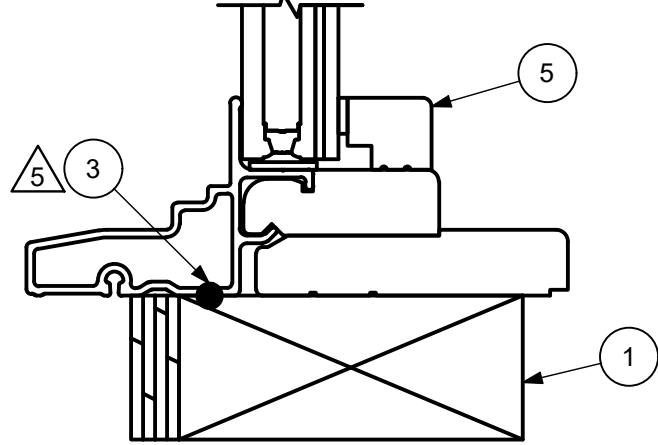

SCALE 1:2

JAMB

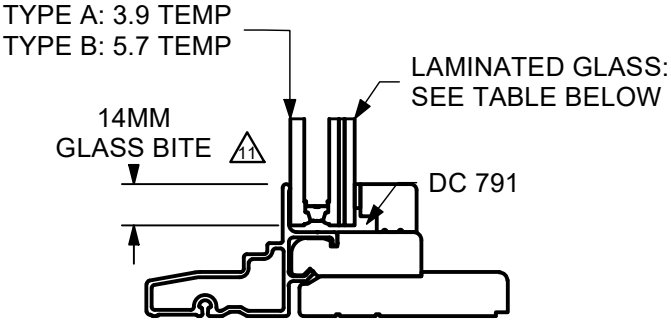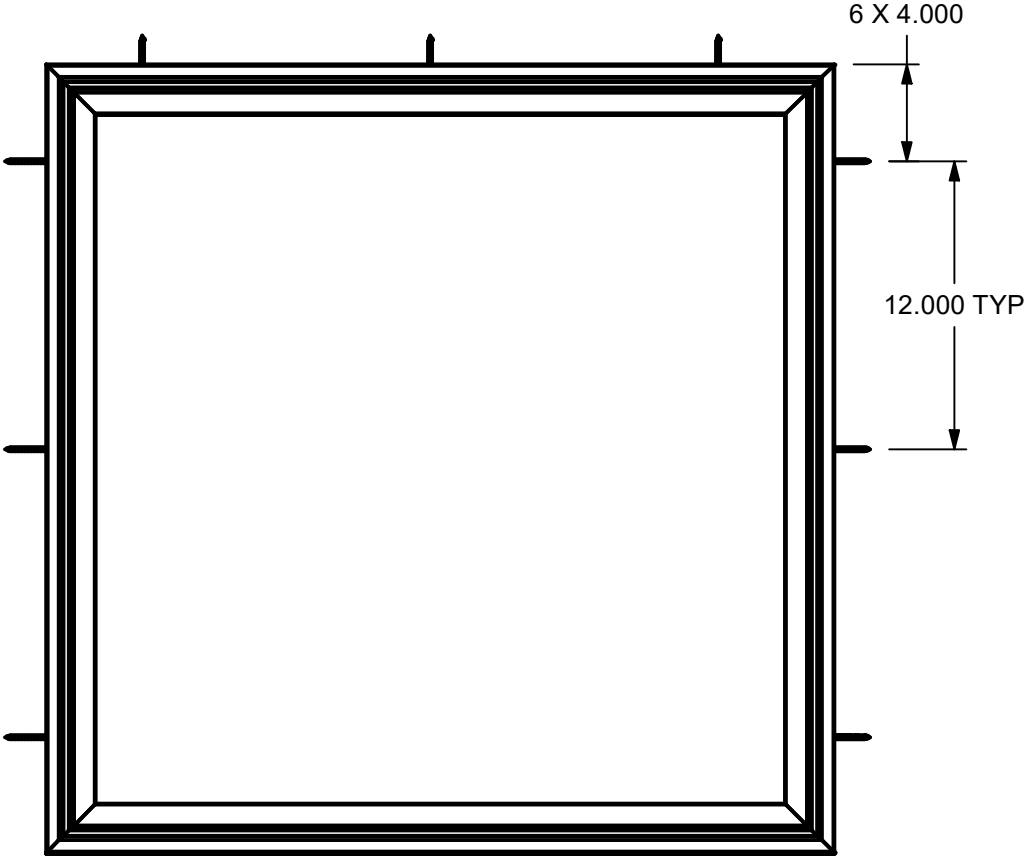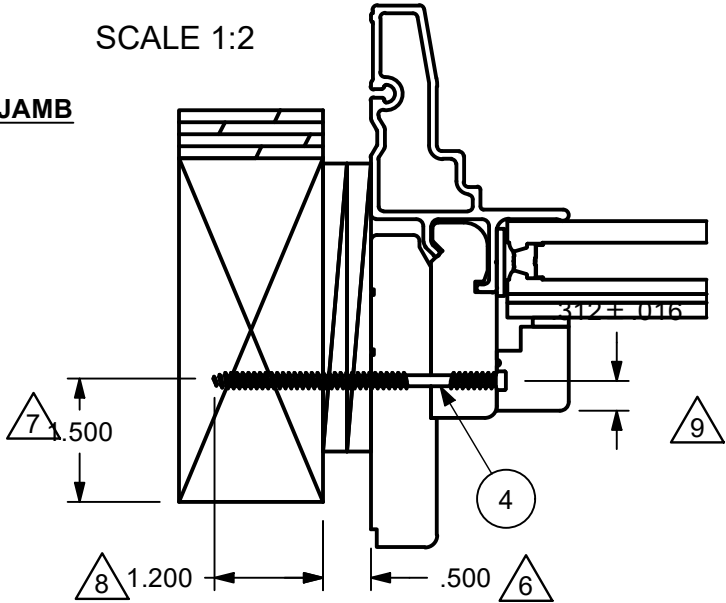

GLAZING DETAIL

TYPE	LAMINATED GLASS MAKEUP
TYPE A	2.2MM (0.087") ANN + 2.29MM (0.090") PVB + 2.2MM (0.087") ANN
TYPE B	3.9MM (0.154") ANN + 2.41MM (0.095") SGP + 3.9MM (0.154") ANN

Unit	Max Frame Size	DP Rating	Glass Type
ELDGI Z3	72 X 29-1/2	+55/-65	TYPE A
ELDGI Z3	95 X 72-1/2	+55/-65	TYPE B

CATEGORY: DIRECT GLAZE
UNIT TYPE: ELDGI Z3

5	00131881	IMPACT GLAZING BEAD
4	00087407	#8 X 3.125" TRIM HEAD, RT SCREW
3	NA	ASTM C920 NS CLASS 25 SEALANT
2	NA	STANDARD SHIM
1	NA	FRAMING MATERIAL
ITEM	DWG NO	DESCRIPTION

PARTS LIST

MARVIN RESEARCH & DEVELOPMENT

COLLECTION: ELEVATE

DWG TYPE: INSTALLATION
DESCRIPTION: INSTALLATION METHODS/ELEVATIONS, THROUGH JAMB, ELDGI Z3, DH/DR FRAME TYPE

CHK:	SIZE: B	CLASS: ASSY	DWG NO: 00120778
APP:	SCALE: 1:8	DATE: 11/20/2019	DWG BY: SWENSON, BRYAN
			SHEET: 1 OF 2

NOTES:

- FOR GENERAL SPECIFICATIONS, REFER TO DOC 00003952
- THIS PRINT IS FOR STRUCTURAL PERFORMANCE ONLY. FOR FLASHING AND SEALING INSTRUCTIONS, REFER TO THE INSTALLATION INSTRUCTIONS
- SHIMS:
 - PLACE SHIMS WITHIN 4"-6" OF EACH CORNER AND AT EACH THROUGH JAMB LOCATION
- IF CHEMICALLY TREATED LUMBER IS USED FOR FRAMING MATERIAL FASTENERS MUST BE A MINIMUM OF .090 OZ/FT^2 ZINC HOT DIPPED GALVANIZED STEEL TYPE 304 OR 316
- PLACE ONE CONTINOUS 5/16" BEAD OF SILICONE SEALANT TO THE BOTTOM OF SILL/FRAMING
- MAX OF .500" GAP AT POINTS OF ATTACHMENT
- MINIMUM FASTENER DISTANCE FROM EDGE 1.500"
- MINIMUM EMBEDMENT OF 1.200"
- PREDRILL .250" DIAMETER HOLE THROUGH STOP WITH FLEXIBLE DRILL EXTENSION
- ELDGI Z3 DH/DOOR FRAME SHOWN FOR ELDGI Z3 CA FRAME UNIT DETAILS. REFER TO DOC 00120773
- GLASS COMPLIES WITH ASTM E1300

2	ADDED NOTE 11, GLAZING DETAIL, SIZE CHART, AND LAMINATED GLASS CHART	27575	08/10/23	JH
1	CHANGED TO NEW GLAZING BEAD	24307	11/02/21	JDD
REV	DESCRIPTION / REQUESTOR	ECN NO	DATE	REV BY