


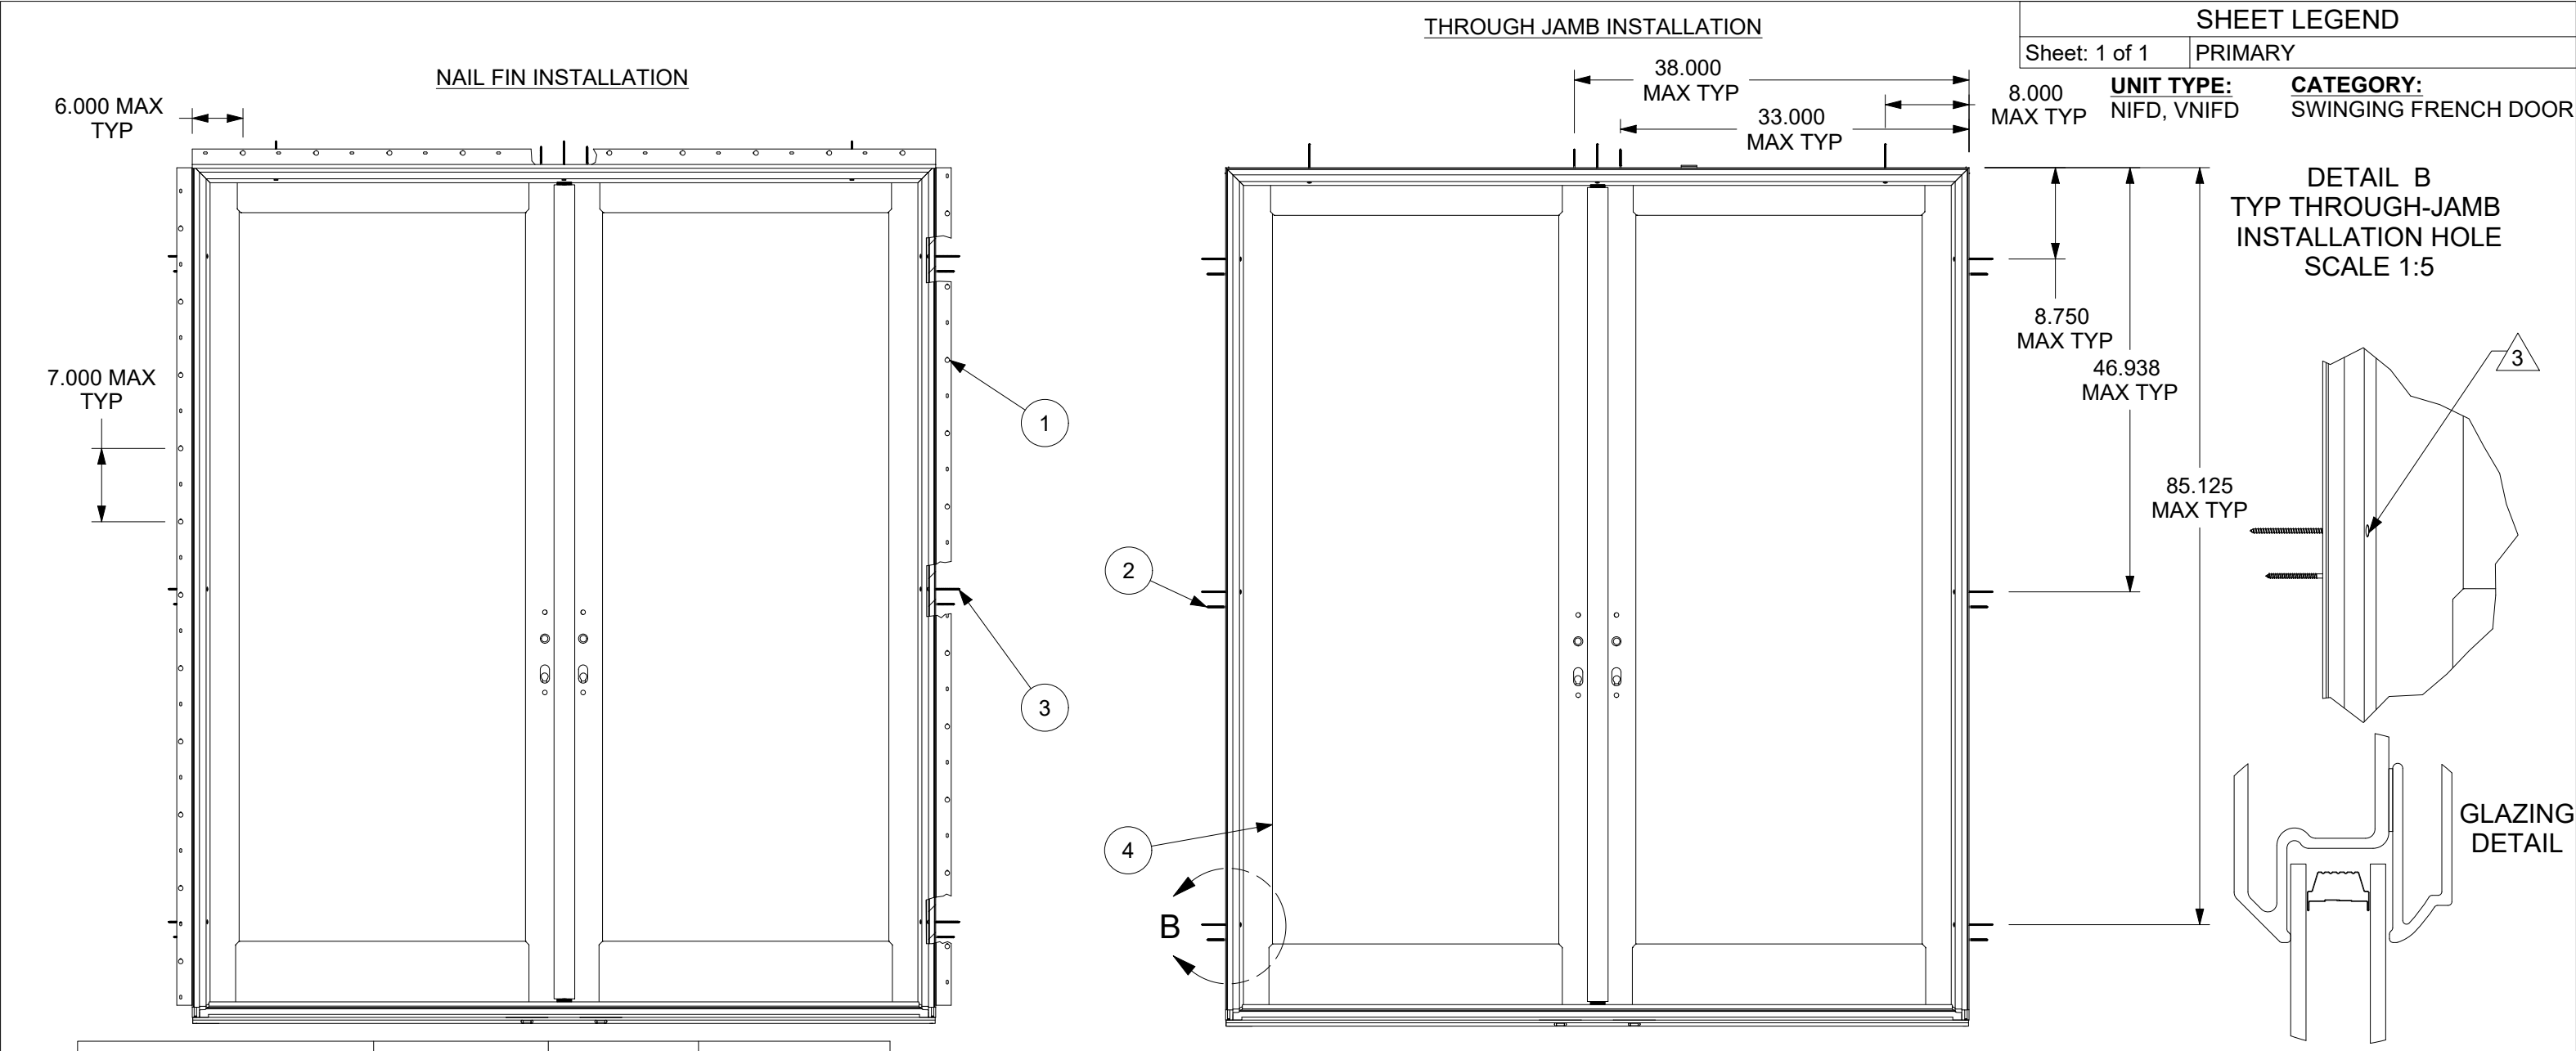

CONFIGURATION	MAX SIZE	DP RATING	MAX PANEL SIZE
O	36 5/16 X 95 1/2	+30/-30	34 19/32 X 92 23/32
X	36 5/16 X 95 1/2	+30/-30	34 19/32 X 92 23/32
OO/XX	71 X 95 1/2	+30/-30	34 19/32 X 92 23/32
XO/OX	71 X 95 1/2	+30/-30	35 5/8 X 92 23/32
OOO	105 3/4 X 95 1/2	+30/-30	34 19/32 X 92 23/32
XOO/OOX,OXO,XXO/OXX	105 3/4 X 95 1/2	+30/-30	34 19/32 X 92 23/32

4	00088018	UNIT, XX, NIFD, VNIFD
3	00003264	#8-18 X 3.000" TYPE AB, FULL THREAD
2	00003228	#8-15 X 2.500" TYPE A/TF, 2/3 THREAD
1	NA	2.000" GALVANIZED ROOFING NAIL
ITEM	DWG NO	DESCRIPTION

PARTS LIST		
------------	--	--

MARVIN

RESEARCH & DEVELOPMENT

COLLECTION: VIVID, INFINITY

DWG TYPE: INSTALLATION
DESCRIPTION: INSTALLATION ELEVATION

SHEET NAME: PRIMARY (1 OF 1)

CHK: 08/21/2025	CLE	SIZE: B	CLASS: MISC	DWG NO: 00104535	REV: 3.1
APP: 08/25/2025	JHS	SCALE: 1:15	DATE: 2/1/2017	DWG BY: BOMAN, DEREK	

NOTES:

1. FOR GENERAL SPECIFICATIONS, REFER TO DOC 00003952
2. CN 6068 XX NIFD SHOWN
- △ 3. PRE-DRILL JAM AND HEADER THROUGH-JAM INSTALLATION HOLES USING 3/16" DRILL BIT
4. #8 X 3.000" SCREWS USED AT EACH THROUGH-JAMB LOCATION
5. #8 X 2.500" SCREWS USED AT HINGE AND STRIKE LOCATIONS
- 1 SCREW PER HINGE
- 2 SCREWS PER JAMB/HEAD JAMB STRIKE PLATE
6. FOR MAX SIZE AND PERFORMANCE, REFER TO DOC 00102709
7. FOR INSTALLATION DETAILS, REFER TO DOC 00104547
- △ 8. GLASS COMPLIES WITH ASTM E1300

3.1	ADDED MAX SIZE, MAX FRAME SIZE, AND DP RATING TABLE	27638	03/05/2025	LCE
2.2	UPDATED ASSEMBLY (STRIKE PLATE)	23678	2019-04-03	AAA
REV	DESCRIPTION / REQUESTOR	ECN NO	DATE	REV BY