


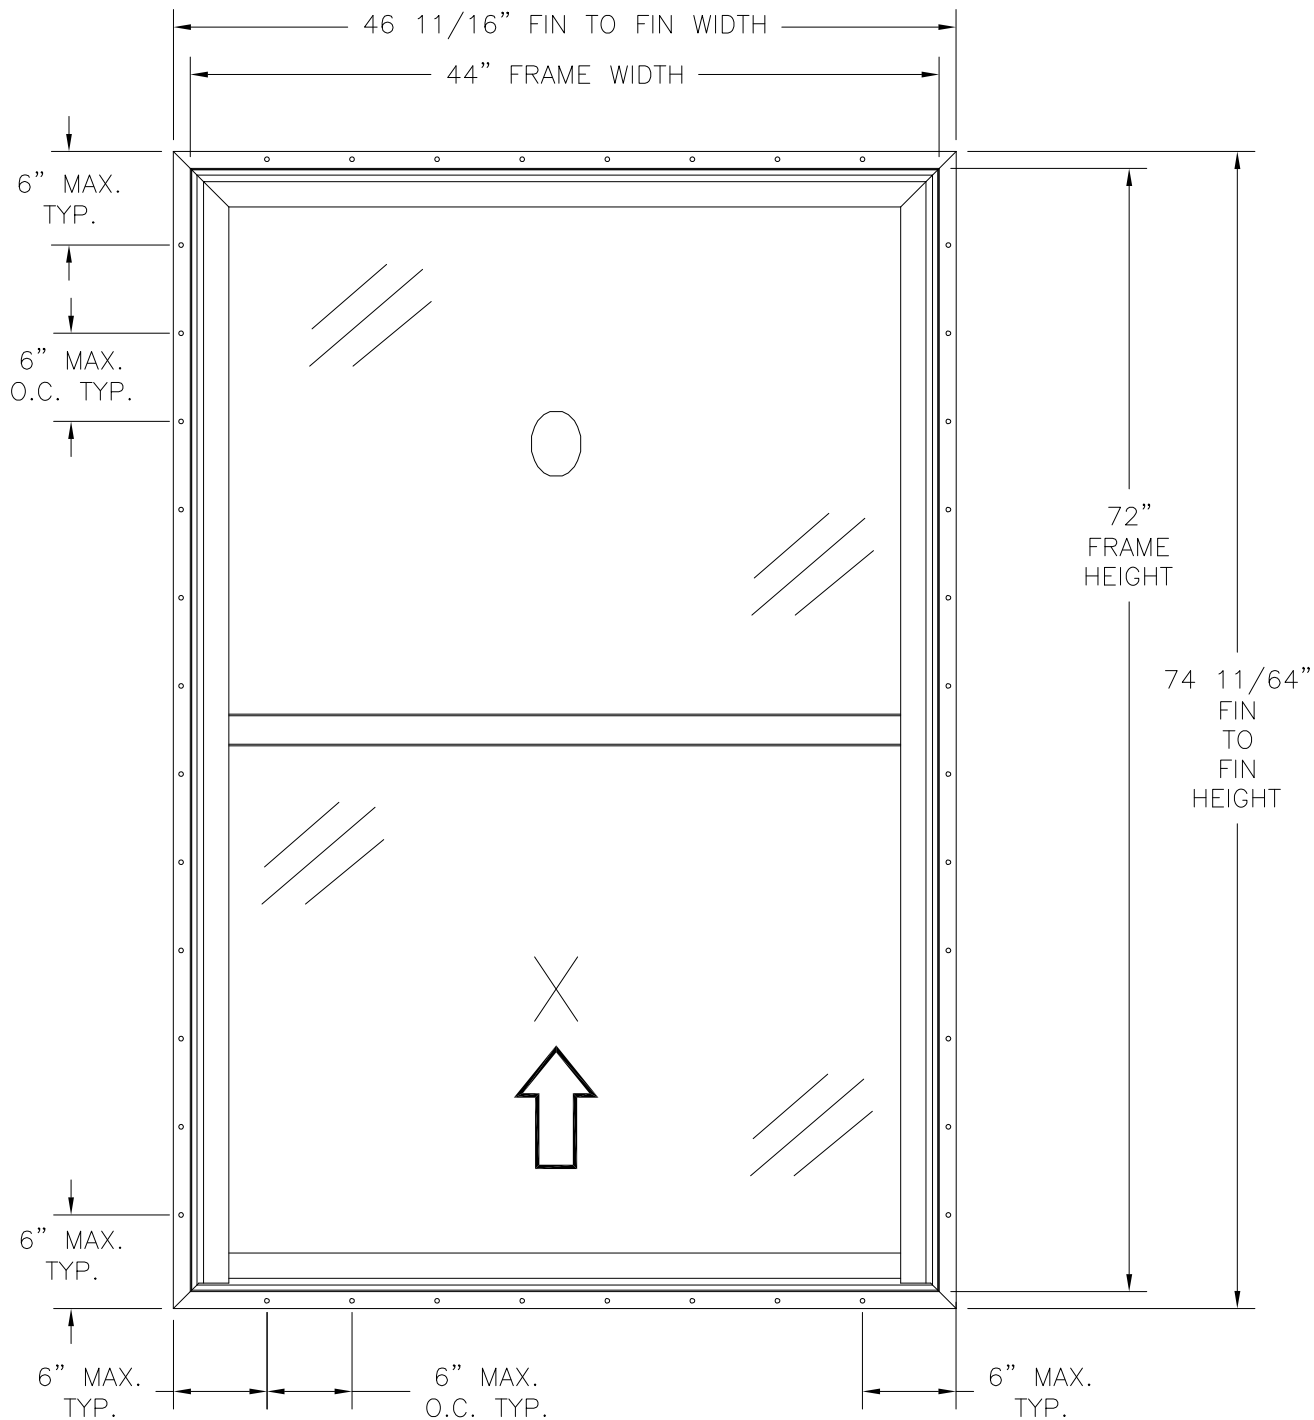

SHORELINE 1100 SH PVC SINGLE HUNG WINDOW
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
±35PSF	NONE

44" X 72" UNIT SHOWN. OTHER SIZES APPROVED AS LONG AS
FRAME AREA DOES NOT EXCEED 22 FT²

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	ELEVATION AND NOTES
2	INSTALLATION DETAILS

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW REQUIREMENTS	12/22/17	R.L.

- NOTES:
- 1) THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
 - 2) WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
 - 3) ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
 - 4) FRAME SASH MATERIAL: EXTRUDED WHITE RIGID PVC .065" THICK.
 - 5) UNITS MUST BE GLAZED PER ASTM E1300.
 - 6) APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN AREAS WHERE WIND BORNE DEBRIS PROTECTION IS REQUIRED.
 - 7) SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
 - 8) FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREW WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/2" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
 - 9) ALL FASTENERS TO BE CORROSION RESISTANT.
 - 10) INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
A. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42.
 - 11) 44" x 72" WINDOW:
MAX. SASH SIZE: 41 1/4" x 35"
MAX. SASH D.L.O.: 38 3/4" x 32 1/2"
MAX. FIXED LITE D.L.O.: 39 3/8" x 32 3/8"

VIWIN TECH WINDOWS AND DOORS
2400 IRVIN COBB DRIVE
PADUCAH, KY 42003

SHORELINE 1100 SH PVC SINGLE HUNG WINDOW
44" x 72"
ELEVATION, ANCHORING AND NOTES


DRAWN: TJH	DWG NO. 08-00755	REV A
SCALE NTS	DATE 05/05/09	SHEET 1 OF 2

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@rlomaspe.com

SIGNED: 12/22/2017




Luis R. Lomas P.E.
FL No.: 62514

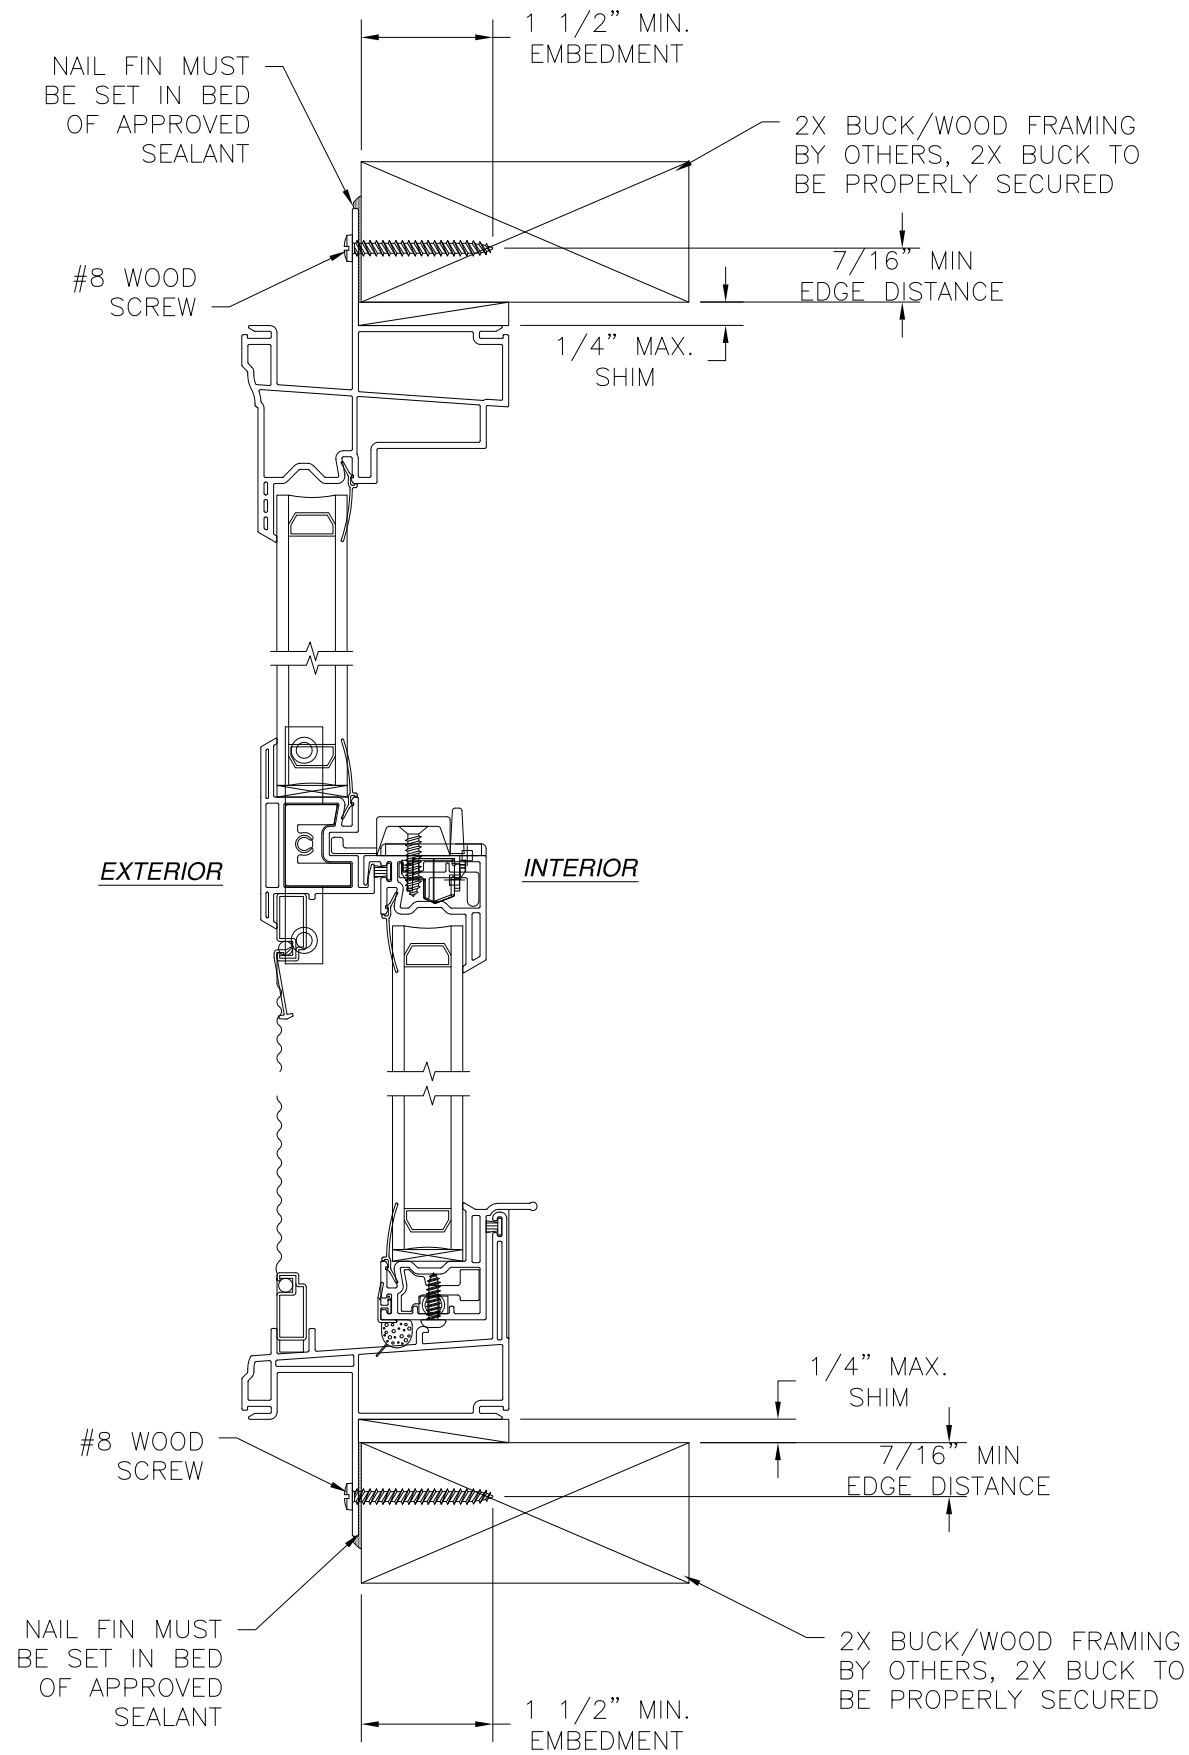

VERTICAL CROSS SECTION
2X BUCK/WOOD FRAMING INSTALLATION

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW REQUIREMENTS	12/22/17	R.L.

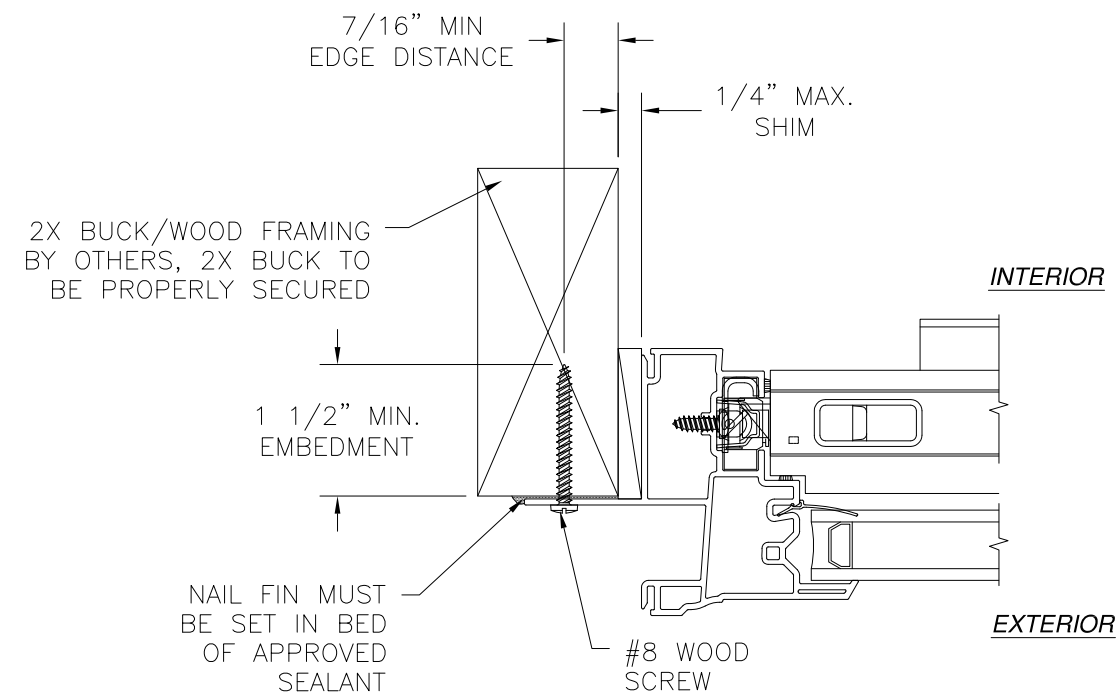

JAMB INSTALLATION
2X BUCK/WOOD FRAMING

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 12/22/2017


VIWIN TECH WINDOWS AND DOORS

2400 IRVIN COBB DRIVE
PADUCAH, KY 42003

SHORELINE 1100 SH PVC SINGLE HUNG WINDOW
44" x 72"
INSTALLATION DETAILS

DRAWN: TJH	DWG NO. 08-00755	REV A
SCALE NTS	DATE 05/05/09	SHEET 2 OF 2

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@rlomaspe.com

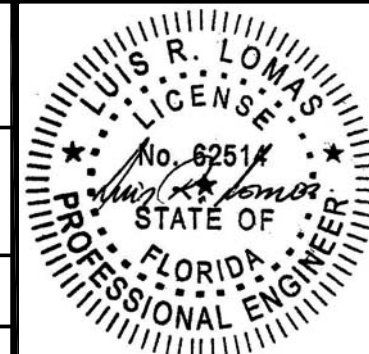

Luis R. Lomas P.E.
FL No.: 62514