

When applying back jambs over dry wall or other non-structrual wall covering, use longer fasteners to insure minimum embedment required.
This chart applies to 2x6 wood species with specific gravity of 0.55 (Southern Pine) or better.
Each anchor requires a 1-1/2" diameter washer that complies with ANSI B18.22.1 type B.


	3/8" DeWALT Screw-Bolt+	Embed 3.5", Min Edge Dist 3.5", Min spacing 9"
	3/8" POWERS Wedge-Bolt+	Embed 3.5", Min Edge Dist 3.5", Min spacing 9"
	3/8" Hilti KB-TZ2	Embed 2.5", Min Edge Dist 3", Min spacing 6"

2500 PSI CONCRETE

MAX WIDTH IN FEET	DESIGN PRESSURE IN POUNDS-PER-SQUARE-FOOT (PSF)													
	12 PSF	15 PSF	18 PSF	21 PSF	24 PSF	27 PSF	30 PSF	33 PSF	36 PSF	39 PSF	42 PSF	46 PSF	50 PSF	53 PSF
≤ 9'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
10'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
12'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
14'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
15'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
16'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
18'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
20'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
22'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
24'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	23"	22"
26'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	23"	21"	20"
30'	24"	24"	24"	24"	24"	24"	24"	24"	24"	23"	22"	20"	18"	17"

CMU FILLED W/ 2000 PSI GROUT


MAX WIDTH IN FEET	DESIGN PRESSURE IN POUNDS-PER-SQUARE-FOOT (PSF)													
	12 PSF	15 PSF	18 PSF	21 PSF	24 PSF	27 PSF	30 PSF	33 PSF	36 PSF	39 PSF	42 PSF	46 PSF	50 PSF	53 PSF
≤ 9'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
10'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
12'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
14'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	23"	21"	20"
15'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	22"	20"	19"
16'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	22"	20"	19"	18"
18'	24"	24"	24"	24"	24"	24"	24"	24"	23"	21"	20"	18"	17"	16"
20'	24"	24"	24"	24"	24"	24"	24"	23"	21"	19"	18"	16"	15"	14"
22'	24"	24"	24"	24"	24"	24"	23"	21"	19"	18"	16"	15"	14"	13"
24'	24"	24"	24"	24"	24"	23"	21"	19"	17"	16"	15"	14"	13"	12"
26'	24"	24"	24"	24"	24"	21"	19"	18"	16"	15"	14"	13"	12"	11"
30'	24"	24"	24"	24"	21"	19"	17"	15"	14"	13"	12"	11"	10"	9"

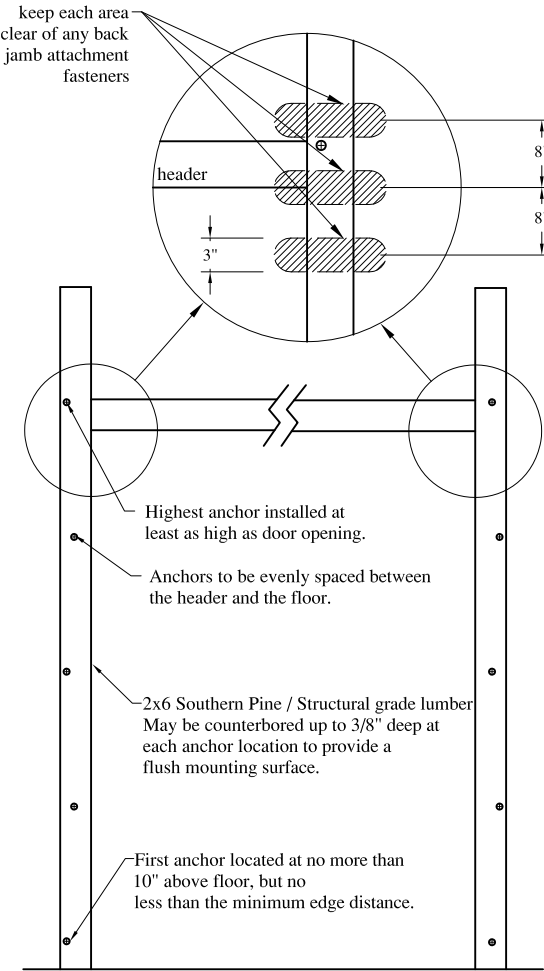

Manufacturer's installation instructions must be followed.
Maximum spacing shown in chart.
Lesser spacing may be used to avoid interference with door hardware and or fastening system, but not less than 8".
Load per jamb = 0.5 x door width x max positive pressure x door height.
8" CMU block walls shall comply with ASTM C90.
Use minimum 2000 PSI grout or concrete when filling CMU.
Fastener spacing distance may vary +/-1".

Digitally signed by John E Scates
Date: 2023.10.05 14:19:13 -05'00'
John E. Scates, P.E.
2560 King Arthur, Ste 124-54
Lewisville, TX 75056
Florida P.E. # 51737
TXPE 56308, F-2203

Printed copies of this document are not considered signed and sealed and the signature must be verified an any electronic copies.

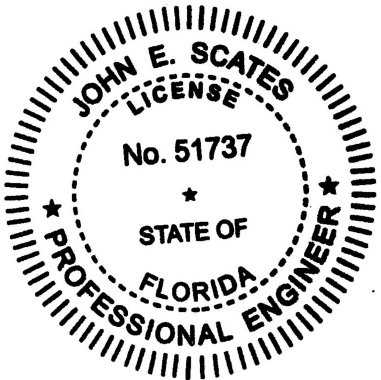

Professional Engineer's seal provided only for verification of windload construction details.

Supporting structural elements shall be designed by a registered professional engineer for wind loads in addition to other loads. This drawing does not address the jamb/wall design, but only door attachment. Jamb/wall construction is shown only for illustration purposes. The building designer is responsible for ensuring that the jamb/wall is sufficient to carry the door live and static loads. This drawing does not address the spring pad connections. Registered professional engineer may approved an alternative design.

	SCALE	none
	DATE	10-02-2023
Back Jamb Attachment Detail Concrete Anchors		
C.H.I. Drawing: BJA-101R9		

Use Southern Pine table only if both structure and jamb are Southern Pine.
Use (SPF) table if the structure is Spruce-Pine-Fir or unknown, 2x6 jambs must always be Southern Pine.
Lesser spacing may be used to avoid interference with door hardware and or fastening system.
Maximum spacing shown in chart.
Lag screw: 3/8" diameter x 3" minimum long; must conform to ANSI/ASME B18.2.1
When applying back jambs over dry wall or other non structural wall covering,
use longer lags screws to insure 1-1/2" minimum embedment required.
Washer: 1-1/8" minimum outside diameter, must conform to ANSI B18.22.1 type A.
Pre-drill 1/4" diameter pilot holes for lag screw insertion. 1-1/2" minimum lag screw edge distance required on 2x6.

Spruce-Pine-Fir (SPF) STRUCTURE														
MAX LAG SCREW SPACING (Inches) FOR DOOR WIDTH (max) vs DESIGN PRESSURE														
MAX WIDTH	DESIGN PRESSURE IN POUNDS-PER-SQUARE-FOOT (PSF)													
IN FEET	12 PSF	15 PSF	18 PSF	21 PSF	24 PSF	27 PSF	30 PSF	33 PSF	36 PSF	39 PSF	42 PSF	46 PSF	50 PSF	53 PSF
≤ 9'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
10'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	23"	21"
12'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	22"	20"	19"	18"
14'	24"	24"	24"	24"	24"	24"	24"	24"	22"	21"	19"	17"	16"	15"
15'	24"	24"	24"	24"	24"	24"	24"	23"	21"	19"	18"	16"	15"	14"
16'	24"	24"	24"	24"	24"	24"	24"	21"	20"	18"	17"	15"	14"	13"
18'	24"	24"	24"	24"	24"	23"	21"	19"	17"	16"	15"	13"	12"	12"
20'	24"	24"	24"	24"	24"	21"	19"	17"	16"	14"	13"	12"	11"	10"
22'	24"	24"	24"	24"	21"	19"	17"	15"	14"	13"	12"	11"	10"	9"
24'	24"	24"	24"	22"	20"	17"	16"	14"	13"	12"	11"	10"	9"	9"
26'	24"	24"	24"	21"	18"	16"	14"	13"	12"	11"	10"	9"	8"	8"
30'	24"	24"	21"	18"	16"	14"	12"	11"	10"	9"	9"	8"	7"	7"


Southern Pine (SP) STRUCTURE														
MAX LAG SCREW SPACING (Inches) FOR DOOR WIDTH (max) vs DESIGN PRESSURE														
MAX WIDTH	DESIGN PRESSURE IN POUNDS-PER-SQUARE-FOOT (PSF)													
IN FEET	12 PSF	15 PSF	18 PSF	21 PSF	24 PSF	27 PSF	30 PSF	33 PSF	36 PSF	39 PSF	42 PSF	46 PSF	50 PSF	53 PSF
≤ 10'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"
12'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	23"
14'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	23"	21"	20"
15'	24"	24"	24"	24"	24"	24"	24"	24"	24"	24"	23"	21"	19"	18"
16'	24"	24"	24"	24"	24"	24"	24"	24"	24"	23"	22"	20"	18"	17"
18'	24"	24"	24"	24"	24"	24"	24"	24"	22"	21"	19"	17"	16"	15"
20'	24"	24"	24"	24"	24"	24"	24"	22"	20"	19"	17"	16"	14"	14"
22'	24"	24"	24"	24"	24"	24"	22"	20"	18"	17"	16"	14"	13"	12"
24'	24"	24"	24"	24"	24"	22"	20"	18"	17"	15"	14"	13"	12"	11"
26'	24"	24"	24"	24"	23"	21"	19"	17"	15"	14"	13"	12"	11"	10"
30'	24"	24"	24"	23"	20"	18"	16"	15"	13"	12"	11"	10"	9"	9"

Southern Pine (SP) specific gravity = 0.55
Spruce-Pine-Fir (SPF) specific gravity = 0.42
Maximum load per jamb = 0.5 x (door height) x (door width) x (maximum positive pressure)
These charts do not address spring pad connections to the building.
Alternative design may be approved by a registered professional engineer.
Supporting structural elements shall be designed by a registered professional engineer for wind loads in addition to other loads.


Digitally signed by John E Scates
Date: 2023.10.05 14:18:42 -05'00'

John E. Scates, P.E.
2560 King Arthur, Ste 124-54
Lewisville, TX 75056
Florida P.E. # 51737
TXPE 56308, F-2203

Printed copies of this document are not considered signed and sealed and the signature must be verified an any electronic copies.

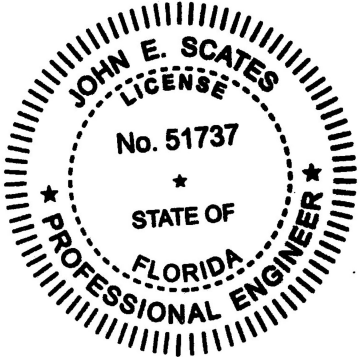


Professional Engineer's seal provided only for verification of windload construction details.

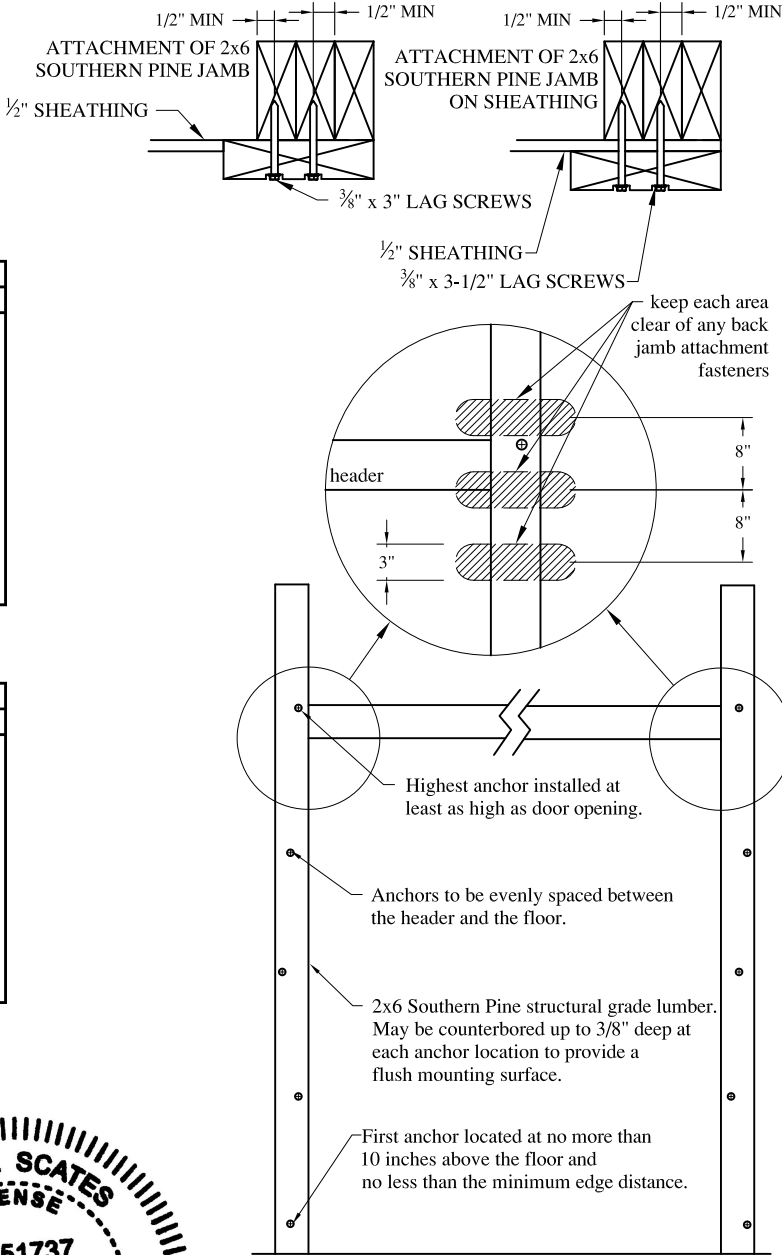


C.H.I. OVERHEAD DOORS	SCALE	none
	DATE	03-26-2020
Back Jamb Attachment Detail Lag Screw		
C.H.I. Drawing: BJA-102R7		

Self tapping screws
(with steel)
Reverse Angle Only



Screw: 1/4" dia x 3/4" self tapping screw; must conform to ANSI/ASME B18.2.1.
Washer: 9/16" O.D. minimum; must conform to ANSI B18.22.1 type A.
Lowest fastener to be within 10-inches of the floor
For 3/16" jambs, locate screws as shown on door drawing.
For 12ga jambs, use (2) screws at each location shown on door drawing.
Add holes to continuous angle as required to satisfy fastener quantity.
This document does not address spring pad connections to the building.

.100" x 1" fillet welds

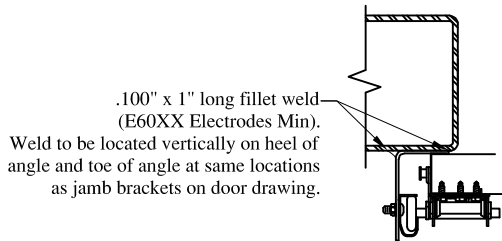


.100" x 1" long fillet weld
(E60XX Electrodes Min).
Weld to be located vertically on heel of
angle and toe of angle at same locations
as jamb brackets on door drawing.

Reverse Angle

Welds performed by a Certified Welder or inspected by a
Certified Welding Inspector to verify integrity of welds.
12 gauge or 3/16" steel Jambs; allowable load per weld= 1,272 lbs.
Use all necessary precautions when welding galvanized steel.
Locate welds in same location as jamb brackets on door drawing.

Minimum of 3 welds per jamb allowed.
Fillet welds to have a straight or convex face surface.
Tack weld toe of angle at same spacing to prevent rotation of track angle.
Cracks and blemishes shall be ground to a smooth
contour and checked to ensure soundness.
This document does not address spring pad connections to the building.

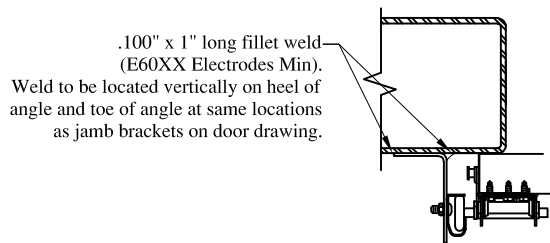


.100" x 1" long fillet weld
(E60XX Electrodes Min).
Weld to be located vertically on heel of
angle and toe of angle at same locations
as jamb brackets on door drawing.

Bracket Mount or
Leg Out Angle

Digitally signed by John E Scates
Date: 2023.10.05 14:18:16 -05'00'

John E. Scates, P.E.
2560 King Arthur, Ste 124-54
Lewisville, TX 75056
Florida P.E. # 51737
TXPE 56308, F-2203

Printed copies of this document are not
considered signed and sealed and the signature
must be verified an any electronic copies.

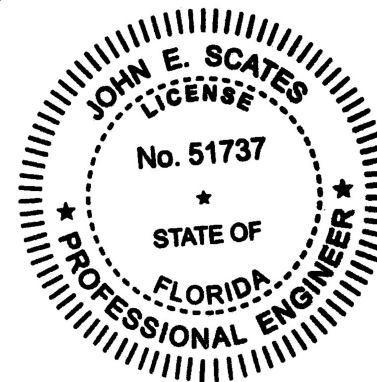


Professional Engineer's seal provided only for
verification of windload construction details.

Alternative design may be approved by a registered
professional engineer.

Supporting structural elements shall be designed by a registered
professional engineer for wind loads in addition to other loads.



This drawing does not address the jamb/wall design, but only door
attachment. Jamb/wall construction is shown only for illustration
purposes. The building designer is responsible for ensuring that
the jamb/wall is sufficient to carry the door live and static loads.

	SCALE	none
	DATE	03-26-2020
Steel Attachment Detail		
C.H.I. Drawing: BJA-103R8		

3/8" DeWALT Screw-Bolt+ Minimum Embedment 3.25", Minimum Edge Distance 1.5", Minimum spacing 6"
3/8" Hilti KH-EZ Minimum Embedment 2.5", Minimum Edge Distance 4", Minimum spacing 6",
Hilti KH-EZ not applicable when minimum track bracket spacing is less than 6". If expansion anchors are required, see wall buck mounting instruction BJA-101.


Locate anchors as shown on door drawing.
Lowest anchor to be greater than the minimum edge distance up from the floor and less than 10-inches from the floor.
Load per jamb = 0.5 x door width x max positive pressure x door height
This document does not address spring pad connections to the building.

8" CMU block walls shall comply with ASTM C-90 and shall be filled with minimum 2000 psi grout or concrete.
Move track brackets up or down up to 1-1/2" to avoid installing anchors into grout lines

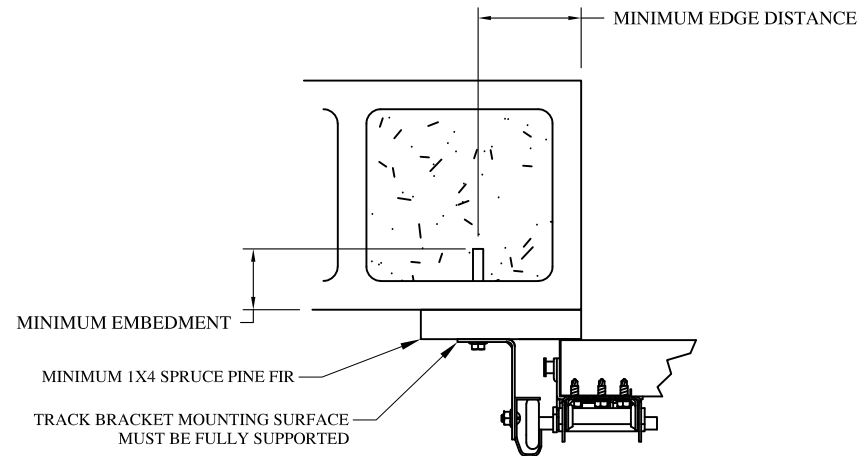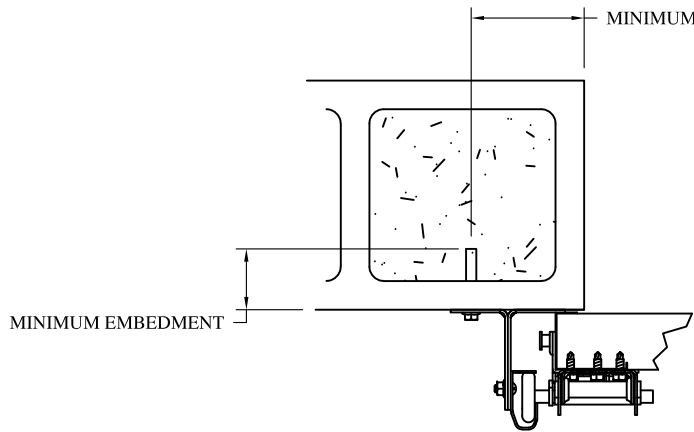

Digitally signed by John E Scates
Date: 2023.10.05 14:17:51 -05'00'

John E. Scates, P.E.
2560 King Arthur, Ste 124-54
Lewisville, TX 75056
Florida P.E. # 51737
TXPE 56308, F-2203

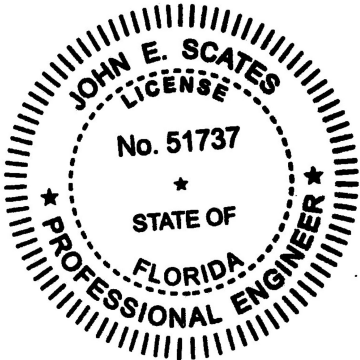

Printed copies of this document are not considered signed and sealed and the signature must be verified an any electronic copies. Professional Engineer's seal provided only for verification of windload construction details.

Alternative design may be approved by a registered professional engineer.



Supporting structural elements shall be designed by a registered professional engineer for wind loads in addition to other loads.
This drawing does not address the jamb/wall design, but only door attachment. Jamb/wall construction is shown only for illustration purposes. The building designer is responsible for ensuring that the jamb/wall is sufficient to carry the door live and static loads.

	SCALE	none
	DATE	10-02-2023

CMU Block Wall Attachment Detail	
C.H.I. Drawing: BJA-104R9	

1/4" Tapcon+ (PLUS) Minimum Embedment 2.0", Minimum Edge Distance 1.63", Minimum spacing 3"
1/4" Hilti KH-EZ Minimum Embedment 2.0", Minimum Edge Distance 1.63", Minimum spacing 6",
Hilti KH-EZ not applicable when minimum track bracket spacing is less than 6". If expansion anchors are required, see wall buck mounting instruction BJA-101.
Each anchor requires a minimum 9/16" O.D. washer that conforms to ANSI B18.22.1 type A
Locate anchors as shown on door drawing.
Lowest anchor to be greater than the minimum edge distance up from the floor and less than 10-inches from the floor.
Load per jamb = 0.5 x door width x max positive pressure x door height
This document does not address spring pad connections to the building.


Concrete walls shall be minimum 2500 psi concrete and of sufficient strength to resist loads.

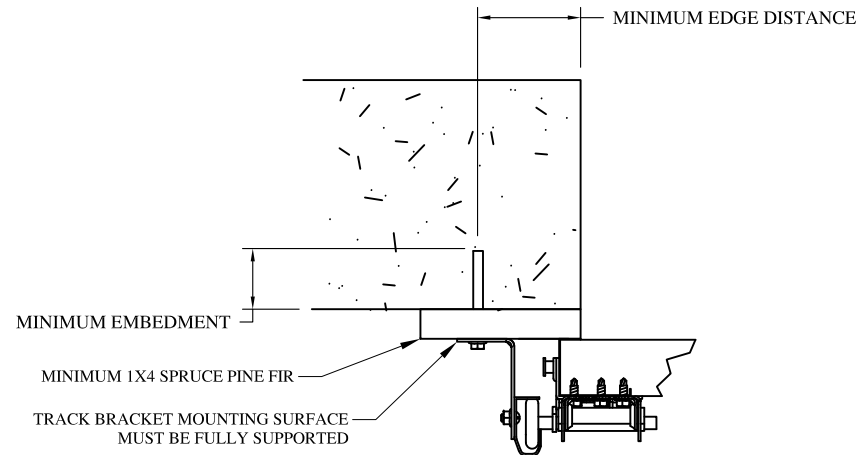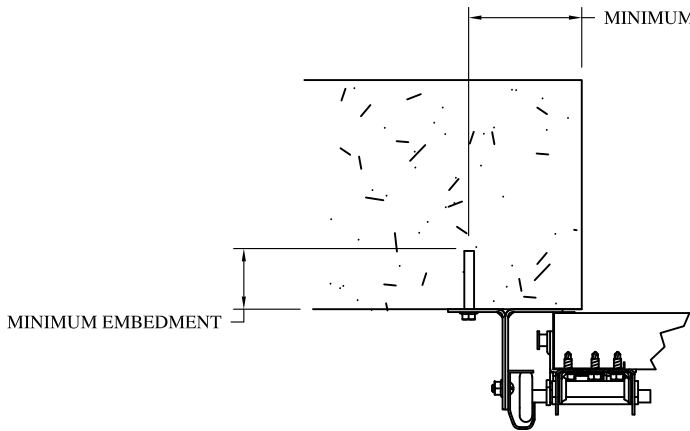

Digitally signed by John E Scates
Date: 2023.10.05 14:17:27 -05'00'

John E. Scates, P.E.
2560 King Arthur, Ste 124-54
Lewisville, TX 75056
Florida P.E. # 51737
TXPE 56308, F-2203

Printed copies of this document are not considered
signed and sealed and the signature must be
verified on any electronic copies.

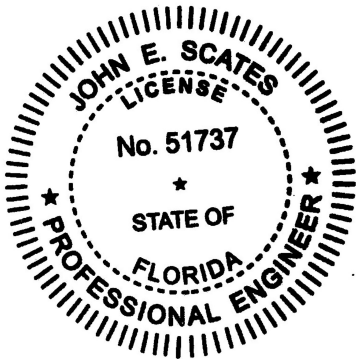

Professional Engineer's seal provided only for
verification of windload construction details.

Alternative design may be approved by a registered
professional engineer.

Supporting structural elements shall be designed by a registered
professional engineer for wind loads in addition to other loads.



This drawing does not address the jamb/wall design, but only door
attachment. Jamb/wall construction is shown only for illustration
purposes. The building designer is responsible for ensuring that
the jamb/wall is sufficient to carry the door live and static loads.

C.H.I. OVERHEAD DOORS	SCALE	none
	DATE	10-02-2023

Concrete Wall
Attachment Detail

C.H.I. Drawing: BJA-105R8


Refer to door drawing installation instructions for bracket spacing.
To avoid splitting wood, drill pilot holes with 3/16" sized drill bit.
Lag screws must conform to ANSI/ASME B18.2.1:
 use 5/16" diameter x 1-5/8" minimum long when mounting directly to 2x4 southern pine jambs,
 longer lag screws required when mounting through wood and drywall or directly to spruce-pine-fir;
1-1/2" minimum lag screw embedment into southern pine.
2-1/2" minimum lag screw embedment into spruce-pine-fir.
1/2" minimum lag screw edge distance required.
Lag screws must be seated in full height frame members.

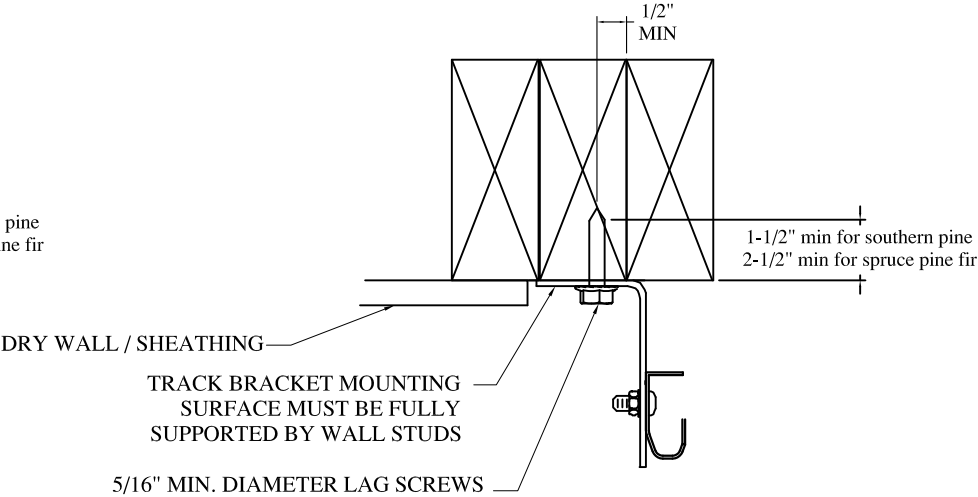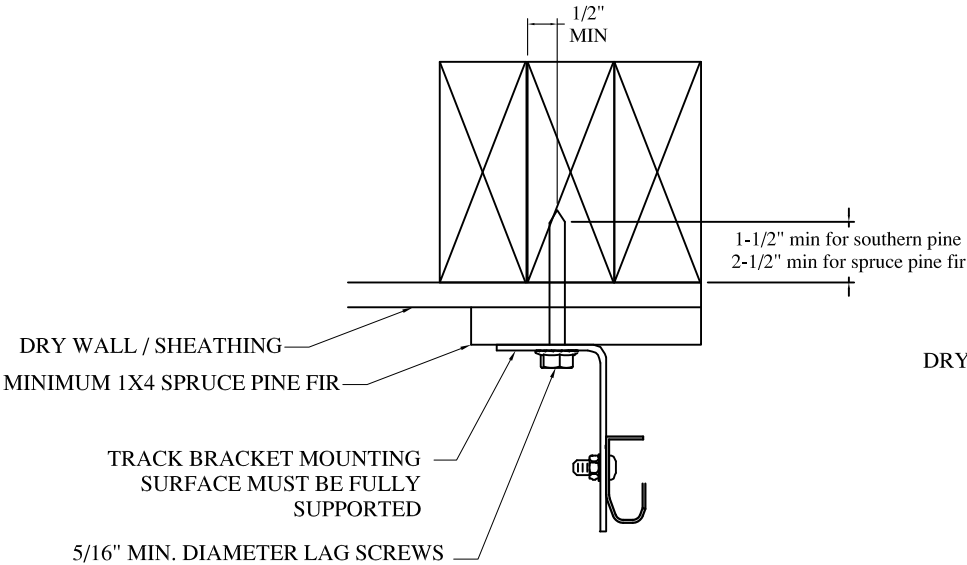

Digitally signed by John E Scates
Date: 2023.10.05 14:17:02 -05'00'

John E. Scates, P.E.
2560 King Arthur, Ste 124-54
Lewisville, TX 75056
Florida P.E. # 51737
TXPE 56308, F-2203

Printed copies of this document are not
considered signed and sealed and the signature
must be verified an any electronic copies.

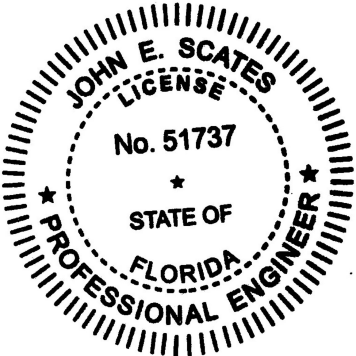

Professional Engineer's seal provided only for
verification of windload construction details.

For door jambs structural southern pine (SP), specific gravity = 0.55 or better;
 spruce-pine-fir (SPF), specific gravity = 0.42 or better.
Maximum load per jamb = 0.5 x (door height) x (door width) x (maximum positive pressure)
Alternative design may be approved by a licensed professional engineer.
Supporting structural elements shall be designed by a licensed professional engineer
 for wind loads in addition to other loads.
The suitability of the structural building components must be verified by the engineer of
 record for the building.

	SCALE	none
	DATE	03-26-2020
Track Bracket Attachment Detail Wood Jambs		
C.H.I. Drawing: BJA-106R5		