

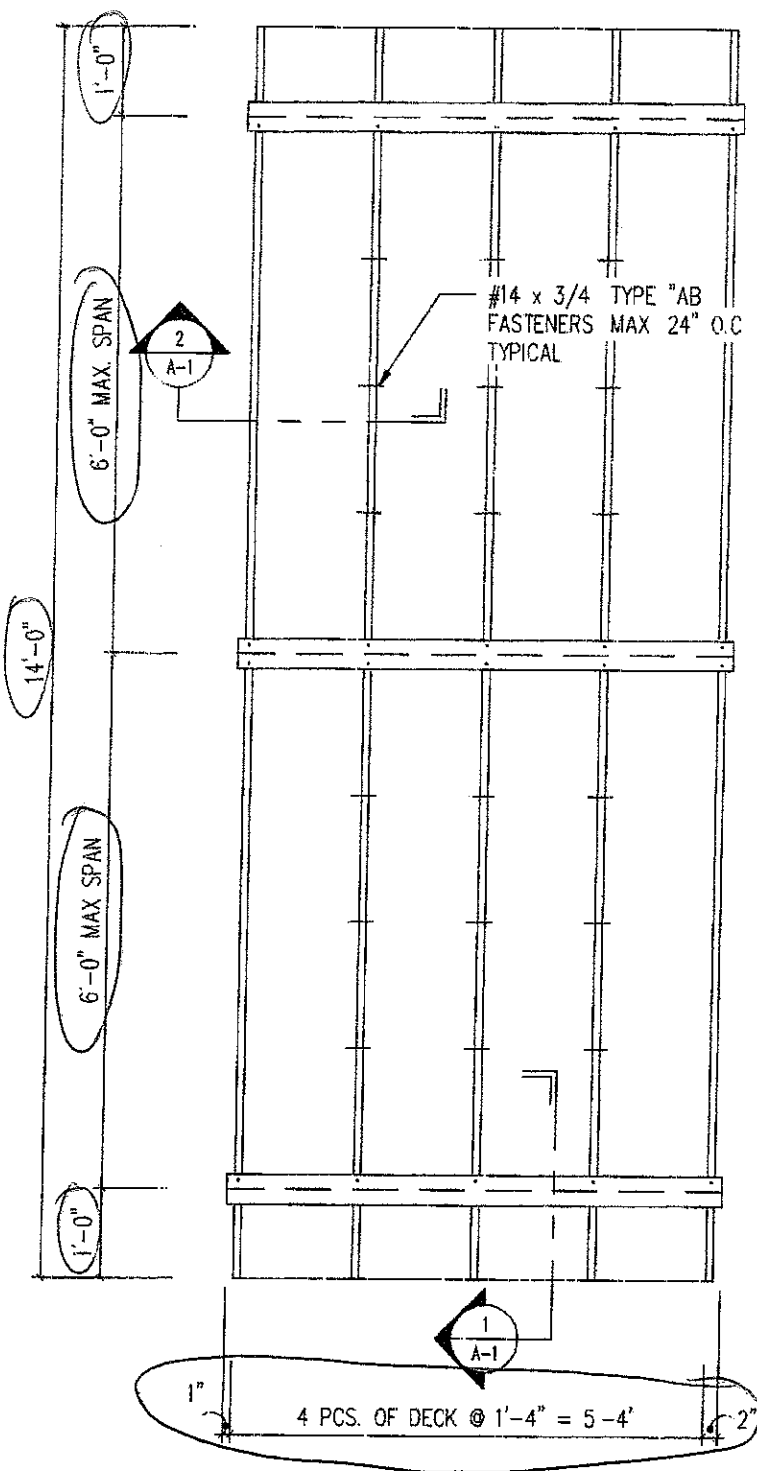


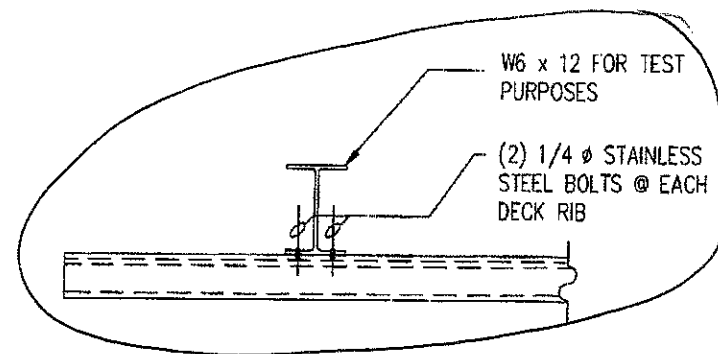


PLAN VIEW
SCALE: 1/2" = 1'-0"

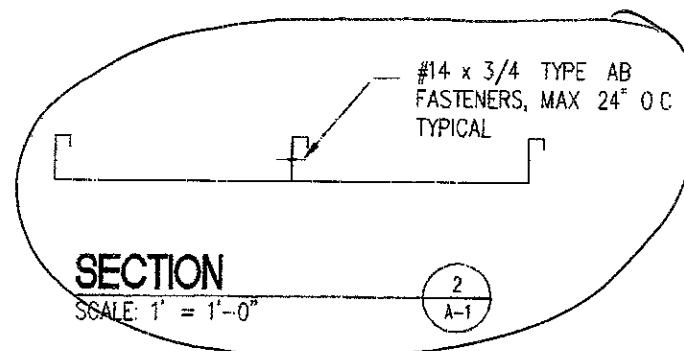

GENERAL NOTES

- 1) THE MAXIMUM DESIGN ALLOWABLES FOR THE 20 GAUGE STEEL ROOF PANELS (3' x 16" PANEL) AND THE 1/4" STAINLESS STEEL BOLTS SHALL BE AS FOLLOWS:

6'-0" SPAN UPLIFT = 90 PSF
6'-0" SPAN LIVE LOAD + DEAD LOAD = 70 PSF
MAXIMUM DEFLECTION OF PANEL = L/180
- 2) THIS 20 GAUGE STEEL PANEL SHALL BE USED IN THE CONSTRUCTION OF OPEN CANOPIES AND EACH PROJECT SHALL BE CONSTRUCTED USING THE SAME PANEL CROSS SECTION AND SUPPORT DETAILS AS SHOWN IN THIS TEST. THE DESIGN OF THE PANEL SHALL BE IN COMPLIANCE WITH THE ABOVE MAXIMUM ALLOWABLES

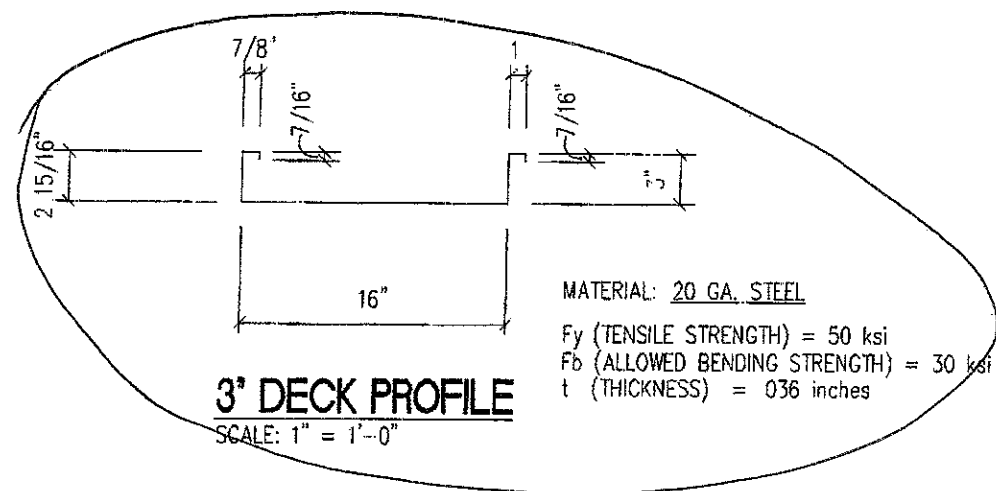

AMERICAN TEST LAB
NORTH
DATE 3/13/08
REPORT NO. ATLNC 0226.01-08
Kent Owen
ATL INSPECTOR

MADISON
1805 BIG DAWG, S.W. • CORVALLIS, OR 97331
770 483-4400 • FAX 770 780-7967



PROJECT NO. <u>0226.01-08</u>	
DATE	DATE
01-08-08	
CHECKED BY	DATE
SCALE	REV. DATE
AS NOTED	
DRAWING NO. <u>A-1</u>	
SHEET <u>1</u> OF <u>1</u>	
TEST	SHOWN