

BEST ROLLING DOORS, INC.


STEEL ROLL-UP DOORS

MODELS S10-6065, S10-6565 & S10-100

RATED FOR LARGE IMPACT RESISTANCE

VALID FOR USE INSIDE AND OUTSIDE THE HVHZ

NON-SITE-SPECIFIC STRUCTURAL PERFORMANCE EVALUATION. A DESIGN PROFESSIONAL SHALL BE RESPONSIBLE FOR CERTIFYING THE APPLICATION OF THIS INFORMATION TO ANY SITE-SPECIFIC LOCATION.

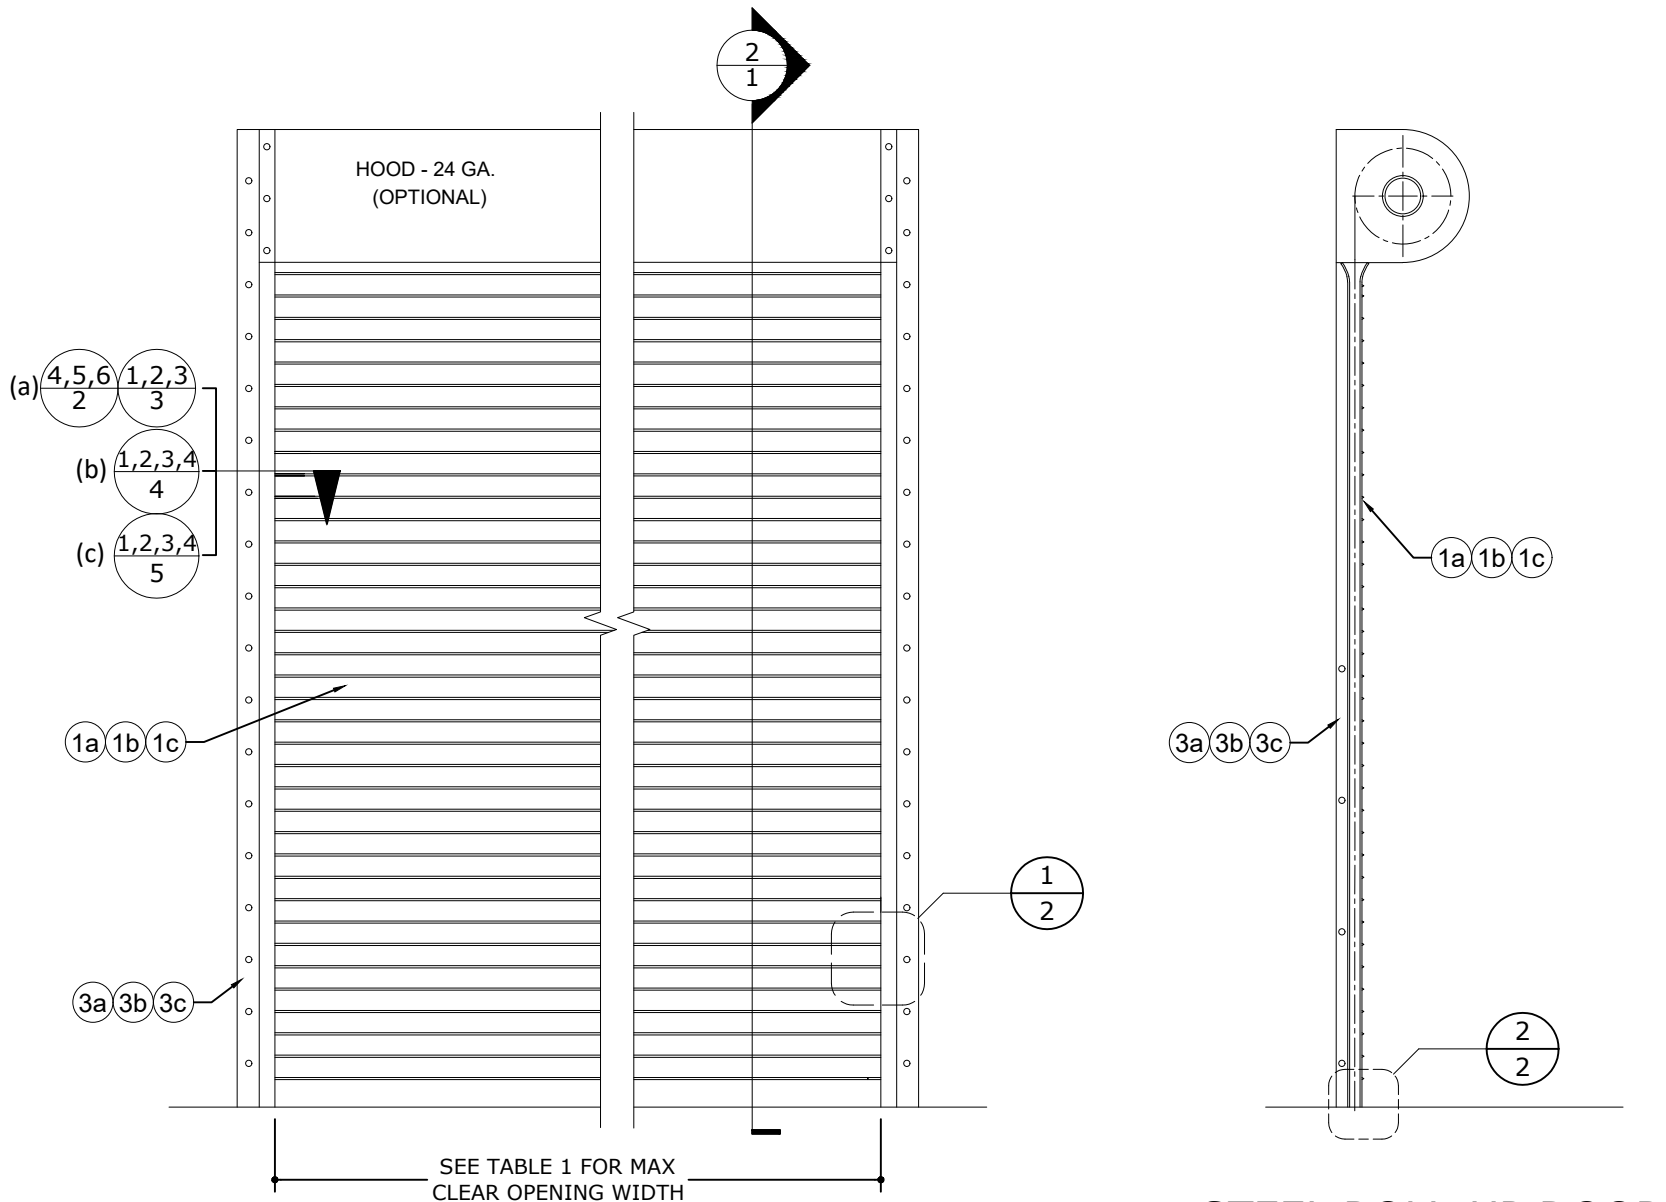

INDEX

SHEET # | DESCRIPTION

- COVER SHEET
- CONNECTION DETAILS
- CONNECTION DETAILS
- CONNECTION DETAILS
- CONNECTION DETAILS
- SYSTEM COMPONENTS


TABLE 1: MAXIMUM ALLOWABLE PRESSURE AND CLEAR OPENING WIDTH

	MODEL #	MAXIMUM CLEAR OPENING WIDTH	MAXIMUM ALLOWABLE PRESSURE
(a)	S10-6065	24'-1 1/2"	+60psf / -65psf
(b)	S10-6565	30'-4 1/2"	+65psf / -65psf
(c)	S10-100	30'-4 1/2"	+100psf / -100psf

NOTE REGARDING USE OF THIS DOCUMENT & USE OUTSIDE FLORIDA:
THIS IS A NON-SITE-SPECIFIC STRUCTURAL PERFORMANCE EVALUATION. THIS PRODUCT EVALUATION IS VALID FOR USE IN **FLORIDA ONLY**. USE OF THIS EVALUATION REQUIRES A REVIEW & CERTIFICATION BY A LOCAL DESIGN PROFESSIONAL WHO SHALL BE RESPONSIBLE FOR THE PROPER ADAPTATION OF THIS GENERAL PERFORMANCE EVALUATION TO ANY SITE-SPECIFIC PROJECT. CONTACT THIS OFFICE AT **ENGINEERINGEXPRESS.COM/QUOTE** FOR ASSISTANCE WITH YOUR PROJECT-SPECIFIC NEEDS & FOR ADAPTATION & CERTIFICATION OF THIS DOCUMENT OUTSIDE OF FLORIDA.

ENGINEER SIGNATURE & SEAL NOTICE:
*PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED & SEALED. SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.
*FOR FLORIDA STATEWIDE PRODUCT APPROVALS (FSAs) REGISTERED & APPROVED WITH THE STATE OF FLORIDA: ORIGINAL, SEALED COPIES OF APPROVED FLORIDA PRODUCT APPROVALS ARE NOT REQUIRED FOR PERMIT. SEE **ECALC.IO/SEAL** TO LEARN MORE.

RAMEZ SAYED, P.E.
PE# 94621 CA# 9885



Digitally signed by
Ramez Sayed, PE
Date: 2026.09.29
16:39:52 -04'00'

GENERAL NOTES:

- THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE NINTH EDITION (2026) FOR USE OUTSIDE THE HIGH VELOCITY HURRICANE ZONE, PER TAS 201, 202, AND 203 STANDARDS. SEE PRODUCT EVALUATION REPORT FOR MORE INFORMATION.
- POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED PER SEPARATE ENGINEERING IN ACCORDANCE WITH THE GOVERNING CODE. PRESSURE REQUIREMENTS AS DETERMINED IN ACCORDANCE WITH ASCE 7-22 AND THE FLORIDA BUILDING CODE SHALL BE LESS THAN OR EQUAL TO THE POSITIVE OR NEGATIVE DESIGN PRESSURE CAPACITY VALUES LISTED HEREIN (TABLE 1) FOR ANY ASSEMBLY AS SHOWN.
- ALLOWABLE DESIGN PRESSURES NOTED HEREIN ARE BASED ON MAXIMUM TESTED PRESSURES DIVIDED BY A 1.5 SAFETY FACTOR.
- THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT. THESE INSTALLATION INSTRUCTIONS ARE PART OF A PRODUCT APPROVAL EVALUATION AND SHALL ONLY BE USED IN CONJUNCTION WITH THE EVALUATION REPORT SUBMITTED FOR THE SAME PRODUCT APPROVAL.
- SLATS TO BE A.S.T.M. A-653 GR 50 STRUCTURAL QUALITY STEEL WITH MIN. Fy = 50 KSI AND G-90 GALVANIZING PER A.S.T.M. A-653, OR A.I.S.I. 304 SERIES STAINLESS STEEL MANUFACTURED WITH A MINIMUM YIELD STRENGTH OF Fy = 50 KSI.
- WINDLOCKS SHALL BE 11 GA PLATED STEEL. A.S.T.M. A-1011
- ALL ASSEMBLY BOLTS TO BE S.A.E. GRADE 2 CADMIUM PLATED OR GALVANIZED STEEL.
- ALL RIVETS TO BE A.I.S.I. 1035 STEEL, CADMIUM PLATED, STAINLESS STEEL OR ZINC PLATED W/ Fy= 37,000 PSI.
- FOR PERMANENT OUTDOOR INSTALLATIONS, ALL EXPOSED ANCHORS, FASTENERS, CONNECTORS, AND METAL PLATES SHALL BE CORROSION RESISTANT. CORROSION RESISTANCE MAY BE PROVIDED BY INHERENT MATERIAL COMPOSITION OR, WHERE PERMITTED BY CODE, BY AN APPROVED PROTECTIVE COATING OR GALVANIZATION. WHERE APPLICABLE NEAR A SALTWATER COASTLINE, SUCH COMPONENTS SHALL COMPLY WITH FBC SECTION 1711, INCLUDING APPLICABLE REQUIREMENTS FOR EXPOSED, PROTECTED, OR ENCLOSED CONDITIONS. MATERIALS, COATINGS, AND FINISHES SHALL BE COMPATIBLE WITH CONNECTED MATERIALS, AND PROTECTIVE COATINGS SHALL BE CONTINUOUS OVER EXPOSED SURFACES. FASTENERS USED WITH ALUMINUM MEMBERS SHALL ALSO COMPLY WITH SECTION J.3.7.2 OF THE ALUMINUM DESIGN MANUAL, "SPECIFICATION FOR ALUMINUM STRUCTURES." SUBSTITUTION OF COMPONENTS FROM ALTERNATE MANUFACTURERS, OR WITH DIFFERENT MATERIALS, COATINGS, OR FINISHES, SHALL NOT BE ASSUMED EQUIVALENT AND MAY REQUIRE ADDITIONAL ENGINEERING REVIEW OR SITE-SPECIFIC ANALYSIS.
- INSULATION MATERIAL SHALL BE EPS-EXPANDED POLYSTYRENE INSULATION MANUFACTURED BY DYPLAST PRODUCTS LLC COMPANY, MIAMI-DADE COUNTY NOTICE OF ACCEPTANCE # 17-1207.05 OR LATEST VERSION.
- DOOR MAY BE INSTALLED ON THE INSIDE OR OUTSIDE OF AN EXTERIOR WALL. DOOR IMPACTED ON BOTH SIDES.
- GUIDE DETAILS CAN BE USED IN ANY COMBINATION.
- ROLL-UP MECHANISM AND HOOD ASSEMBLY ARE NOT PART OF THIS APPROVAL.
- THIS DOCUMENT CONTAINS INFORMATION RELEVANT TO THE NECESSARY STRUCTURAL REQUIREMENTS OF THE SYSTEM INSTALLATION. COMPONENTS AND FASTENERS NOT REFERENCED WHICH ARE PART OF THE INTERNAL FABRICATION OF THE SPECIFIED SYSTEMS OR ASSEMBLIES SHALL BE PER MANUFACTURER PUBLISHED SPECIFICATIONS.
- PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS OUTLINED HEREIN.
- UNITS SHALL BE LABELED IN ACCORDANCE WITH THE FLORIDA BUILDING COMMISSION AND THE FLORIDA DEPARTMENT OF BUSINESS & PROFESSIONAL REGULATION SPECIFICATION.
- CONTRACTOR SHALL BE RESPONSIBLE TO INSULATE DISSIMILAR MATERIALS TO PREVENT ELECTROLYSIS.
- WATERPROOFING IS NOT PART OF THIS CERTIFICATION AND SHALL BE CERTIFIED BY OTHERS.
- ALTERATIONS ADDITIONS OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE THIS
- CERTIFICATION. EXCEPT AS EXPRESSLY PROVIDED HEREIN, NO ADDITIONAL CERTIFICATIONS OR AFFIRMATIONS ARE INTENDED

VISIT **ECALC.IO/BESTROLLINGDOOR**

FOR SITE SPECIFIC DEVIATIONS
& MORE INFORMATION ABOUT THIS DOCUMENT
OR SCAN THIS QR CODE

VISIT **ENGINEERINGEXPRESS.COM/DIVERSITECH**
FOR ADDITIONAL PLANS, REPORTS & RESOURCES



FL 10706.1

ENGINEERING
EXPRESS

POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

BEST ROLLING DOORS, INC.

9770 N.W. 79TH AVENUE
HIALEAH GARDENS, FL
Phn. (305) 698-3550

STEEL ROLL-UP DOORS

FLORIDA BUILDING CODE NINTH EDITION (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#10706.1)


REMARKS	DATE	DRWN	CHKD
INIT ISSUE	08/16/17	RWN	FLB
FBC 2020 (21-36346)	01/25/21	JEM	FLB
FBC 2023 (23-62056a)	09/29/23	AMZ	RS
2026 FBC UPDATE	08/03/26	NRD	RS

COPYRIGHT ENGINEERING EXPRESS®


26-101599

SCALE: NTS UNLESS NOTED


1 OF 6

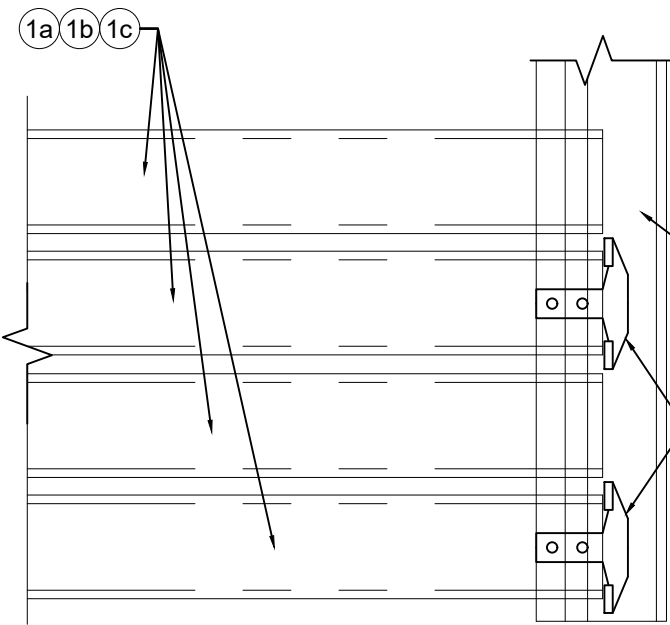

1
2 **SLAT TO CHANNEL (ALL MODELS)**
SCALE: NTS SECTION

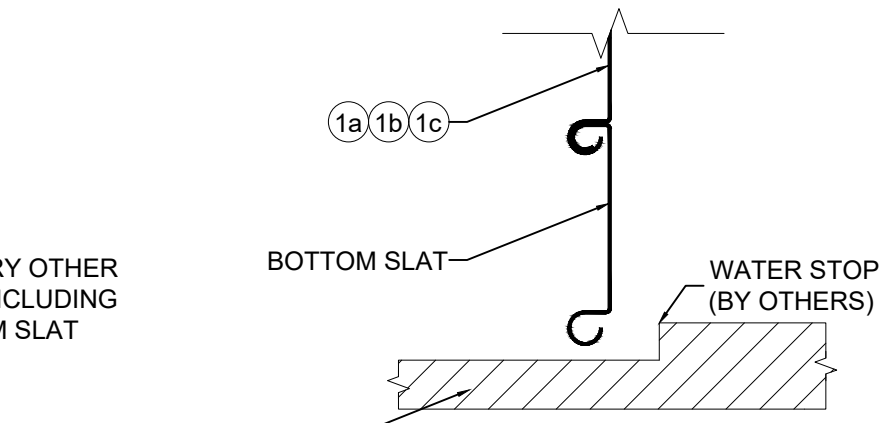


2
2 **BOTTOM SLAT (ALL MODELS)**
SCALE: NTS SECTION

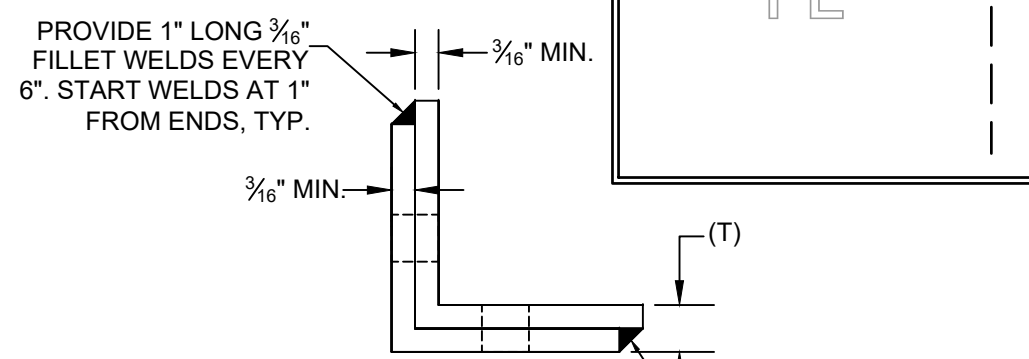


3
2 **WALL ANGLE STACKING OPTION (S10-6565 & S10-100 ONLY)**
SCALE: NTS SECTION


JAMB CONNECTIONS
MODEL #S10-6065

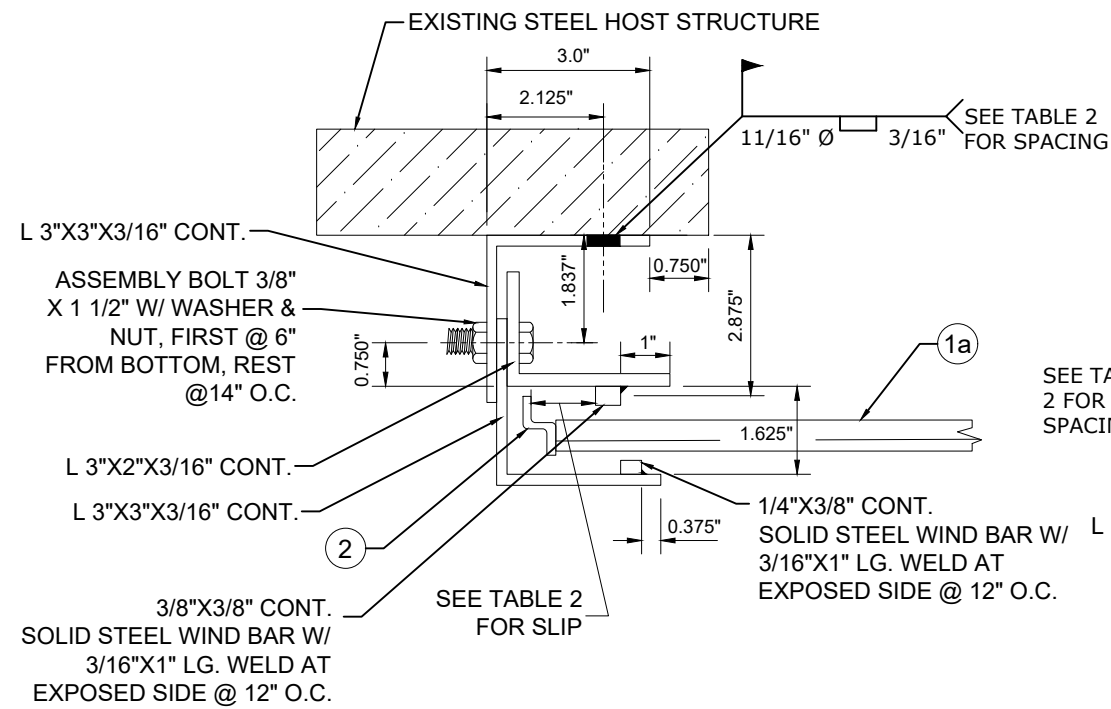

4
2 **ANGLE JAMB TO STEEL (MODEL S10-6065)**
SCALE: NTS SECTION

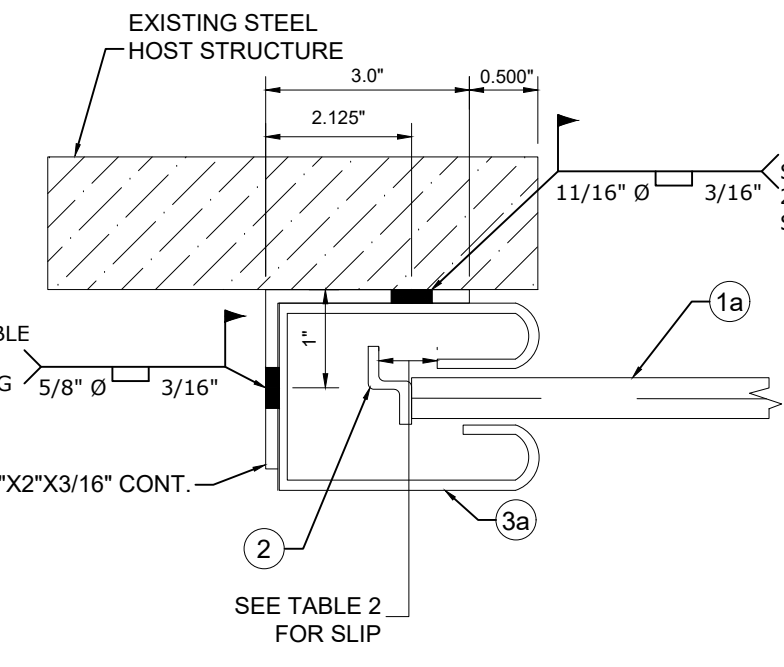


5
2 **CHANNEL JAMB TO STEEL (MODEL S10-6065)**
SCALE: NTS SECTION

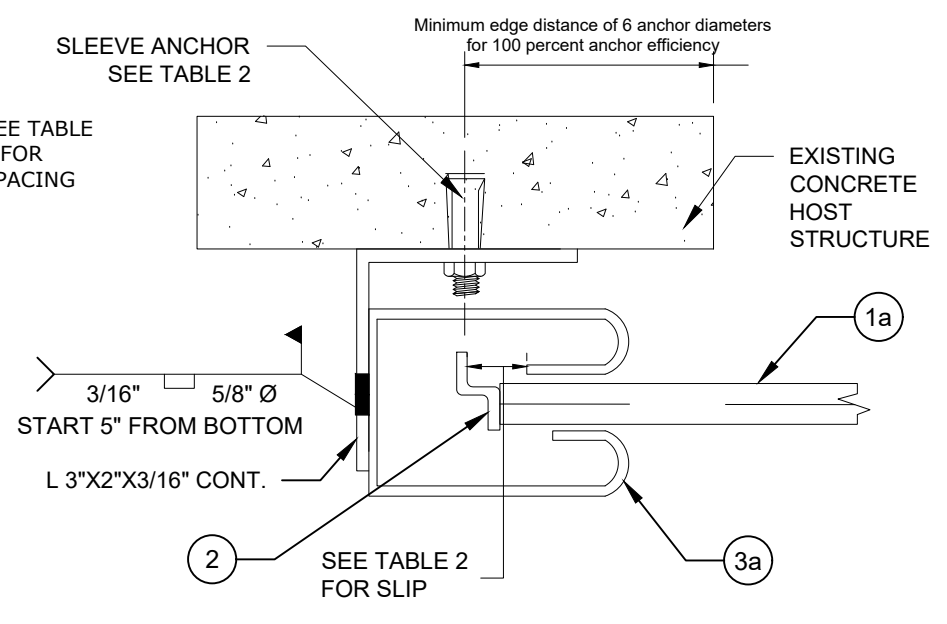

6
2 **CHANNEL JAMB TO CONCRETE 1 (MODEL S10-6065)**
SCALE: NTS SECTION

RAMEZ SAYED, P.E.
PE# 94621 CA# 9885

FL



FL 10706.1


ENGINEERING EXPRESS
POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

BEST ROLLING DOORS, INC.
9770 N.W. 79TH AVENUE
HIALEAH GARDENS, FL
Phn. (305) 698-3550
STEEL ROLL-UP DOORS
FLORIDA BUILDING CODE NINTH EDITION (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#10706.1)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	RWN	FLB	08/16/17
FBC 2020 (21-36346)	JEM	FLB	01/25/21
FBC 2023 (23-62056a)	AMZ	RS	09/29/23
2026 FBC UPDATE	NRD	RS	08/03/26


COPYRIGHT ENGINEERING EXPRESS®
26-101599

SCALE: NTS UNLESS NOTED



SCALE: NTS


SECTION

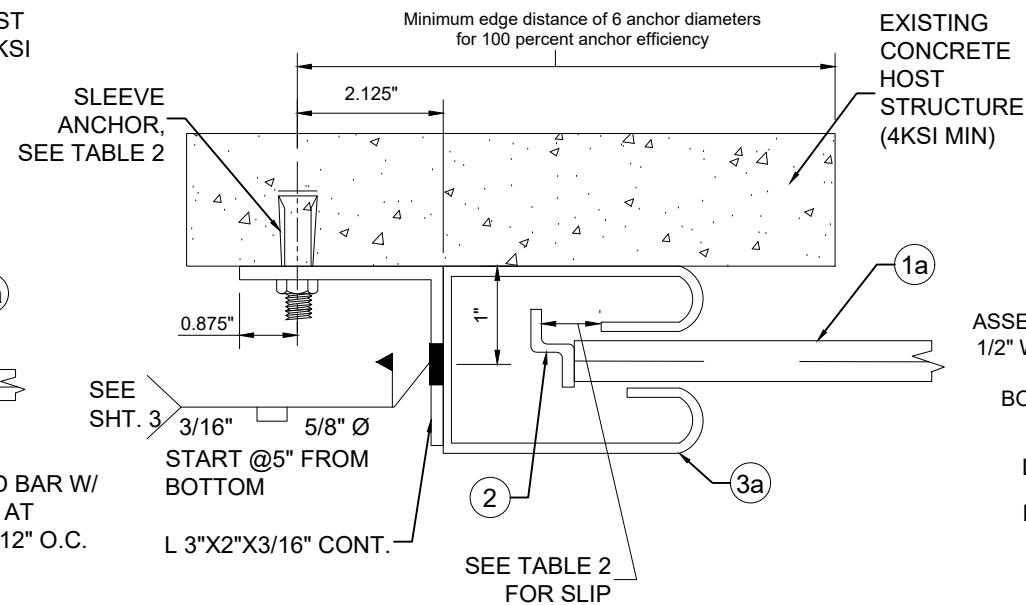

CHANNEL JAMB TO CONCRETE 2 (MODEL S10-6065)

SCALE: NTS

SECTION

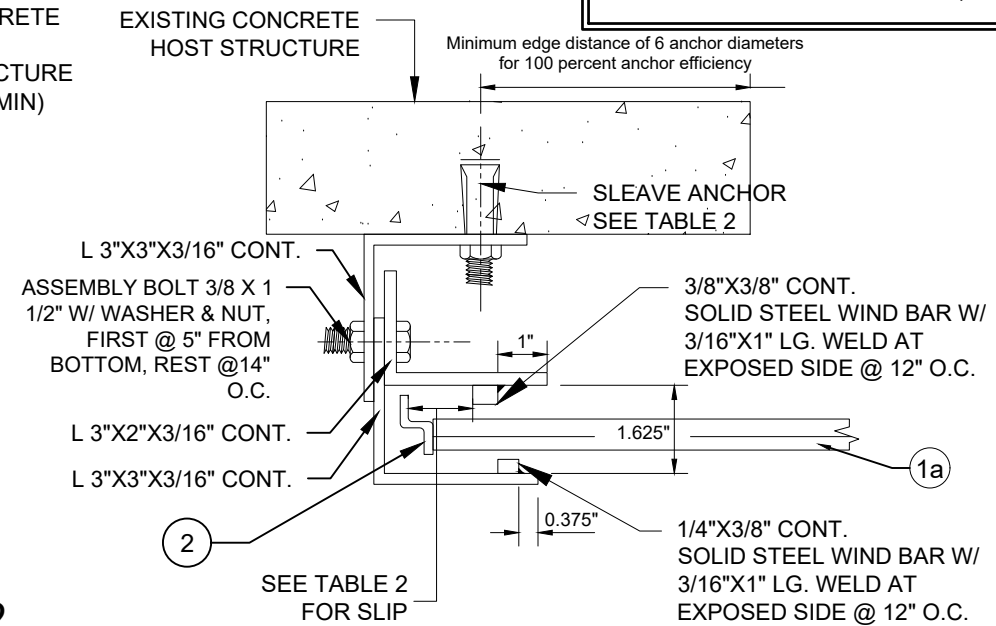


ANGLE JAMB TO CONCRETE 2
(MODEL S10-6065)

SCALE: NTS

SECTION

DOOR OPENING WIDTH	SLIP EACH END	ASSEMBLY CARRIAGE BOLT	ANCHORS TO CONCRETE JAMB		FIELD WELD TO STEEL JAMB			
			ANGLE GUIDE	CHANNEL GUIDE	ANGLE GUIDE	CHANNEL GUIDE		
			HILTI KWIK BOLT 3 OR DYNABOLT SLEEVE ANCHOR*	HILTI KWIK BOLT 3 OR DYNABOLT SLEEVE ANCHOR*		PLUG WELD WALL ANGLE TO JAMB	PLUG WELD WALL ANGLE TO JAMB	PLUG WELD CHANNEL TO WALL ANGLE
			dia. x embedment x spacing	dia. x embedment x spacing				
24' 1-1/2"	1.00"	1/2"-13x1-1/2" @14" o.c.	3/4" x 6-1/2" @4-3/4" o.c.	3/4" x 6-1/2" @10" o.c.	11/16" dia. x 3/16" @5-1/2" o.c.	11/16" dia. x 3/16" @14" o.c.	5/8" x 3/16" @4" o.c.	
20'-0"	1.00"	1/2"-13x1-1/2" @14" o.c.	3/4" x 6-1/2" @8" o.c.	3/4" x 6-1/2" @13" o.c.	11/16" dia. x 3/16" @7-1/2" o.c.	11/16" dia. x 3/16" @14" o.c.	5/8" x 3/16" @5" o.c.	
16'-0"	1.00"	1/2"-13x1-1/2" @14" o.c.	3/4" x 6-1/2" @13" o.c.	3/4" x 4-3/4" @14" o.c. or 5/8" x 4" @13" o.c.	11/16" dia. x 3/16" @11" o.c.	11/16" dia. x 3/16" @14" o.c.	5/8" x 3/16" @7" o.c.	
14'-0"	1.00"	1/2"-13x1-1/2" @14" o.c.	3/4" x 4-3/4" @14" o.c. or 5/8" x 5-1/2" @12" o.c.	3/4" x 3-1/4" @14" o.c. or 5/8" x 4" @14" o.c.	11/16" dia. x 3/16" @14" o.c.	11/16" dia. x 3/16" @14" o.c.	5/8" x 3/16" @8-1/2" o.c.	
12'-0"	0.50"	1/2"-13x1-1/2" @14" o.c.	3/4" x 3-1/4" @8-1/2" o.c. or 5/8" x 5-1/2" @11" o.c.	3/4" x 3-1/4" @14" o.c. or 5/8" x 5-1/2" @14" o.c.	11/16" dia. x 3/16" @13" o.c.	11/16" dia. x 3/16" @14" o.c.	5/8" x 3/16" @9" o.c.	
10'-0"	0.50"	1/2"-13x1-1/2" @14" o.c.	3/4" x 3-1/4" @14" o.c. or 5/8" x 5-1/2" @14" o.c.	3/4" x 3-1/4" @14" o.c. or 5/8" x 5-1/2" @14" o.c.	11/16" dia. x 3/16" @14" o.c.	11/16" dia. x 3/16" @14" o.c.	5/8" x 3/16" @13" o.c.	

LOAD DIAGRAM (ANGLES)

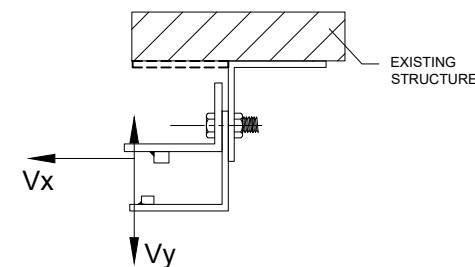

LOAD DIAGRAM (CHANNEL)

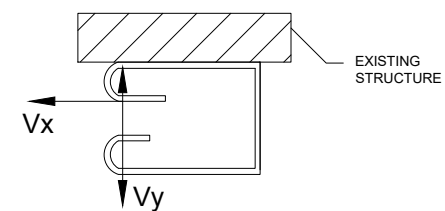


TABLE 3: MODEL #S10-6065 JAMB REACTIONS

DOOR OPENING WIDTH	SLIP EACH END	C CHANNEL OR ANGLE GUIDES			
		POSITIVE WIND		NEGATIVE WIND	
		Vx plf	Vy plf	Vx plf	Vy plf
24' 1-1/2"	1.00"	3486	727	3784	787
20'-0"	1.00"	2574	602	2799	653
16'-0"	1.00"	1738	482	1900	523
14'-0"	1.00"	1329	422	1461	457
12'-0"	0.50"	1434	363	1582	393
10'-0"	0.50"	858	302	971	327

FL 10706.1



EX ENGINEERING
EXPRESS®

POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

BEST ROLLING DOORS, INC.
 6750 N.W. 10TH AVENUE

970 N.W. 79TH AVENUE
HIALEAH GARDENS, FL

Phn. (305) 698-3550

STEEL ROLL-UP DOORS
FLORIDA BUILDING CODE NINTH EDITION (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#10706.1)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	RWN	FLB	08/16/17
FBC 2020 (21-36346)	JEM	FLB	01/25/21
FBC 2023 (23-62056a)	AMZ	RS	09/29/23
2026 FBC UPDATE	NRD	RS	08/03/26
-	-	-	-

26-101599

SCALE: NTS UNLESS NOTED

3

6

JAMB CONNECTIONS

MODEL #S10-6565

NAMEZ SAYED, P.E.
PE# 94621 CA# 9885

FL

NAMEZ M. SAYED
LICENSE
No 94621
STATE OF FLORIDA
PROFESSIONAL ENGINEER

09/29/2026



FL 10706.1

**ENGINEERING
EXPRESS®**

POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431

9770 N.W. 79TH AVENUE
HIALEAH GARDENS, FL
Phn. (305) 698-3550

STEEL ROLL-UP DOORS

FLORIDA RULING CODE NINTH EDITION 2026)

INIT. ISSUE	RWIN	FLB	FOR TO
FBC 2023 (21-36346)	JEM	FLB	01/25/21
FBC 2023 (23-62056a)	AMZ	RS	09/29/23
2026 FBC UPDATE	NRD	RS	08/03/26
.	.	.	.


RIGHT ENGINEERING EXP

26-101599

SALE: NTS UNLESS NOTED OTHERWISE


0

41

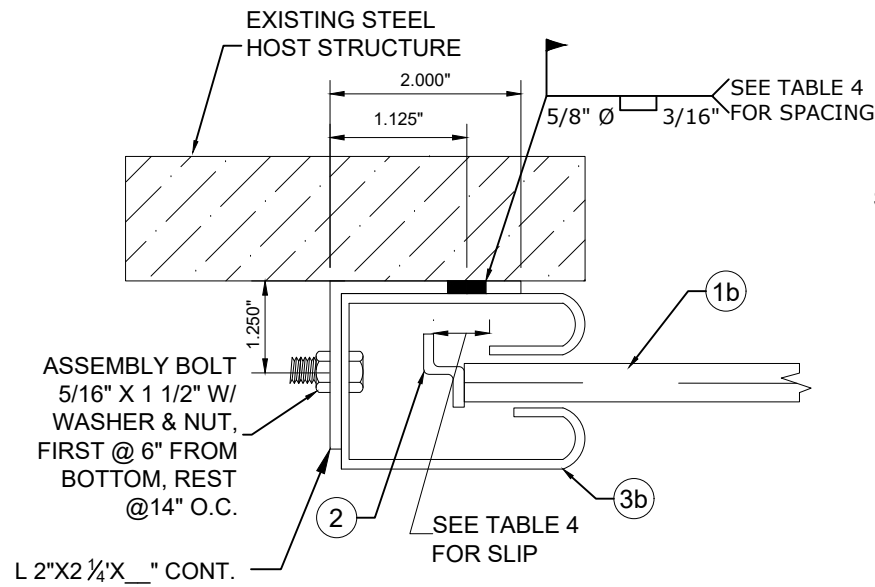


CHANNEL JAMB TO STEEL 1 (MODEL S10-6565)

SCALE: NTS SECTION

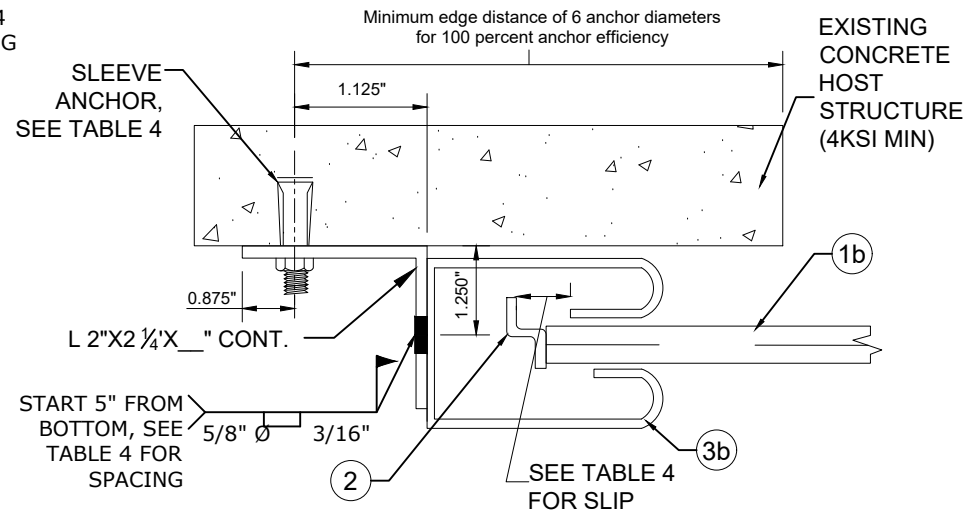

CHANNEL JAMB TO CONCRETE (MODEL S10-6565)

SCALE: NTS SECTION

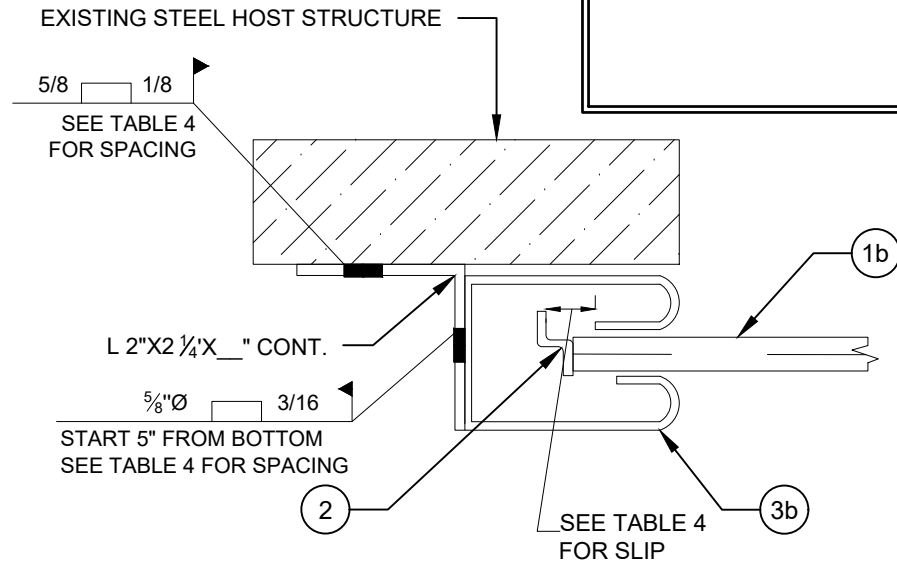

CHANNEL JAMB TO STEEL 2 (MODEL S10-6565)

SCALE: NTS SECTION



TABLE 4: MODEL #S10-6565 JAMB CONNECTIONS

DOOR OPENING WIDTH	SLIP EACH END	ANCHORS TO CONCRETE JAMB fc= 4000 psi	FIELD WELD TO STEEL JAMB Based on a minimum wall angle thickness: 3/16"		WALL ANGLE THICKNESS Gr50 Fy = 50 ksi, <i>see detail</i> 3/2 for angle stacking options	
		WALL ANGLE TO JAMB	CHANNEL GUIDE		CHANNEL GUIDE	
		HILTI Kwik Bolt 3 or Dynabolt Sleeve Anchor *	PLUG WELD WALL ANGLE TO JAMB	PLUG WELD CHANNEL TO WALL ANGLE	E-GUIDE STEEL JAMB	Z-GUIDE CONCRETE JAMB
		dia. x embedment x spacing				
30' 4-1/2"	1.50	5/8" x 4" @ 6-1/2" o.c.	5/8" dia. x 3/16" @ 6-1/2" o.c.	5/8" dia. x 3/16" @ 10" o.c.	3/8"	3/8"
25'- 0"	1.50	5/8" x 4" @ 9-1/2" o.c.	5/8" dia. x 3/16" @ 8" o.c.	5/8" dia. x 3/16" @ 12" o.c.	5/16"	5/16"
20'- 0"	1.50	5/8" x 4" @ 13-1/2" o.c.	5/8" dia. x 3/16" @ 12" o.c.	5/8" dia. x 3/16" @ 14" o.c.	1/4"	1/4"
16'- 0"	1.00	5/8" x 4" @ 16" o.c.	5/8" dia. x 3/16" @ 14" o.c.	5/8" dia. x 3/16" @ 14" o.c.	1/4"	1/4"
14'- 0"	0.75	5/8" x 4" @ 16" o.c.	5/8" dia. x 3/16" @ 14" o.c.	5/8" dia. x 3/16" @ 14" o.c.	3/16"	3/16"
12'- 0"	0.50	5/8" x 4" @ 16" o.c.	5/8" dia. x 3/16" @ 14" o.c.	5/8" dia. x 3/16" @ 14" o.c.	3/16"	3/16"
8'- 0"	0.25	5/8" x 4" @ 16" o.c.	5/8" dia. x 3/16" @ 14" o.c.	5/8" dia. x 3/16" @ 14" o.c.	3/16"	3/16"
4'- 0"	0.50	5/8" x 4" @ 16" o.c.	5/8" dia. x 3/16" @ 14" o.c.	5/8" dia. x 3/16" @ 14" o.c.	3/16"	3/16"

* FIRST AND LAST ANCHOR SHALL BE 7" MAXIMUM FROM END OF ANGLE

TABLE 5: MODEL #S10-6565 JAMB REACTIONS

Design Wind Load (psf)	Opening Width	Design Slip	Vx (lb/ft)	Vy (lb/ft)
+50 / -50	12'-0"	1/2"	1213	302
	16'-0"	1"	1459	402
	20'-0"	1 1/2"	1739	502
	25'-0"	1 1/2"	2501	627
	30'- 4 1/2"	1 1/2"	3389	761
+55 / -55	12'-0"	1/2"	1362	332
	16'-0"	1"	1620	442
	20'-0"	1 1/2"	1923	552
	25'-0"	1 1/2"	2758	690
	30'- 4 1/2"	1 1/2"	3732	838
+60 / -60	12'-0"	1/2"	1510	362
	16'-0"	1"	1782	483
	20'-0"	1 1/2"	2106	603
	25'-0"	1 1/2"	3014	752
	30'- 4 1/2"	1 1/2"	4075	914
+65 / -65	12'-0"	1/2"	1659	393
	16'-0"	1"	1943	523
	20'-0"	1 1/2"	2290	653
	25'-0"	1 1/2"	3271	815
	30'- 4 1/2"	1 1/2"	4418	990

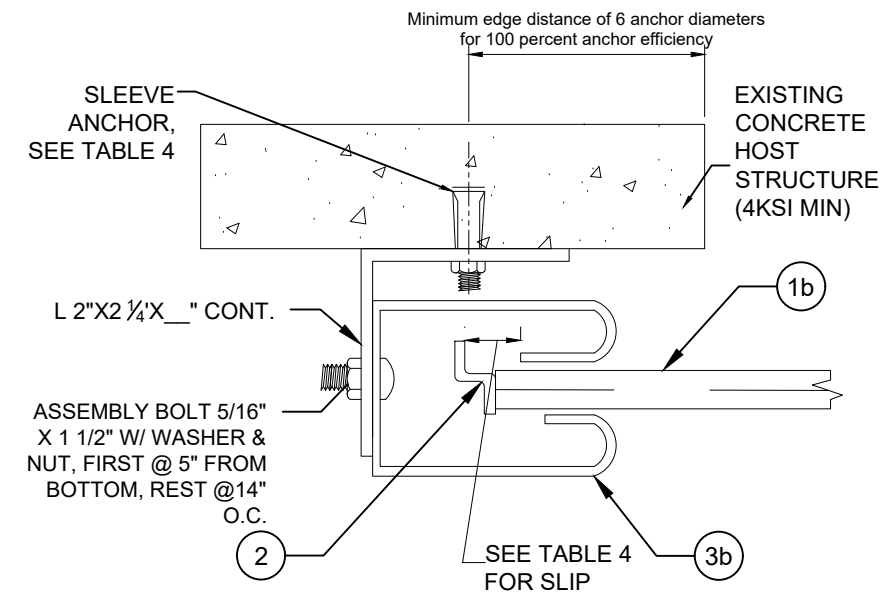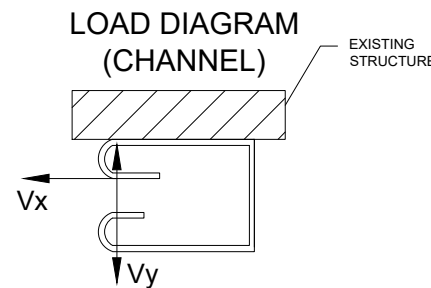



CHANNEL JAMB TO CONCRETE 2 (MODEL S10-6565)

SCALE: NTS SECTION


JAMB CONNECTIONS
MODEL #S10-100

RAMEZ SAYED, P.E.
PE# 94621 CA# 9885


FL

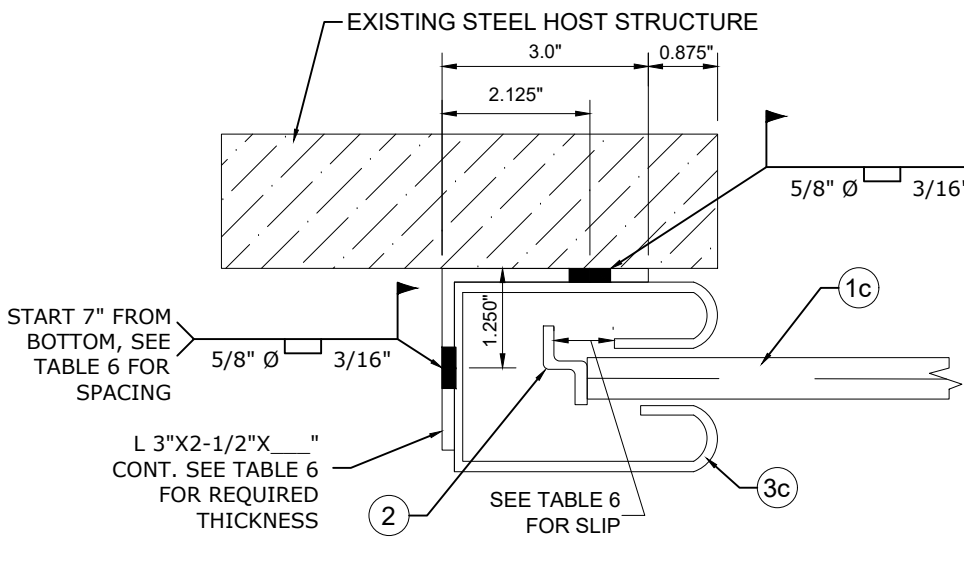

1
5 CHANNEL JAMB TO STEEL 1
(MODEL S10-100)
SCALE: NTS SECTION

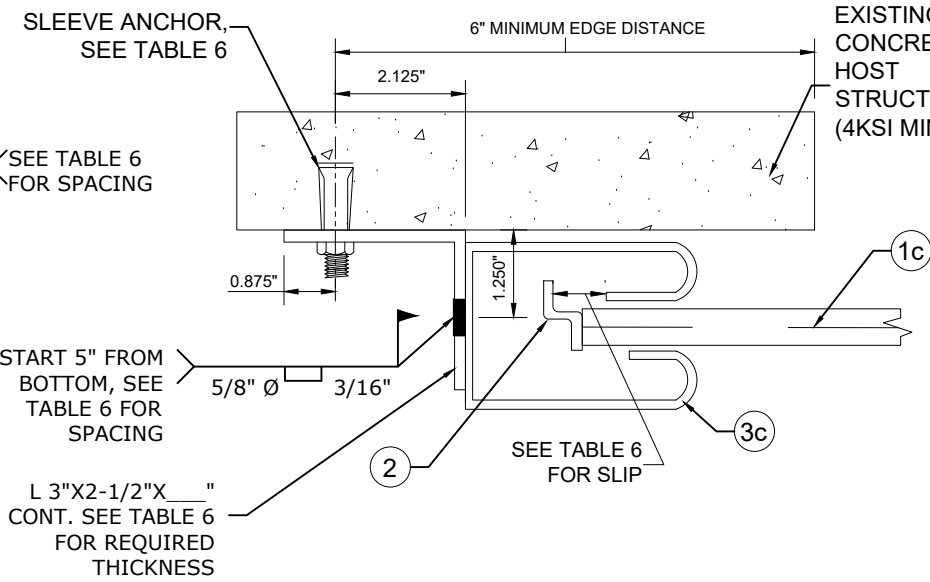

2
5 CHANNEL JAMB TO CONCRETE 1
(MODEL S10-100)
SCALE: NTS SECTION

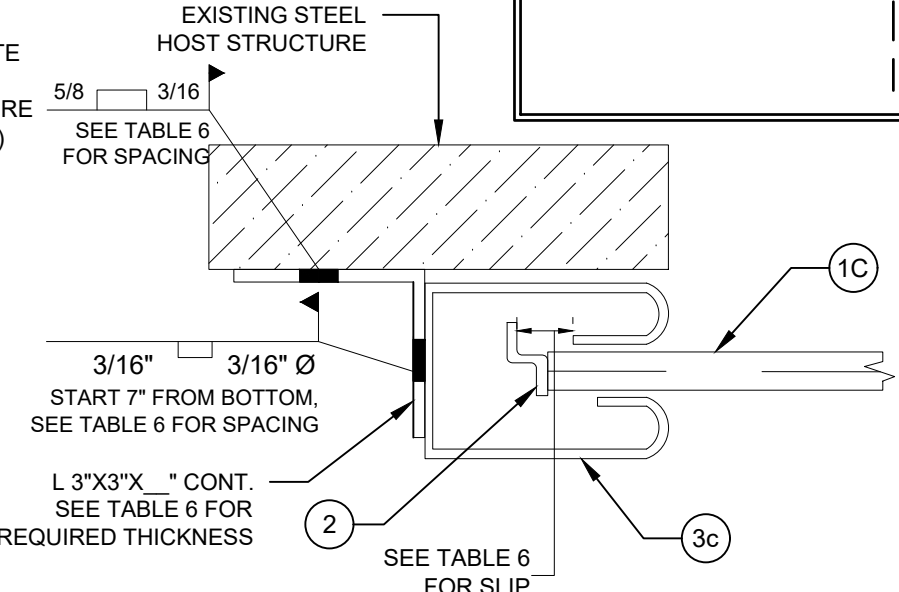

3
5 CHANNEL JAMB TO STEEL 2
(MODEL S10-100)
SCALE: NTS SECTION

TABLE 6: MODEL #S10-100 JAMB CONNECTIONS

DOOR OPENING WIDTH	SLIP EACH END	ANCHORS TO CONCRETE JAMB fc= 4000 psi	FIELD WELD TO STEEL JAMB		WALL ANGLE THICKNESS Gr50 Fy = 50 ksi, <i>see detail</i> 3/2 for angle stacking options	
		WALL ANGLE TO JAMB	CHANNEL GUIDE		CHANNEL GUIDE	
		HILTI Kwik Bolt 3 or Dynabolt Sleeve Anchor *	PLUG WELD WALL ANGLE TO JAMB	PLUG WELD CHANNEL TO WALL ANGLE	E-GUIDE STEEL JAM	Z-GUIDE CONCRETE JAM
		dia. x embedment x spacing				
30' 4-1/2"	1.50"	3/4" x 6-1/2" @5-1/4" o.c.	5/8" dia. x 3/16" @ 4-3/4" o.c.	5/8" dia. x 3/16" @ 7" o.c.	1/2"	1/2"
25'-0"	1.50"	3/4" x 6-1/2" @7" o.c.	5/8" dia. x 3/16" @ 6-1/4" o.c.	5/8" dia. x 3/16" @ 9-1/4" o.c.	7/16"	7/16"
20'-0"	1.50"	3/4" x 6-1/2" @10-1/2" o.c.	5/8" dia. x 3/16" @ 9" o.c.	5/8" dia. x 3/16" @ 12" o.c.	3/8"	3/8"
15'-0"	1.00"	3/4" x 6-1/2" @14" o.c.	5/8" dia. x 3/16" @ 12" o.c.	5/8" dia. x 3/16" @ 14" o.c.	5/16"	5/16"

* FIRST AND LAST ANCHOR SHALL BE 7" MAXIMUM FROM END OF ANGLE


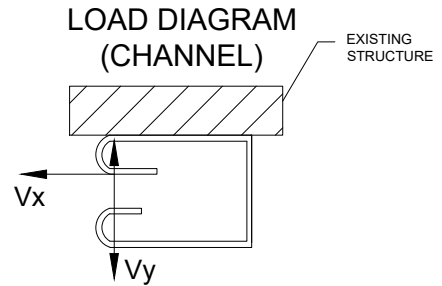


TABLE 7: MODEL #S10-100
JAMB REACTIONS

DOOR OPENING WIDTH	Vx (+ or -)	Vy (+ or -)
	lb / ft	lb / ft
30' 4-1/2"	6799	1523
25'-0"	5035	1254
20'-0"	3528	1004
15'-0"	2670	754

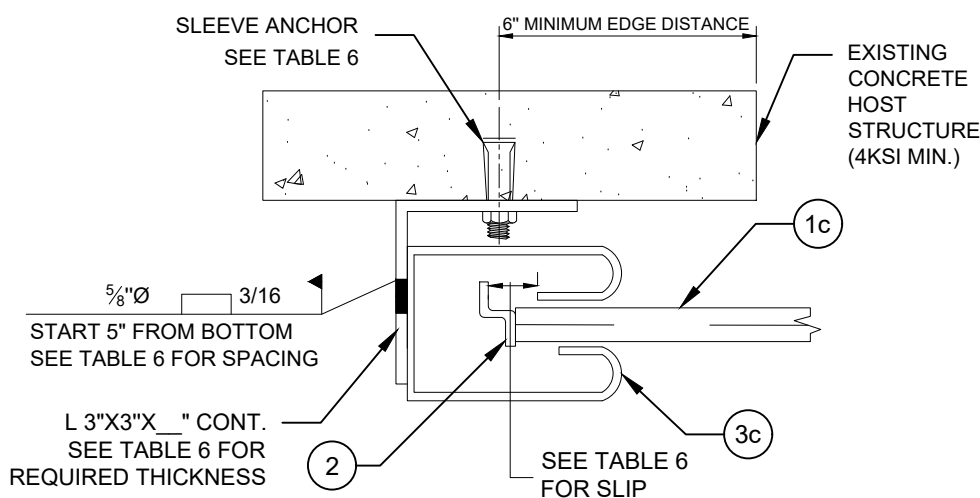

4
5 CHANNEL JAMB TO CONCRETE 2
(MODEL S10-100)
SCALE: NTS SECTION

FL 10706.1

**ENGINEERING
EXPRESS**
POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

BEST ROLLING DOORS, INC.
9770 N.W. 79TH AVENUE
HIALEAH GARDENS, FL
Phn. (305) 698-3550
STEEL ROLL-UP DOORS
FLORIDA BUILDING CODE NINTH EDITION (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#10706.1)

DRWN	CHKD	DATE
RWN	FLB	08/16/17
JEM	FLB	01/25/21
AMZ	RS	09/29/23
NRD	RS	08/03/26
REMARKS	INIT	ISSUE
FBBC 2020 (21-36346)		
FBBC 2023 (23-62056a)		
2026 FBC UPDATE		

26-101599

SCALE: NTS UNLESS NOTED








8/13/2026 10:14 AM COLBYBENNAARD@Bentley\projects\26-101599 2026 multiple product fbc update f10706\work\2026 fbc\drawings & cad\26-101599 -f10706.1 - dwg_1.dwg

RAMEZ SAYED, P.E.
PE# 94621 CA# 9885

FL



SYSTEM COMPONENTS
ALL MODELS

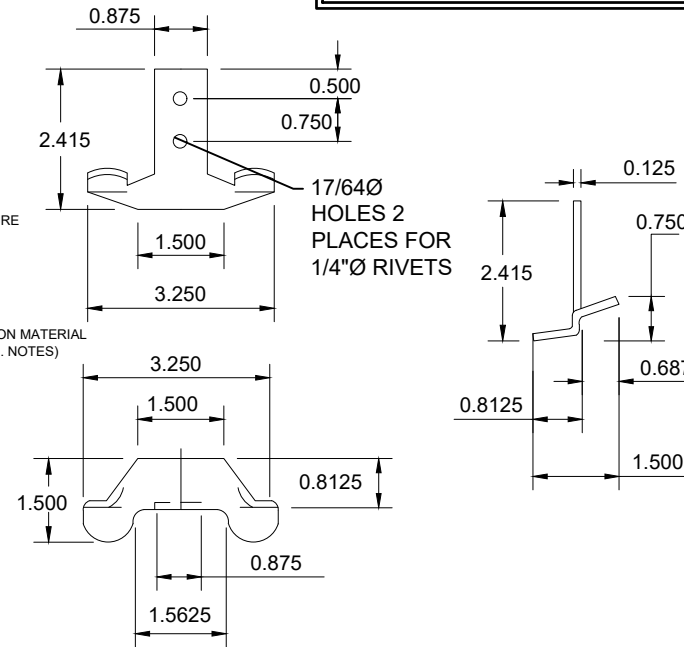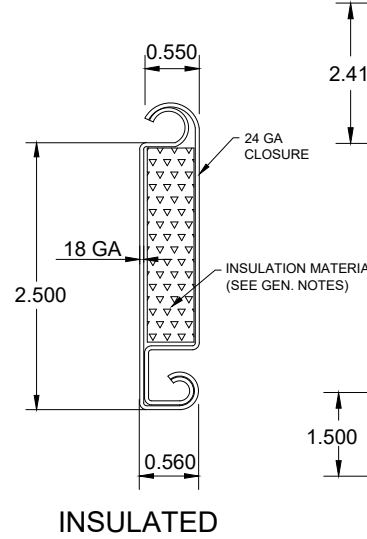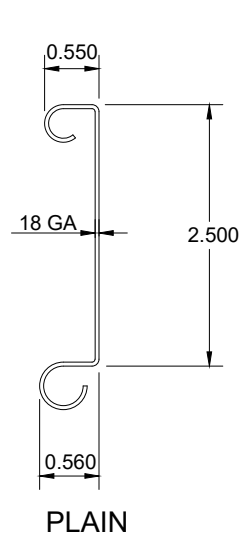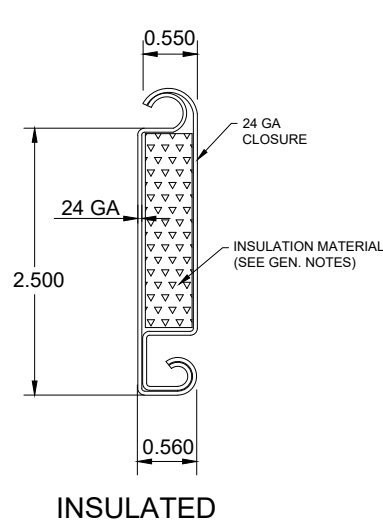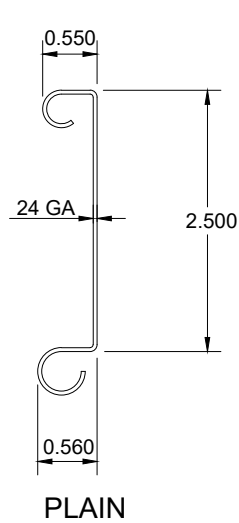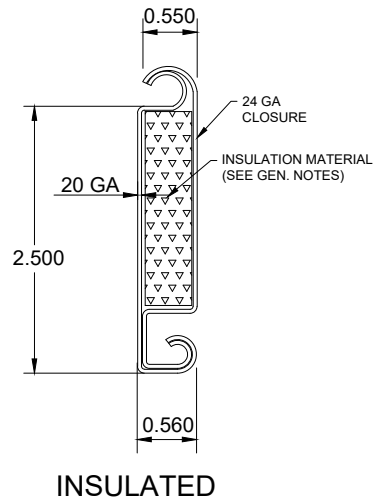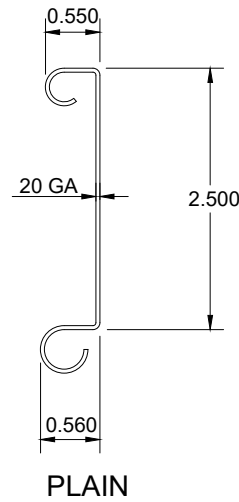




1a FLAT SLAT (Model S10-6065)
SCALE: NTS STEEL*

1b FLAT SLAT (Model S10-6565)
SCALE: NTS STEEL*

1c FLAT SLAT (Model S10-100)
SCALE: NTS STEEL*

2 WINDLOCK (ALL MODELS)
SCALE: NTS STEEL (ASTM A-1011)

***SLAT STEEL NOTE:**
SLAT TO BE A.S.T.M. A-653 GR 50 STRUCTURAL QUALITY STEEL WITH MIN. FY = 50 KSI AND G-90 GALVANIZING PER A.S.T.M. A-653, OR A.I.S.I. 304 SERIES STAINLESS STEEL MANUFACTURED WITH A MINIMUM YIELD STRENGTH OF FY = 50 KSI.

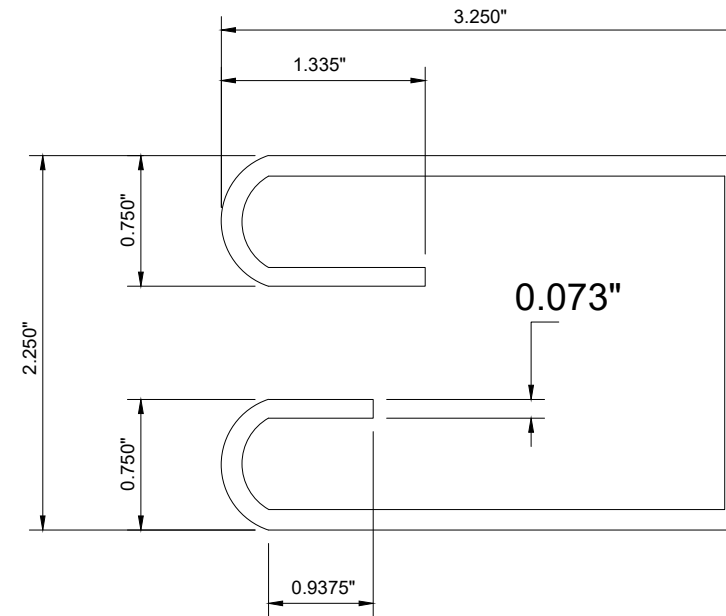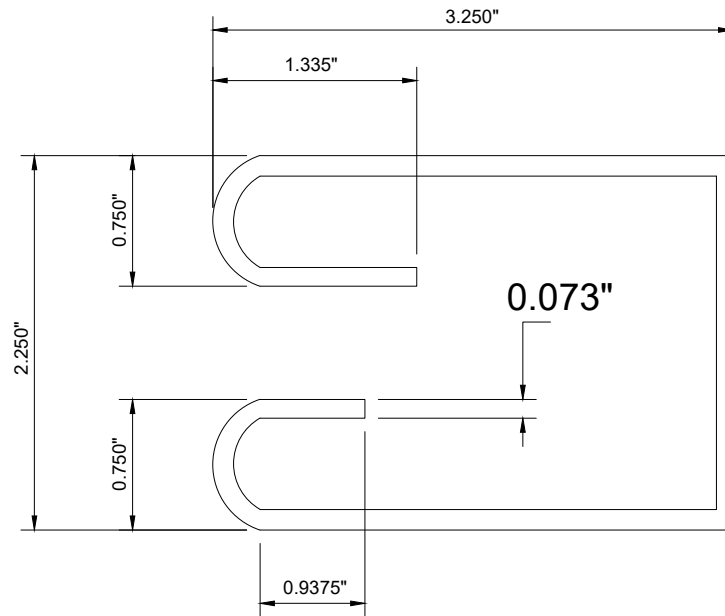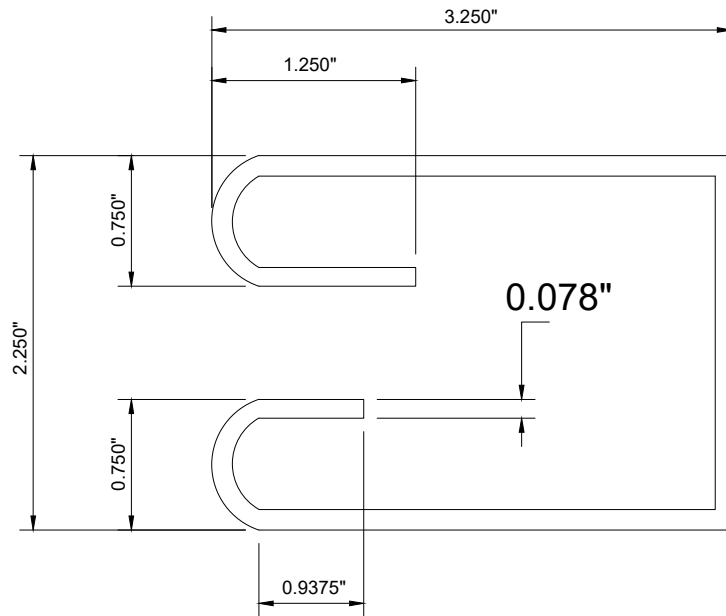

3a CHANNEL GUIDE (Model S10-6065)
SCALE: NTS STEEL (Fy=30KSI MIN.)

3b CHANNEL GUIDE (Model S10-6565)
SCALE: NTS STEEL (Fy=30KSI MIN.)

3c CHANNEL GUIDE (Model S10-100)
SCALE: NTS STEEL (Fy=30KSI MIN.)

FL 10706.1

**ENGINEERING
EXPRESS**
POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

BEST ROLLING DOORS, INC.

9770 N.W. 79TH AVENUE
HIALEAH GARDENS, FL
Phn. (305) 698-3550

STEEL ROLL-UP DOORS
FLORIDA BUILDING CODE NINTH EDITION (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#10706.1)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	RWN	FLB	08/16/17
FBC 2020 (21-36346)	JEM	FLB	01/25/21
FBC 2023 (23-62056a)	AMZ	RS	09/29/23
2026 FBC UPDATE	NRD	RS	08/03/26

COPYRIGHT ENGINEERING EXPRESS®

26-101599

SCALE: NTS UNLESS NOTED

