

NOTES:

1. IMPACT RESISTANT GLAZING OPTION – IMPACT RESISTANT GLAZING SYSTEM MAY BE INSTALLED IN TOP OR INTERMEDIATE SECTION (WITH OR WITHOUT DECORATIVE INSERTS). GLAZING SHALL BE 1/4" POLYCARBONATE. MAXIMUM GLAZING DIMENSIONS SHALL BE 14" x 46" CUTOUT. FASTENED WITH A MINIMUM #8 X 1" SMS: 3X ALONG THE HORIZONTAL AND 3X ALONG THE VERTICAL. SEE DETAIL E ON SHEET 2 FOR ASSEMBLY DETAILS.

2. NON-IMPACT REISTANT GLAZING OPTION – .090" MINIMUM SSB GLAZING IN MOLDED FRAMES SCREWED TOGETHER WITH A MINIMUM OF (10) #8x1" SCREWS (3X ALONG THE HORIZONTAL AND 2X ALONG THE VERTICAL) INSTALLED IN TOP OR INTERMEDIATE SECTION (WITH OR WITHOUT DECORATIVE INSERTS) MEETS UNIFORM STATIC WIND PRESSURES SHOWN ON THIS DRAWING. MAXIMUM GLAZING DIMENSIONS SHALL BE 15" x 46" CUTOUT. GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS.

3. VINYL OR WOOD DOOR STOP NAILED A MAXIMUM OF 6" O.C. MUST OVERLAP TOP AND BOTH ENDS OF PANELS MINIMUM 7/16" TO MEET NEGATIVE PRESSURES.

4. KEY LOCK, SLIDE LOCK, OR OPERATOR REQUIRED.

5. LOUVER OPTION – .040" MINIMUM LOUVERS IN MOLDED FRAMES SCREWED TOGETHER WITH A MINIMUM OF (10) #8x1" SCREWS (3X ALONG THE HORIZONTAL AND 2X ALONG THE VERTICAL) INSTALLED IN THE BOTTOM SECTION. MAXIMUM LOUVER DIMENSIONS SHALL BE 15" x 19" CUTOUT. LOUVERS ARE NOT IMPACT RESISTANT AND DO NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS.

6. FACER STEEL TO HAVE A MINIMUM 27 GA THICKNESS AND BACKER STEEL TO HAVE A MINIMUM 29 GA THICKNESS.

7. A 4-1/2" x 6" x 22 GA BACKER PLATE IS TO BE LOCATED AT EVERY INTERMEDIATE AND OUTER END HINGE LOCATION.

8. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

9. DOOR JAMB TO BE MINIMUM 2x4 STRUCTURAL GRADE LUMBER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.

10. FOR LOW HEAD ROOM LIFT CONDITIONS, TOP BRACKET SHALL BE A 13 GA LHR 7/4 TOP BRACKET WITH A MINIMUM OF (3) 1/4-14x7/8" SELF DRILLING CRIMPITE SCREWS IN LIEU OF THE BRACKET SHOWN ON THIS DRAWING. U-BAR ON TOP SECTION SHALL BE INSTALLED ON TOP OF LHR TOP BRACKETS.

13 GA HORIZ ANGLE

13 GA FLAG ANGLE

16 GA MIN HORIZ TRACK

5/16x1-5/8"

LAG SCREW (MIN 3

(4) 1/4-20x9/16" LARGE

HEAD TRACK BOLTS OR

1/4-20 STUDS WITH

1/4-20 HEX NUTS

15 GA MIN VERT TRACK

1/4-20x9/16" TRACK

BOLT AND 1/4-20 HEX

NUT AT EACH JB-US

JAMB BRACKET LOCATION

5/16x1-5/8" LAG

SCREW AT EACH

JAMB BRACKET

15 GA STIFFENED JAMB

BRACKETS

SEE SCHEDULE FOR

QUANTITY, LOCATION,

AND TYPE

KEY LOCK OR SLIDE

LOCK ONE END (NOT

REQUIRED WITH

OPERATOR – SEE

NOTE 3). SLIDE LOCK

SHOWN FOR CLARITY

NOTE: (4) SECTION SOLID

DOOR SHOWN. SEE NOTE 1

THIS SHEET FOR GLAZING

OPTIONS.

A
SHEET 2

B
SHEET 2

19 GA END STILE

D
SHEET 2

CL DOOR

C
SHEET 2

REVISIONS

P1 REVISED MODELS
GRT 1/22/14

P2 UPDATED GLAZING
AND LOUVER DESCRIPTION
GRT 5/9/14

P3 UPDATED TITLE BLOCK
ESC 10/3/17

P4 ADDED MODEL# 8650
PCR32177
TLC 11/15/19

P5 UPDATED FOR IMPACT
RATING. NPD0054
TLC 12/30/2019

P6 UPDATED JAMB
BRACKET SCHEDULE
TLC 04/08/20

REV G ADDED OPTION
FOR NYLON ROLLERS.
PCR32442
TLC 7/28/20

REV H ADD IRC/ICB NOTE
PCR32442
TLC 8/25/20

REV J – UPDATED MODEL
NUMBERS
PCR 32661
EFK6/25/21

JAMB BRACKET SCHEDULE

DOOR HEIGHT	NO. OF SECTIONS	NO. OF JAMB BRACKETS (EACH JAMB)	LOCATION OF CENTERLINE OF JAMB BRACKETS MEASURED FROM BOTTOM OF TRACK (ALL DIMENSIONS ± 2")
6'-6"	4	7	2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 29-3/4" (JB-US), 39" (JB-US), 48" (JB-US), 57-1/4" (JB-US)
7'-0"	4	7	2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 29-3/4" (JB-US), 42" (JB-US), 52-1/2" (JB-US), 63-1/4" (JB-US)
7'-6"	4 OR 5	8	2" (JB-US), 10" (JB-US), 18-3/4" (JB-US), 26-3/4" (JB-US), 36" (JB-US), 45" (JB-US), 54-1/4" (JB-US), 74-1/2" (JB-US)
8'-0"	4 OR 5	8	2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 29-3/4" (JB-US), 39" (JB-US), 48" (JB-US), 57-1/2" (JB-US), 75-1/2" (JB-US)
> 8'-0"			SEE NOTE BELOW

NOTE:


(JB-US) FOLLOWING DIMENSION DENOTES SLOTTED JAMB BRACKET ATTACHED TO TRACK WITH 1/4-20x9/16" TRACK BOLT AND NUT AS SHOWN ABOVE.

ALL DOORS GREATER THAN 8' IN HEIGHT REQUIRE USE OF CONTINUOUS WALL ANGLE. SEE SUPPLEMENT TRACK CHART FOR DETAILS.

**SUPERIMPOSED DESIGN PRESSURE
LOADS ON SUPPORTING STRUCTURE**

DOOR WIDTH	DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)
8'-2"	ALL	+145.8/-167.4
9'-2"	ALL	+163.6/-187.9

THE DOORS ARE DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2018 IRC AND THE 2018 IBC.

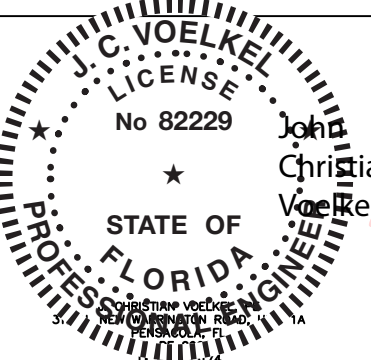

Digitally signed
by John Christian
Voelkel
Date: 2021.08.06
10:51:16 -05'00'



A DIVISION OF OVERHEAD DOOR CORP.
3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A	
DESIGN (PSF):	+35.70/-41.00	MAX WIDTH:	9'-2"		DATE	NAME	
TEST (PSF):	+53.55/-61.50	MAX HEIGHT:	24'-0"		DRAWN	6/12/13	GRT
IMPACT/CYCLIC RATED (YES/NO): YES		MAX SECTION HEIGHT: 24"		CHECKED	7/15/21	TLC	
MODELS 6600/8300/8350/8500/8600/5150/5200/TM515/TM525				SHEET 1 OF 2			
WINDLOAD SPECIFICATION OPTION CODE 2204				DRAWING PART NO.		REV.	
				352066		J	

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR
VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.

13 GA ROLLER SLIDE ATTACHED TO BRACKET WITH 5/16-18 BOLT & NUT IN CENTER SLOT AND 1/4-20x9/16" TRACK BOLT & 1/4-20 HEX NUT THROUGH ANY TWO ALIGNING HOLES

12 GA COMMERCIAL 'A' FRAME TOP BRACKET ATTACHED WITH (4) 1/4-14x7/8" SELF DRILLING CRIMPITTE SCREWS

ADD (2) 1/4-14x7/8" SELF DRILLING CRIMPITTE SCREWS (INSIDE OF EACH END HINGE)

2" STEEL ROLLER WITH 5-1/4" STEM
OPTIONAL NYLON, 10/11-BALL BEARING ROLLER AVAILABLE

13 GA WIDE BODY END HINGE ATTACHED WITH (4) 1/4-14x7/8" SELF DRILLING CRIMPITTE SCREWS

14 GA WIDE BODY INTERMEDIATE HINGE ATTACHED WITH (4) 1/4-14x7/8" SELF DRILLING CRIMPITTE SCREWS

14 GA BOTTOM BRACKET ATTACHED WITH (2) 1/4-14x7/8" SELF DRILLING CRIMPITTE SCREWS AND (1) 1/4-14x5/8" SELF DRILLING TAMPER RESISTANT SCREW


DETAIL A

DETAIL B

DETAIL C

DETAIL D

HINGE & BACKER PLATE LOCATIONS

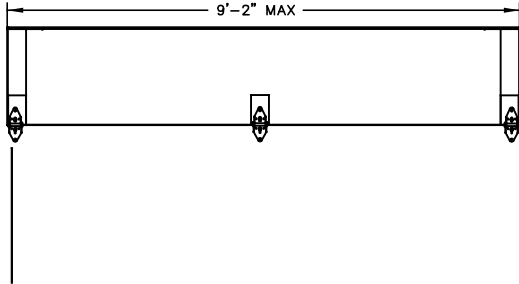

(10) SECTION DOORS WITH
(11) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(9) SECTION DOORS WITH
(10) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(8) SECTION DOORS WITH
(9) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN



(7) SECTION DOORS WITH
(8) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(6) SECTION DOORS WITH
(7) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(5) SECTION DOORS WITH
(6) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(4) SECTION DOORS WITH
(5) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

ALL U-BARS SHALL BE ATTACHED WITH (2) 1/4-14x7/8" SELF DRILLING CRIMPITTE SCREWS AT EACH HINGE LOCATION AND BETWEEN ALL END HINGES AND INTERMEDIATE HINGES. A MINIMUM OF (10) FASTENERS ARE TO BE USED.

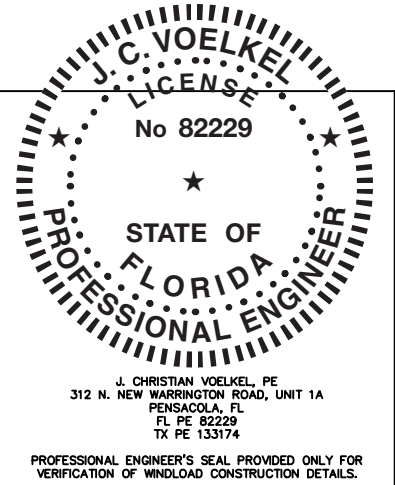

THE DOORS ARE DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2018 IRC AND THE 2018 IBC.

 A DIVISION OF OVERHEAD DOOR CORP. 3395 ADDISON DRIVE PENSACOLA, FLORIDA 32514 (850) 474-9890	STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A	
	DESIGN (PSF):	+35.70/-41.00	MAX WIDTH:	9'-2"		DATE		NAME
	TEST (PSF):	+53.55/-61.50	MAX HEIGHT:	24'-0"	DRAWN	6/12/13		GRT
	IMPACT/CYCLIC RATED (YES/NO): YES		MAX SECTION HEIGHT: 24"		CHECKED	7/15/21		TLC
	MODELS 6600/8300/8350/8500/8600/5150/5200/TM515/TM525					SHEET 2 OF 2		
WINDLOAD SPECIFICATION OPTION CODE 2204					DRAWING PART NO.		REV.	
					352066		J	