

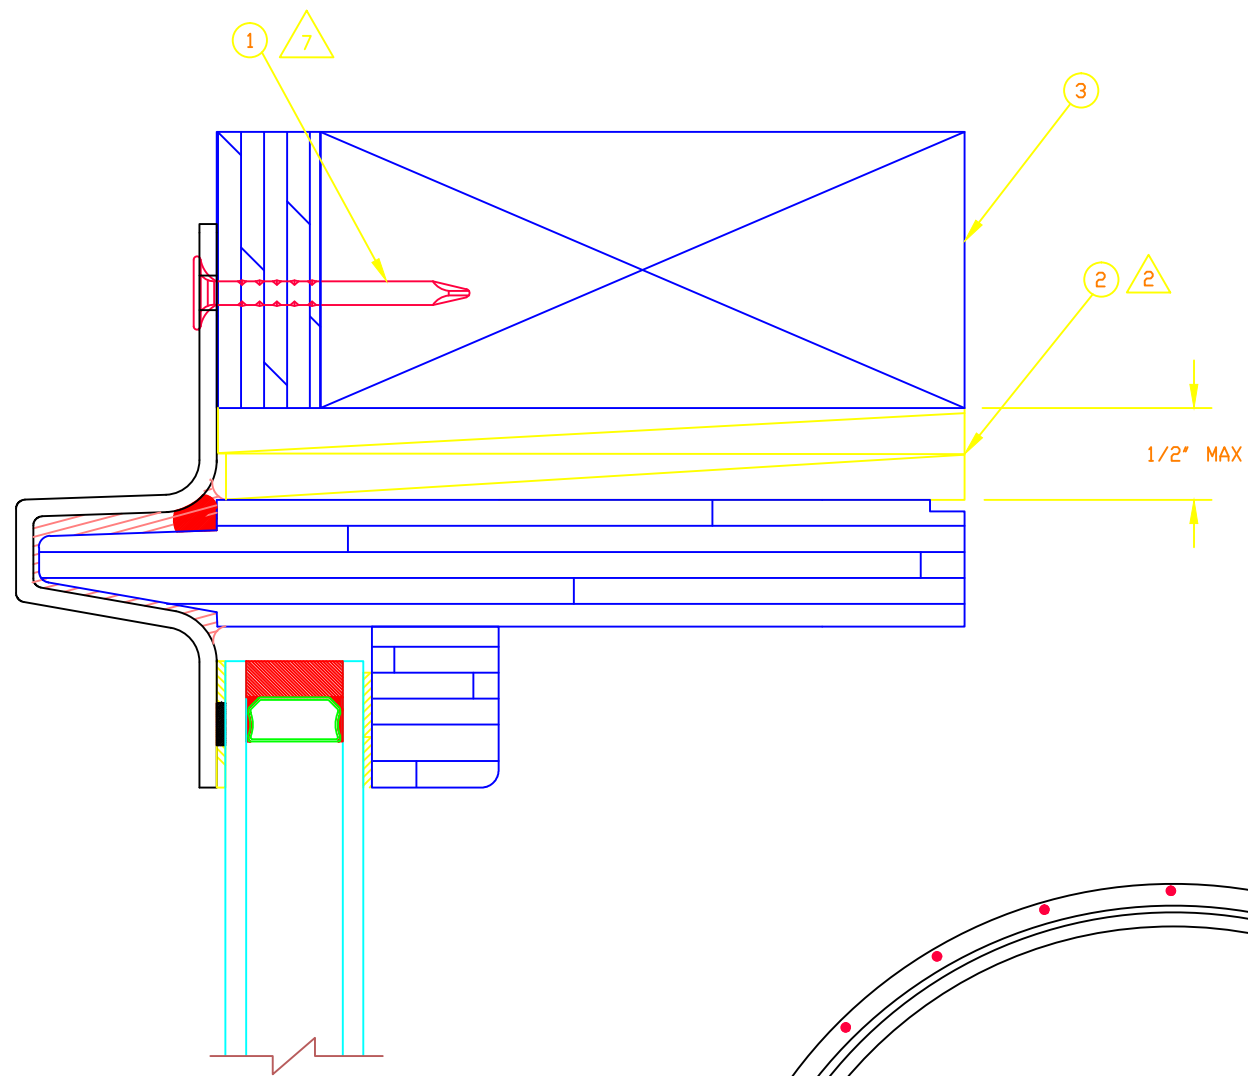


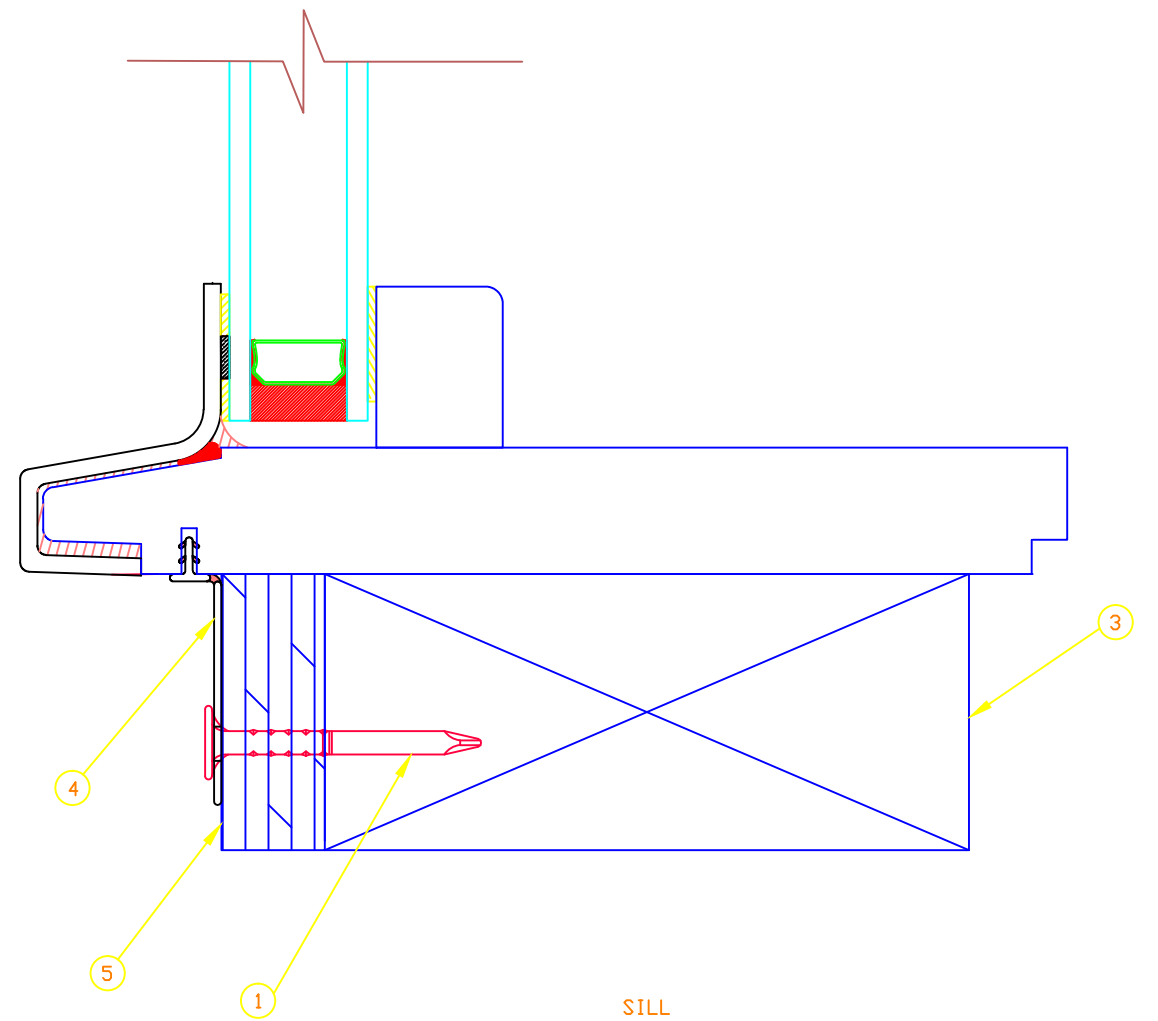

HEADJAMB AND JAMB

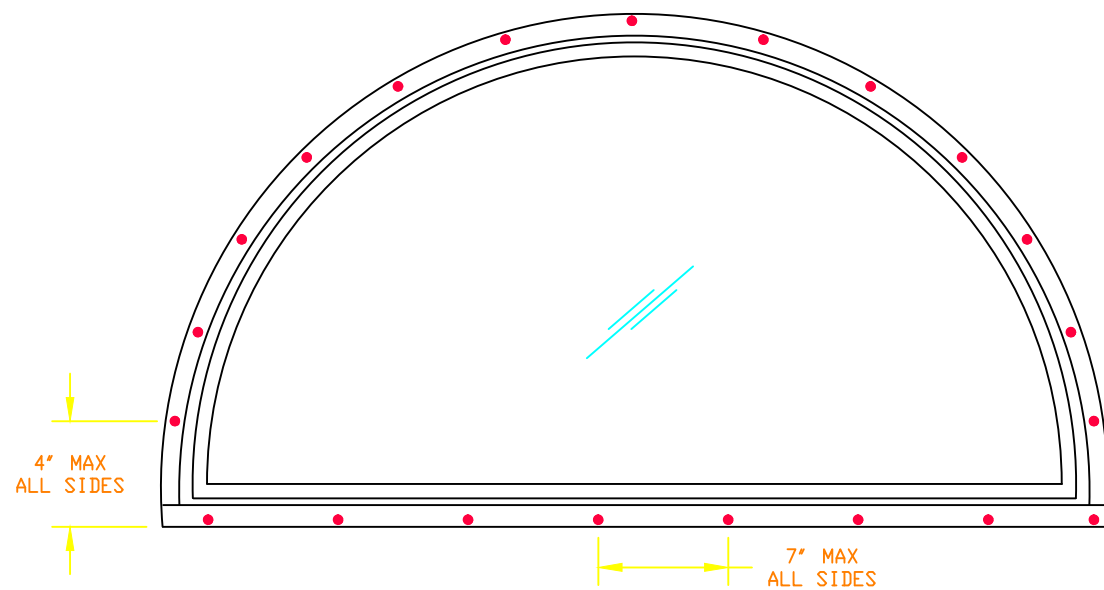

SILL

- NOTES:
1. THIS PRINT IS FOR STRUCTURAL PERFORMANCE ONLY. FOR FLASHING & SEALING INSTRUCTIONS, REFER TO THE INSTALLATION INSTRUCTIONS.
 2. SHIMS
—PLACE A SHIM WITHIN 4–6 INCHES OF EACH CORNER AND SPACE ALL OTHERS EVENLY A MAXIMUM OF 15" APART.
 3. IF CHEMICALLY TREATED LUMBER IS USED FOR BUCK MATERIAL, FASTENERS INTO THE BUCK MUST BE A MINIMUM OF 0.90 OZ/FT² ZINC HOT DIPPED GALVANIZED OR STAINLESS STEEL TYPE 304 OR 316.
 4. MINIMUM OF 2 FASTENERS PER SIDE
 5. APPLY TO ALL SIDES
 6. SPACING PER ELEVATION
 7. #8 x 1–1/4" PAN HEAD OR WAFFLE HEAD SCREWS MAY BE SUBSTITUTED FOR 2" ROOFING NAILS.
 8. MINIMUM NAIL EMBEDMENT DEPTH 1 15/16"
 9. MINIMUM EDGE DISTANCE 1/2"

NAILING FIN INSTALLATION METHOD IS APPROVED FOR THE FOLLOWING PRODUCTS:
FL 10783.1 IRT-CA
FL 10783.2 IRT-DH

0.0	ORIGINAL ISSUE	PENDING	04/16/08	BDR
REV#	DESCRIPTION / REQUESTER	ECN NO	DATE	DRAFTER

5	-----	SHEATHING
4	-----	SILL NAIL FIN
3	-----	2X WOOD BUCK BY OTHERS
2	-----	SHIM
1	-----	2.000 GAL. ROOF NAIL
ITEM NO	REF NO	DESCRIPTION

CHECKED: BLM 04/23/08	WOOD TREATMENT SPEC	MARVIN RESEARCH AND DEVELOPMENT BOX 100, WARROAD, MN 56763 (218) 386-1430 FAX 386-4205		
APPROVED: WJA 04/18/08	☐ TREAT ☐ DO NOT			
DWG CLASS: MISC	PRODUCT LINE:	INTEGRITY		
UNSPECIFIED TOLERANCES:	PRODUCT:	ROUND TOP		
DECIMALS: .XX = ±.03 .XXX = ±.012	ANGLE: ±.5 °	INSTALLATION FL 10783		
FAB LINEALS:	MATERIAL:	SIZE: B	DRAWING NO: 00038235	
N/A	N/A	SCALE: 1:1	DATE: 7/5/05	DRAWN BY: JOHN SOPKOWIAK
				SHEET: 1 OF 1