

MODEL DESIGNATION: Simonton Casement Series 08-09 / 08-10 / 08-20 Vinyl Window

MAXIMUM OVERALL NOMINAL SIZE: Triple up to 105" x 63



DESIGN PRESSURE RATING: Positive: 50.0 PSF
Negative: 50.0 PSF

USABLE CONFIGURATIONS: XXX


GENERAL DESCRIPTION: The head, sill, and side jambs are extruded PVC. The wall thickness through which the anchor screw penetrates is a minimum of 0.070".

NO P.E. SEAL REQUIRED
INSTALLATION SUPPORTED
BY AAMA TEST REPORTS


REV. #	REVISIONS:	REVISED BY:	DATE:
3	ADDED GLAZING DETAILS.	T.D.D.	06/03/11
4	REMOVED GLAZING DETAILS AND ADDED NOTE 10.	T.D.D.	01/31/12
5	UPDATED HEIGHT FROM 51" TO 63".	T.D.D.	08/26/13
6	ADDED MIN. EDGE DIST. NOTES.	B.J.S.	06/17/15
7	CURRENT FBC.	LMH	01/10/25

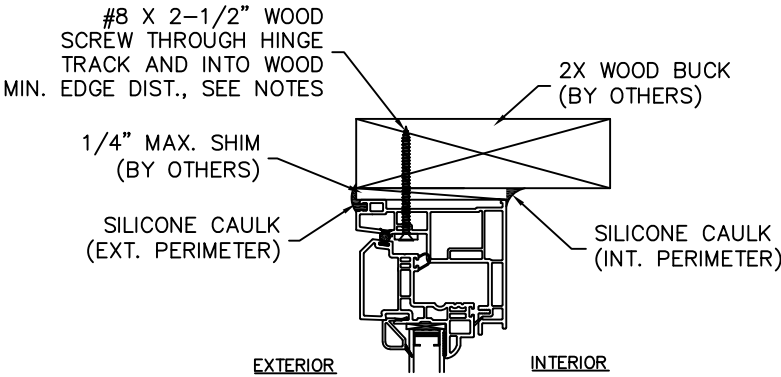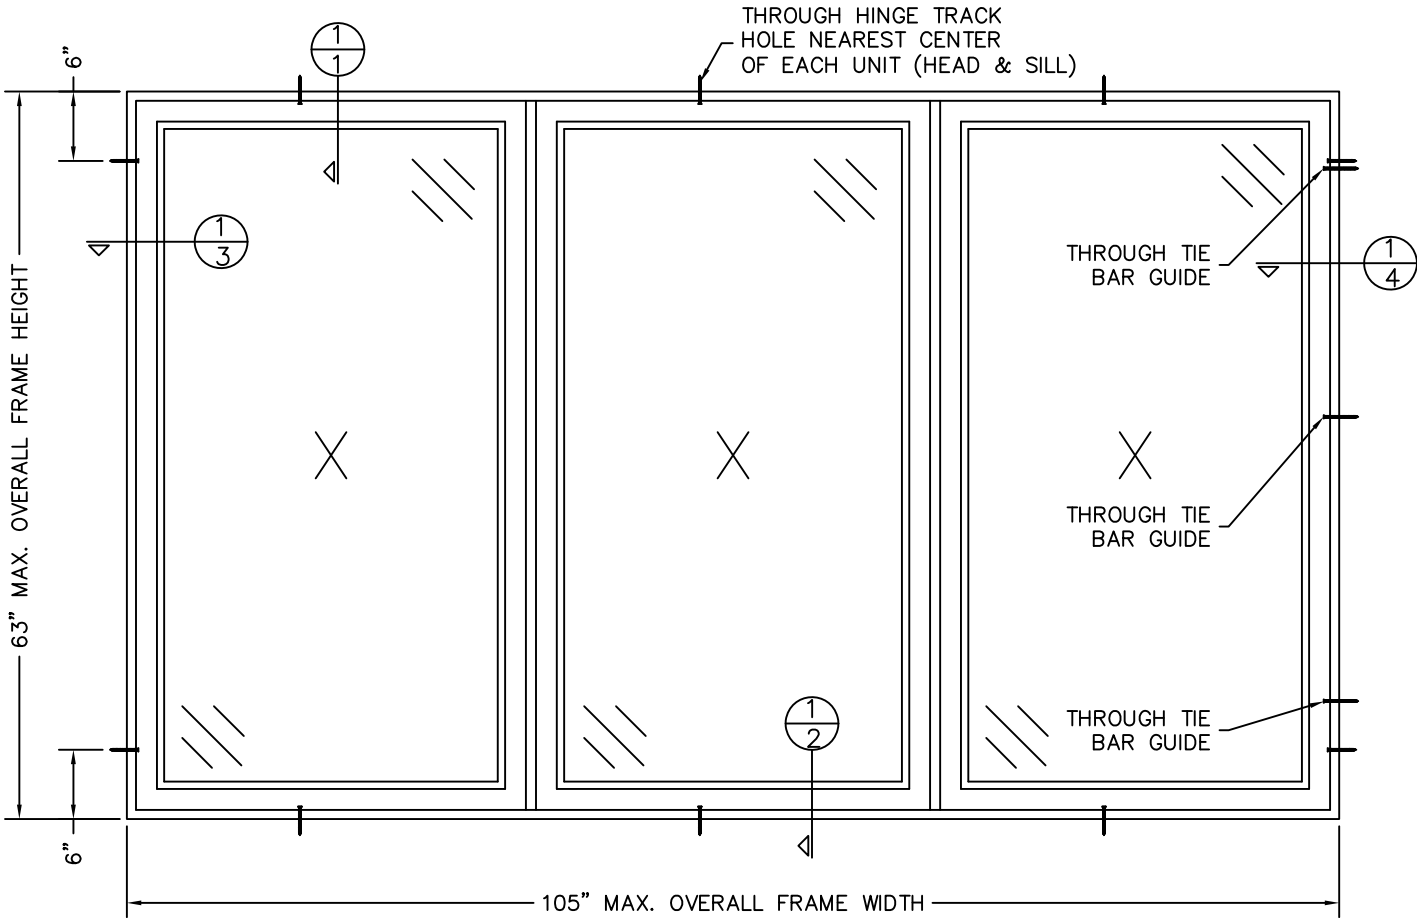


1
1 HEAD
THROUGH FRAME

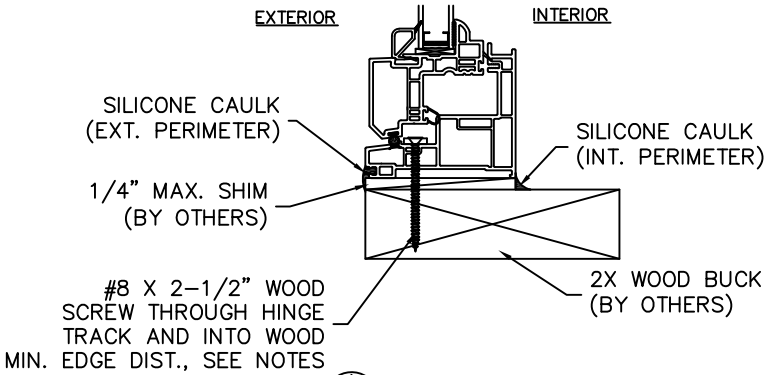

1
2 SILL
THROUGH FRAME

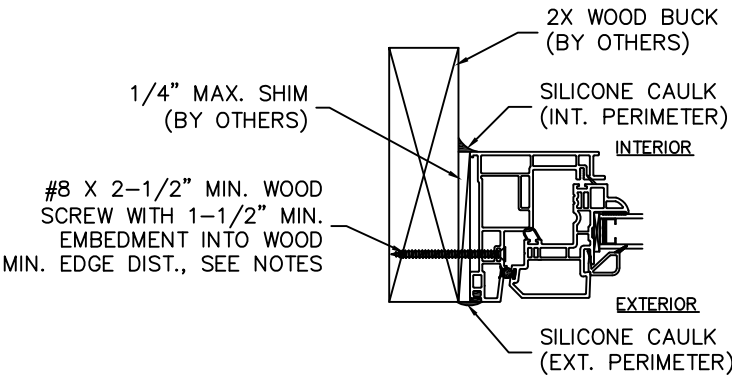

1
3 KEEPER JAMB
THROUGH FRAME

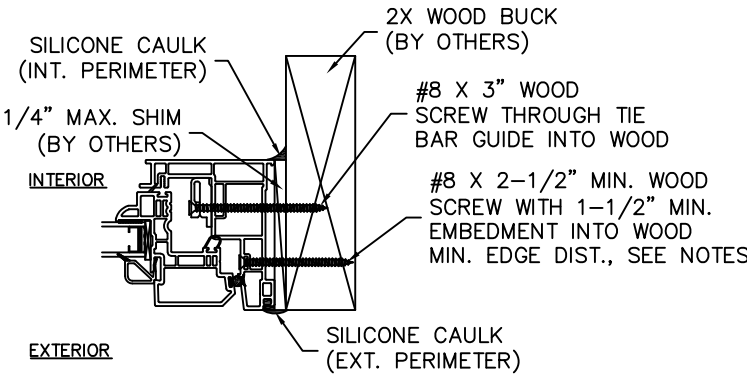

1
4 LOCK JAMB
THROUGH FRAME

- NOTES:**
- THIS INSTALLATION HAS BEEN EVALUATED FOR USE IN LOCATIONS ADHERING TO THE TEXAS AND FLORIDA BUILDING CODES AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES DO NOT EXCEED THE DESIGN PRESSURE RATINGS HEREIN. FOR USE OUTSIDE THE H.V.H.Z.
 - ALL EXTERIOR PERIMETER SURFACES OF THE WINDOW MUST BE CAULKED. INTERIOR CAULKING IS OPTIONAL UNLESS NOTED OTHERWISE.
 - ANCHORS SHALL BE SPECIFIED AND SPACED AS SHOWN. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO AND INTO WOOD.
 - THE RESPONSIBILITY FOR SELECTION OF SIMONTON PRODUCTS TO MEET ANY LOCAL LAWS, BUILDING CODES, ORDINANCES, OR OTHER SAFETY REQUIREMENTS RESTS SOLELY WITH THE ARCHITECT, BUILDING OWNER, OR CONTRACTOR.
 - SHIMS ARE OPTIONAL. MAXIMUM SHIM STACK IS 1/4".
 - WOOD BUCKS (BY OTHERS) MUST BE ENGINEERED AND ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
 - WHEN USED IN AREAS REQUIRING IMPACT PROTECTION, THIS PRODUCT REQUIRES THE USE OF APPROVED IMPACT RESISTANT SHUTTERS OR OTHER EXTERNAL PROTECTION.
 - FLASHING SHOULD BE APPLIED USING THE ASTM E 2112 METHOD APPROPRIATE FOR THE OPENING INTO WHICH THE WINDOW IS BEING INSTALLED.
 - INSTALLATION SCREWS MUST BE AT LEAST 3/4" FROM THE EDGE OF THE WOOD.
 - GLAZING SHALL COMPLY WITH ASTM E 1300.
 - USE A BACKER ROD ON ALL JOINTS >3/4" DEEP AND/OR WIDER THAN 1/4". FINISHED CAULK JOINT SHOULD BE A MINIMUM OF 3/8" DEEP AND MAKE FULL CONTACT WITH BOTH THE NEW WINDOW AND STRUCTURAL OPENING SURFACES.
 - DESIGNATION "X" IS FOR OPERABLE AND "O" IS FOR FIXED.

DISCLOSURE STATEMENT This document is the property of Simonton Windows, which retains all proprietary and other rights to its subject matter. This document is provided to the recipient on the expressed condition that it is not to be disclosed, reproduced in whole or part, nor used in conjunction with the design, manufacture or repair of goods for anyone other than Simonton Windows without its consent. This restriction does not limit the recipient's rights to utilize information contained in this document which is properly obtained from another source. FILE: FL 107	MATERIAL:		Dimensional Tolerances Unless Otherwise Specified Decimals Angles .X ± .03 .XX ± .01 .XXX ± .005 0° 30 min.	 SIMONTON® W I N D O W S 1 Cochrane Avenue Pennsboro, WV 26415	SIZE: DRAWING NO.: B IN0325	REV.: 7
	RMS FINISH:				DRAWN BY: T.D.D.	DATE: 09/18/08
	EXCEPT AS NOTED				CHECKED BY:	DATE:
	ALLOY & TEMPER:					
	WEIGHT:	VOLUME:				
	SURFACE AREA:	PERIMETER:				
FINISH TREATMENT:		SERIES: 08-09 / 08-10 / 08-20 TRIPLE T-MULLED CASEMENT				
		TITLE: 2X BUCK INSTALLATION				