

CAOBA DOORS

10' OUTSWING NARROW STILE DOORS (IMPACT) (HVHZ)

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR INSTALLATION INTO WOOD FRAMING USE #12 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 3/16 INCH DIAMETER ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT WITH 2 1/2" MIN. EDGE DISTANCE AND 3" MIN. SPACING BETWEEN ANCHORS.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW OR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER). MIN. f'c = 1500 PSI.
 - GROUT FILLED CMU - STRENGTH CONFORMANCE TO ASTM C-90, GROUT CONFORMS TO ASTM C-476, MIN f'c=2000 PSI.


GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT TO BE REVIEWED BY BUILDING OFFICIAL OR AHJ.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- DOOR FRAME MATERIAL: SOLID MAHOGANY
 - S.G.=0.42
 - E=1100 KSI
- IN ACCORDANCE WITH THE FBC, WOOD COMPONENTS SHALL HAVE BEEN PRESERVATIVE TREATED OR SHALL BE OF A DURABLE SPECIES.
- GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	-	INSTALLATION, GENERAL NOTES AND GLAZING DETAILS
2	-	ELEVATIONS & ANCHOR LAYOUTS
3	-	ELEVATIONS & ANCHOR LAYOUTS
4	-	ELEVATIONS & ANCHOR LAYOUTS
5	-	VERTICAL SECTIONS
6	-	HORIZONTAL SECTIONS
7	-	HORIZONTAL SECTIONS
8	-	COMPONENTS
9	-	COMPONENTS AND BILL OF MATERIALS

DESIGN PRESSURE RATING		
PANEL SIZE	DESIGN PRESSURE	MISSILE IMPACT RATING
36" x 80"	±75.0 PSF	LARGE AND SMALL MISSILE IMPACT RATED
36" x 108"	±70.0 PSF	
42" x 96"	±64.0 PSF	
42" x 120"	±60.0 PSF	
48" x 120"	±55.0 PSF	

* NOTE: DOORS WITH ADA SILL NOT RATED FOR WATER INFILTRATION. UNITS MAY BE USED AT LOCATIONS PROTECTED BY OVERHANG SUCH THAT THE OVERHANG RATIO (OH) = OH LENGTH/OH HEIGHT IS GREATER THAN 1.0 WHERE WATER INFILTRATION IS REQUIRED.

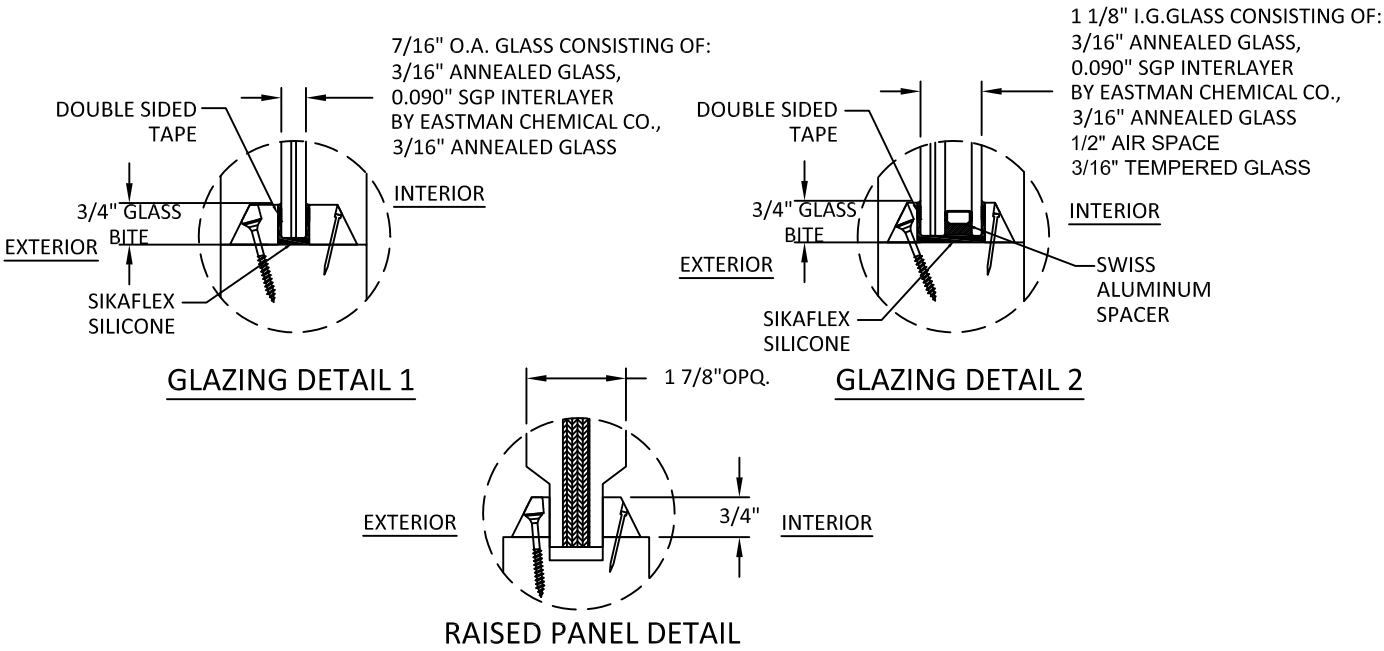

4918 CEDAR AVENUE
PHILADELPHIA, PA 19143

PH: (215) 525-5048 FX: (215) 747-8908


TITLE:
10' OUTSWING NARROW STILE
DOOR
INSTALLATION, GENERAL NOTES
AND GLAZING DETAILS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero
Reason: I am approving this document
Date: 2019.10.18 20:56:19 -0400

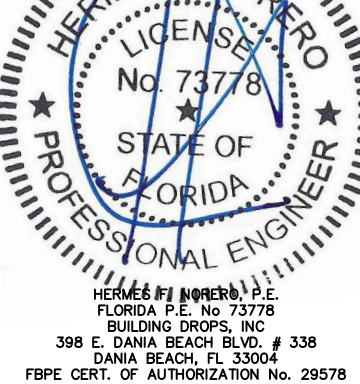

FL #:
FL11217

DATE:
07.04.19

DWG. BY:
EG


CHK. BY:
HFN

SCALE:
NTS


DWG. #:
CAB053

SHEET:
1

OF 9

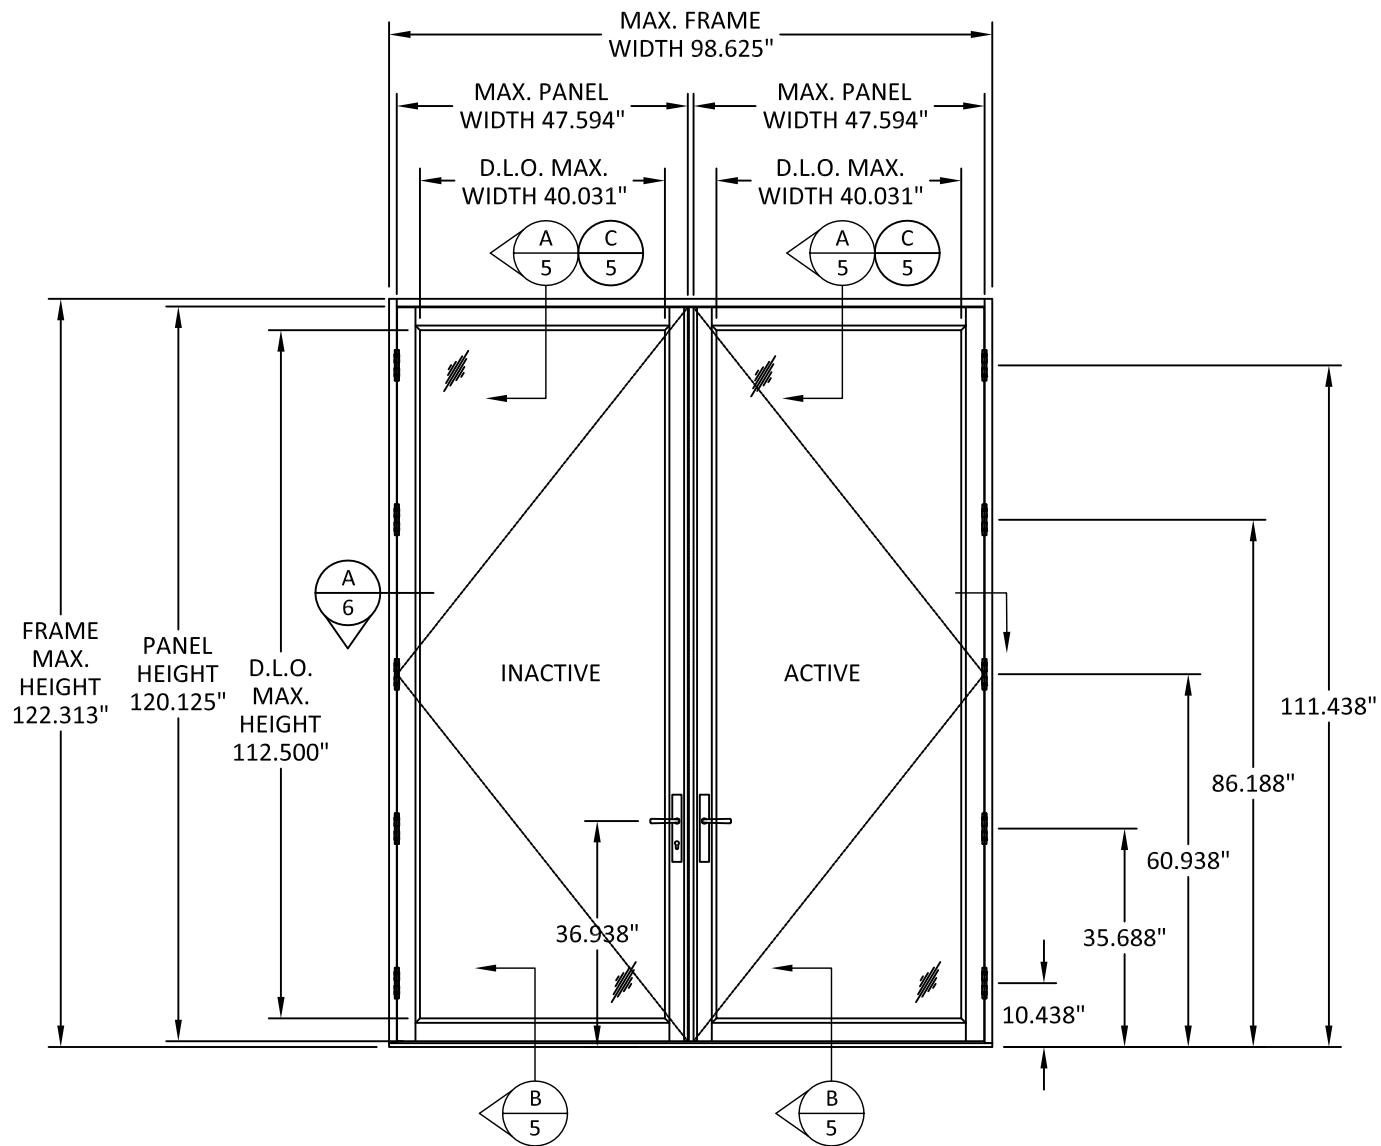

EXTERIOR ELEVATION
(OUTSWING DOORS)

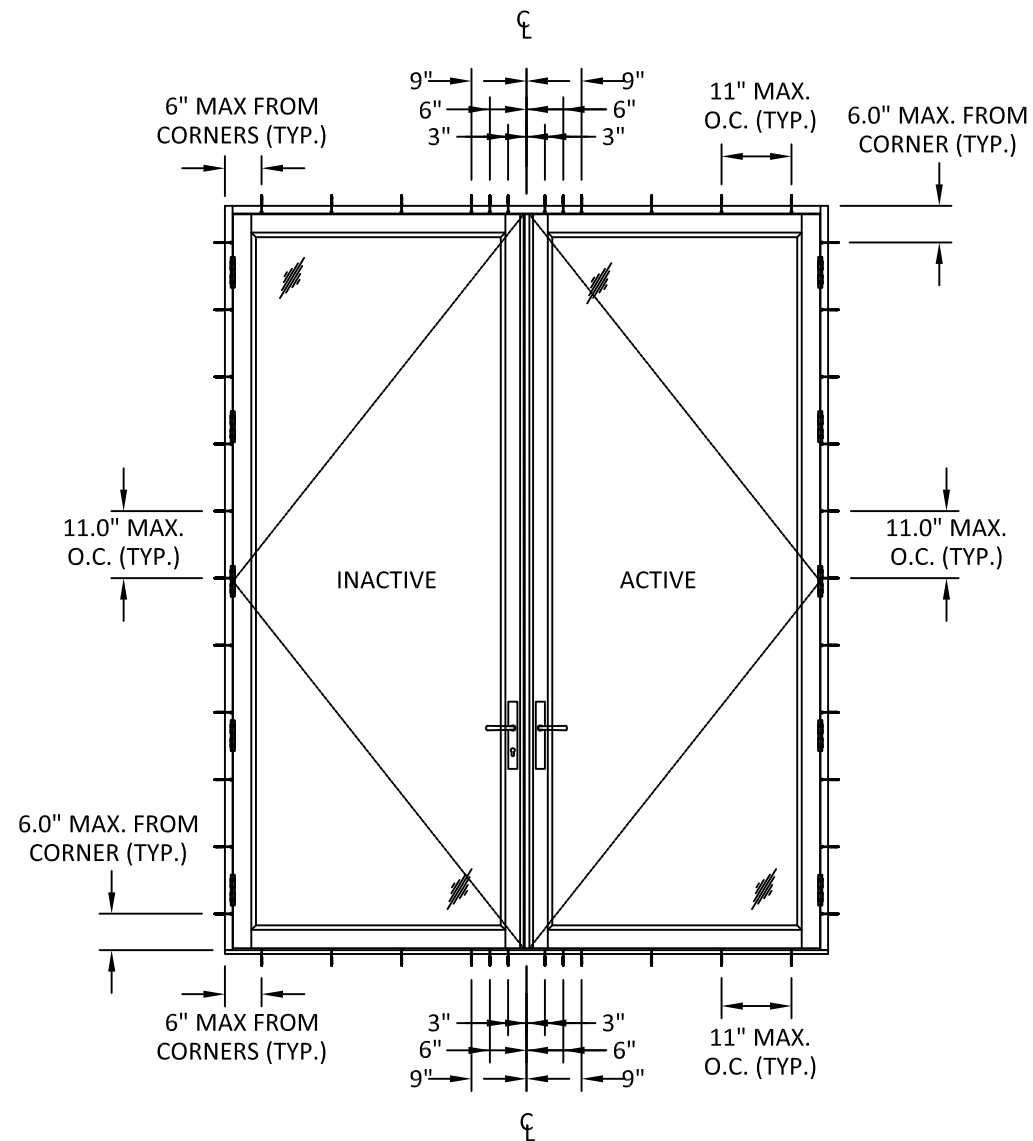

ANCHOR LAYOUT



4918 CEDAR AVENUE
PHILADELPHIA, PA 19143

PH: (215) 525-5048 FX: (215) 747-8908


TITLE: 10' OUTSWING NARROW STILE
DOOR
ELEVATION AND ANCHORS LAYOUT

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

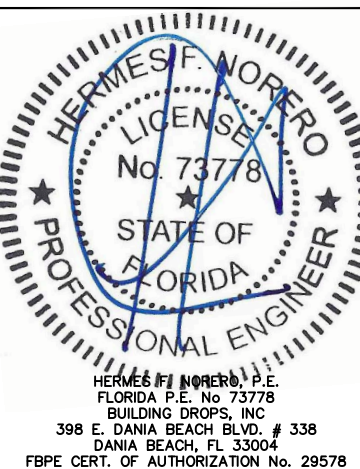

FL #:

FL11217

DATE: 07.04.19

DWG. BY: EG
CHK. BY: HFN



SCALE: NTS

DWG. #: CAB053

SHEET:

2

OF 9

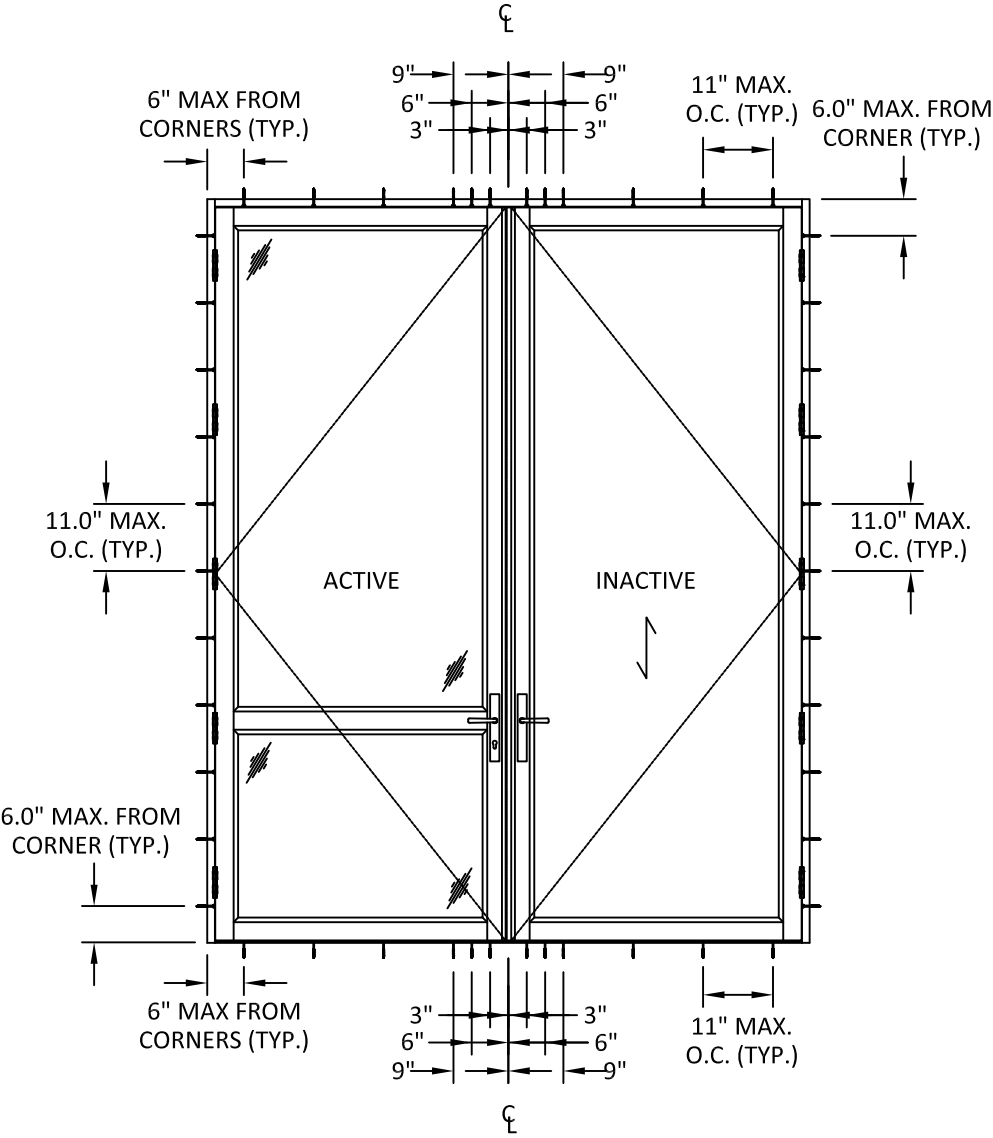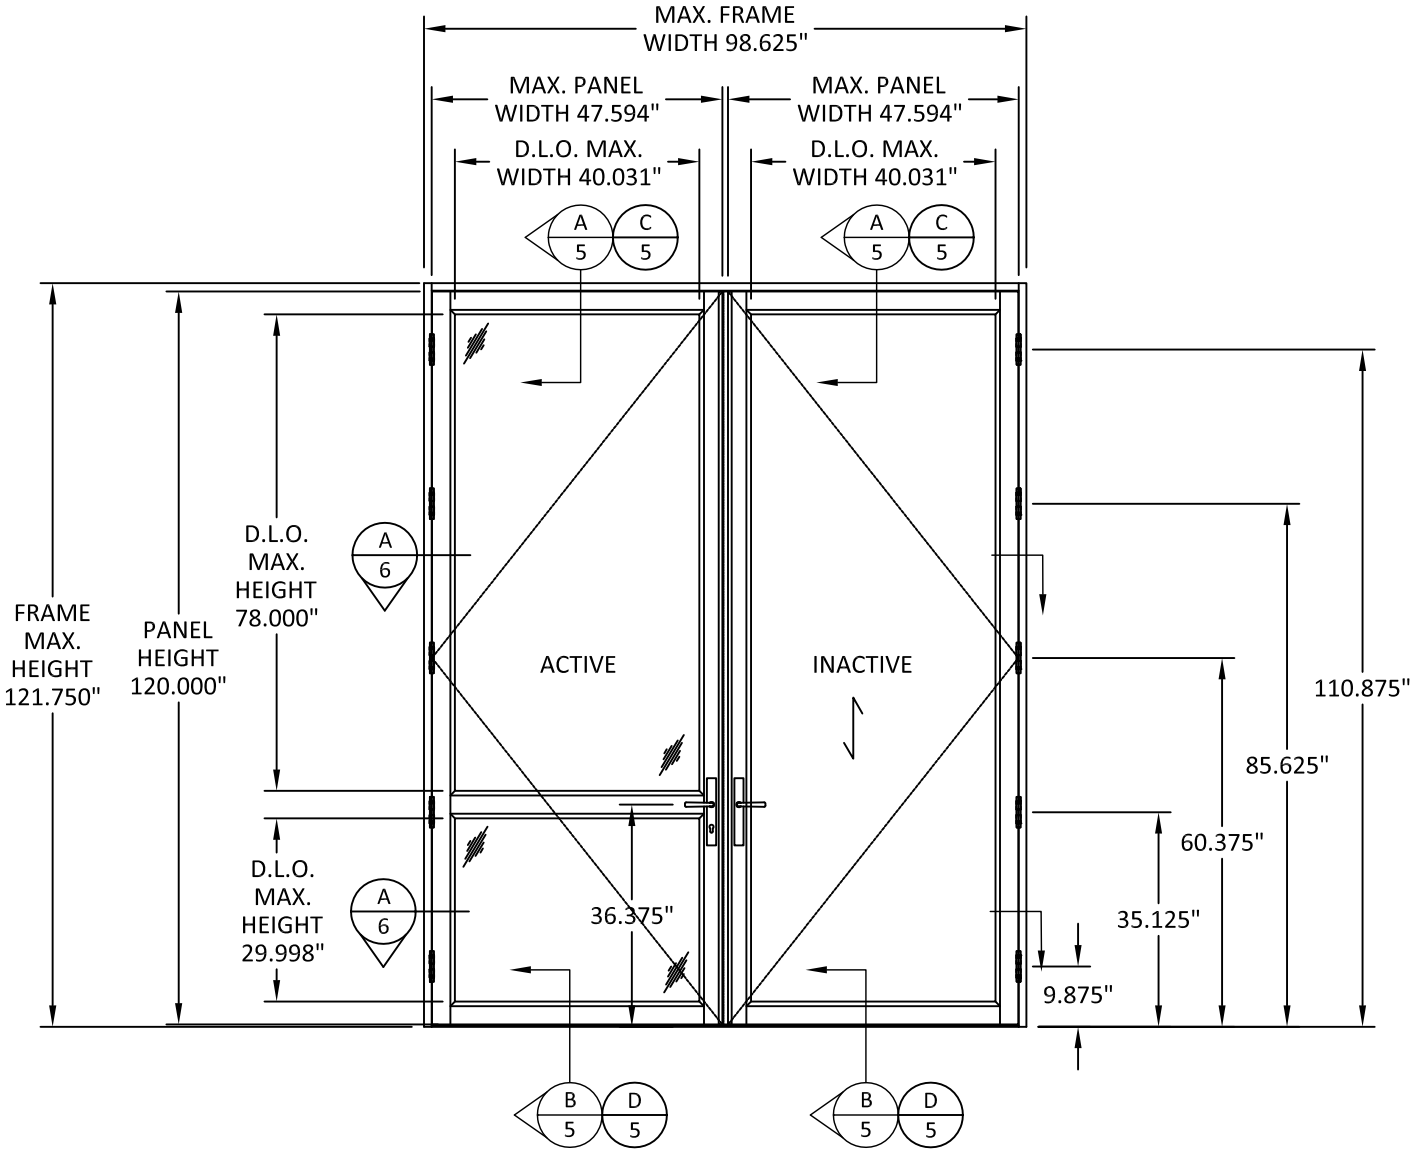



4918 CEDAR AVENUE
PHILADELPHIA, PA 19143


PH: (215) 525-5048 FX: (215) 747-8908

TITLE: 10' OUTWING NARROW STILE DOOR
ELEVATION AND ANCHORS LAYOUT

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

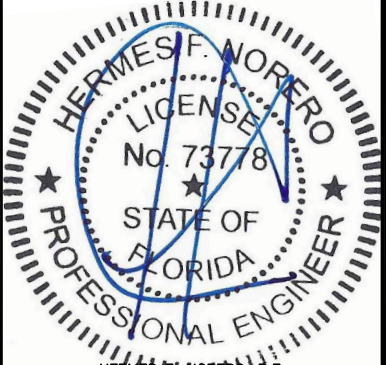

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL11217

DATE: 07.04.19

DWG. BY: EG

CHK. BY: HFN

SCALE: NTS

DWG. #: CAB053

SHEET:

3

OF 9



4918 CEDAR AVENUE
PHILADELPHIA, PA 19143

PH: (215) 525-5048 FX: (215) 747-8908

TITLE: 10' OUTWING NARROW STILE
DOOR
ELEVATION AND ANCHORS LAYOUT


PREPARED BY:

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

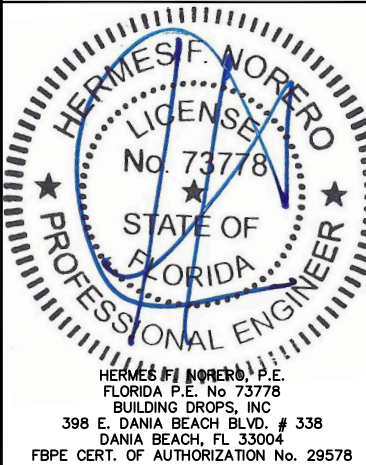

FL #:

FL11217

DATE: 07.04.19

DWG. BY:
EG

CHK. BY:
HFN



SCALE: NTS

DWG. #: CAB053

SHEET:


4

OF 9

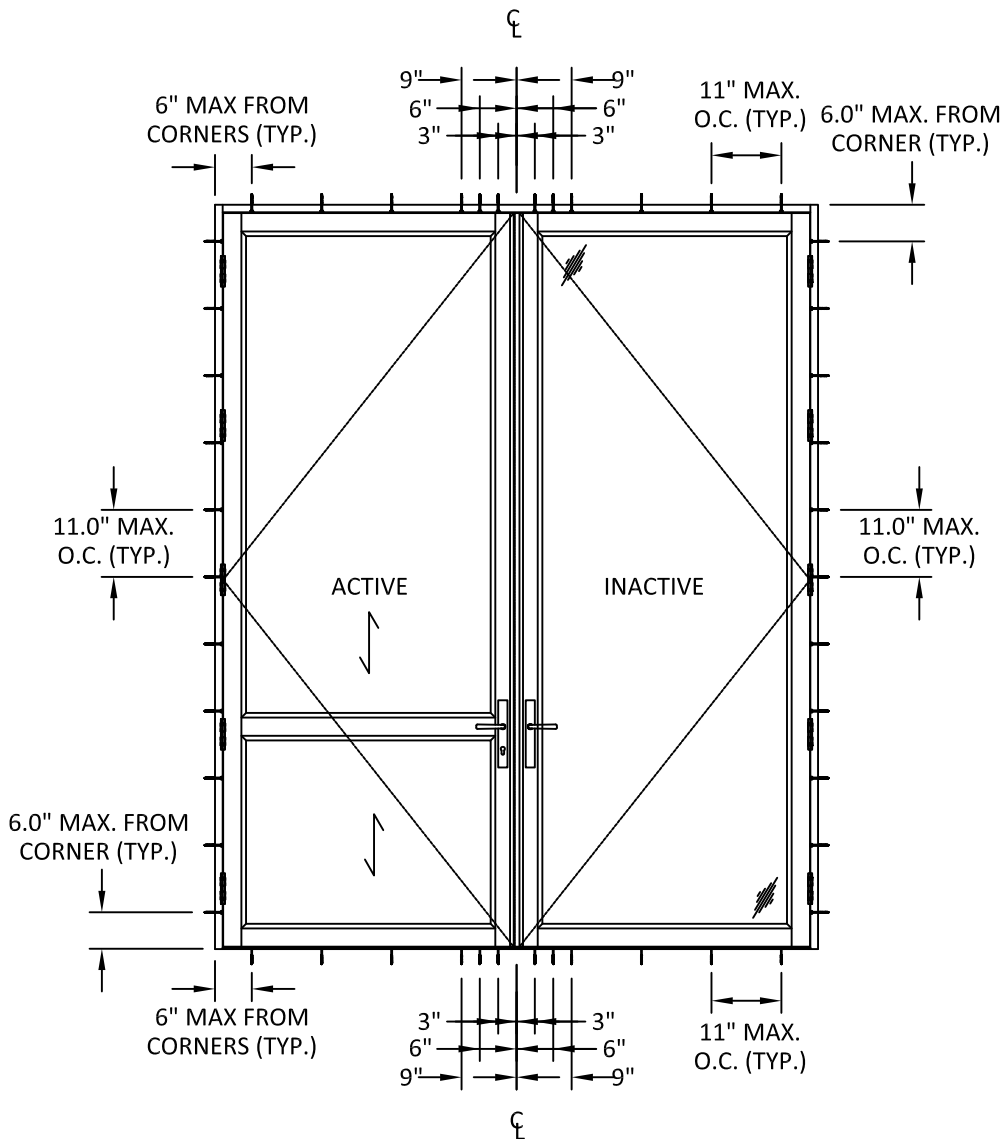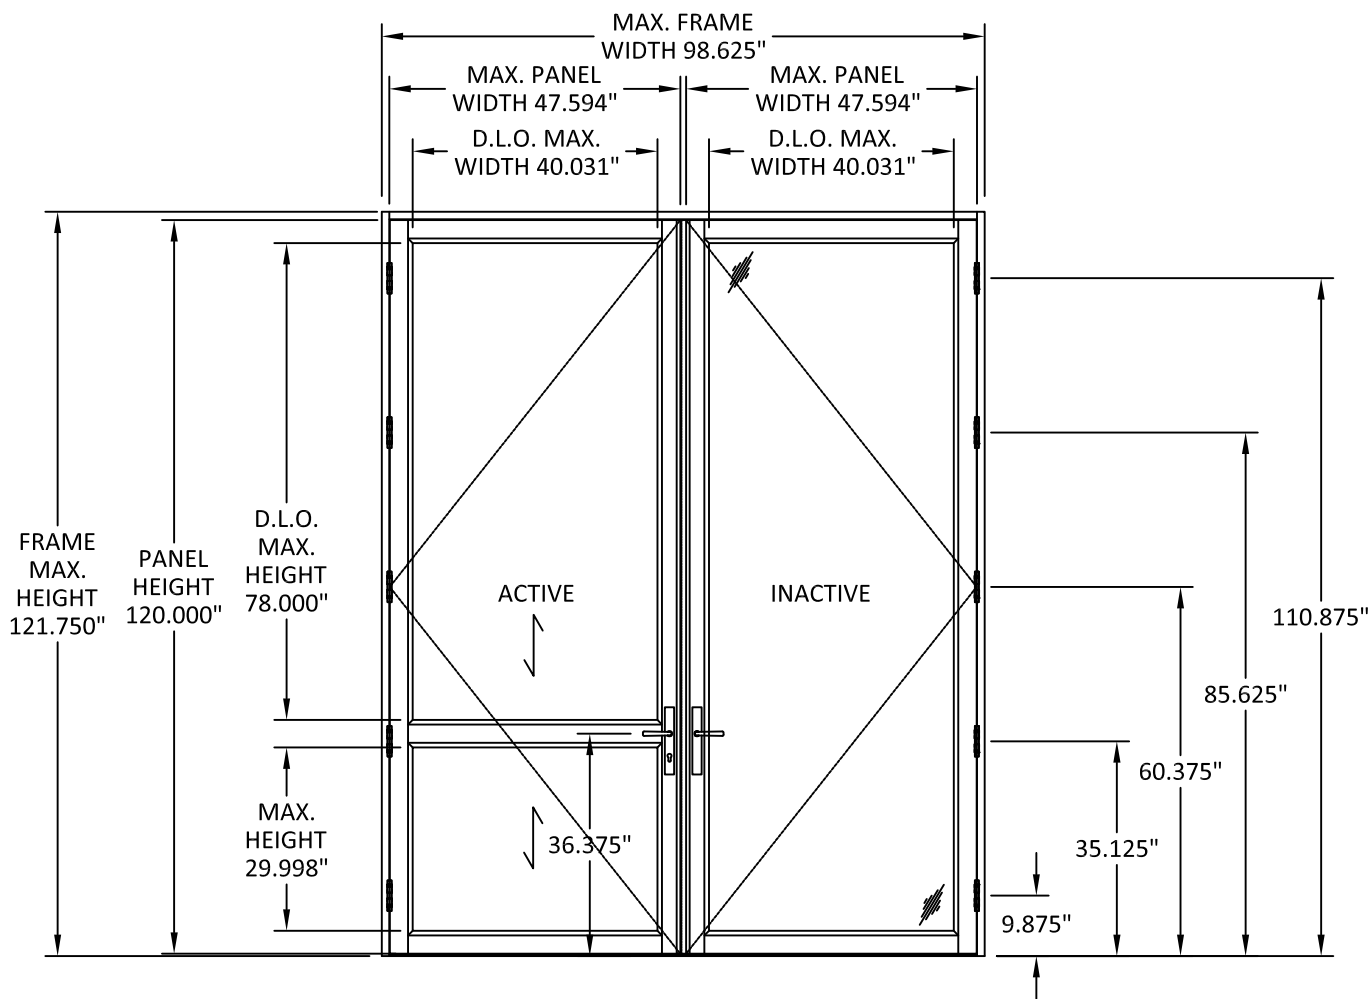


10/18/2019 8:46 PM


s:\projects\caoba doors\fb-19-0145 - caoba doors - fbc submittal - fl11217 exterior os is door.dwg

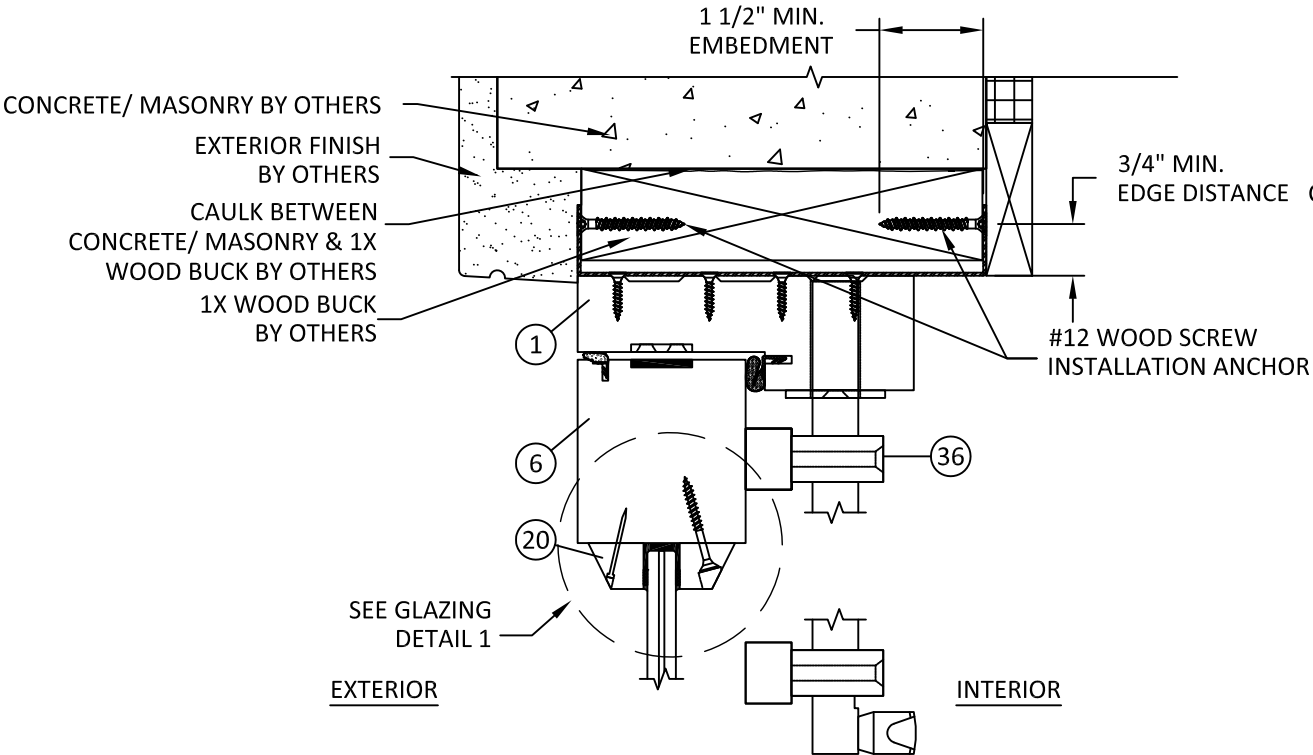


A
5 VERTICAL SECTION
HEAD - CONCRETE/MASONRY

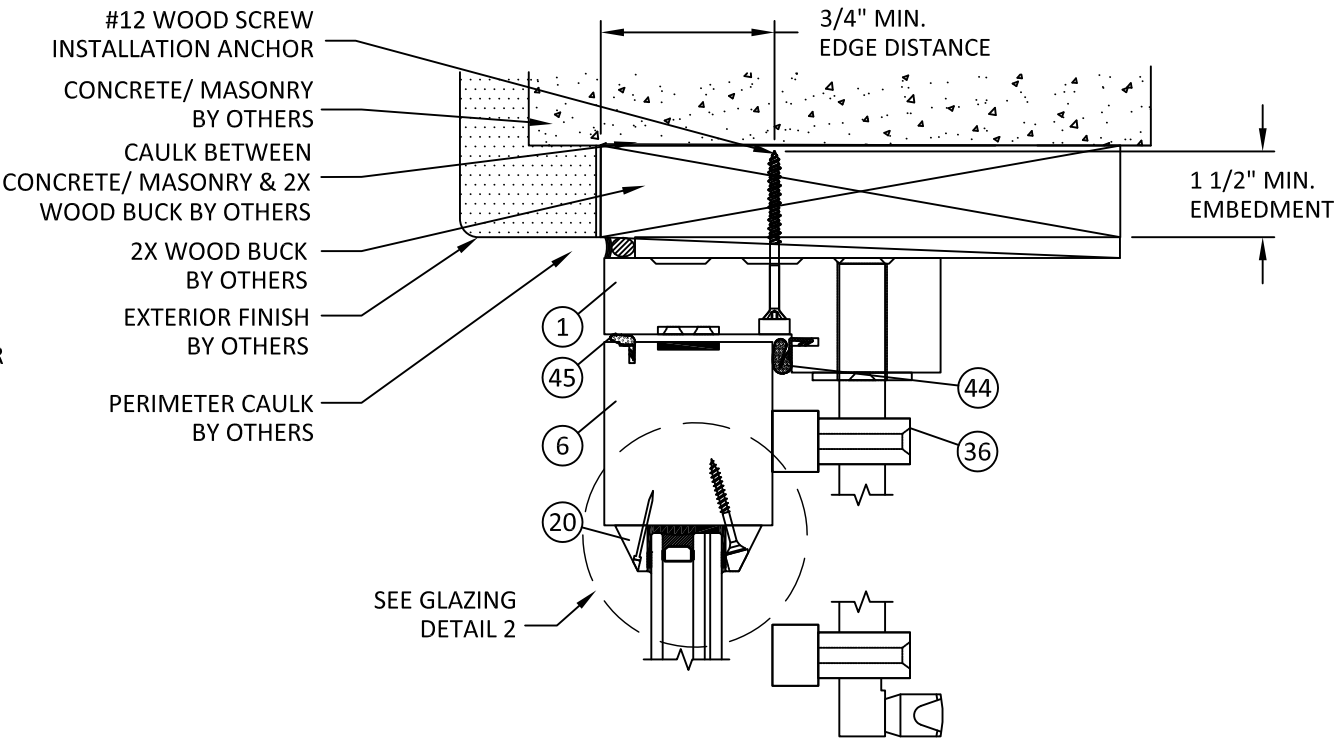

C
5 VERTICAL SECTION
HEAD - CONCRETE/MASONRY

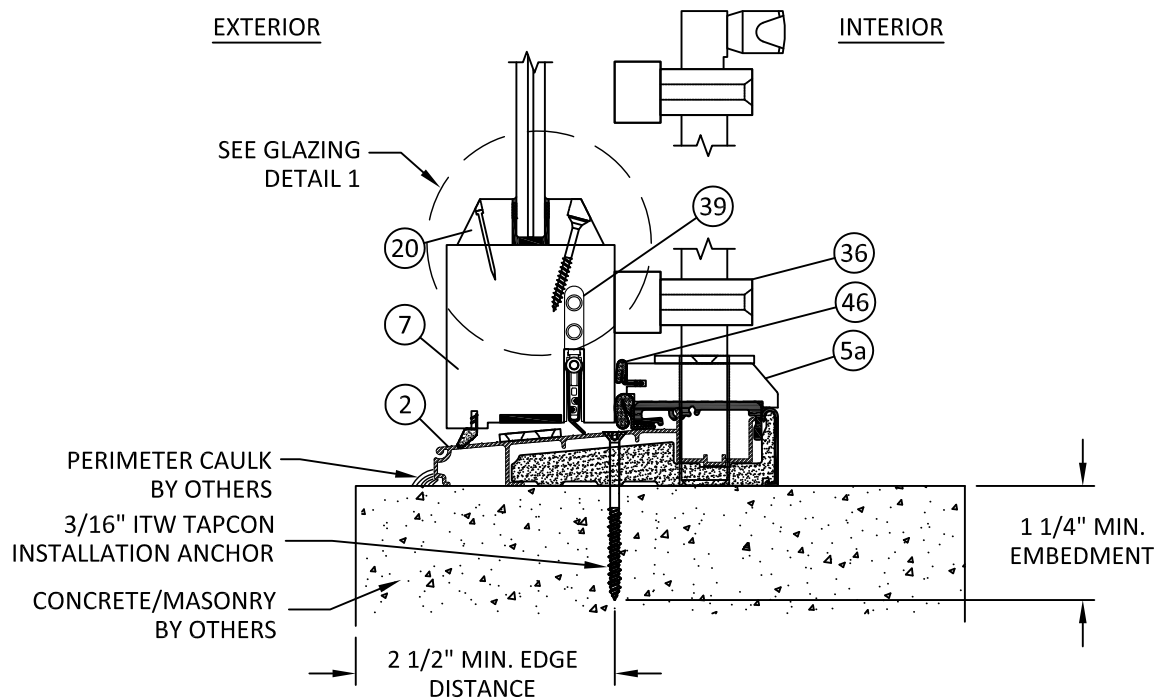

B
5 VERTICAL SECTION
SILL - CONCRETE/MASONRY

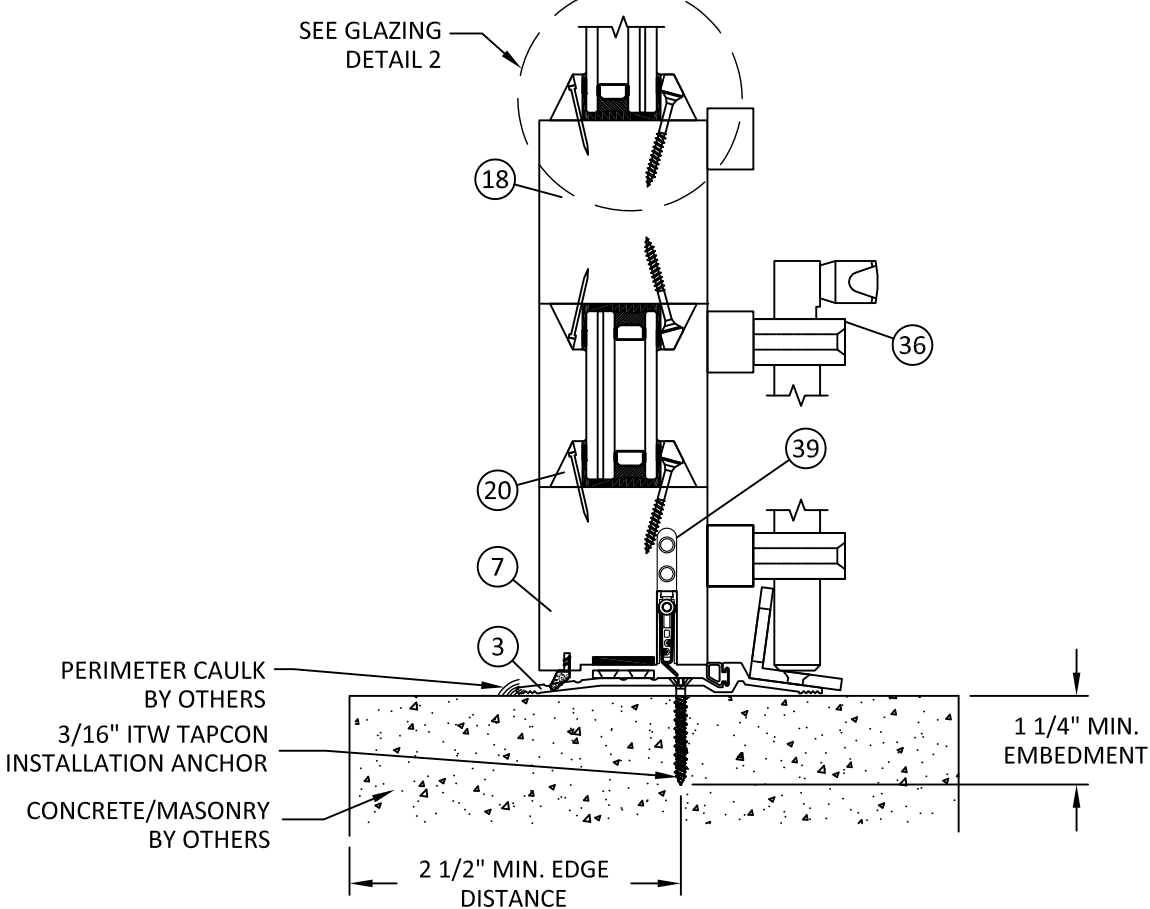

D
5 VERTICAL SECTION
ADA SILL - CONCRETE/MASONRY
(NOT RATED FOR WATER INFILTRATION)



4918 CEDAR AVENUE
PHILADELPHIA, PA 19143


PH: (215) 525-5048 FX: (215) 747-8908

TITLE:
10' OUTWING NARROW STILE
DOOR
VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

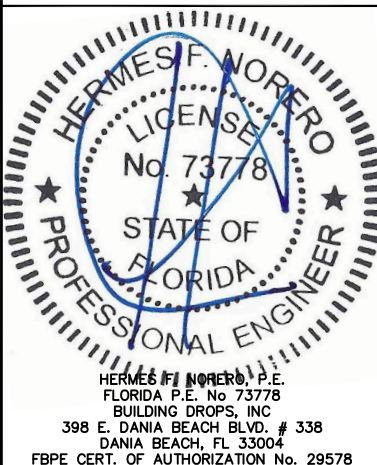

FL #:
FL11217

DATE:
07.04.19

DWG. BY:
EG

CHK. BY:
HFN

SCALE:
NTS

DWG. #:
CAB053


SHEET:
5
OF 9



4918 CEDAR AVENUE
PHILADELPHIA, PA 19143
PH: (215) 525-5048 FX: (215) 747-8908


TITLE: 10' OUTWING NARROW STILE
DOOR
HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

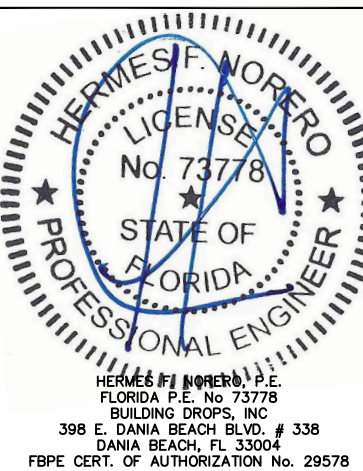

FL #: FL11217

DATE: 07.04.19

DWG. BY: EG
CHK. BY: HFN


SCALE: NTS

DWG. #: CAB053

SHEET:


7

OF 9

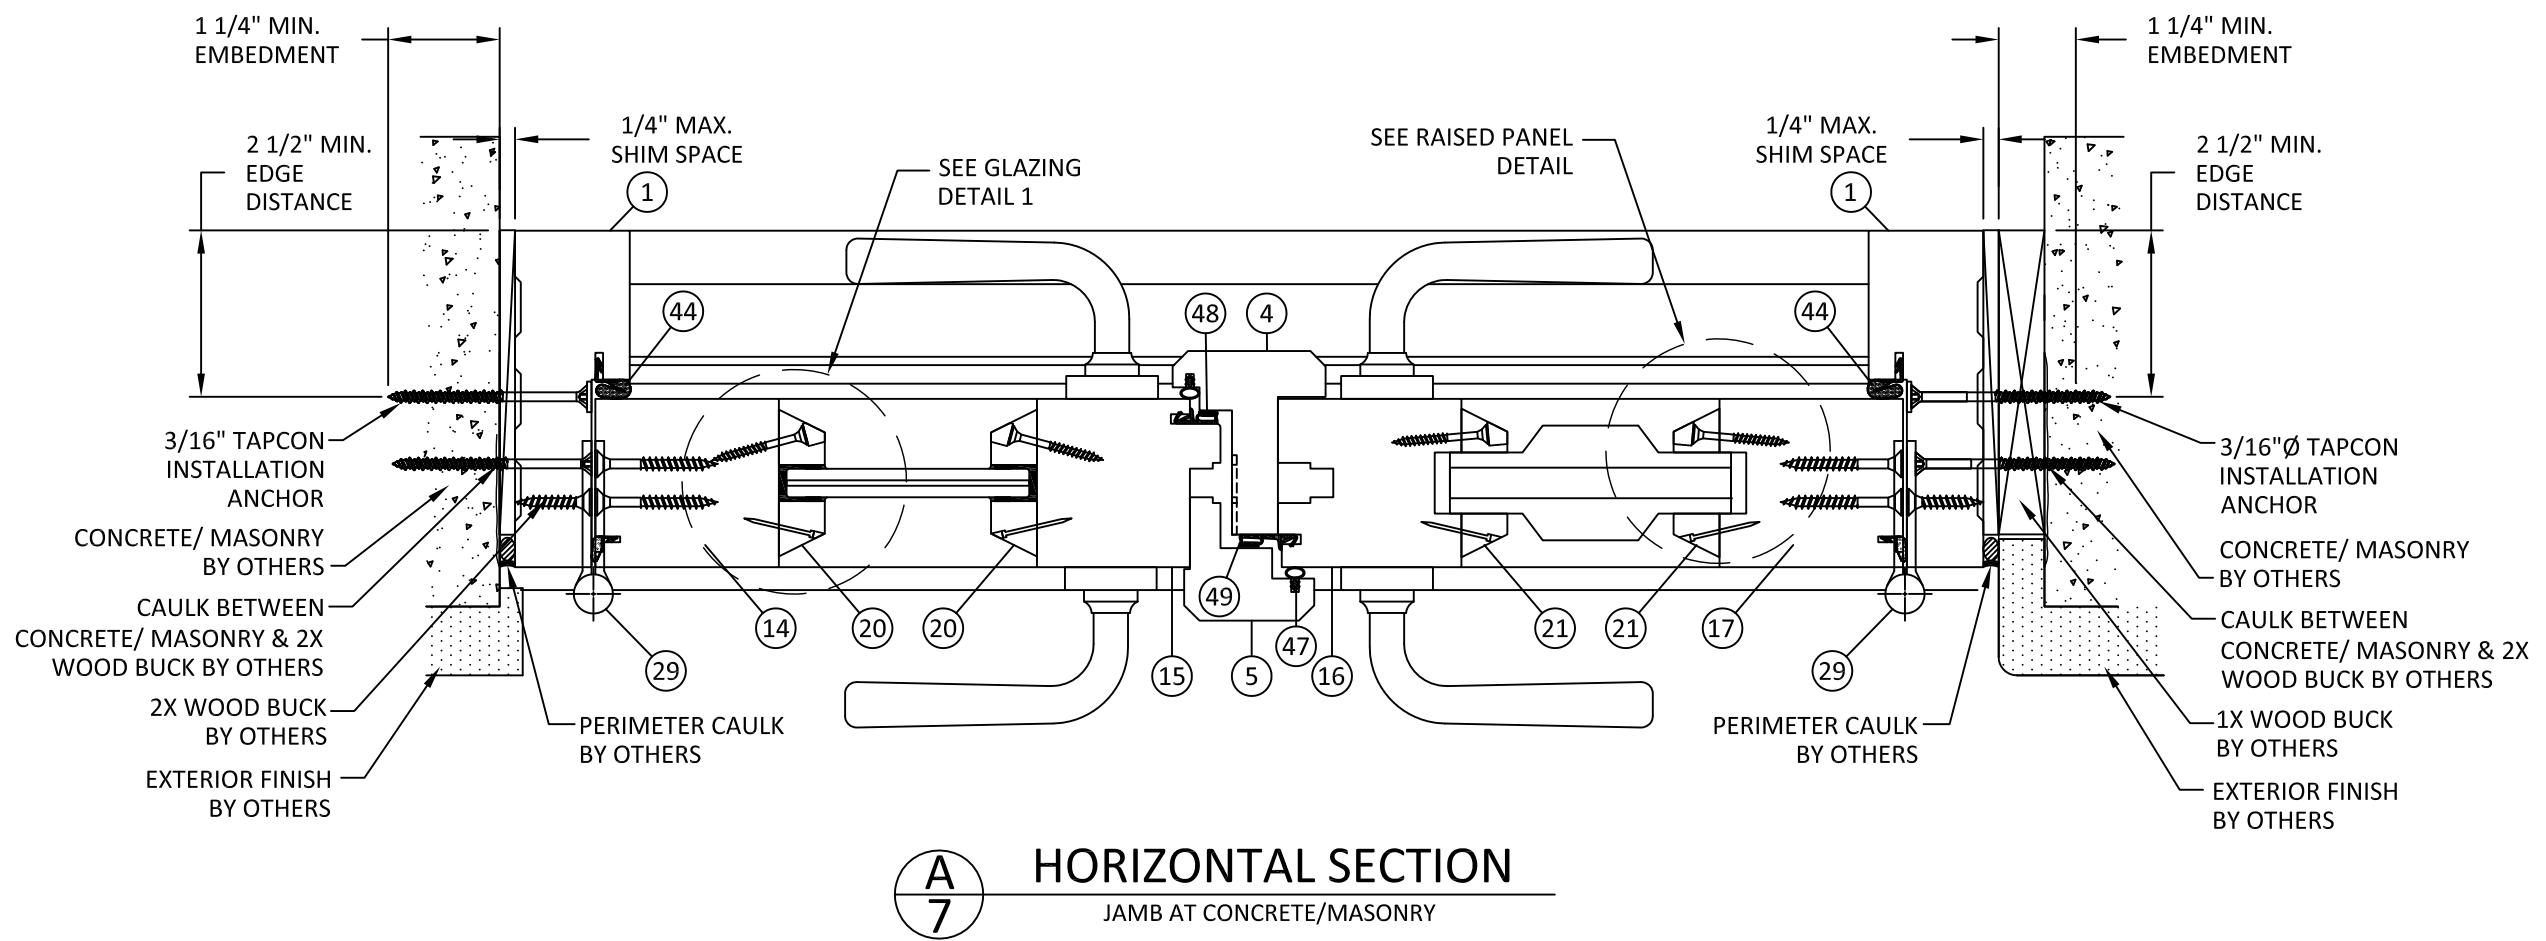


10/18/2019 8:47 PM


s:\projects\caoba doors\fb-c-19-0145 - caoba doors - fbc submittal - fl11217 exterior os is door.dwg s:\projects\caoba doors\fb-c-19-0145 - caoba doors - fbc submittal - fl11217 exterior os is door.dwg

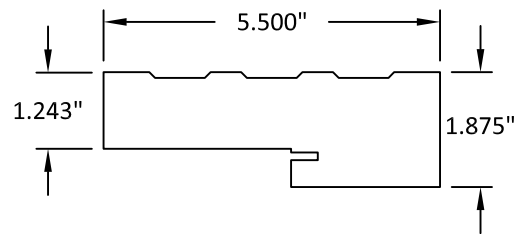


1 STD HEAD AND JAMB WOOD

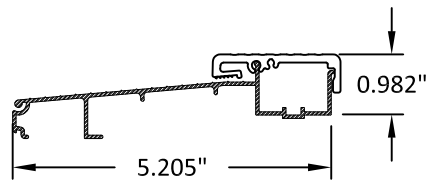


2 STANDARD SILL ALUMINUM/PVC

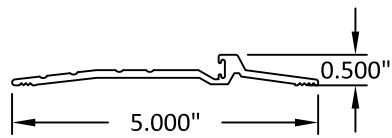


3 ADA SILL ALUMINUM




4 INACTIVE DOOR ASTRAGAL WOOD




5 ACTIVE DOOR ASTRAGAL WOOD

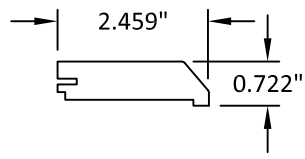


5a SILL COVER WOOD

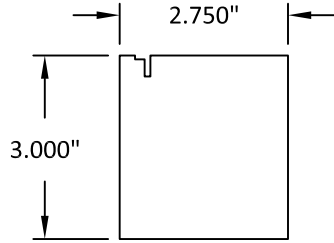


6 TOP RAIL WOOD

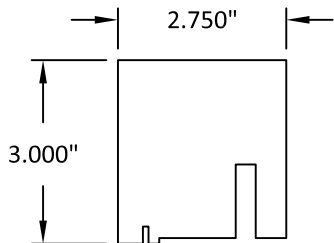


7 BOTTOM RAIL WOOD

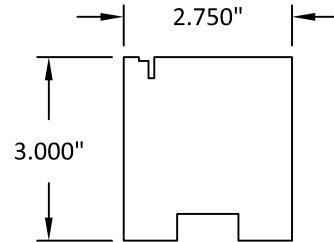


8 TOP RAIL OPQ DOOR WOOD

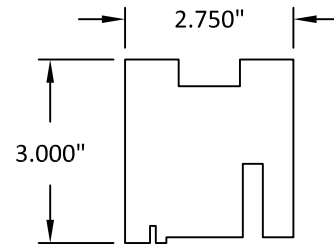


9 BOTTOM RAIL OPQ DOOR WOOD

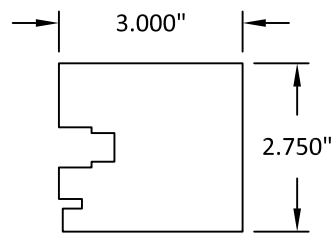


12 INACTIVE LOCK STILE WOOD

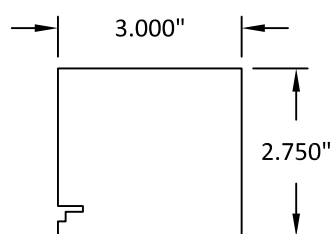


14 HINGE SIDE STILE WOOD

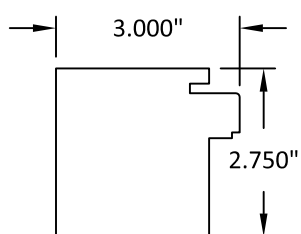


15 ACTIVE LOCK STILE WOOD

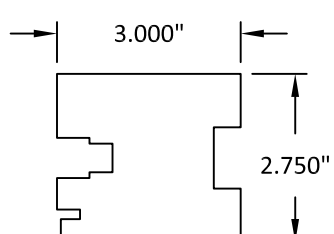


16 INACTIVE LOCK STILE WOOD

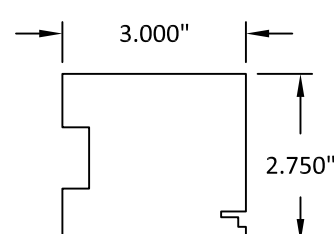


17 HINGE SIDE STILE OPQ PANEL WOOD

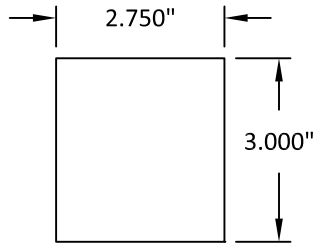


18 MIDDLE RAIL WOOD

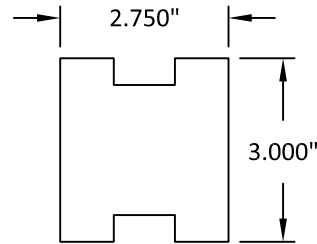


19 MIDDLE RAIL WOOD

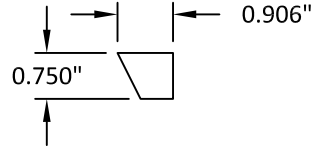

20 MOULDING - GZ1 WOOD

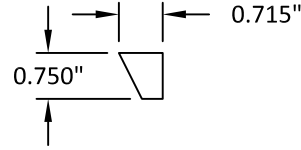

21 MOULDING -OPQ WOOD



22 MOULDING - GLZ 2 WOOD



4918 CEDAR AVENUE
PHILADELPHIA, PA 19143

PH: (215) 525-5048 FX: (215) 747-8908

TITLE: 10' OUTWING NARROW STILE DOOR COMPONENTS

COMPONENTS


PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

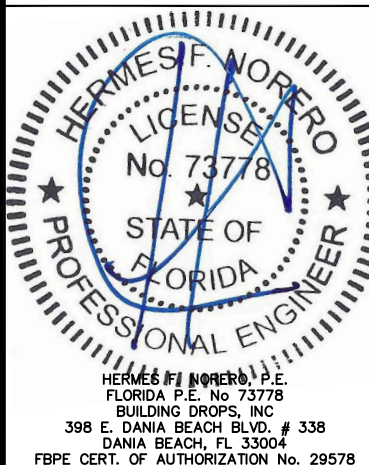

FL #:

FL11217

DATE: **07.04.19**

DWG. BY: EG	CHK. BY: HFN
--------------------	---------------------

SCALE: **NTS**


DWG. #: **CAB053**

SHEET:

8

OF 9


BILL OF MATERIALS				
ITEM#	PART#	ITEM DESCRIPTION	MANUFACTURER	MATERIAL
FRAME PARTS				
1	---	HEAD JAMB AND LEG JAMBS	CAOBA DOORS	WOOD
2	909	STANDARD SILL	COLUMBIA / ENDURA	ALUMINUM / PVC
3	2005DT	ADA SILL	PEMCO	ALUMINUM
4	---	INACTIVE DOOR T ASTRAGAL	CAOBA DOORS	WOOD
5	---	ACTIVE DOOR T ASTRAGAL	CAOBA DOORS	WOOD
5a	---	SILL COVER	CAOBA DOORS	WOOD
SASH PARTS				
6	---	TOP RAIL GLASS DOOR	CAOBA DOORS	WOOD
7	---	BOTTOM RAIL GLASS DOOR	CAOBA DOORS	WOOD
8	---	TOP RAIL PANEL DOOR	CAOBA DOORS	WOOD
9	---	BOTTOM RAIL PANEL DOOR	CAOBA DOORS	WOOD
10	---	HINGE SIDE STILE PANEL DOOR	CAOBA DOORS	WOOD
11	---	ACTIVE LOCK STILE PANEL DOOR	CAOBA DOORS	WOOD
12	---	INACTIVE LOCK STILE GLASS DOOR	CAOBA DOORS	WOOD
13	---	HINGE SIDE STILE GLASS DOOR	CAOBA DOORS	WOOD
14	---	HINGE SIDE STILE GLASS DOOR	CAOBA DOORS	WOOD
15	---	ACTIVE LOCK STILE GLASS DOOR	CAOBA DOORS	WOOD
16	---	INACTIVE LOCK STILE PANEL DOOR	CAOBA DOORS	WOOD
17	---	HINGE SIDE STILE PANEL DOOR	CAOBA DOORS	WOOD
18	---	MIDDLE RAIL GLASS DOOR	CAOBA DOORS	WOOD
19	---	MIDDLE RAIL PANEL DOOR	CAOBA DOORS	WOOD
20	---	MOULDING GLZ - G1	CAOBA DOORS	WOOD
21	---	MOULDING OPQ	CAOBA DOORS	WOOD
22	---	MOULDING GLZ - G2	CAOBA DOORS	WOOD
23	---	PANEL	CAOBA DOORS	WOOD
GLASS				
24	---	3/16" O.A. LAMINATED GLASS CONSISTING OF: 3/16" ANNEALED GLASS - 090" SGP INTERLAYER - 3/16" ANNEALED GLASS	CARDINAL	GLASS
25	---	1 1/8" O.A. LAMINATED INSULATING GLASS CONSISTING OF: 3/16" TEMPERED GLASS, AIR SPACE, 3/16" ANNEALED GLASS - 090" SGP INTERLAYER - 3/16" ANNEALED GLASS	CARDINAL	GLASS
SEALANT AND TAPE				
26	AWT3	1/4" X 1/16" GLASING TAPE	ARLON	TAPE
27	SG-20	SILICON SEALANT	SIKAFLEX	SILICONE
28	WS-305	SILICON SEALANT	SIKAFLEX	SILICONE
HARDWARE				
29	BB1191	BALL BEARING HINGES 5" x 5"	HAGER	SOLID BRASS
30	8778619	TOP EXTENSION (ACTIVE DOOR)	HOPPE	SST
31	3644194	MIDDLE EXTENSION (ACTIVE DOOR)	HOPPE	SST
32	3622876	GEAR (ACTIVE DOOR)	HOPPE	SST
33	8778799	TOP EXTENSION (INACTIVE DOOR)	HOPPE	SST
34	2074564	GEAR / BOTTOM EXTENSION (INACTIVE DOOR)	HOPPE	SST
35	2875118	COVER PLATE	HOPPE	SST
36	SB360	SURFACE BOLTS	IVES	HEAVY DUTY STEEL
37	---	HINGE SIDE & ACTIVE LOCK SIDE REINFORCEMENT PLATE	Caoba Doors	Aluminum
38	---	INACTIVE LOCK SIDE REINFORCEMENT PLATE	Caoba Doors	Aluminum
39	23121	AUTOMATIC DOOR SWEEP	Planet	Aluminum / Silicone
40	MSTA12	INSTALLATION STRAPS	Simpson Strong-Tie	SST
41	---	INSTALLATION BRACKET	Caoba Doors	SST
42	---	#12 X 3" WOOD INSTALLATION SCREW	---	Steel
43	---	#8 X 1" WOOD SCREW	---	Steel
WEATHERSTRIPPING				
44	12610	Weatherseal	Amesbury	Foam
45	12407	Weatherseal	Amesbury	Foam
46	12464	Weatherseal	Amesbury	Foam
47	WS 33	Bulb Weatherseal	Conservation	Silicone
48	DS 6922a	Weatherseal	Deventer	Silicone
49	DS 6988a	Weatherseal	Deventer	Silicone

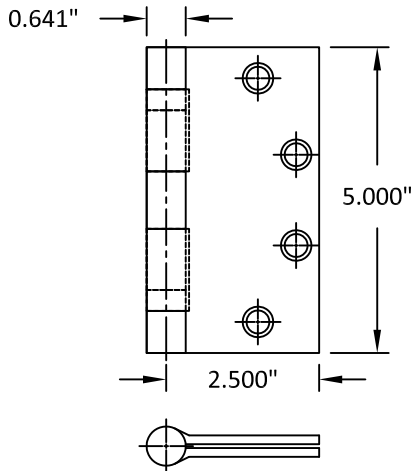


29 BALL BEARING HINGES BRASS




39 AUTOMATIC DOOR SWEEP ALUM./SILICONE

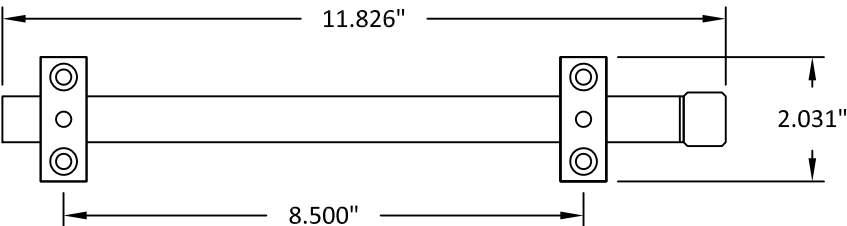


36 SURFACE BOLTS

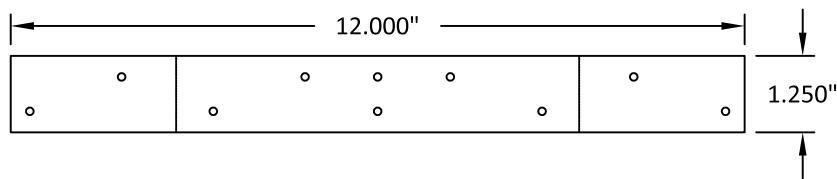


40 INSTALLATION STRAPS SST

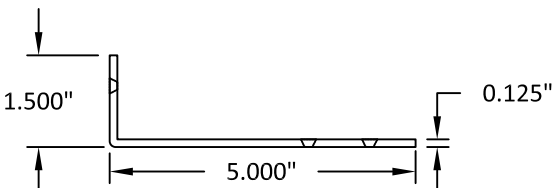

41 INSTALLATION BRACKET SST

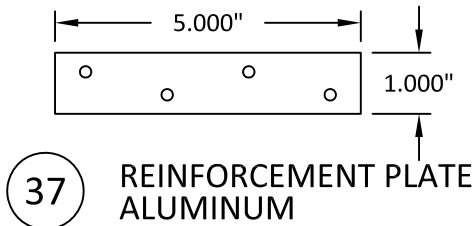

37 REINFORCEMENT PLATE ALUMINUM

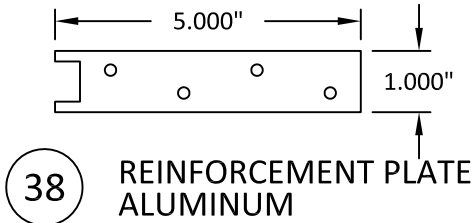

38 REINFORCEMENT PLATE ALUMINUM

30 TOP EXTENSION ACTIVE DOOR

31 MIDDLE EXTENSION ACTIVE DOOR

32 GEAR ACTIVE DOOR

33 TOP EXTENSION INACTIVE DOOR

34 BOTTOM EXTENSION INACTIVE DOOR



4918 CEDAR AVENUE
PHILADELPHIA, PA 19143

PH: (215) 525-5048 FX: (215) 747-8908

TITLE: 10' OUTWING NARROW STILE DOOR

COMPONENTS AND BILL OF MATERIALS

PREPARED BY:

BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004


PH: (954) 399-8478
FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

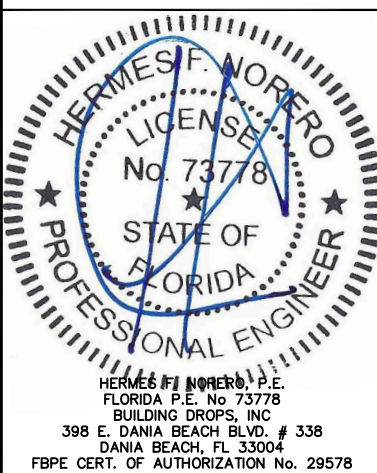

FL #:

FL11217

DATE: 07.04.19

DWG. BY: EG

CHK. BY: HFN

SCALE: NTS

DWG. #: CAB053

SHEET:

9

OF 9