

SLIDING GLASS DOOR - NON-IMPACT

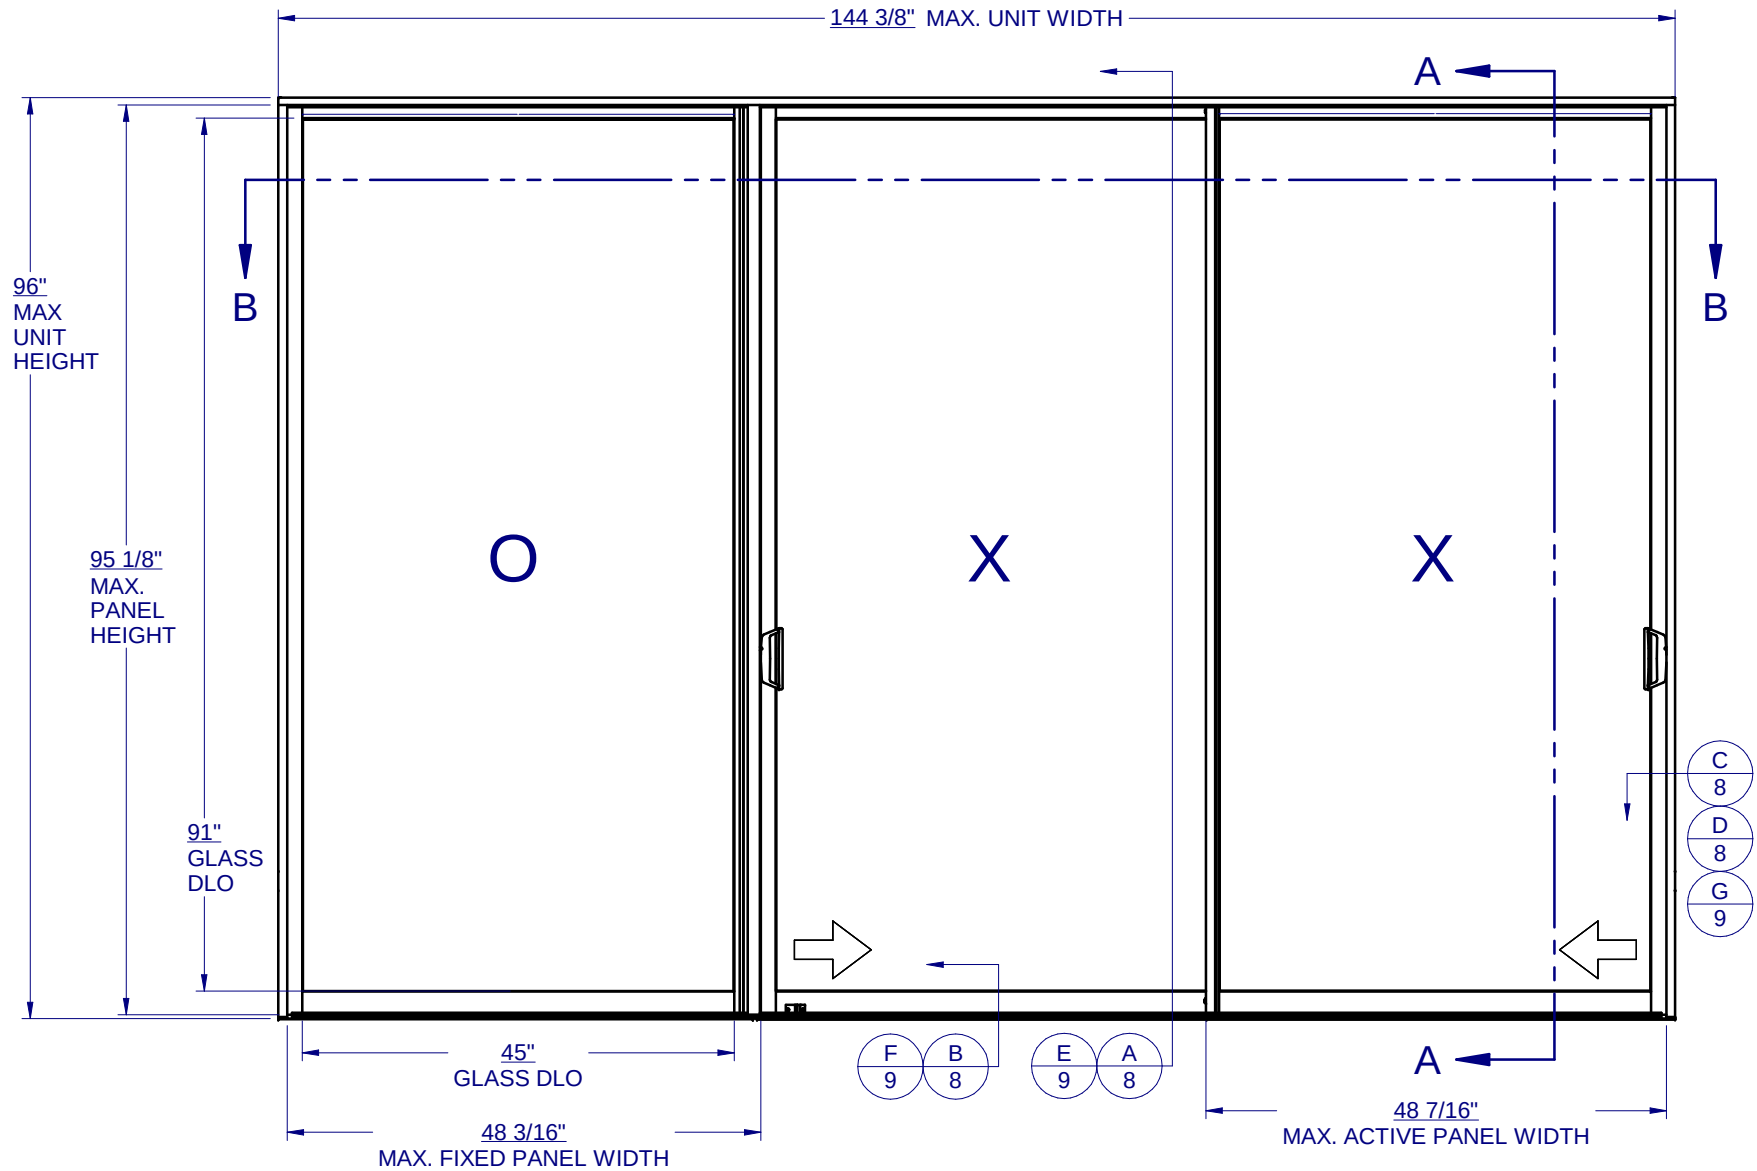


TABLE OF CONTENTS

GENERAL NOTES & ELEVATIONS.....1
DP CHART & GLAZING DETAILS.....2
SECTION VIEWS.....3
BOM & EXTRUSIONS.....4
EXTRUSIONS.....5
ANCHOR SCHEDULE & NOTES.....6
FRAME ANCHOR PATTERNS.....7
INSTALLATION DETAILS.....8-9

PANEL TYPE	MAX. PANEL SIZE	DESIGN PRESSURE RATING	IMPACT RATING
ACTIVE	48-3/16" x 95-1/8"	SEE COMPARATIVE ANALYSIS CHART, SHEET 2	NONE
FIXED	48-7/16" X 95-1/8"		NONE

(3) PANELS SHOWN, UNLIMITED NUMBER OF PANELS IS APPLICABLE AS LONG AS INDIVIDUAL PANELS DO NOT EXCEED PANEL SIZE AS SHOWN.

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE FLORIDA BUILDING CODE (FBC), CURRENT EDITION.
2. GLAZING OPTIONS: (SEE SHEET 2)
3. APPROVED CONFIGURATIONS INCLUDE BUT ARE NOT LIMITED TO: "XO", "OX", "XX", "OXO", "XXX", "OXXO", "XXXX" 3 TRACK, 4 TRACK
4. DESIGN PRESSURE RATING (SEE SHEET 2):
 - NEGATIVE DESIGN LOADS BASED ON, TESTED PRESSURE AND GLASS TABLES ASTM E-1300-04e01/09.
 - POSITIVE DESIGN LOADS BASED ON, TESTED PRESSURE, WATER INFILTRATION TEST PRESSURE AND GLASS TABLES ASTM E-1300-04e01/09.
5. ANCHORAGE: THE 33 1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. SEE SHEETS 8-9 FOR ANCHOR DETAILS. WINDLOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
6. NOT APPROVED FOR IMPACT RESISTANCE. IMPACT PROTECTIVE SYSTEM IS REQUIRED IN WIND BORNE DEBRIS REGION.
7. ALL FRAMES AND PANELS ARE PROCESSED AND SCREWED TOGETHER.
8. SERIES / MODEL DESIGNATION SGD-9200.
10. THE DESIGNATION X AND O STAND FOR THE FOLLOWING:
X = OPERABLE SASH, O = FIXED SASH
11. SECTION CALLOUTS APPLY TO ALL CONFIGURATIONS IN A SIMILAR LOCATION.

Lucas Turner
2023.10.03
11:35:02
-05'00'




1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

9200 ALUM.
SLIDING GLASS
DOOR
NON-IMPACT

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN
THIS DRAWING IS THE SOLE
PROPERTY OF CUSTOM WINDOW
SYSTEMS, INC. ANY
REPRODUCTION IN PART OR AS A
WHOLE WITHOUT THE WRITTEN
PERMISSION OF CUSTOM WINDOW
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
11908

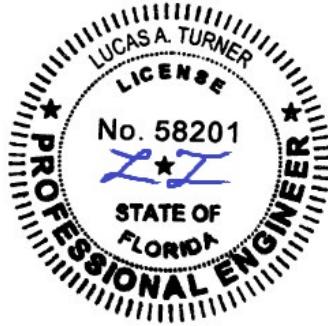

10/3/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering &
Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:

GENERAL NOTES AND
ELEVATIONS


DRAWN BY:	DATE:
MCS	9/15/2023
DWG #:	REV.:
CWS-284	H
SCALE:	SHEET
1:20	1 OF 9

			PANEL HEIGHT (IN)			
PANEL WIDTH (IN)	CONFIG	GLASS TYPE	79 1/8	84 1/8	90 1/8	95 1/8
30 7/16	OX, XO, XX	A,B	+50 / -75	+50 / -75	+50 / -75	+50 / -71
36 7/16	OX, XO, XX	A,B	+50 / -75	+50 / -71.7	+50 / -65.7	+50 / -61.5
42 7/16	OX, XO, XX	A,B	+50 / -65.3	+50 / -64.4	+50 / -58.8	+50 / -54.8
48 7/16	OX, XO, XX	A,B	+50 / -50	+50 / -50	+50 / -50	+50 / -50
30 7/16	O XO , XXX	A,B	+50 / -75	+50 / -75	+50 / -75	+50 / -71
36 7/16	O XO , XXX	A,B	+50 / -75	+50 / -71.7	+50 / -65.7	+50 / -61.5
42 7/16	O XO , XXX	A,B	+50 / -65.3	+50 / -64.4	+50 / -58.8	+50 / -54.8
48 7/16	O XO , XXX	A,B	+50 / -50	+50 / -50	+50 / -50	+50 / -50
30 7/16	O X X O , X X X X	A,B	+50 / -75	+50 / -75	+50 / -75	+50 / -71
36 7/16	O X X O , X X X X	A,B	+50 / -75	+50 / -71.7	+50 / -65.7	+50 / -61.5
42 7/16	O X X O , X X X X	A,B	+50 / -65.3	+50 / -64.4	+50 / -58.8	+50 / -54.8
48 7/16	O X X O , X X X X	A,B	+50 / -50	+50 / -50	+50 / -50	+50 / -50
30 7/16	X X X X X , O X X X X X O	A,B	+50 / -75	+50 / -75	+50 / -75	+50 / -71
36 7/16	X X X X X , O X X X X X O	A,B	+50 / -75	+50 / -71.7	+50 / -65.7	+50 / -61.5
42 7/16	X X X X X , O X X X X X O	A,B	+50 / -65.3	+50 / -64.4	+50 / -58.8	+50 / -54.8
48 7/16	X X X X X , O X X X X X O	A,B	+50 / -50	+50 / -50	+50 / -50	+50 / -50
30 7/16	X X X X X X X , O X X X X X X O	A,B	+50 / -75	+50 / -75	+50 / -75	+50 / -71
36 7/16	X X X X X X X , O X X X X X X O	A,B	+50 / -75	+50 / -71.7	+50 / -65.7	+50 / -61.5
42 7/16	X X X X X X X , O X X X X X X O	A,B	+50 / -65.3	+50 / -64.4	+50 / -58.8	+50 / -54.8
48 7/16	X X X X X X X , O X X X X X X O	A,B	+50 / -50	+50 / -50	+50 / -50	+50 / -50


NOTE: DP 40 AND BELOW MAY USE THE 4-ANCHOR STAGGERED OR 8-ANCHOR PATTERN.
DP ABOVE 40 MUST USE THE 8-ANCHOR PATTERN. SEE SHEET 7.

NOTES:

1. IF SIZE INTENDED IS NOT SHOWN, USE NEXT LARGER SIZE.

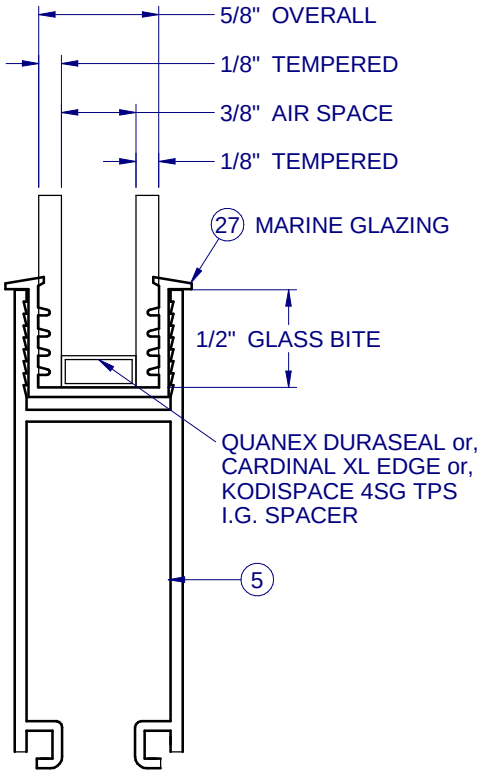

GLASS TYPE A

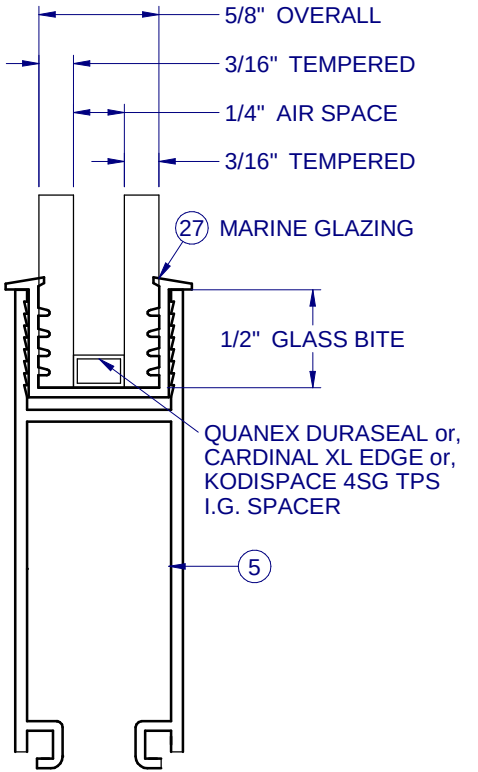

GLASS TYPE B




1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

9200 ALUM.
SLIDING GLASS
DOOR
NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
11908

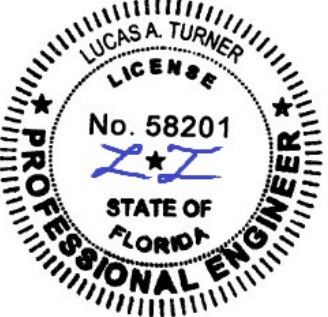

10/3/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering & Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:
COMPARATIVE ANALYSIS
AND GLAZING DETAIL

DRAWN BY:	DATE:
MCS	9/15/2023
DWG #:	REV.:
CWS-284	H
SCALE:	SHEET
1:1	2 OF 9



1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

9200 ALUM. SLIDING GLASS DOOR NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
11908





10/3/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering &
Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574




SHEET DESCRIPTION:
SECTION VIEWS

DRAWN BY:	DATE:
MCS	9/15/2023
DWG #:	REV.:
CWS-284	H
SCALE:	SHEET
1:2	3 OF 9


INTERIOR

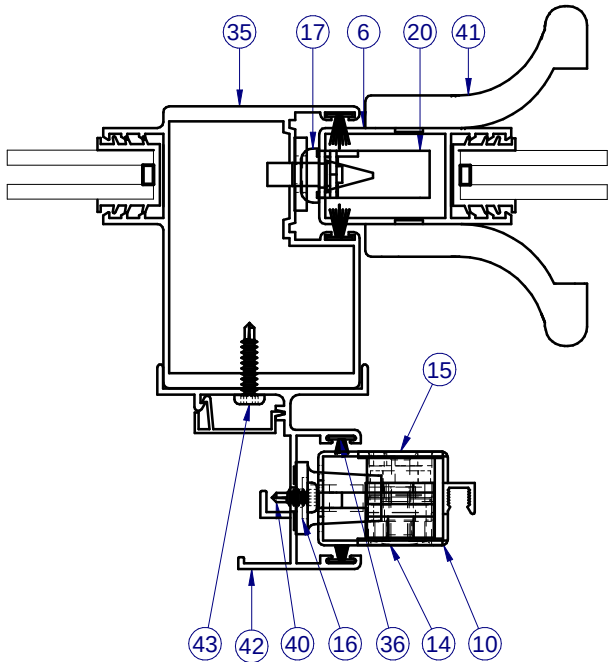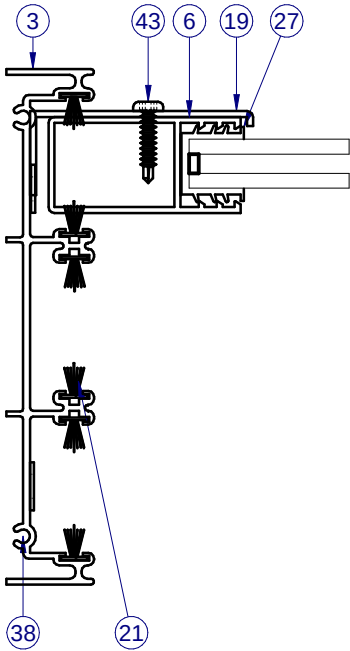


SECTION VIEW B-B

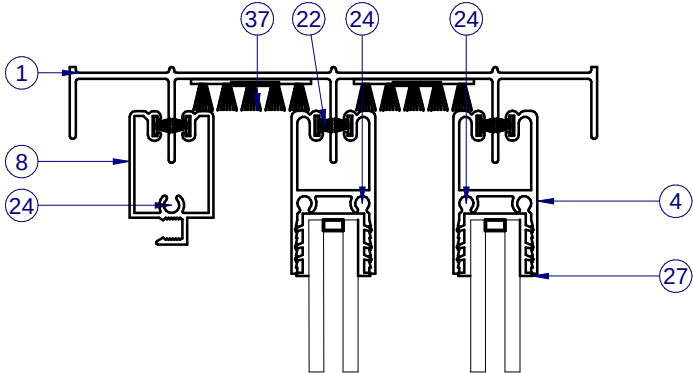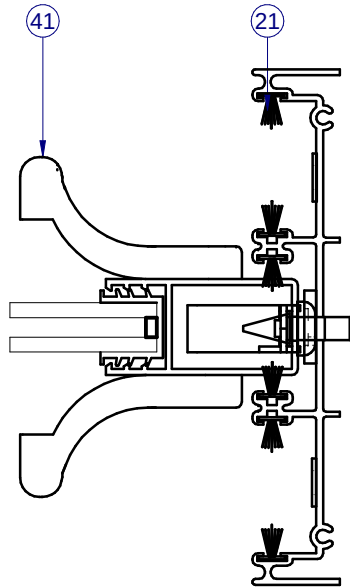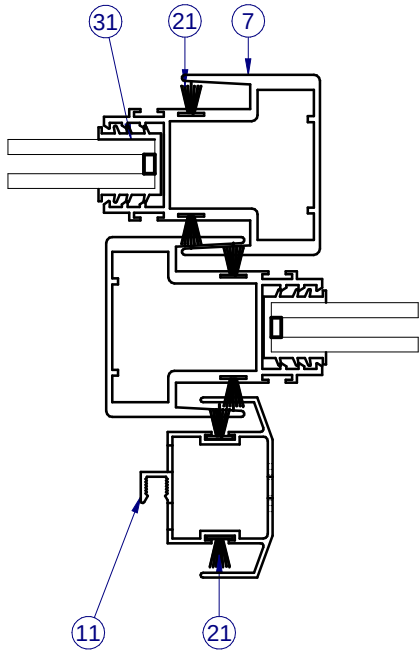

INTERIOR

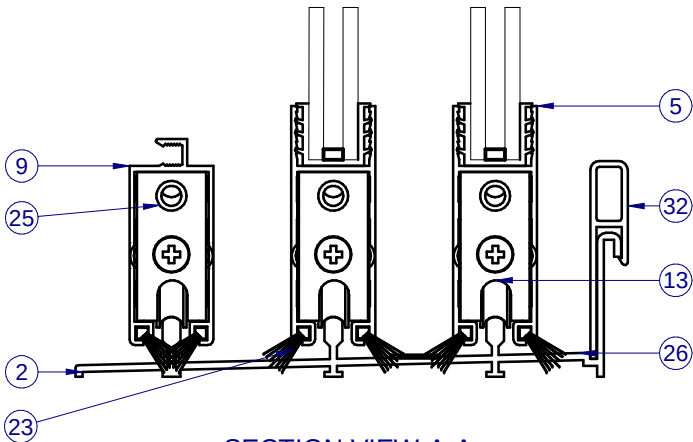

SECTION VIEW A-A




ALTERNATE INTERIOR SILL

ITEMS NOT SHOWN FOR CLARITY:
12, 18-19, 22, 28-30, 33-34, 36, 38-39

1. THE INTERIOR SILL (1016 AND 1103) ARE NOT TESTED FOR WATER INFILTRATION RESISTANCE.
2. THE USE OF INTERIOR SILL IS ALLOWED TO THE FULL DP'S INDICATED IN LOCATIONS WHERE WATER INFILTRATION RESISTANCE IS NOT REQUIRED, SUCH AS BUT NOT LIMITED TO LOCATIONS WHERE AN OVERHANG IS PRESENT THAT IS AS WIDE AS THE WALL IS TALL.

PARTS LIST			
ITEM	PART #	DESCRIPTION	MATERIAL
1	S-1078	Head, 3 Trk., SGD	Alum
1	S-1089	Head, 4 Trk., SGD	Alum
2	S-1301	Sill, Ext., 3 Trk., SGD	Alum
2	S-1302	Sill, Ext., 4 Trk., SGD	Alum
2	S-1016	Sill, Int., 3 Trk., SGD	Alum
2	S-1103	Sill, Int., 4 Trk., SGD	Alum
3	S-1080	Jamb, 3 Trk., SGD	Alum
3	S-1093	Jamb, 4 Trk., SGD	Alum
4	S-1307	Top Rail, Pnl.,	Alum
5	S-1021	Bot. Rail, Pnl.,	Alum
6	H-1017	LockStile, Pnl.,	Alum
7	H-1354	Intlk., Double, HD	Alum
8	S-1109	Top Rail, Scrn	Alum
9	S-1110	Bot. Rail, Scrn	Alum
10	H-1108	LockStile, Scrn	Alum
11	H-1107	Intlk., Scrn	Alum
12	S-1463	Buttstile, Adaptor	Alum
13	P-3221	Roller, Tandem, SGD, Steel	Steel
14	P-3231W	Pull, Ext., SGD, White	Plastic
15	P-3230W	Pull, Int., SGD, White	Plastic
16	P-4777	SGD SCREEN KEEPERS STANDARD (52X0+9200	Zinc
17	P-3609	Bumper, Rubber	Rubber
18	S-4291	Panel Bump Stop, 9200/89XX, /SGD	Alum
19	S-1022	Fixed Panel Clip	Alum
20	P-3232	SGD, Mortise Lock	Steel
21	P-3308	Wstp., 0.310 x .270 back FinSeal, Black, SoftTouch	
22	P-3309	Wstp., 0.210 x .187 back FinSeal, Black, SoftTouch	
23	P-3402	Wstp., .530 x .115 back, Black soft touch center fin diamond	
24	P-3514	#8 x 1.000 Ph PH Type A SMS, Zinc	Steel
25	P-3504R	1/4 - 20 x 0.500 Ph Tr. Hd. MS, Zinc	Steel
26	P-3246	Gasket, Sill at Jb., SGD	
27	P-3206	Glaz. Chnl., Black	Rubber
31	GLASS	SEE SHEET 2	
32	S-1697	SILL RISER, STANDARD, SGD	Alum
33		Screen, Spline	Rubber
34		Screen, Cloth	
35	H-1306	Astragal, Pnl	Alum
36	P-3497	Wtsp., 0.150 X .187 back, FinSeal, Black, SoftTouch	
37	P-4659	DUST PLUG- (.5x1.25 x 3" long)	
38	P-4144	#8 x 1 w/ 1/4" lead Pan Head	Steel
39	P-3091	Hole Cover, Outerframe	
40	P-3559	#8 x 3/8 Pan Tek	Steel
41	P-5563	KIT, INT/EXT HANDLE W/ THUMBTURN, SGD, 3800/9X00	
42	S-1512	Screen Astragal	Alum
43	P-3539	#8 X 3/4 Pan Tek	Steel

NOTE: ALL EXTRUSIONS ARE 6063-T6 ALUMINUM

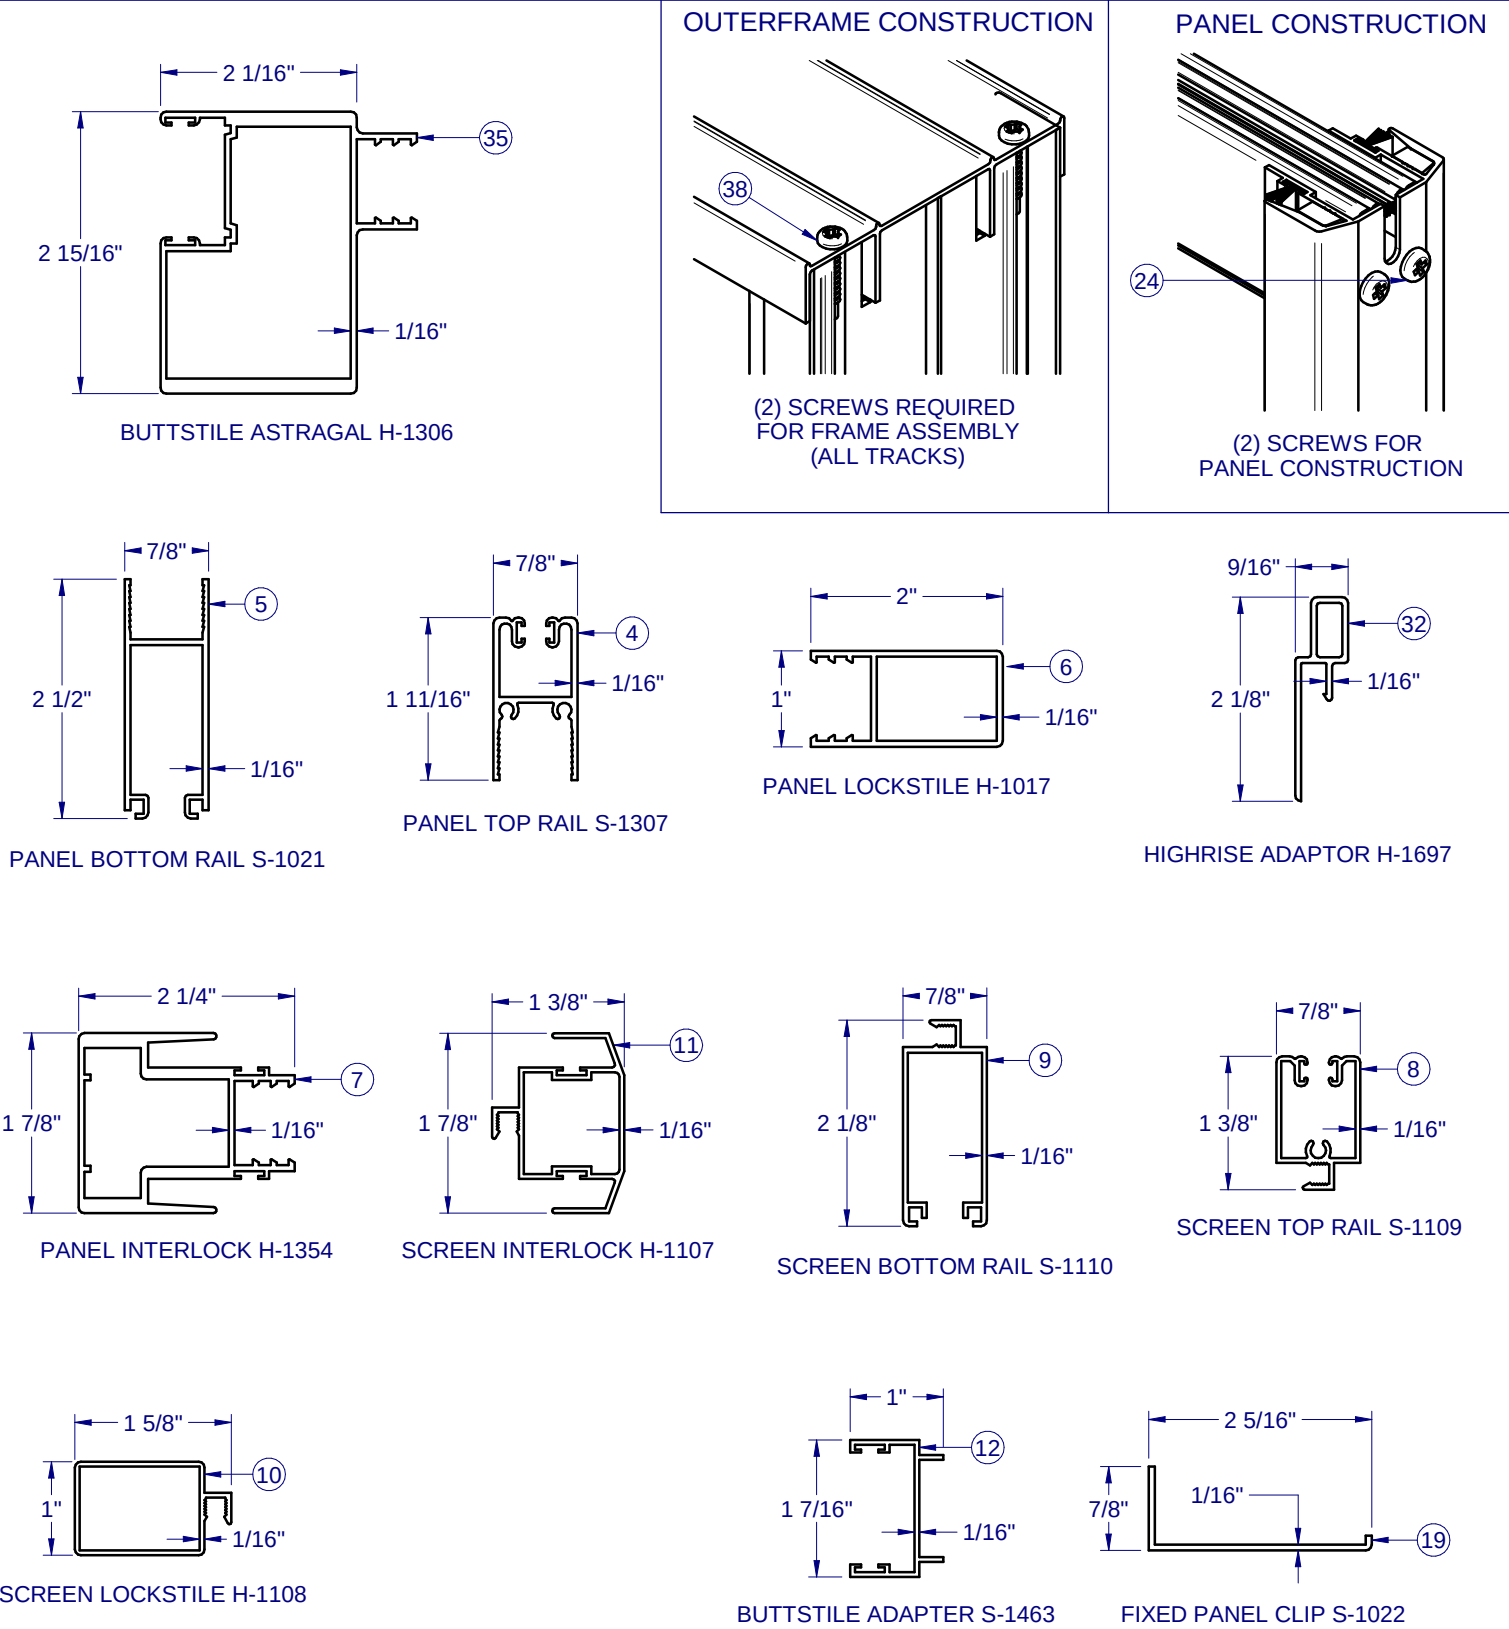

1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

**9200 ALUM.
SLIDING GLASS
DOOR
NON-IMPACT**

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
11908


10/3/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering & Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574


SHEET DESCRIPTION:

BOM AND EXTRUSIONS


DRAWN BY: MCS	DATE: 9/15/2023
DWG #: CWS-284	REV.: H
SCALE: 1:2	SHEET 4 OF 9

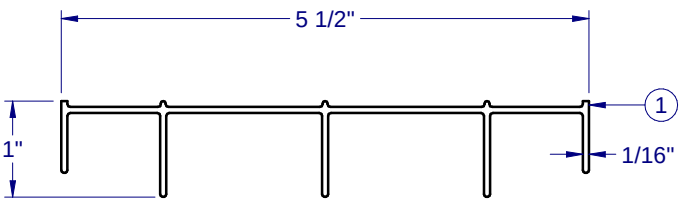


3 TRACK HEAD S-1078

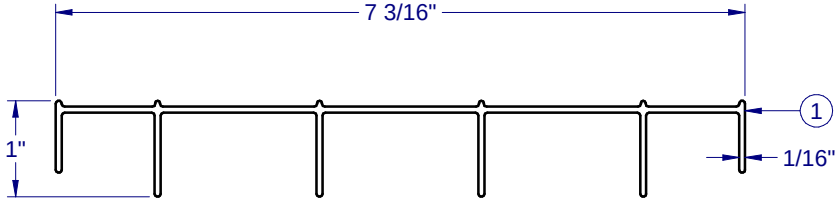


4 TRACK HEAD S-1089

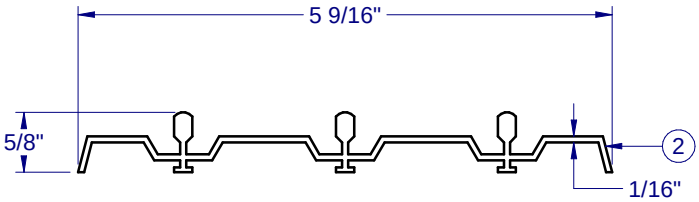


3 TRACK INTERIOR SILL S-1016

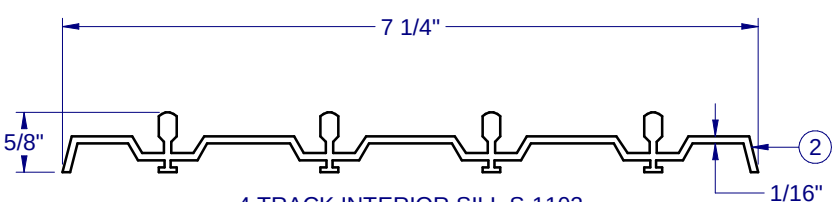


4 TRACK INTERIOR SILL S-1103

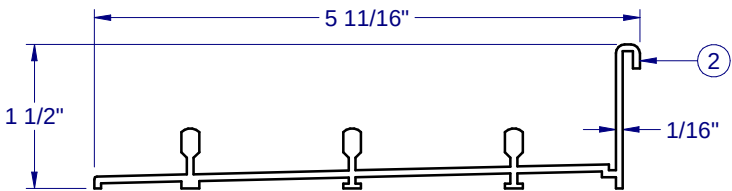


3 TRACK EXTERIOR SILL S-1301

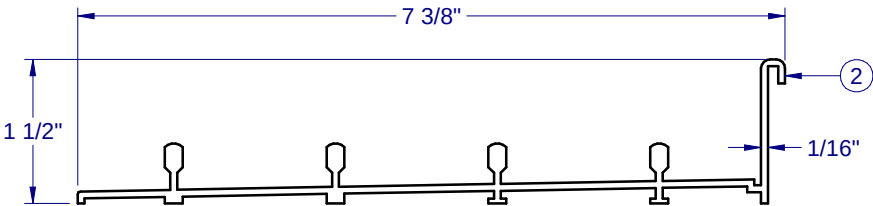

4 TRACK EXTERIOR SILL S-1302

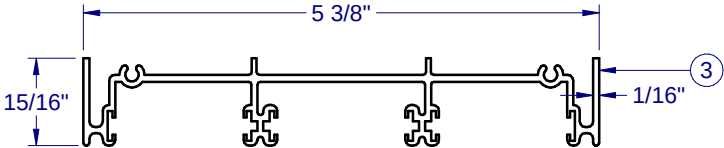

3 TRACK JAMB S-1080

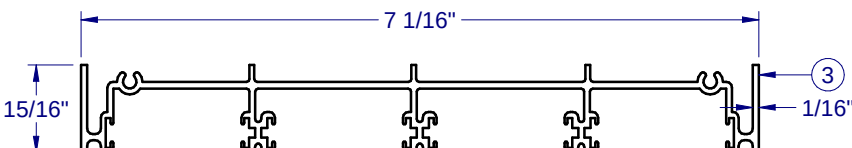

4 TRACK JAMB S-1093

NOTE: ALL EXTRUSIONS ARE 6063-T6 ALUMINUM

9200 ALUM.
SLIDING GLASS
DOOR
NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
11908




10/3/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering & Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:

EXTRUSIONS

DRAWN BY:	DATE:
MCS	9/15/2023
DWG #:	REV.:
CWS-284	H
SCALE:	SHEET
1:2	5 OF 9

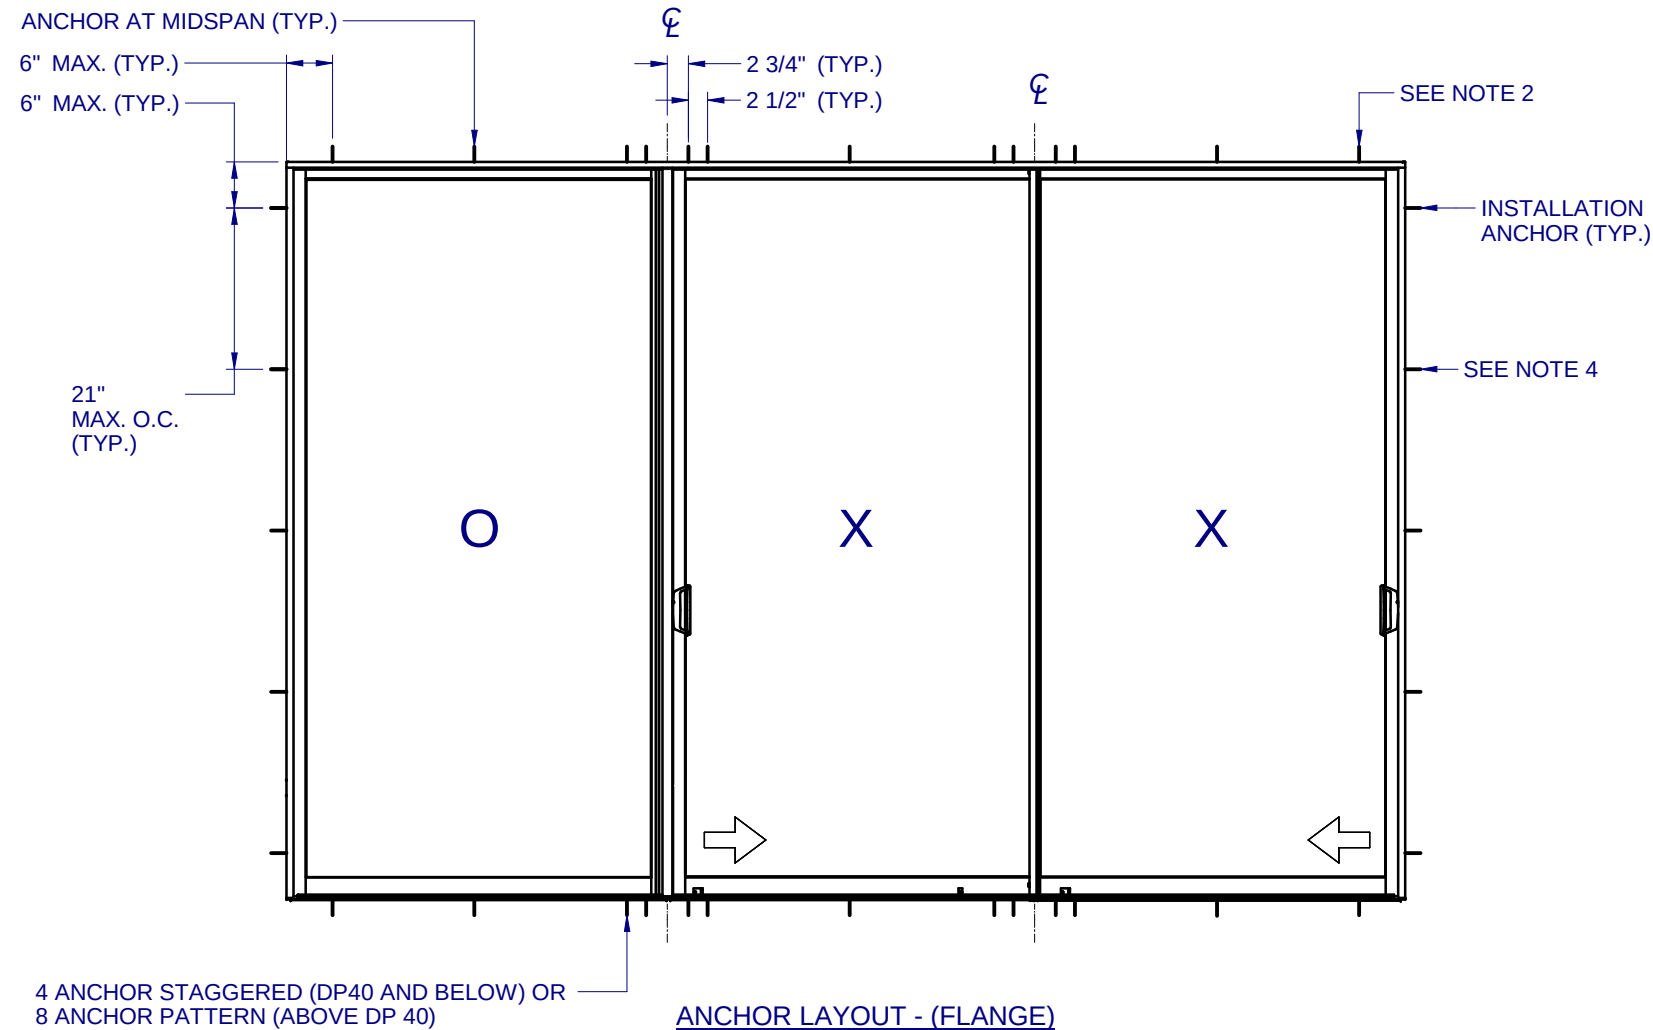

NOTES:

1. INSTALL TWO ANCHORS AT EACH INSTALLATION LOCATION IN 3 & 4 TRACK EXCEPT FOR STAGGERED PATTERN LOCATIONS AS INDICATED ON SHEET 7. SILL ANCHOR SPACING SAME AS HEAD.
2. SHIM AS REQ AT EACH INSTALLATION ANCHOR USING LOAD BEARING SHIMS. MAX. ALLOWABLE SHIM STACK TO BE 1/4". USE SHIMS WHERE SPACE GREATER THAN 1/16" IS PRESENT. LOAD BEARING SHIMS SHALL BECONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER. WOOD SHIMS ARE NOT ALLOWED.
3. ANCHOR TYPE, SIZE, SPACING AND EMBEDMENT SHALL BE AS SPECIFIED IN THESE DRAWINGS, SEE TABLE 1, SHEET 8.
4. ALL INSTALLATION ANCHORS MUST BE MADE OF OR PROTECTED WITH A CORROSION RESISTANT MATERIAL OR COATING. DISSIMILAR METALS OR MATERIALS IN CONTACT WITH PRESSURE TREATED WOOD MUST BE PROTECTED TO PREVENT REACTION. ALL FACTORY APPLIED HOLES IN FRAME MEMBERS NOT DESIGNATED FOR CONCRETE SCREW ANCHORS SHOULD BE FILLED WITH #8 SCREWS OF SUFFICIENT LENGTH TO ACHIEVE A MIN. EMBEDMENT OF 5/8" INTO WOOD BUCK.
5. INSTALLATION ANCHORS SHALL BE IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM SPECIFIED IN TABLE 1, SHEET 8.
6. ANCOR EMBEDMENT TO SUBSTRATE SHALL BE BEYONG WALL DRESSING OR STUCCO. FOR CONCRETE/CMU OPENINGS, EMBEDMENT SHALL BE BEYOND WOOD BUCKS, IF USED, INTO SUBSTRATE - 1X BUCKS ARE OPTIONAL.
7. A MINIMUM CENTER-TO-CENTER SPACING SHALL BE MAINTAINED BETWEEN ALL FASTENERS: 1-3/4" FOR MASONRY IN 8-ANCHOR CLUSTERS, 3" FOR MASONRY IN STAGGERED 4-ANCHOR CLUSTERS AND JAMBS, 2" FOR FIXED PANEL CLIPS (ALL SUBSTRATES), 1" FOR WOOD AND METAL.
8. WOOD OR MASONRY OPENINGS, BUCKS AND BUCK FASTENERS SHALL BE PROPERLY DESIGNED BY THE ARCHITECT OR ENGINEER OF RECORD AND INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE. SUBSTRATES SHALL MEET THE MINIMUM STRENGTH REQUIREMENTS AS SHOWN IN TABLE1, SHEET 8. CONCRETE AND MASONRY SUBSTRATES MAY NOT BE CRACKED.
9. SEALING AND FLASHING STRATEGIES FOR OVERALL WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS FOLLOWING THE CURRENT VERSION OF THE REFERENCE DOCUMENTS: FMA/AAMA 100(FIN WINDOWS), FMA/AAMA 200(FLANGE WINDOWS), FMA/WDMA 250(BOX WINDOWS), FMA/AAMA/WDMA 300(EXTERIOR DOORS)



1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

**9200 ALUM.
SLIDING GLASS
DOOR
NON-IMPACT**

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN
THIS DRAWING IS THE SOLE
PROPERTY OF CUSTOM WINDOW
SYSTEMS, INC. ANY
REPRODUCTION IN PART OR AS A
WHOLE WITHOUT THE WRITTEN
PERMISSION OF CUSTOM WINDOW
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:

11908



10/3/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering &
Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:

**ANCHOR SCHEDULE AND
NOTES**

DRAWN BY:	DATE:
MCS	9/15/2023
DWG #:	REV.:
CWS-284	H
SCALE:	SHEET
1:25	6 OF 9

NOTE: PUNCHED HOLES IN HEAD AND SILL THAT DO REQUIRE TAPCONS NEED TO BE COVERED WITH SEALANT.



1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

9200 ALUM.
SLIDING GLASS
DOOR
NON-IMPACT

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN
THIS DRAWING IS THE SOLE
PROPERTY OF CUSTOM WINDOW
SYSTEMS, INC. ANY
REPRODUCTION IN PART OR AS A
WHOLE WITHOUT THE WRITTEN
PERMISSION OF CUSTOM WINDOW
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:

11908



10/3/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering &
Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:

4 ANCHOR STAGGER AND
8 ANCHOR PATTERN

DRAWN BY:

MCS

DATE:

9/15/2023

DWG #:

CWS-284

REV.:


H

SCALE:



1:12

SHEET


7 OF 9

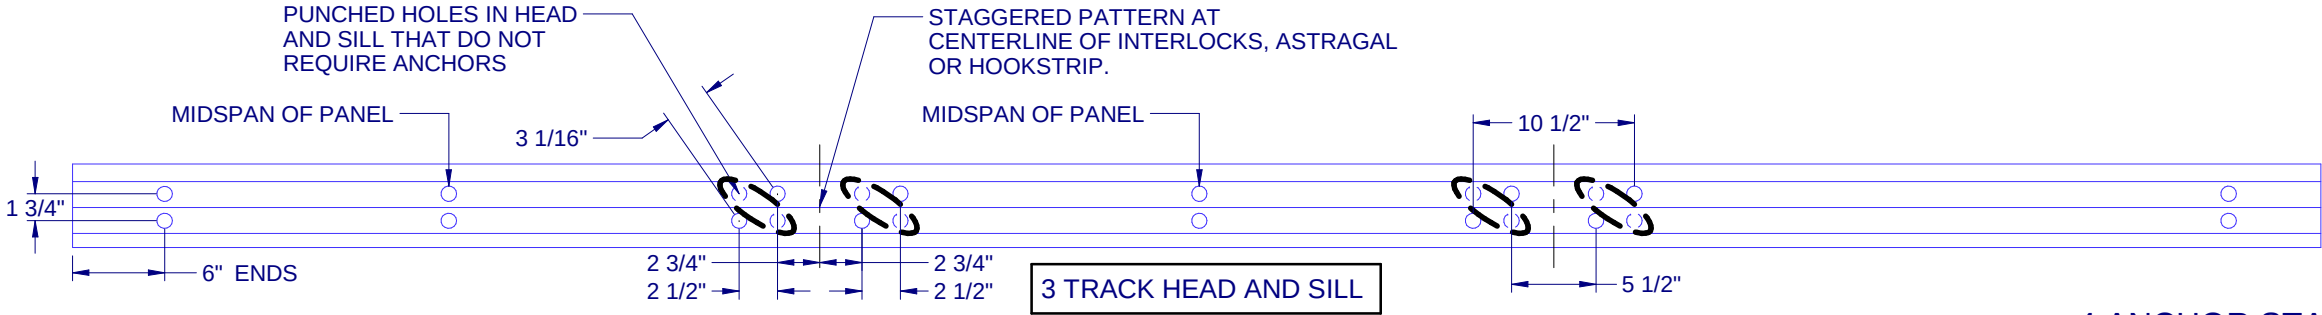

4 ANCHOR STAGGERED PATTERN,
FOR USE ON DOORS DP 40 AND BELOW

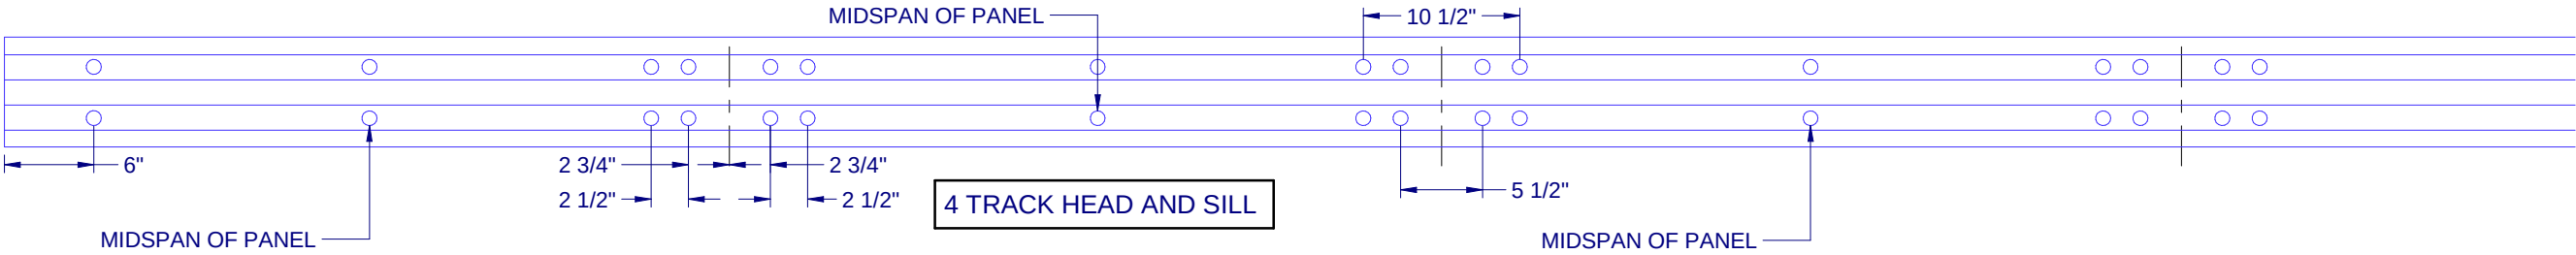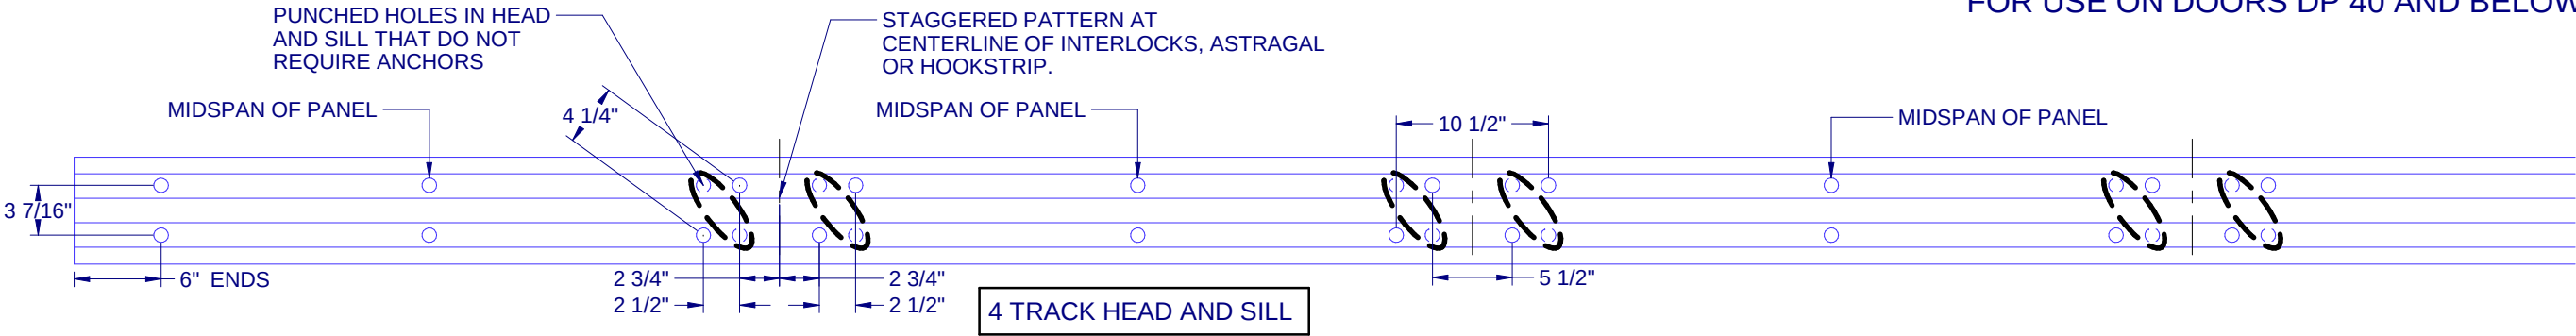

8 ANCHOR PATTERN,
RQUIRED ON DOORS ABOVE DP 40

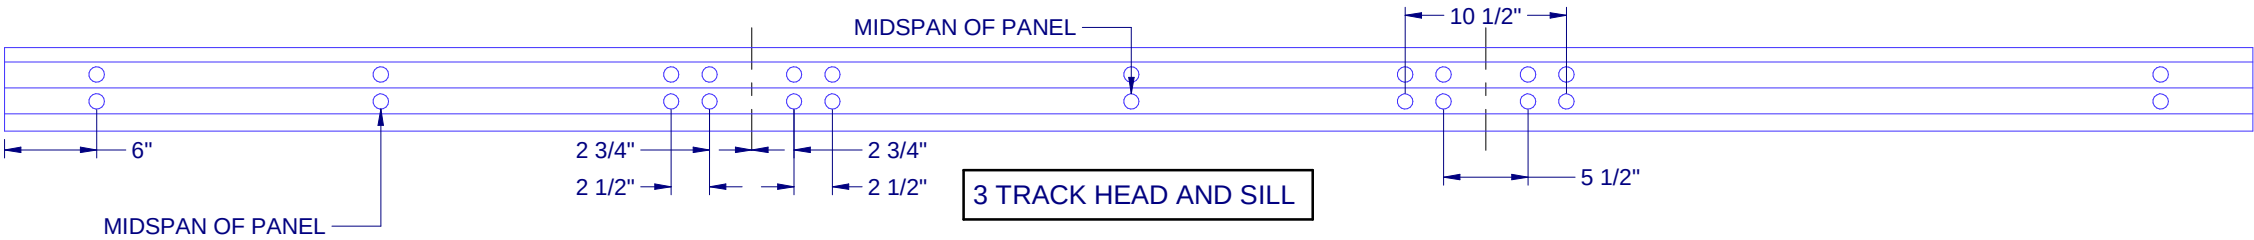


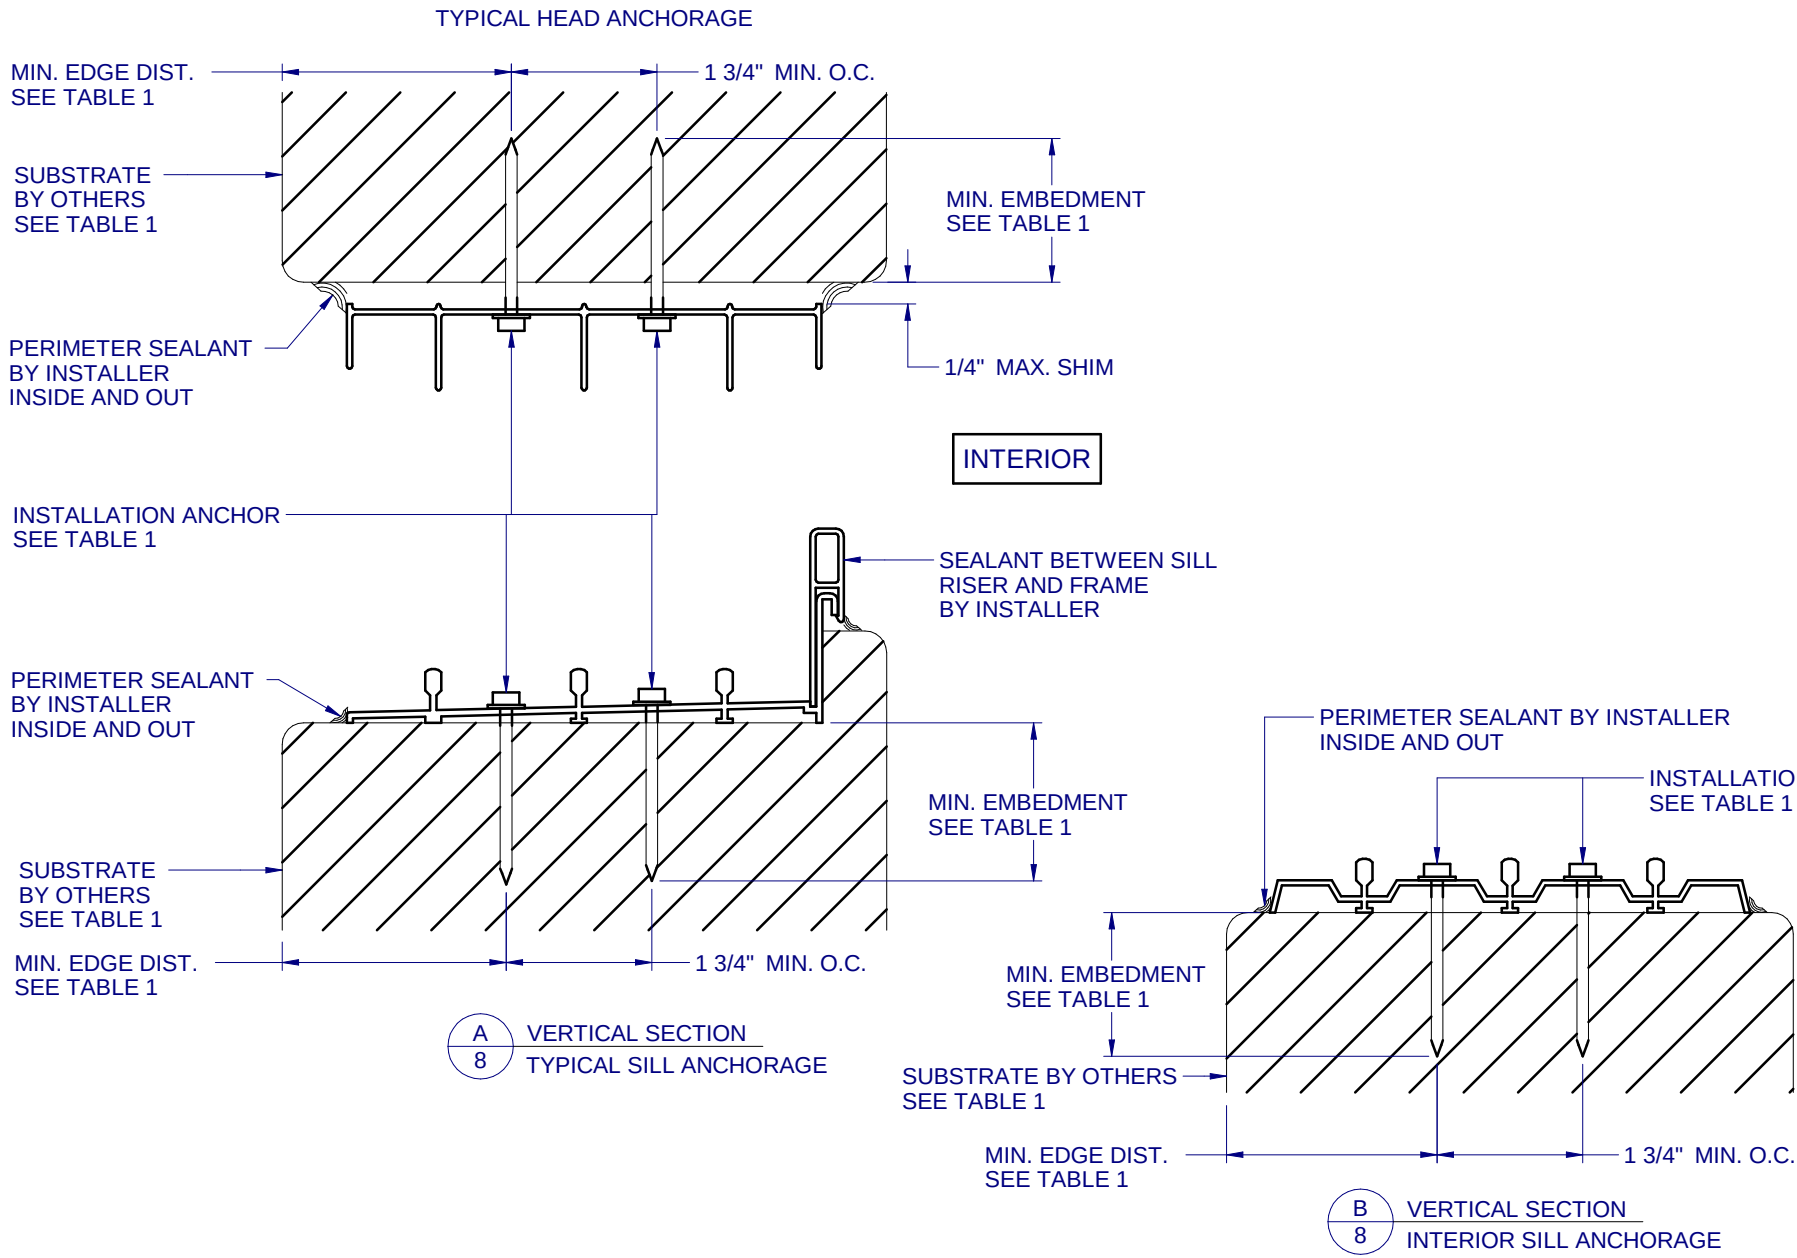


TABLE 1: APPROVED INSTALLATION FASTENERS			
SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DIST.
CONCRETE (2.0 KSI MIN.)	3/16" ITW TAPCON	1"	3"
CONCRETE (3.05 KSI MIN.)	3/16" DEWALT ULTRACON+	1-3/4"	1"
HOLLOW OR GROUT-FILLED CMU (ASTM C-90)	3/16" DEWALT ULTRACON+	1-1/4"	2-1/2"
2X MIN. SPRUCE-PINE-FIR (G=0.42)	3/16" ITW TAPCON OR DEWALT ULTRACON+	1-3/8"	7/8"
2X MIN. SPRUCE-PINE-FIR (G=0.42)	#10 WOOD SCREW	1-3/8"	7/8"
16 GAUGE (0.060") MIN. STEEL STUD (33 KSI YIELD MIN)	#10-16 HILTI KWIK-FLEX OR ITW TEKS SELF-DRILLING SCREW	FULL THREAD THRU 0.060"	1/2"
1/8" ALUM. (6063-T5 MIN.) OR 1/8" STEEL (33 KSI MIN.)	#10 GRADE 5 SELF-TAPPING / DRILLING SCREW	FULL THREAD THRU 0.125"	1/2"
FIXED PANEL CLIP ANCHORS INTO CONCRETE (2.0 KSI MIN.) OR HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	3"
FIXED PANEL CLIP ANCHORS INTO CONCRETE (3.05 KSI MIN.) OR HOLLOW OR GROUT-FILLED CMU (ASTM C-90)	3/16" DEWALT ULTRACON+	1-3/4"	2-1/2"

NOTE: FIXED PANEL CLIP ANCHORS INTO WOOD OR METAL SHALL FOLLOW THE ANCHOR TYPE, MIN. EMBEDMENT AND MIN. EDGE DISTANCE LISTED IN TABLE 1.

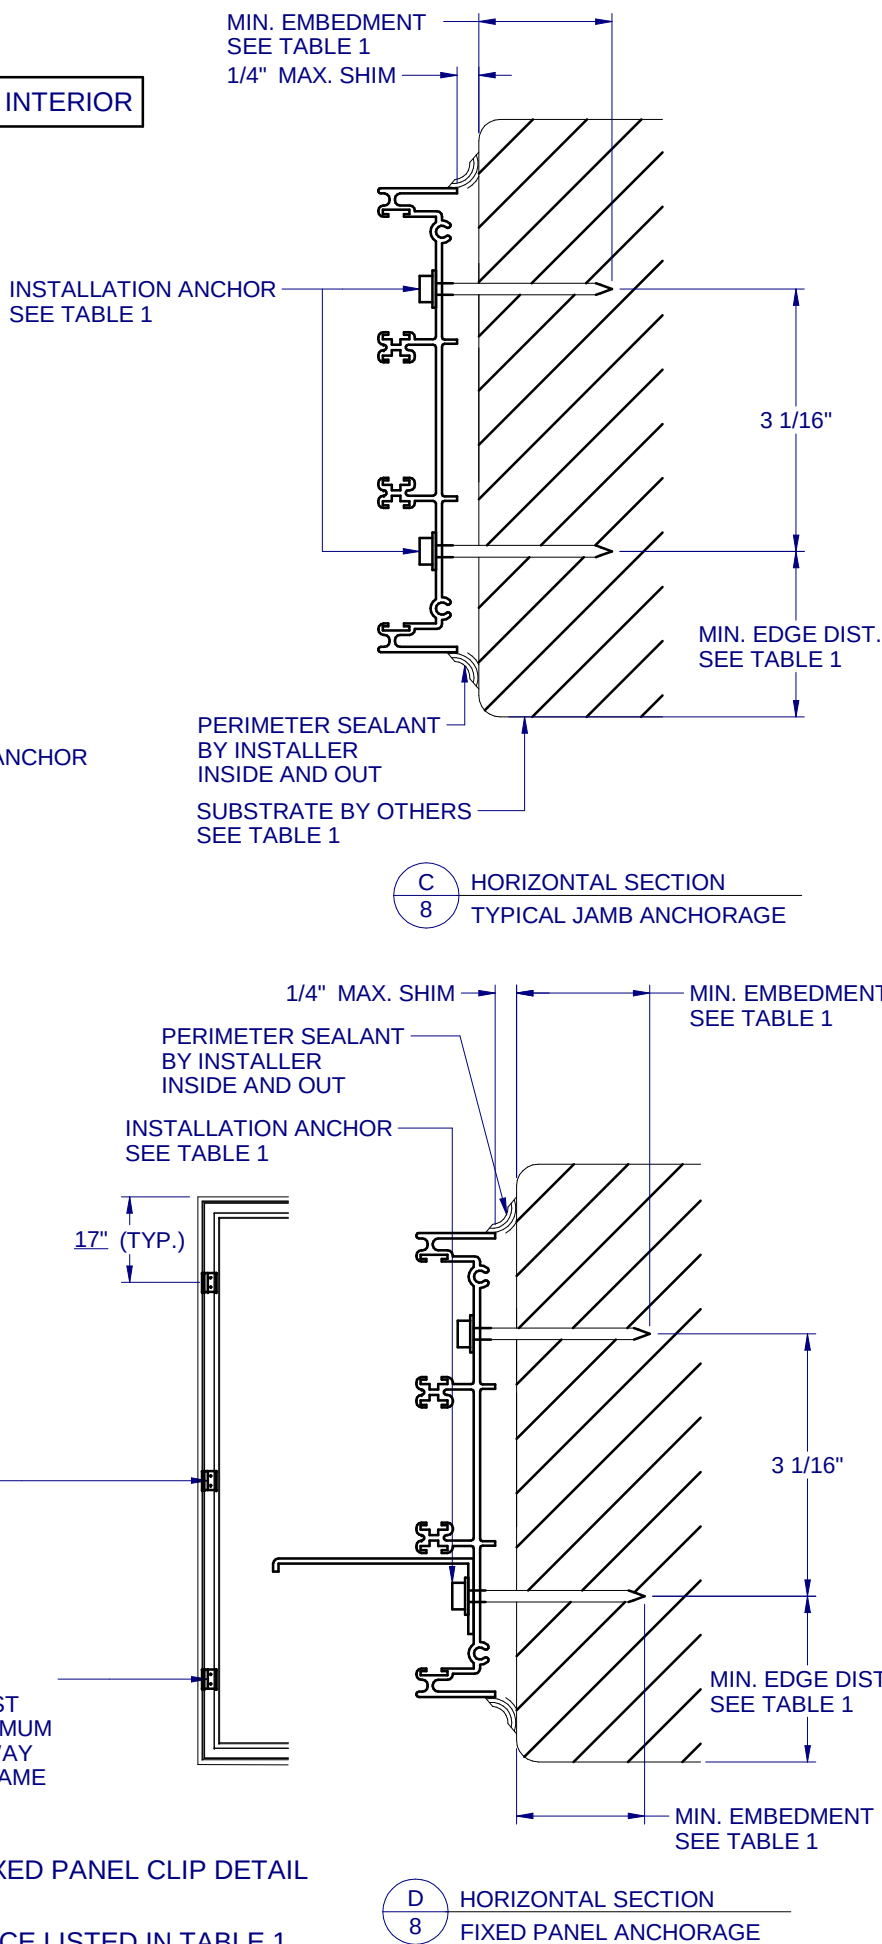

1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

9200 ALUM. SLIDING GLASS DOOR NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.: 11908

10/3/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering & Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:

INSTALLATION DETAILS 3 TRACK

DRAWN BY:	DATE:
MCS	9/15/2023
DWG #:	REV.:
CWS-284	H
SCALE:	SHEET
1:2	8 OF 9



1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

**9200 ALUM.
SLIDING GLASS
DOOR
NON-IMPACT**

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN
THIS DRAWING IS THE SOLE
PROPERTY OF CUSTOM WINDOW
SYSTEMS, INC. ANY
REPRODUCTION IN PART OR AS A
WHOLE WITHOUT THE WRITTEN
PERMISSION OF CUSTOM WINDOW
SYSTEMS, INC IS PROHIBITED.



FLORIDA APPROVAL NO.:
11908




10/3/2023
LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering &
Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:
**INSTALLATION DETAIL -
4 TRACK**


DRAWN BY:	DATE:
MCS	9/15/2023
DWG #:	REV.:
CWS-284	H
SCALE:	SHEET
1:2	9 OF 9

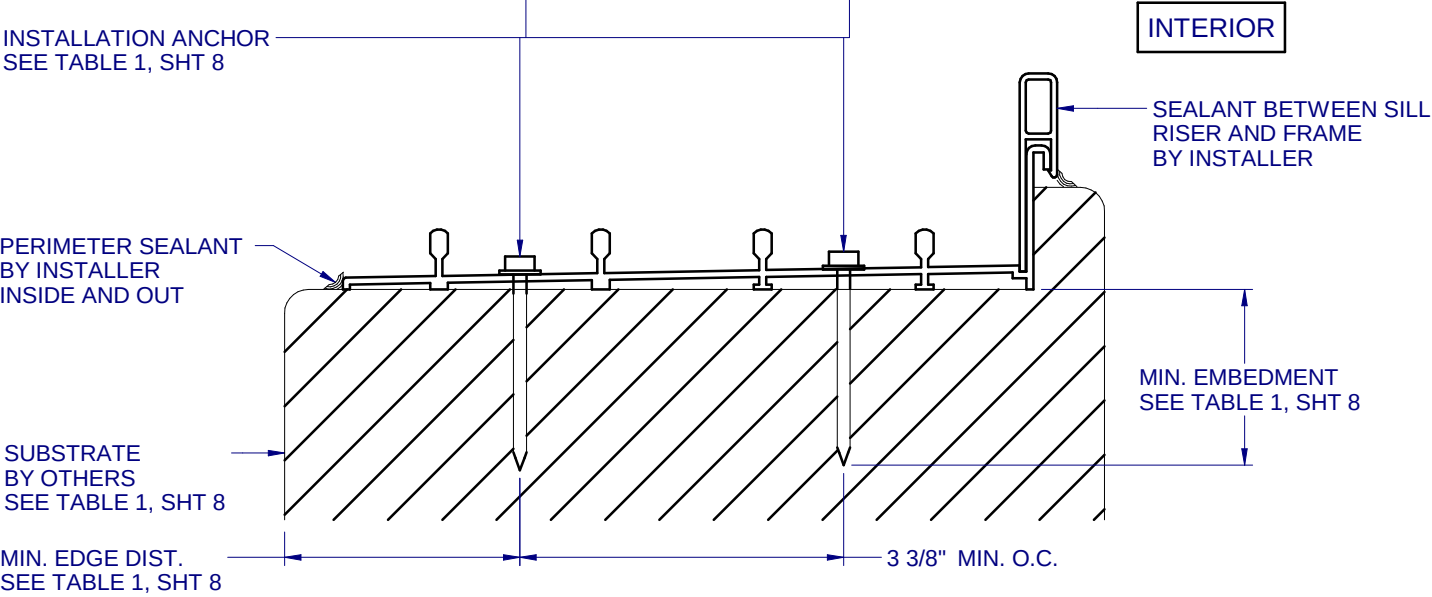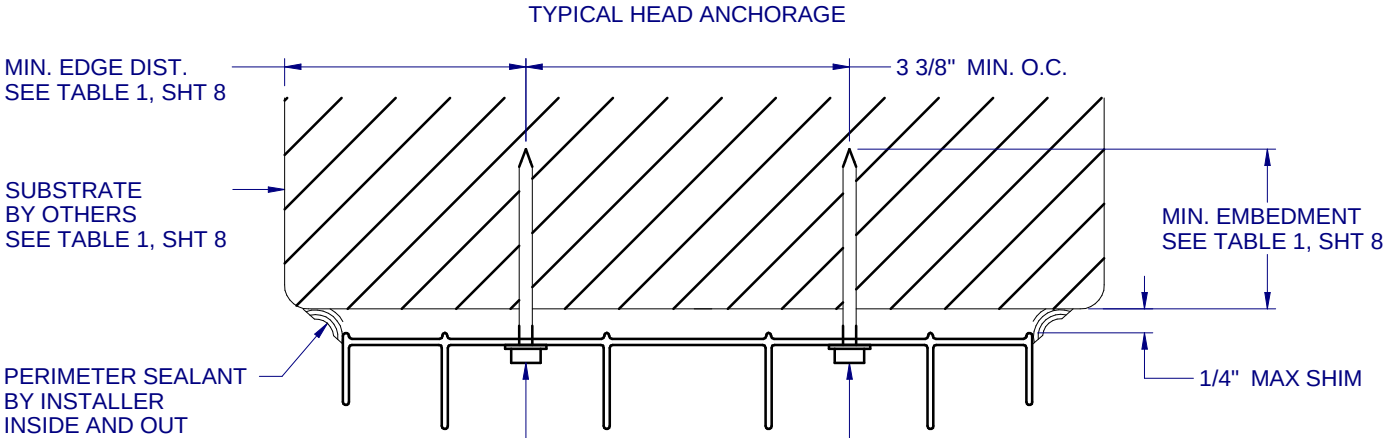

E
9 VERTICAL SECTION
TYPICAL SILL ANCHORAGE

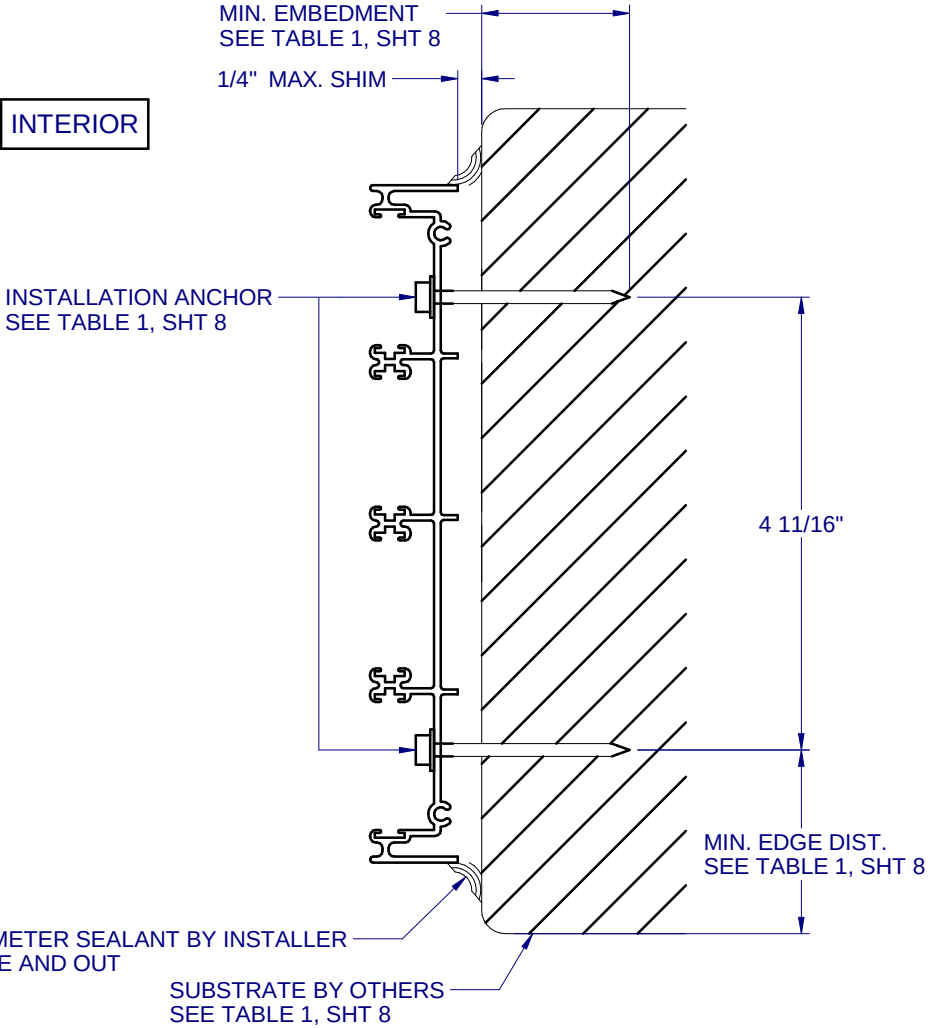

G
9 HORIZONTAL SECTION
TYPICAL JAMB ANCHORAGE

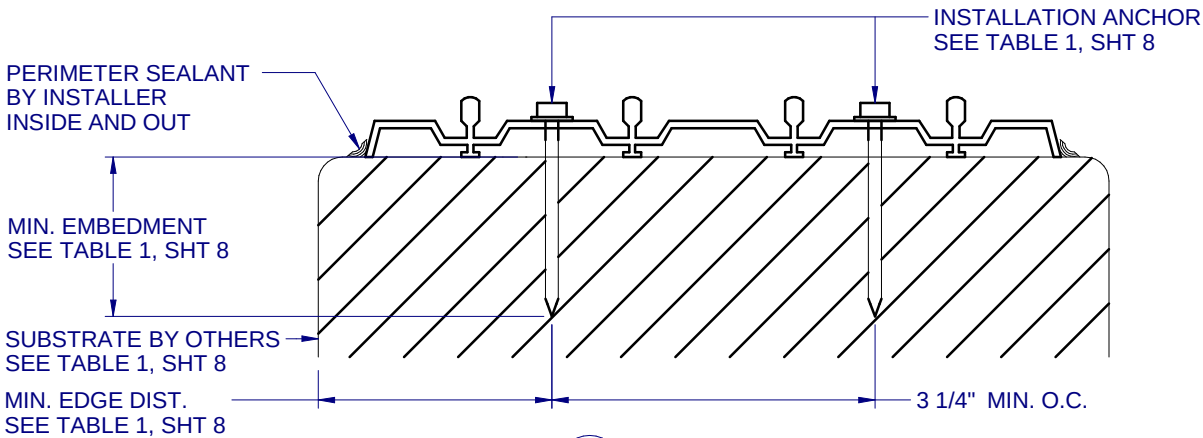

F
9 VERTICAL SECTION
INTERIOR SILL ANCHORAGE