

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
C	REVISED TO ADD CORROSION CHART	09/28/26	

NOTES:


1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING, METAL STRUCTURE AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
4. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
5. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
6. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
7. SHIM AS NEEDED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
8. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
9. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
10. FRAME MATERIAL: EXTRUDED RIGID PVC.
11. UNITS MUST BE GLAZED PER ASTM E1300.
12. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.

13. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
14. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. ALL FASTENERS TO BE CORROSION RESISTANT.
17. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - 17.1. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - 17.2. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - 17.3. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
 - 17.4. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI 1/8" THICK MINIMUM


TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION
3	B.O.M. AND CROSS SECTIONS
4 - 5	INSTALLATION DETAILS

PROVIA DOOR, INC 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
S-4200 PRESTIGE PVC FIXED WINDOW NON-IMPACT NOTES		
DRAWN: V.L.	DWG NO. 08-00671C	REV C
SCALE NTS	DATE 07/05/11	SHEET 1 OF 5
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 09/28/2026

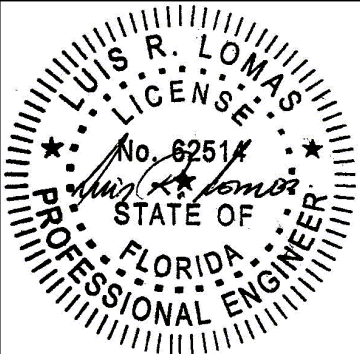

Luis R. Lomas P.E.
FL No.: 62514

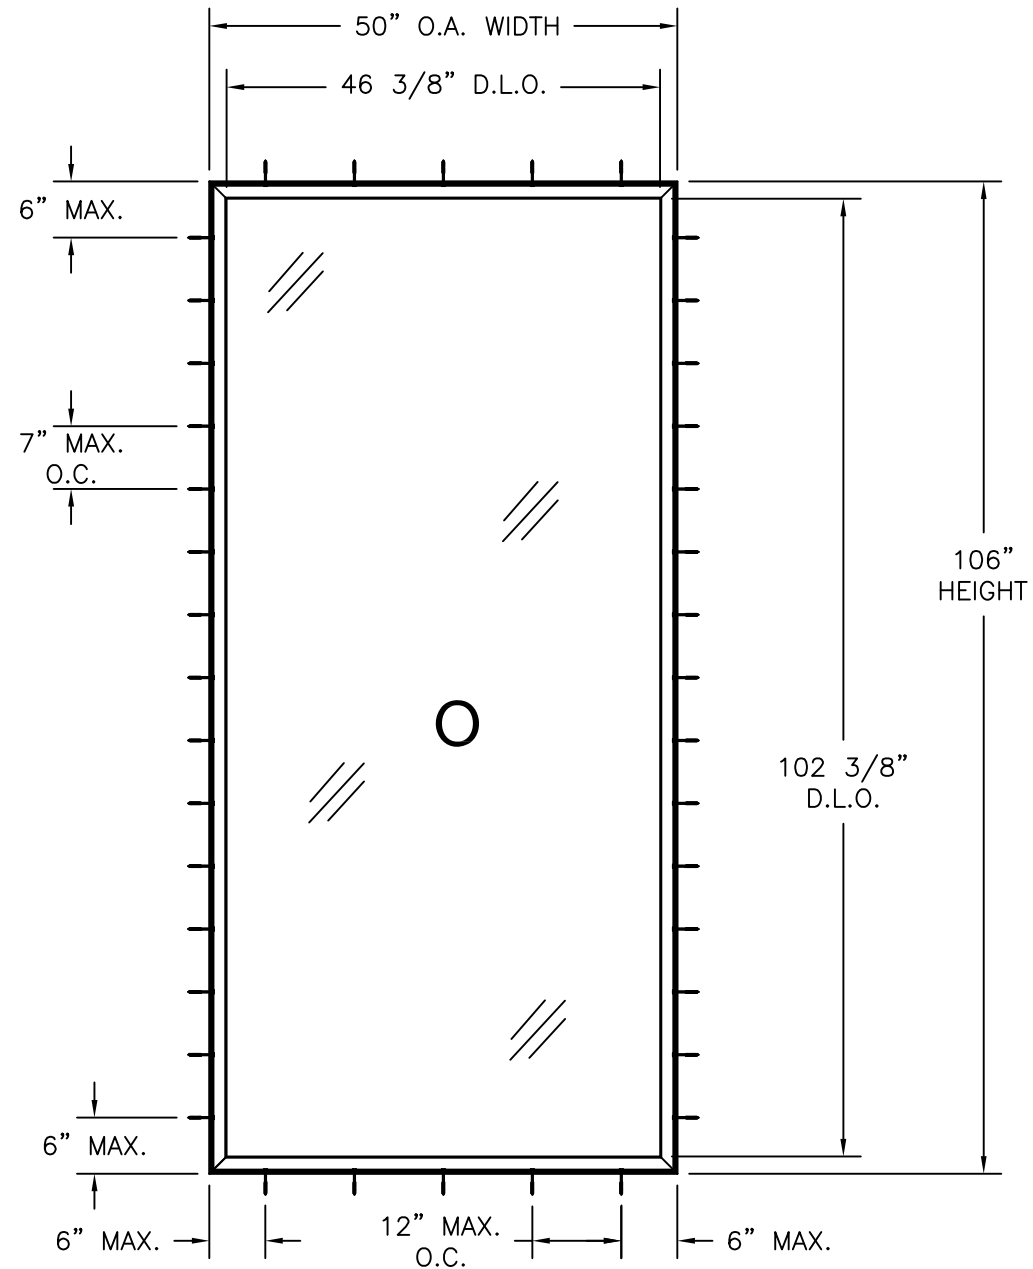

S-4200 PRESTIGE PVC
FIXED WINDOW
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
±75.0PSF	NONE

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
C	REVISED TO ADD CORROSION CHART	09/28/26	

Anchors and anchor connectors corrosion resistance chart		
Exposure	Distance from coastal shoreline	
	0' up to 300'	>300' up to 3000'
Exterior - partially sheltered	304 or A305 or 306 Stainless steel per ASTM A240	Galvanized per ASTM A153 class D or ASTM A641 class 3S
Exterior - open exposed	304 or A305 or 306 Stainless steel per ASTM A240	Galvanized per ASTM A153 class D or ASTM A641 class 3S
Unconditioned interior-vented enclosed	Galvanized per ASTM A153 class D or ASTM A641 class 3S	Galvanized per ASTM A153 class D or ASTM A641 class 3S
Unconditioned interior-unvented enclosed	Galvanized per ASTM A153 class D or ASTM A641 class 3S	Galvanized per ASTM A153 class D or ASTM A641 class 3S

SIGNED: 09/28/2026

PROVIA DOOR, INC
2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

S-4200 PRESTIGE PVC FIXED WINDOW
NON-IMPACT
ELEVATION

DRAWN:
V.L.

DWG NO.
08-00671C


REV
C

SCALE
NTS

DATE
07/05/11

SHEET
2 OF 5



L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

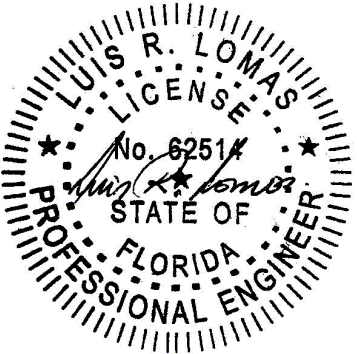

Luis R. Lomas P.E.
FL No.: 62514


PARTS LIST				
NO.	PART NUMBER	DESCRIPTION	MANUFACTURER	MATERIAL
1	4201/4203	MAIN FRAME	P.H TECH	RIGID PVC
2		GLAZING TAPE	VARIOUS	
3	8873	SETTING BLOCK	P.H. TECH	RIGID PVC
4	9739	WEAP HOLE COVER	P.H. TECH	RIGID PVC
5	5800	GLAZING BEAD	P.H TECH	RIGID PVC
6		NON-IMPACT GLAZING	VARIOUS	
7		HEEL BEAD TREMCO SILGLAZE	TREMCO	

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
C	REVISED TO ADD CORROSION CHART	09/28/26	

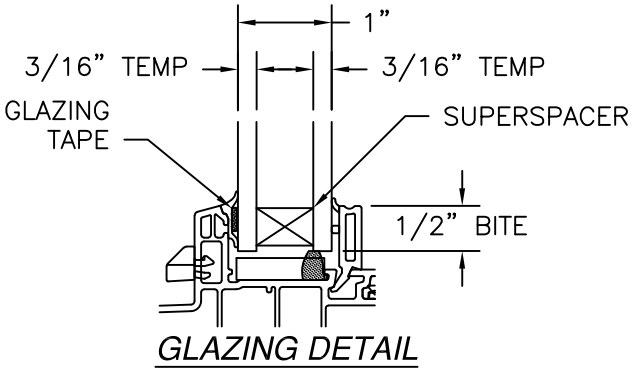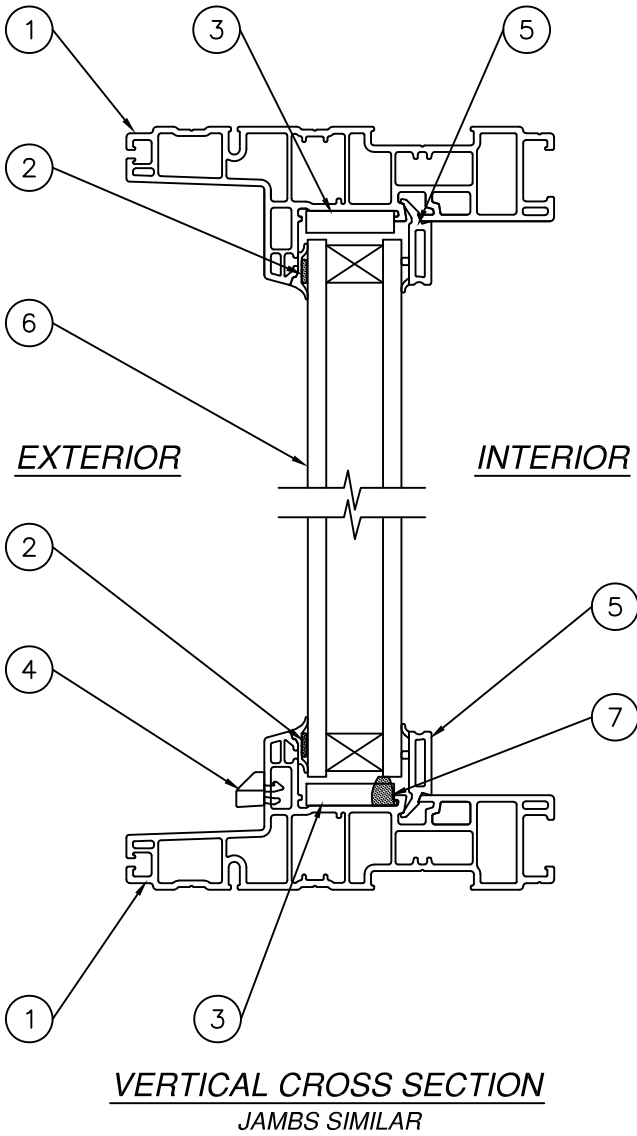


SIGNED: 09/28/2026

PROVIA DOOR, INC 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
S-4200 PRESTIGE PVC FIXED WINDOW NON-IMPACT B.O.M. AND CROSS SECTIONS		
DRAWN: V.L.	DWG NO. 08-00671C	REV C
SCALE NTS	DATE 07/05/11	SHEET 3 OF 5
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

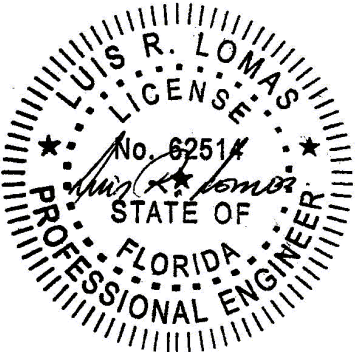


Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
C	REVISED TO ADD CORROSION CHART	09/28/26	

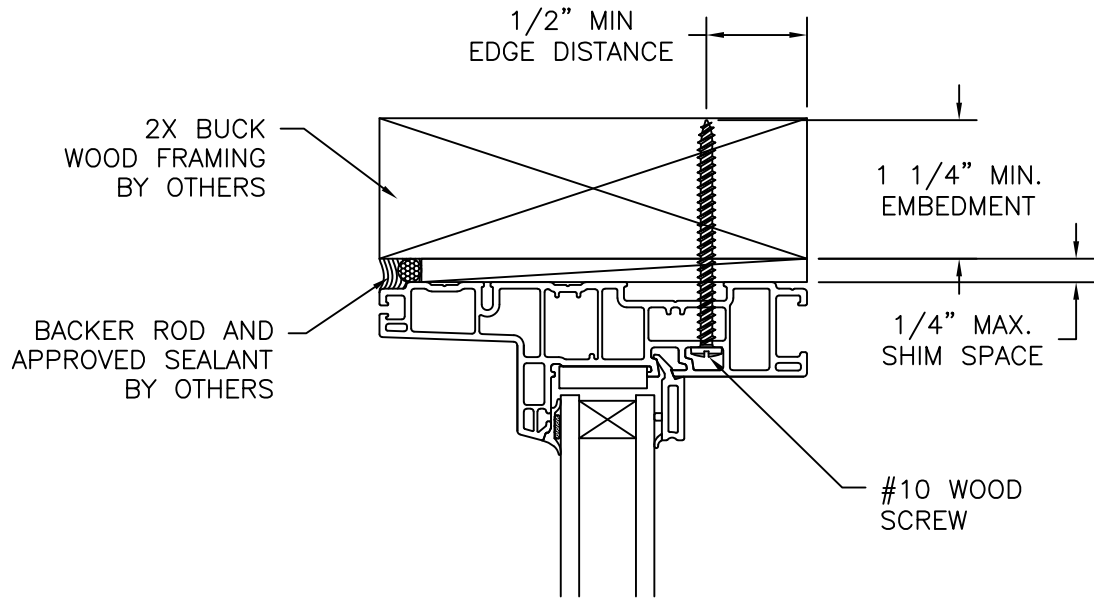


EXTERIOR INTERIOR

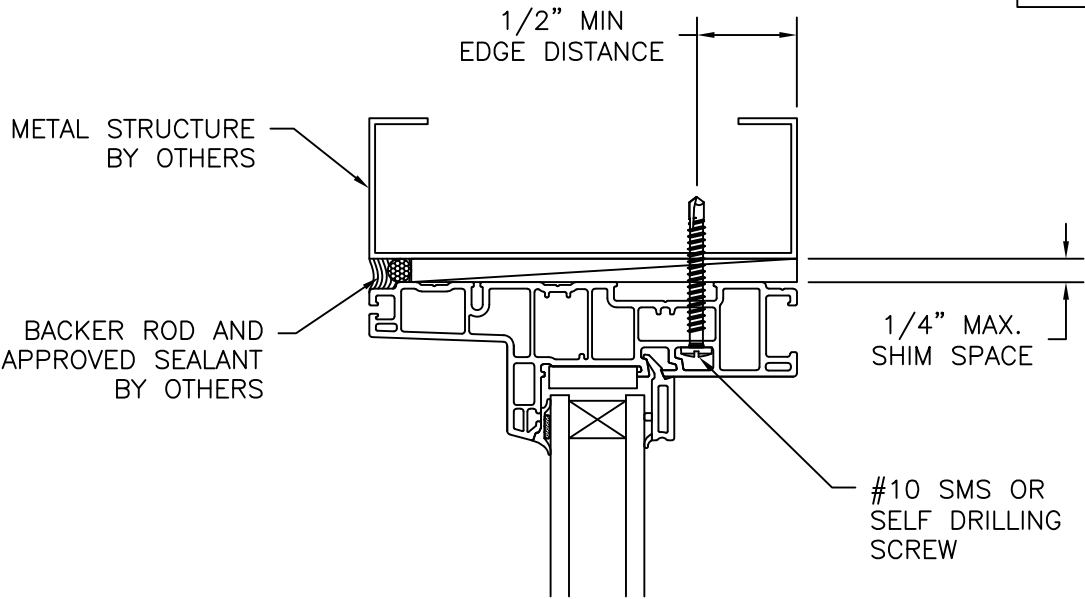


EXTERIOR INTERIOR

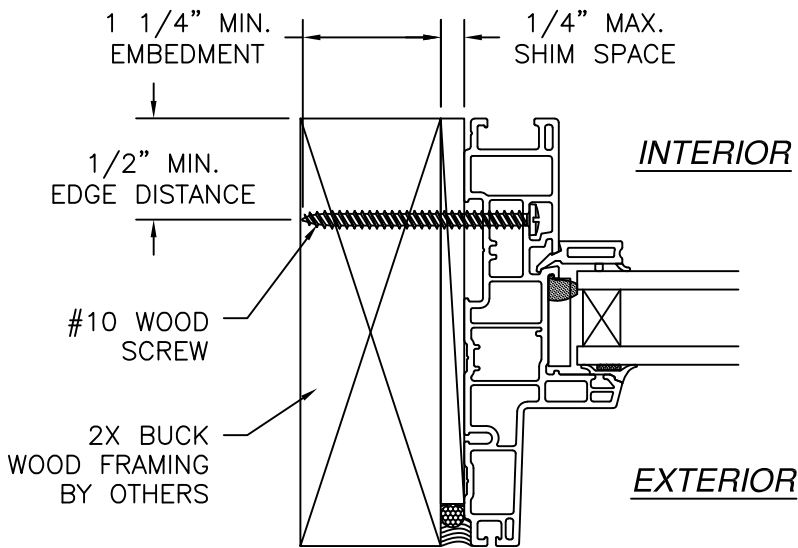


HORIZONTAL CROSS SECTION
2X BUCK/WOOD FRAMING INSTALLATION

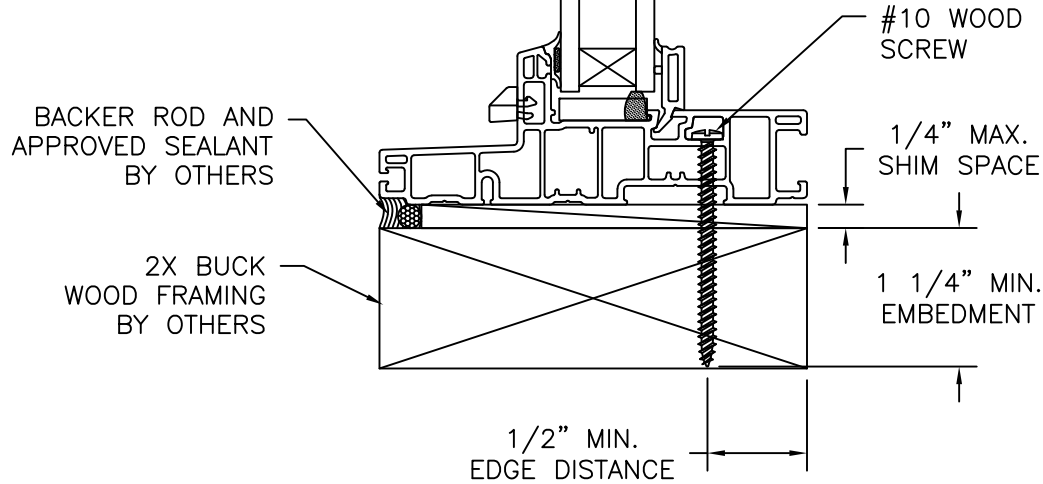

VERTICAL CROSS SECTION
2X BUCK/WOOD FRAMING INSTALLATION

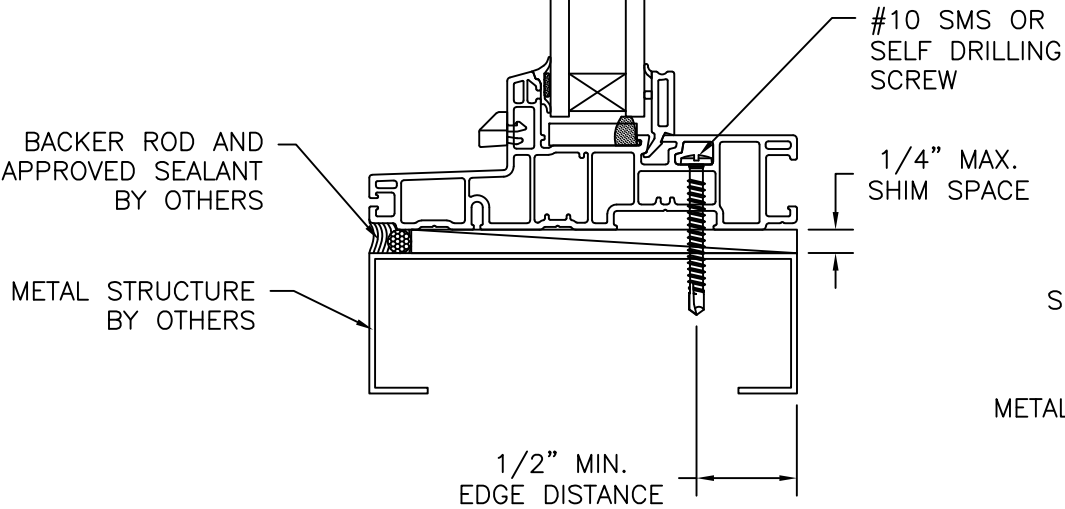

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

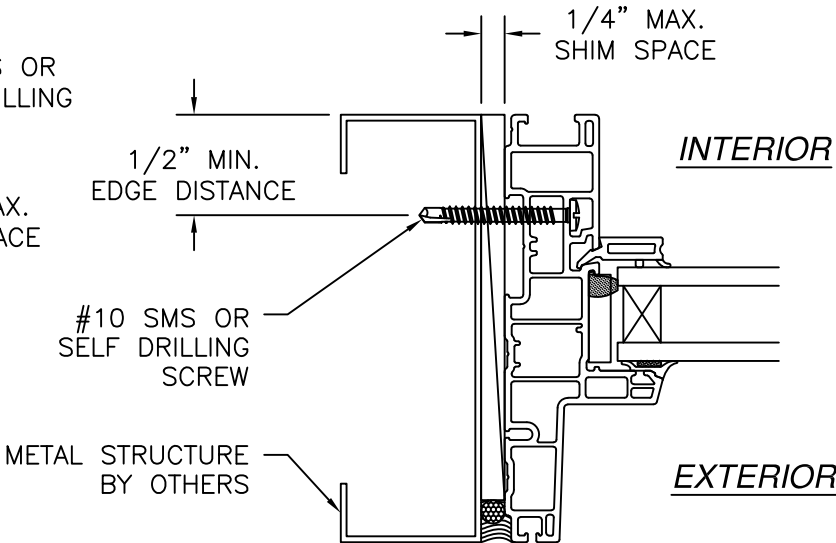

HORIZONTAL CROSS SECTION
METAL STRUCTURE INSTALLATION

SIGNED: 09/28/2026

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

PROVIA DOOR, INC

2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

S-4200 PRESTIGE PVC FIXED WINDOW
NON-IMPACT

INSTALLATION DETAILS

DRAWN:
V.L.

DWG NO.
08-00671C

REV
C


SCALE
NTS

DATE
07/05/11

SHEET
4 OF 5



L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

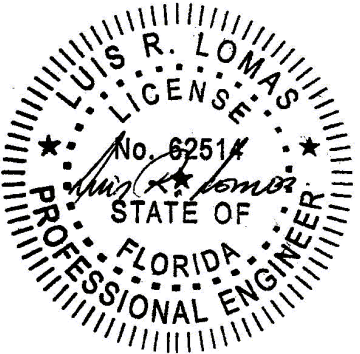


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
C	REVISED TO ADD CORROSION CHART	09/28/26	

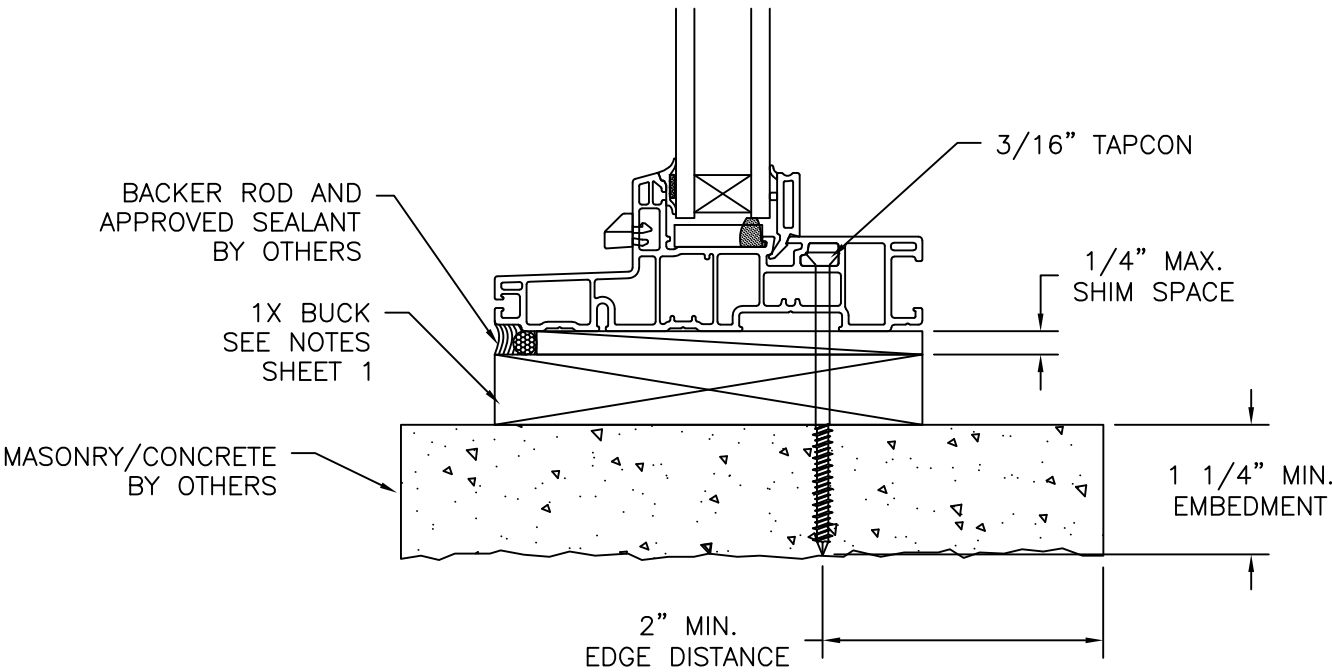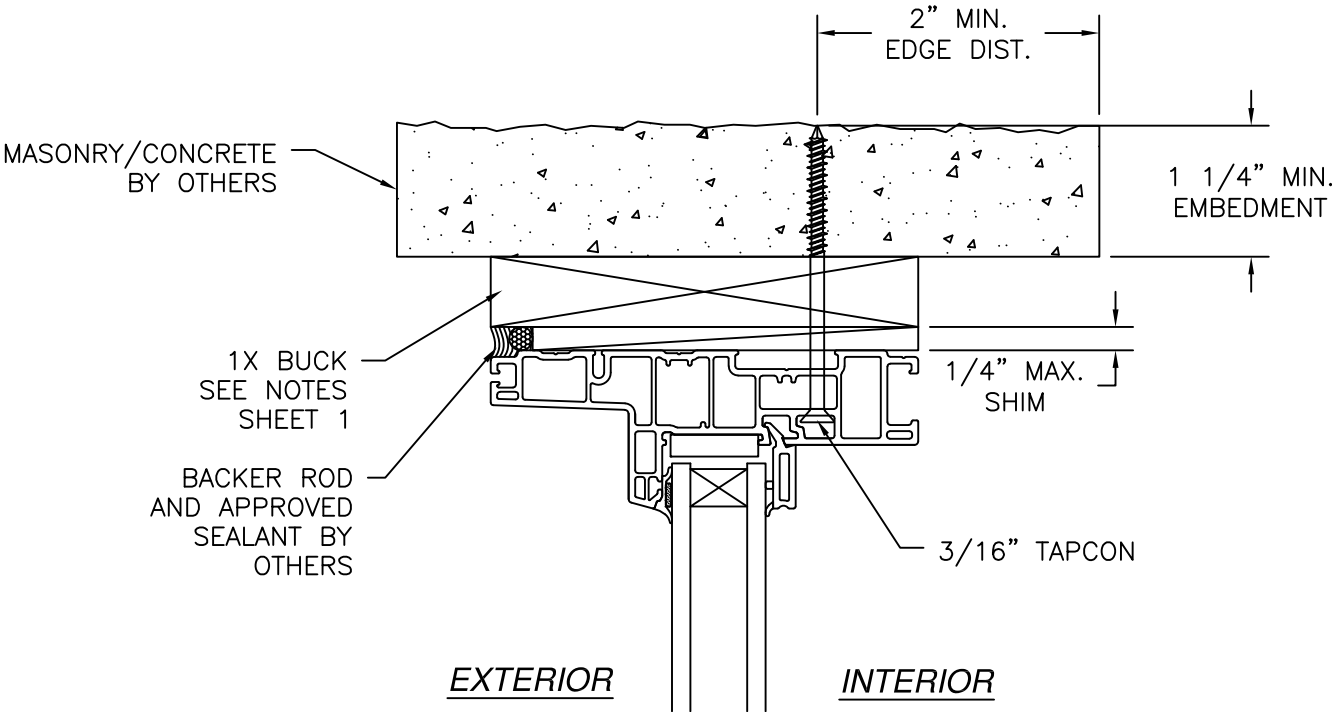

VERTICAL CROSS SECTION
MASONRY/CONCRETE INSTALLATION

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

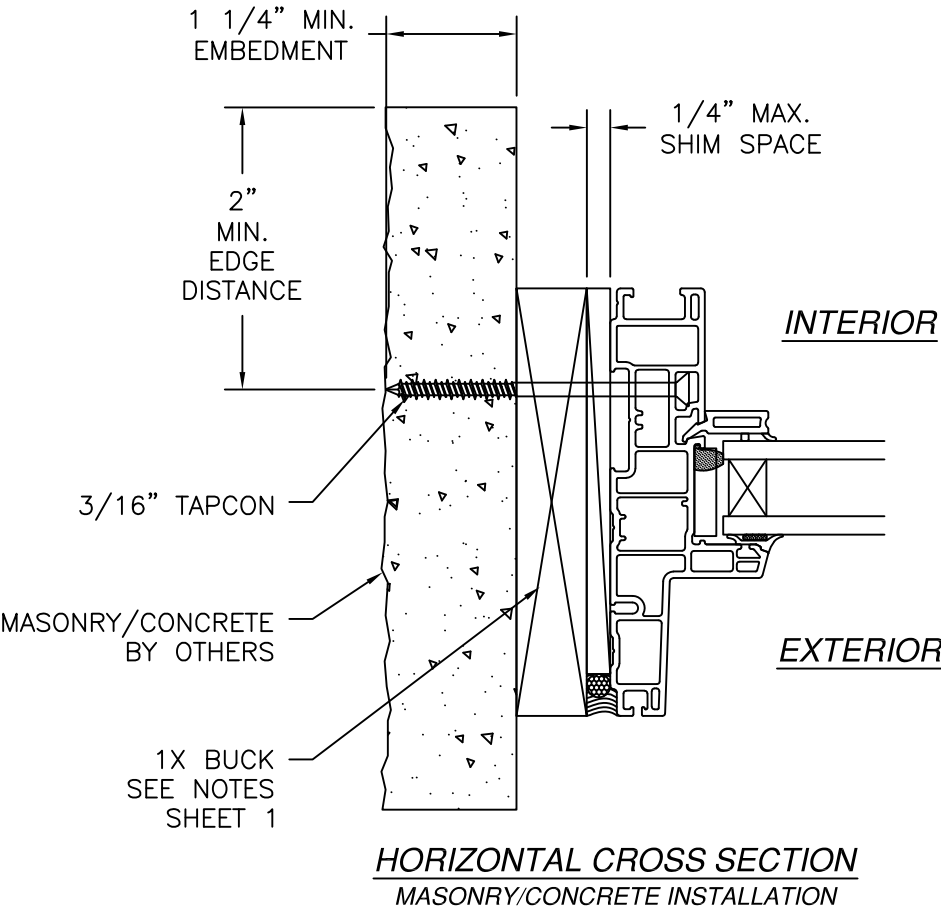

SIGNED: 09/28/2026

PROVIA DOOR, INC

2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

S-4200 PRESTIGE PVC FIXED WINDOW
NON-IMPACT

INSTALLATION DETAILS

DRAWN: V.L.

DWG NO. 08-00671C

REV C

SCALE NTS


DATE 07/05/11

SHEET 5 OF 5

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

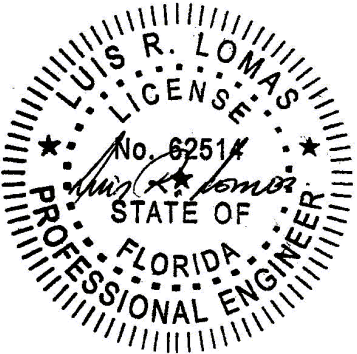

Luis R. Lomas P.E.
FL No.: 62514