

Z:\2023 FBC Drawings\Metal Mfg Industries\FL-12186 R4\12186.1-8.dwg




PRIV. DE RIO SANTIAGO #30
COL. LA RAZA
SOLEDAD DE GRACIANO SANCHEZ
SAN LUIS POTOSI, C.P. 78433

"N" SERIES COMMERCIAL
STEEL DOOR w/ SIDELITE
IN SWING / OUT SWING
"NON-IMPACT"

GENERAL NOTES

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product is required to be protected with an impact resistant covering that complies with Section 1609.1.2 of the FBC and Section 1609.1.2.2 of the FBC.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.


TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical elevations, design pressures, & general notes
2	Door panel sections 161 lock prep
3	Horizontal cross sections
4	Vertical cross sections
5	Vertical cross sections
6	Vertical cross sections
7	Anchoring details
8	Glazing detail & components
9	Bill of materials & components

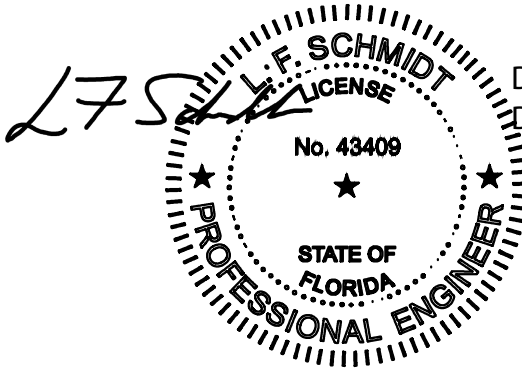

Digitally signed by Lyndon F Schmidt
Date: 2023.07.11 09:27:36 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

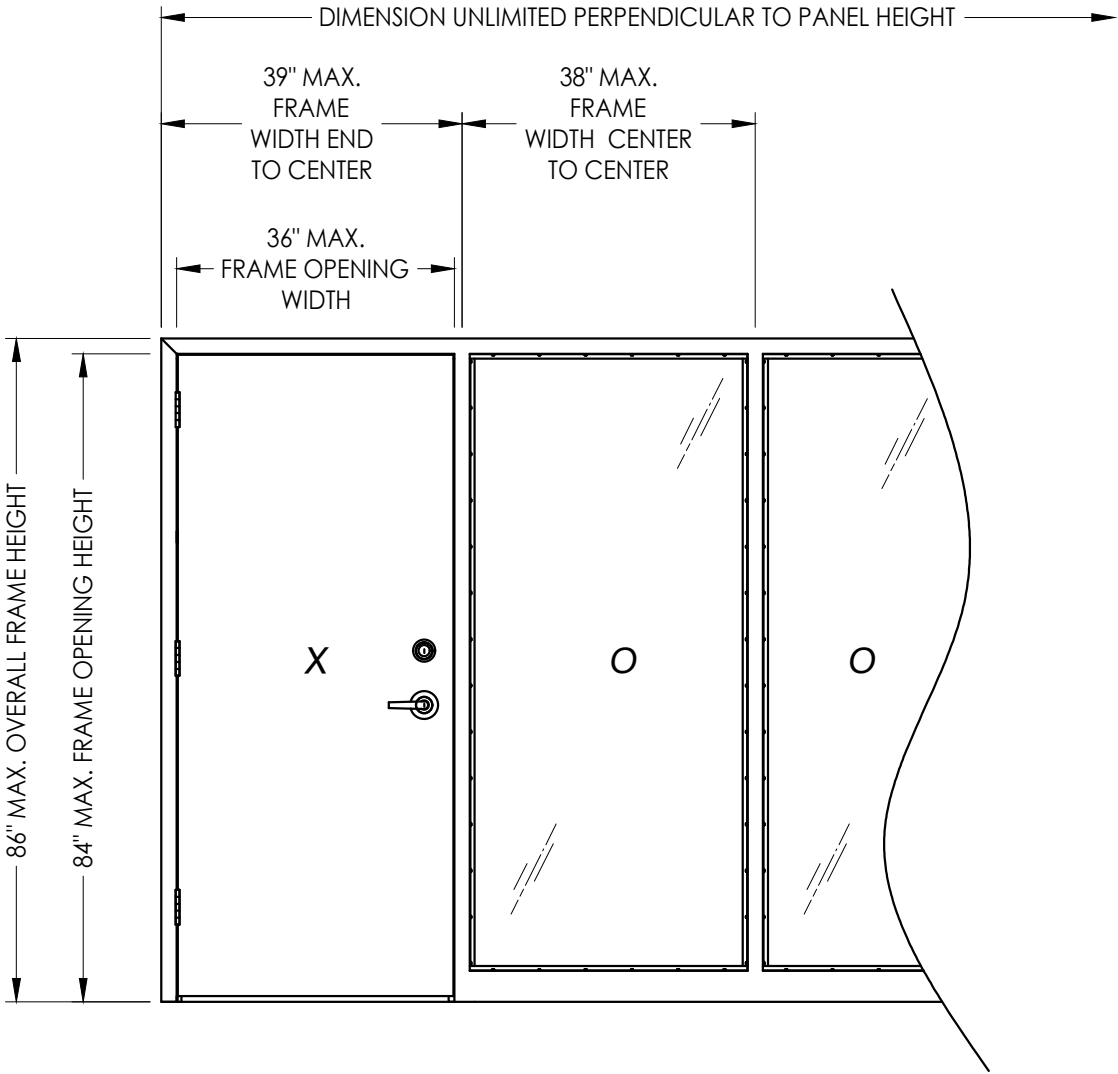

OVERALL FRAME DIMENSION	SIDELITE D.L.O. DIMENSION	LOCK TYPE	GLASS TYPE	DESIGN PRESSURE (PSF)	
				POSITIVE	NEGATIVE
39" x 86"	34.75" x 78.75"	161 LATCH (SCHLAGE)	G1	+55.0	-55.0
		161 LATCH & DEADBOLT (DESIGN HARDWARE)		+65.0	-65.0

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
MMI
"N" STEEL DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATIONS, DESIGN
PRESSURES & GENERAL NOTES

DATE: 11/3/08

SCALE: N.T.S.

DWG. BY: AL

CHK. BY: LFS

DRAWING NO.: FL-12186.2

SHEET 1 OF 9


REVISIONS

NO.	DATE	BY
4	7/11/23	LFS
3	7/30/20	DAC
2	7/18/17	LFS
1	10/14/16	JK

© 2008 R.W. BUILDING CONSULTANTS INC.

BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813





Z:\2023 FBC Drawings\Metal Mfg Industries\FL-12186 R4\12186.1-8.dwg

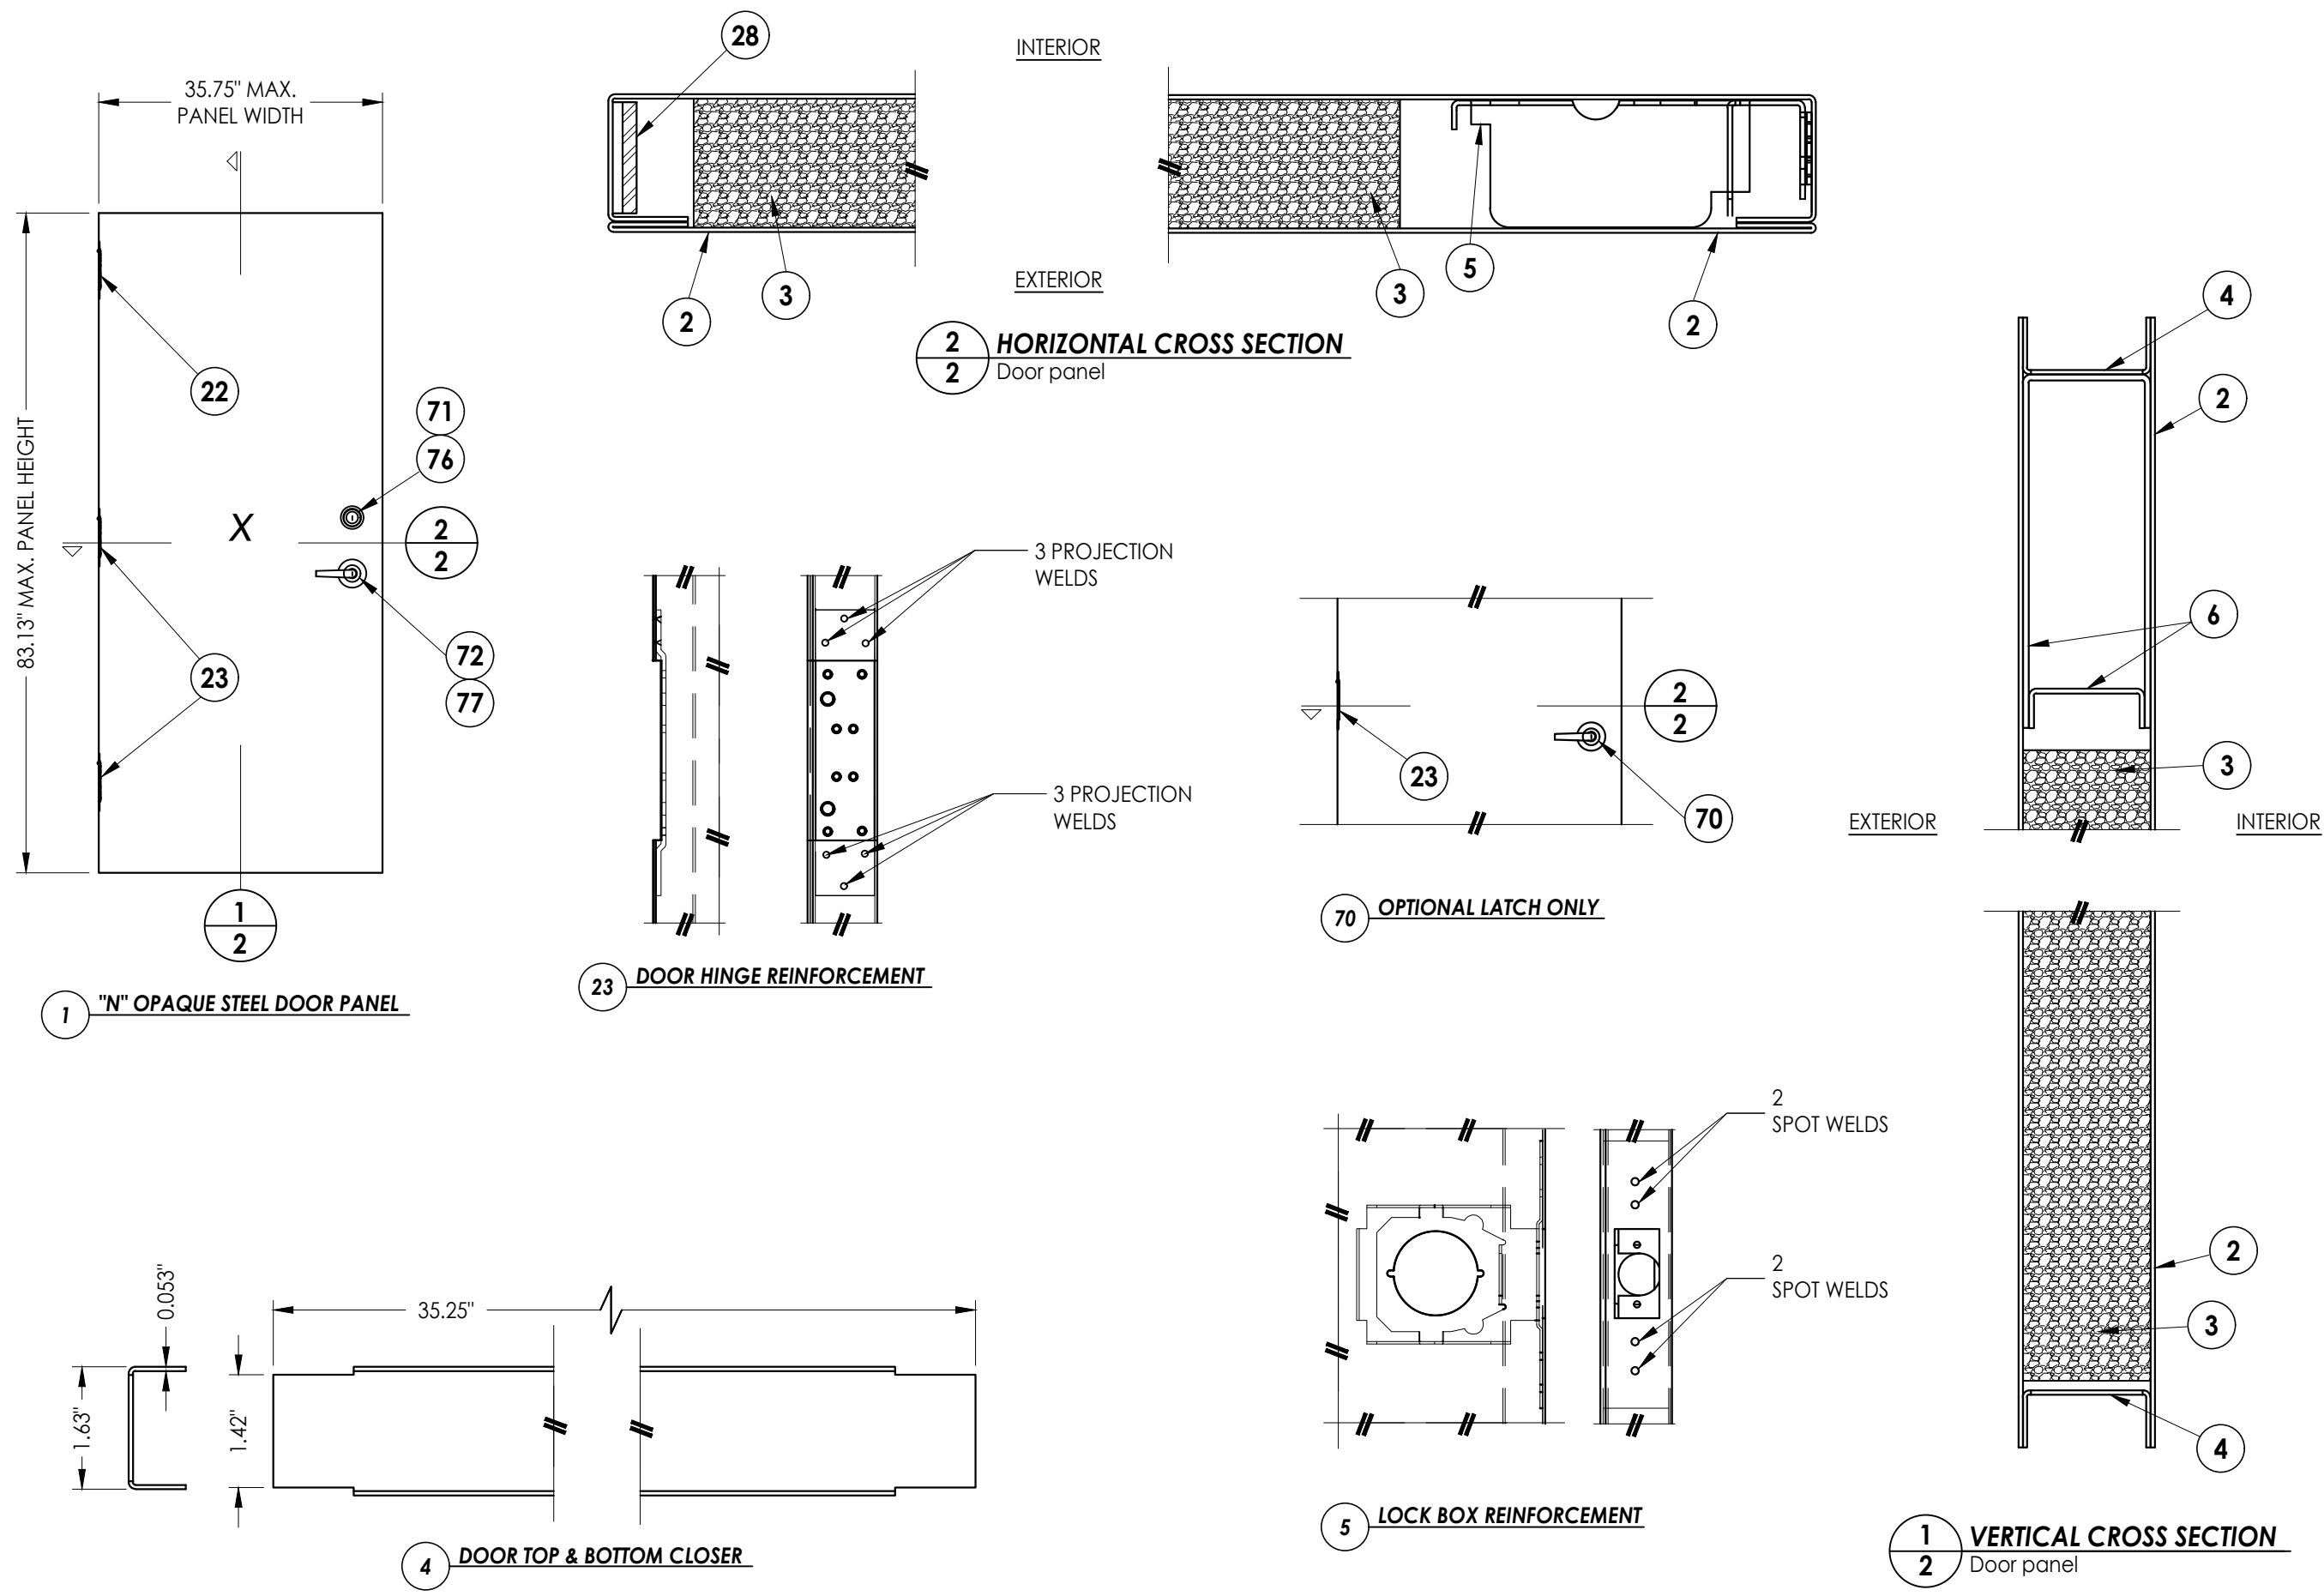

NOTE: ALL WELDING TO CONFORM w/ AMERICAN WELDING SOCIETY, ANSI/AWS AS PER FBC SECTION 2214.3.4.

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT:		MMI "N" STEEL DOOR		PART OR ASSEMBLY: DOOR PANEL SECTIONS 161 LOCK PREP			
			LFS	FBC			
			DAC	FBC			
			LFS	FBC			
			JK	FBC			
			BY				
				REVISIONS			
4	7/11/23	UPDATE TO 8TH ED. (2023)	FBC				
3	7/30/20	UPDATE TO 7th ED. (2020)	FBC				
2	7/18/17	UPDATE TO 6TH ED. (2017)	FBC				
1	10/14/16	UPDATE TO 5TH ED. (2014)	FBC				
	NO.	DATE					
DATE: 11/3/08							
SCALE: N.T.S.							
DWG. BY: AL							
CHK. BY: LFS							
DRAWING NO.: FL-12186.2							
SHEET 2 OF 9							

Z:\2023 FBC Drawings\Metal Mfg Industries\FL-12186 R4\12186.1-8.dwg

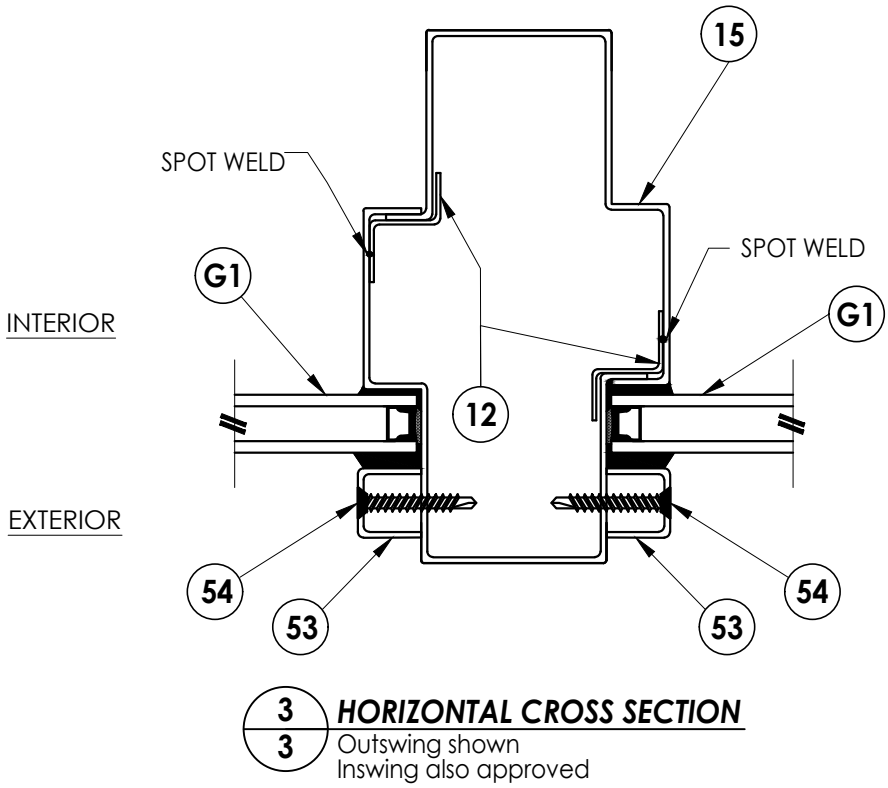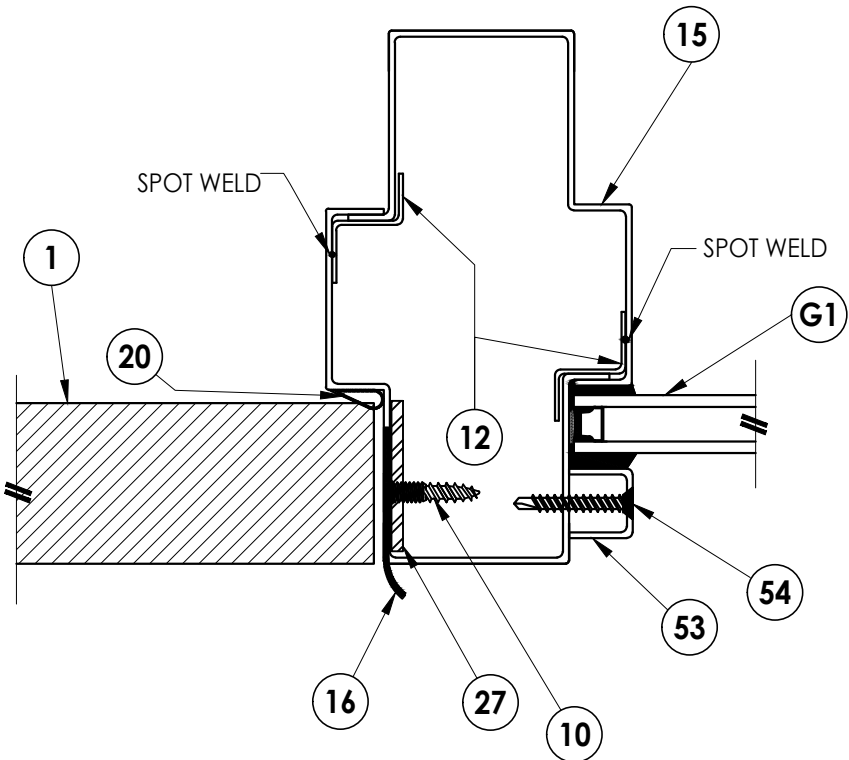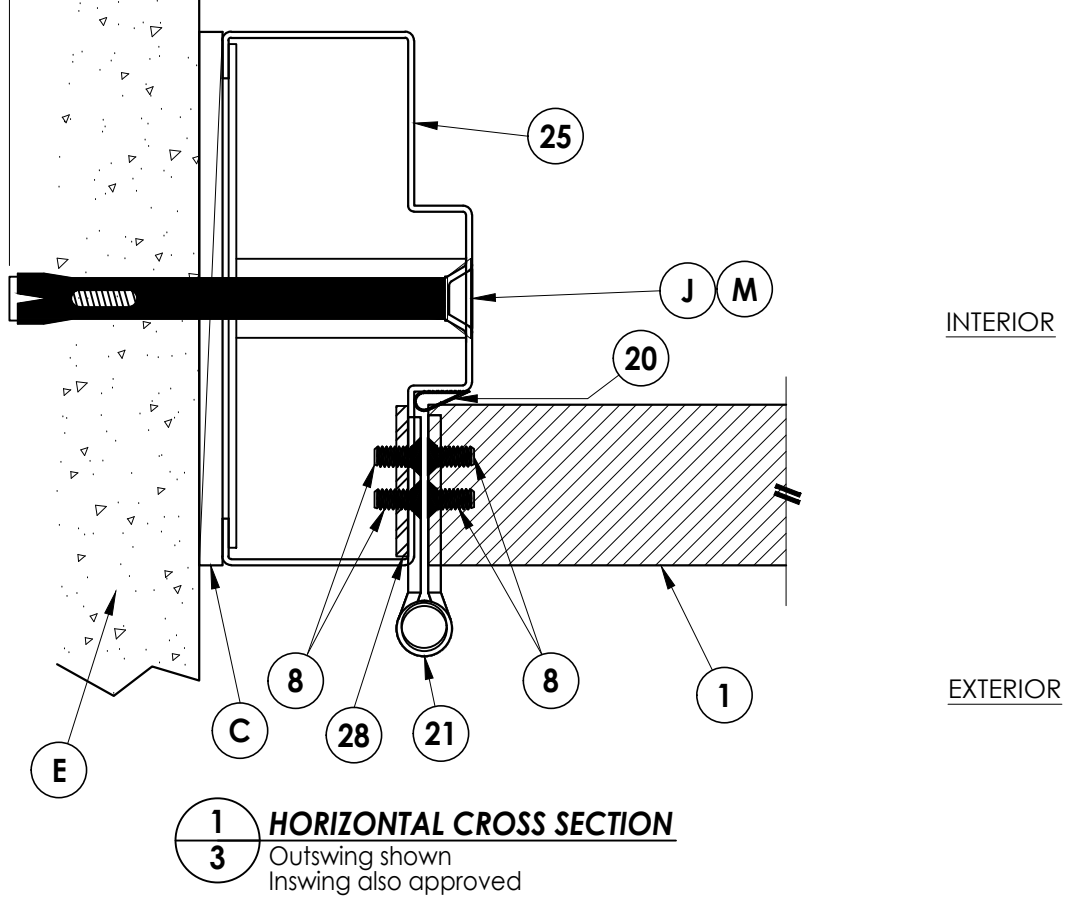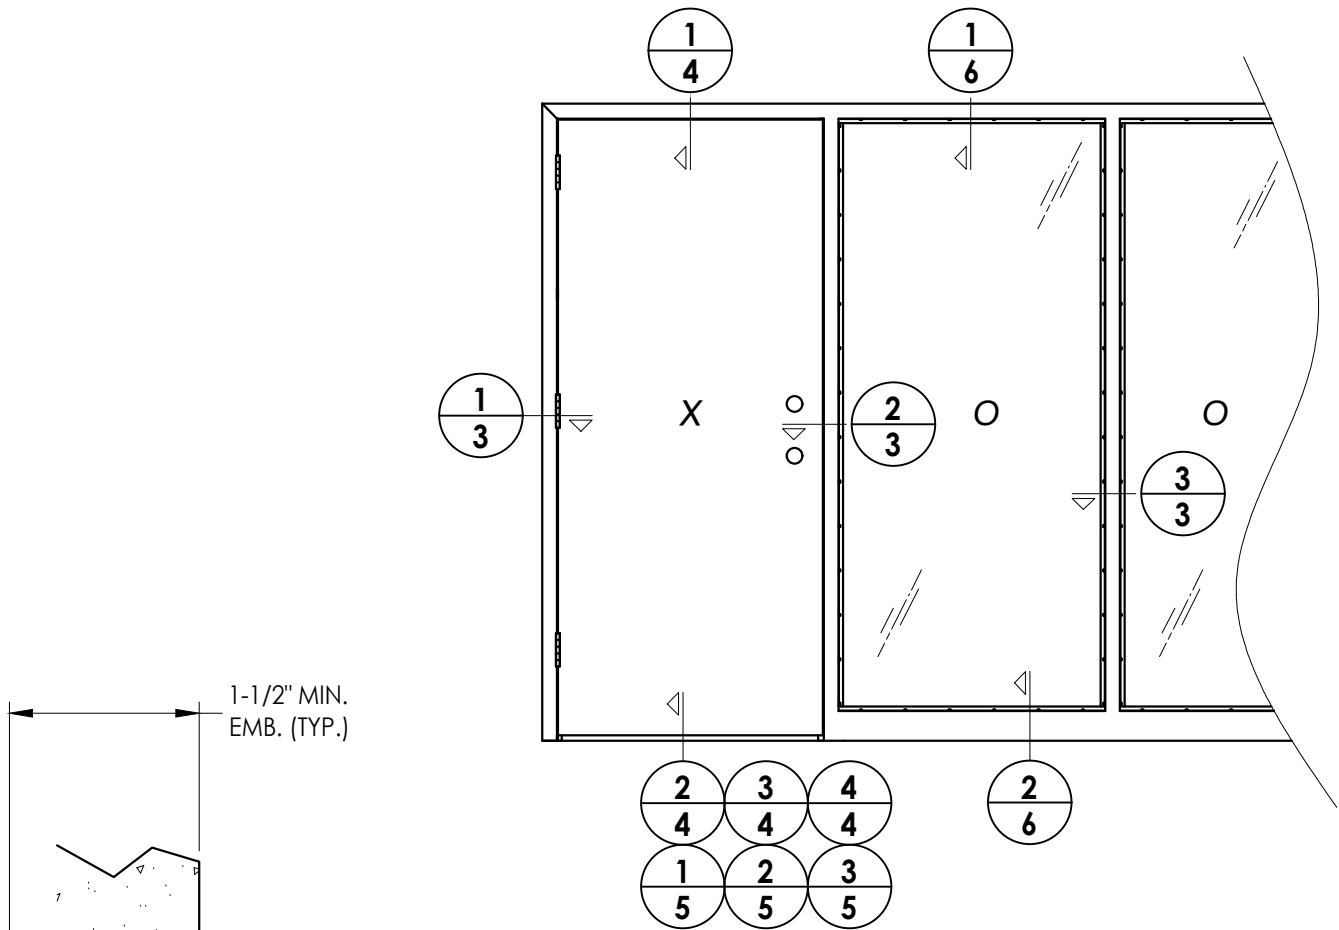

DATE: 11/3/08	
SCALE: N.T.S.	
DWG. BY: AL	
CHK. BY: LFS	
DRAWING NO.: FL-12186.2	
SHEET 3 OF 9	

PRODUCT: MMI "N" STEEL DOOR	
PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS	

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409	
R.W. BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	



VERTICAL CROSS SECTION



VERTICAL CROSS SECTION



VERTICAL CROSS SECTION



VERTICAL CROSS SECTION


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R_W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:	MMI
PART OR ASSEMBLY:	"N" STEEL DOOR
	VERTICAL CROSS SECTIONS


4	7/11/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS
3	7/30/20	UPDATE TO 7th ED.	(2020)	FBC	DAC
2	7/18/17	UPDATE TO 6TH ED.	(2017)	FBC	LFS
1	10/14/16	UPDATE TO 5TH ED.	(2014)	FBC	JK
NO.	DATE				
					REVISIONS

DATE:	11/3/08
SCALE:	N.T.S.
DWG. BY:	AL
CHK. BY:	LFS
DRAWING NO.:	FL-12186.2
SHEET	4 OF 9

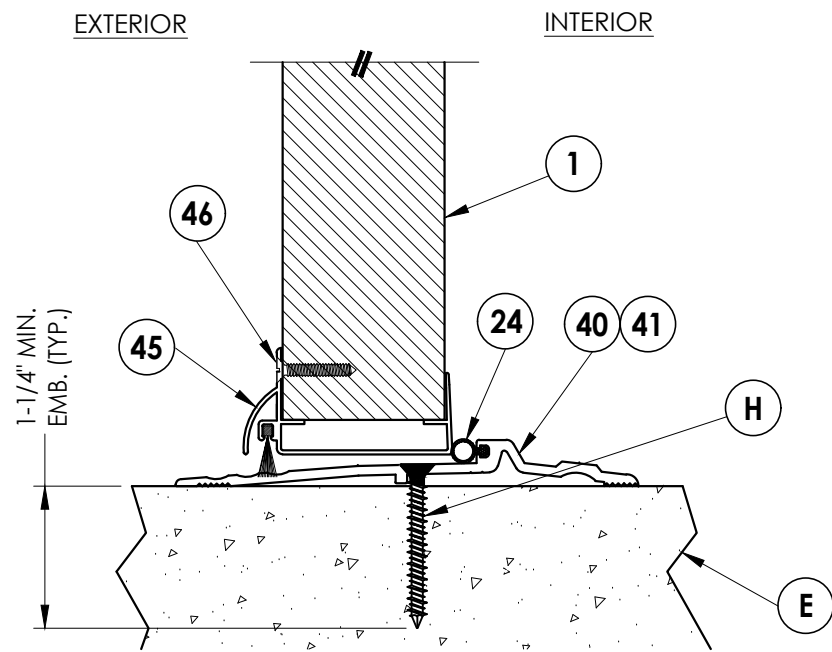


1 VERTICAL CROSS SECTION

5 Outswing shown

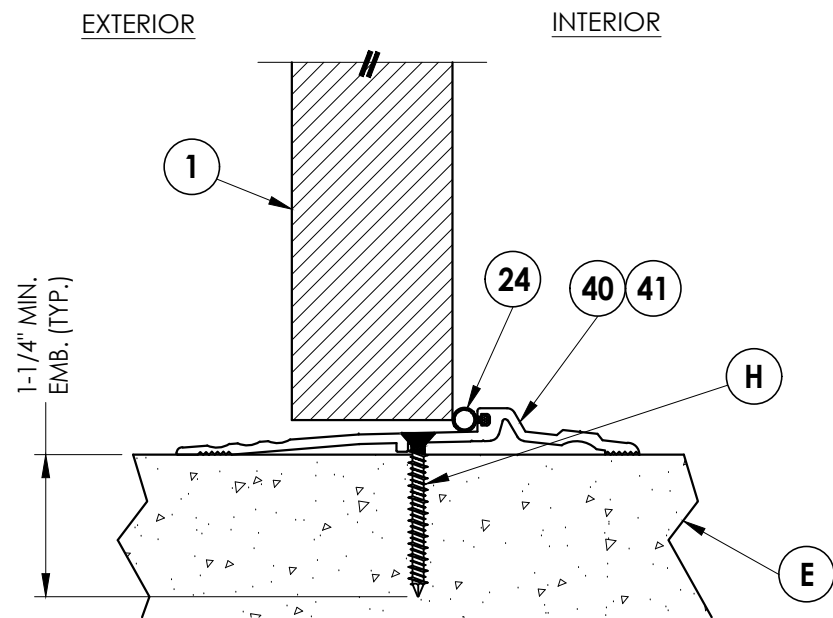

2 **VERTICAL CROSS SECTION**
5 Outswing shown

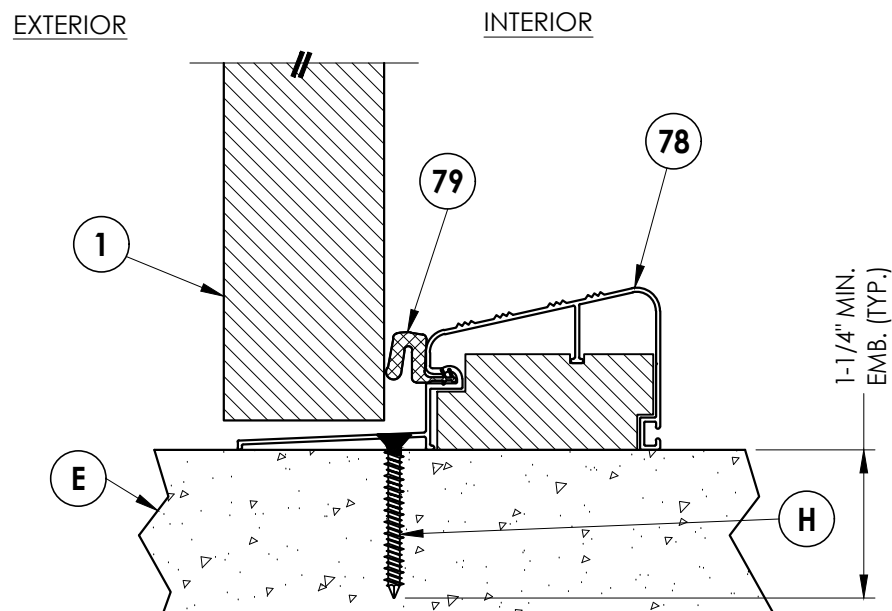


3 VERTICAL CROSS SECTION
5 Outswing shown


4	7/11/23	UPDATE TO 8TH ED. (2023)	FBC	LFS		
3	7/30/20	UPDATE TO 7th ED. (2020)	FBC	DAC		
2	7/18/17	UPDATE TO 6TH ED. (2017)	FBC	LFS		
1	10/14/16	UPDATE TO 5TH ED. (2014)	FBC	JK		
NO.	DATE					BY
REVISIONS						
DATE: 11/3/08						
SCALE: N.T.S.						
DWG. BY: AL						
CHK. BY: LFS						
DRAWING NO.: FL-12186.2						
SHEET 5 OF 9						

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

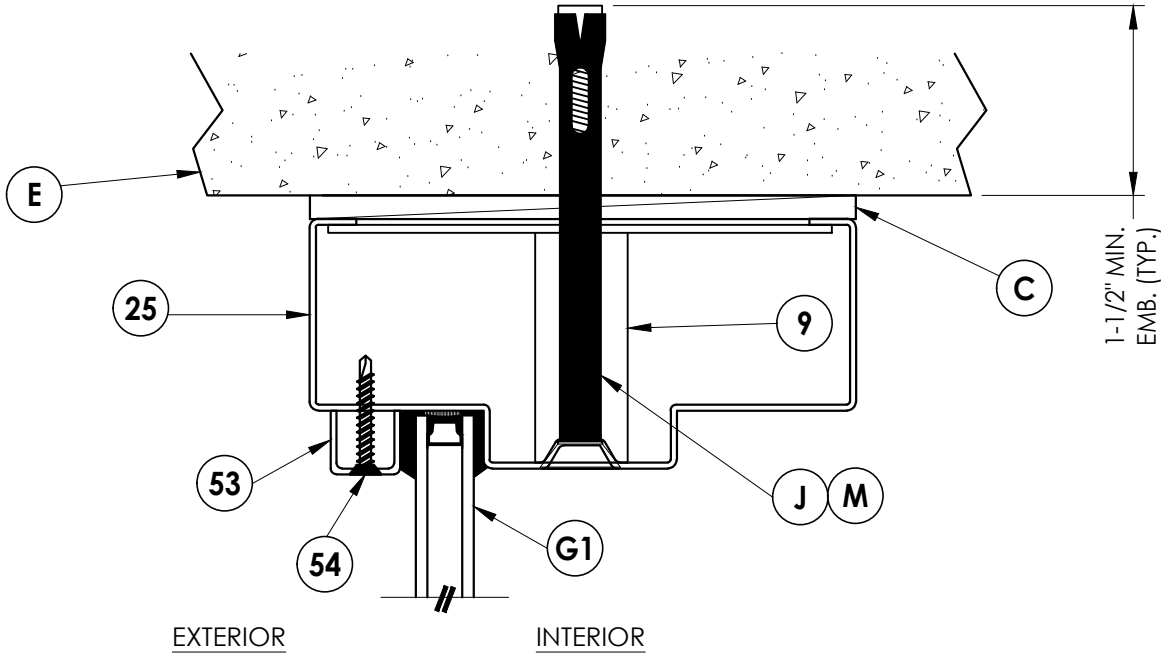

1
6
VERTICAL CROSS SECTION

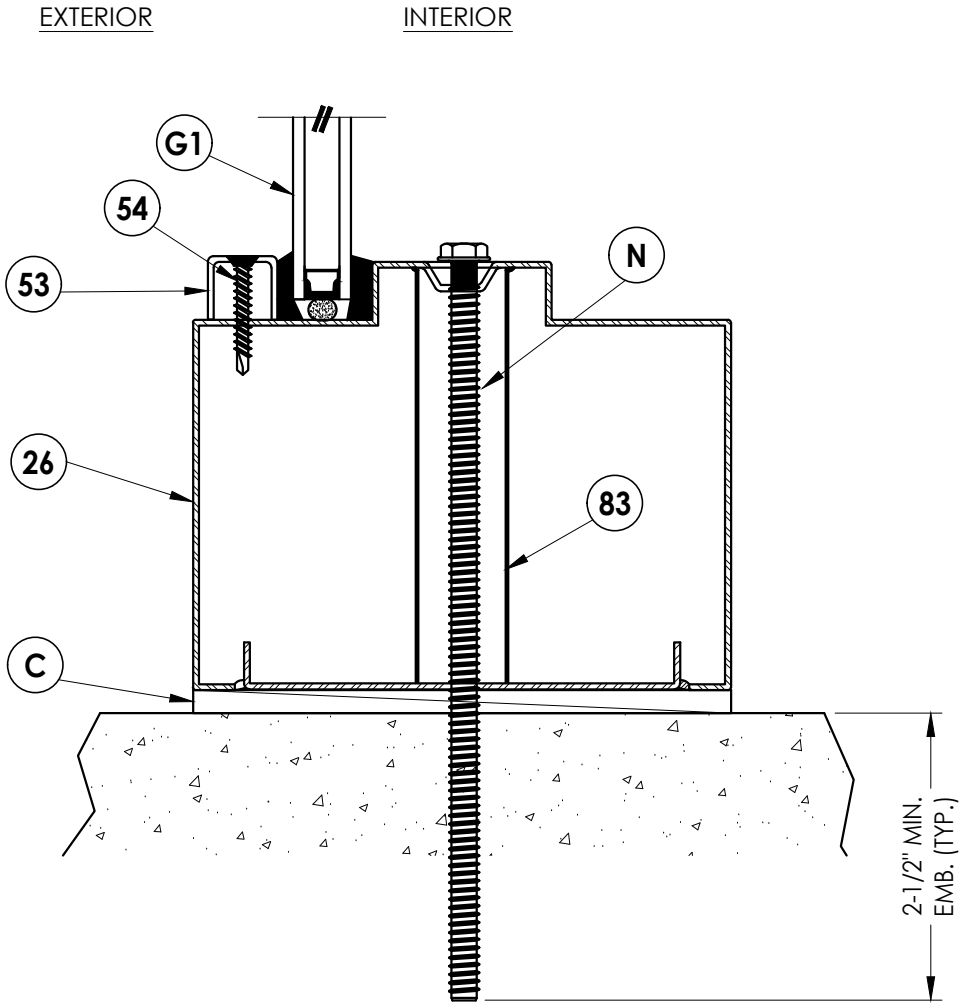


2
6
VERTICAL CROSS SECTION

DATE:		11/3/08	
SCALE:		N.T.S.	
DWG. BY:		AL	
CHK. BY:		LFS	
DRAWING NO.:		FL-12186.2	
SHEET		6 OF 9	

PRODUCT:		MMI "N" STEEL DOOR	
PART OR ASSEMBLY:		VERTICAL CROSS SECTIONS	

Documents Prepared By:		Lyndon F. Schmidt P.E. No. 43409	
R.W.		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	

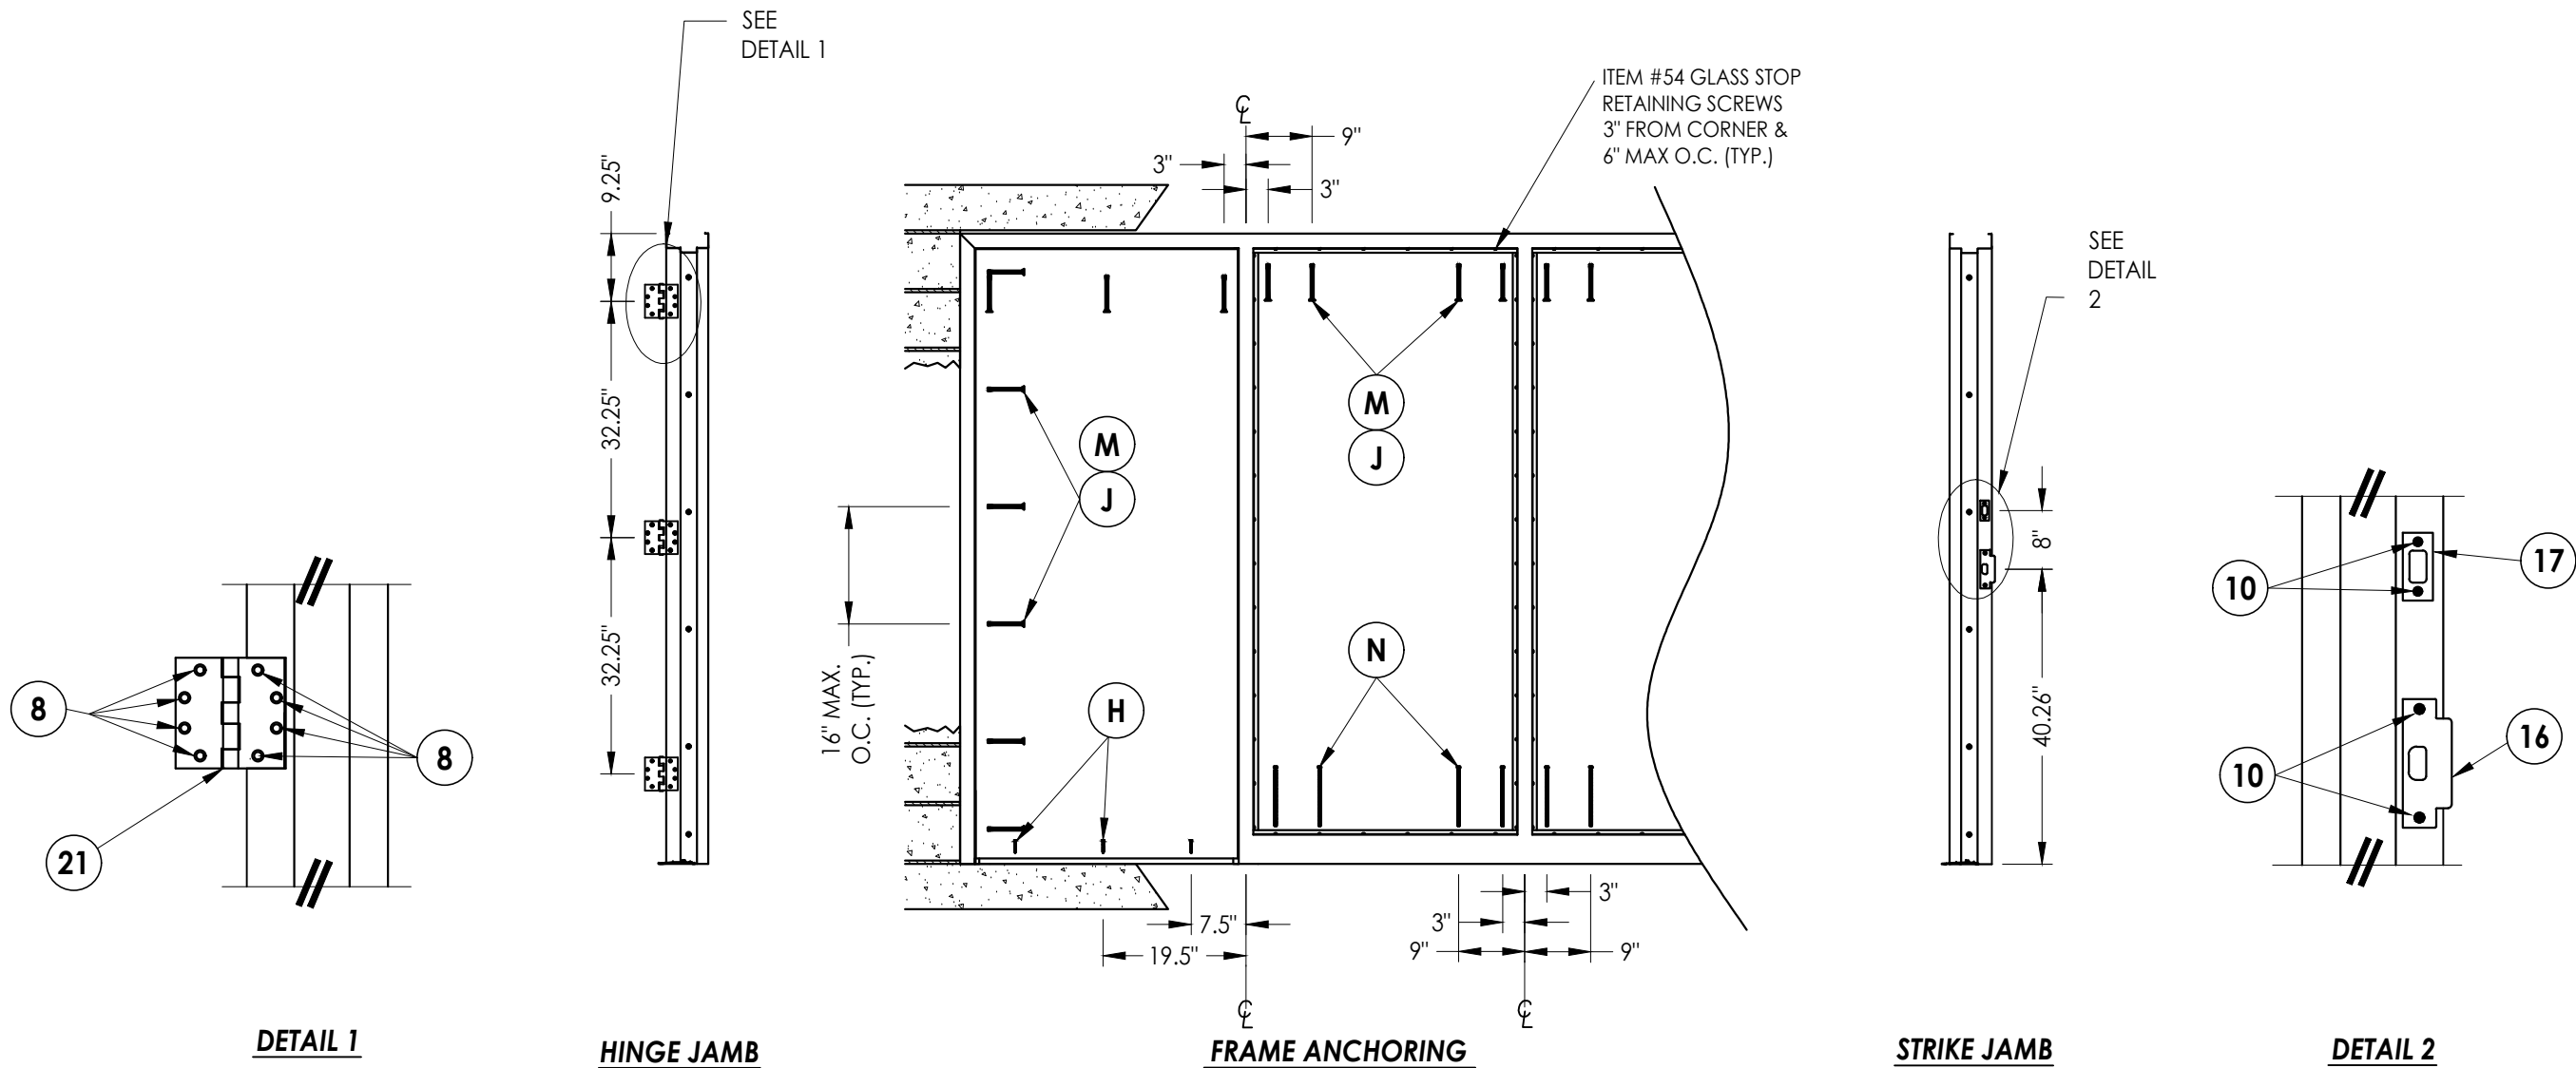

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2-1/2"	4"
DYNABOLT SLEEVE ANCHOR	3/8"	1-1/2"	2-1/4"	4-1/2"
TAPPER	3/8"	1-1/2"	4-1/4"	6"
SCREW-BOLT+™	1/2"	2-1/2"	6"	6"

4. Embedment may be through 1-1/4" face shell of hollow block.

[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 333
Phone No.: 813.659.9197
FBPE Registry No. 9813

BILL OF MATERIALS					
ITEM	DESCRIPTION	MATERIAL	ITEM	DESCRIPTION	MATERIAL
C	MAX. 1/4" SHIM SPACE	-	23	STANDARD (SHORT) DOOR HINGE MIDDLE BOTTOM REINFORCEMENT	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE	24	WEATHER STRIP (THRESHOLD)	NEOPRENE
			25	FRAME 5-3/4" X 2" MIN. (0.056" THK) BY MMI	STEEL
H	1/4" x 1-3/4" ITW PFH CONCRETE SCREW	STEEL	26	FRAME SILL 5-3/4" X 4" MIN. (0.056" THK) BY MMI	STEEL
J	3/8" X 5" PFH ITW DYNABOLT SLEEVE ANCHOR	STEEL	27	LATCH STRIKE REINFORCEMENT	STEEL
M	3/8" X 5" TAPPER CONCRETE SCREW BY POWERS FASTENERS	STEEL	28	FRAME HINGE REINFORCEMENT	STEEL
N	1/2" X 8" HH SCREW-BOLT+ CONC. ANCHOR (DeWALT/POWERS)	STEEL	29	COLUMBIA DOOR BOTTOM SWEEP #2580	ALUMINUM
1	"N" OPAQUE STEEL DOOR PANEL	-	40	THRESHOLD NATIONAL GUARD PRODUCTS, INC. #896	ALUMINUM
2	DOOR SKIN (0.042" THK. STEEL, Fy = 40,300 PSI MIN.)	STEEL	41	THRESHOLD NATIONAL GUARD PRODUCTS, INC. #950	ALUMINUM
3	FOAM 1.0 PCF MIN. DENSITY	POLYSTYRENE	45	95WHA DOOR SWEEP NATIONAL GUARD PRODUCTS, INC.	ALUMINUM
4	DOOR TOP & BOTTOM CLOSER	STEEL	46	#6 X 3/4" PHILIPS HEAD SMS	STEEL
5	LOCK BOX REINFORCEMENT	STEEL	53	U-CHANNEL GLASS STOP	STEEL
6	CLOSER REINFORCEMENT	STEEL	54	#8 X 1.25" PFH SMS	STEEL
8	#12-24 x 1/2" SELF TAPPER	STEEL	70	SCHLAGE LOCK SET ASSEMBLY ND53PD	STEEL
9	TUBE ANCHOR	STEEL	71	DESIGN HARDWARE D1-S SERIES DEADBOLT	STEEL
10	#12-24 x 1.0" COMBINATION MACHINE / WOOD SCREW	STEEL	72	DESIGN HARDWARE "Z" SERIES ENTRY	STEEL
12	MULLION Z BRACKET	STEEL	76	DESIGN HARDWARE D2-S SERIES DEADBOLT	STEEL
14	COLUMBIA ADA THRESHOLD #6510	ALUMINUM	77	DESIGN HARDWARE "X" SERIES ENTRY	STEEL
15	MULLION MIN. (0.056" THK) BY MMI	STEEL	78	OUTSWING THRESHOLD QOSH BY DLP	ALUM/WOOD
16	ANSI LATCH STRIKE	STEEL	79	WEATHER-STRIP	FOAM
17	DEADBOLT STRIKE	STEEL	81	DOW 995 STRUCTURAL SILICONE	SILICONE
19	DEADBOLT STRIKE REINFORCEMENT	STEEL	82	GLASS SPACER	ALUMINUM
20	WEATHER-STRIP	NEOPRENE	83	SILL TUBE ANCHOR	STEEL
21	4-1/2" X 4-1/2" X 0.125" TEMPLATE HINGE	STEEL			
22	STANDARD (LONG) DOOR HINGE TOP HINGE REINFORCEMENT	STEEL			

