

| REVISIONS |                              |            |          |
|-----------|------------------------------|------------|----------|
| REV       | DESCRIPTION                  | DATE       | APPROVED |
| C         | REVISED PER NEW REQUIREMENTS | 12/04/2023 | R.L.     |

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.

2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.

3. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.

4. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.

5. ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.

6. FRAME MATERIAL: ALUMINUM 6063-T6, 6063-T5 AND 6005A-T5.

7. UNITS MUST BE GLAZED PER ASTM E1300, WITH SAFETY GLAZING.

8. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.

9. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8".
10. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #14 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

11. FOR ANCHORING INTO MASONRY/CONCRETE USE 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

12. FOR ANCHORING INTO METAL STRUCTURE USE #14 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

13. ALL FASTENERS TO BE CORROSION RESISTANT.

14. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

14.1. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42

14.2. CONCRETE – MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI.

14.3. MASONRY – STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).

14.4. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 .125" THICK MINIMUM

SIGNED: 12/12/2023

| TABLE OF CONTENTS |                                           |
|-------------------|-------------------------------------------|
| SHEET NO.         | DESCRIPTION                               |
| 1                 | NOTES                                     |
| 2                 | ELEVATION                                 |
| 3                 | ANCHORING LAYOUT & DESIGN PRESSURE CHARTS |
| 4 – 8             | CROSS SECTIONS                            |
| 9 – 11            | INSTALLATION DETAILS                      |
| 12                | WEEP DETAILS                              |
| 13                | COMPONENTS                                |

SOLAR INNOVATIONS, INC.

31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 FGW 3X8 PANEL 90° CORNER  
NO POST INFOLD-NON IMPACT  
NOTES

DRAWN:  
J.L.

DWG NO.  
08-01959


REV  
C

SCALE NTS

DATE 04/19/13


SHEET 1 OF 13

L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

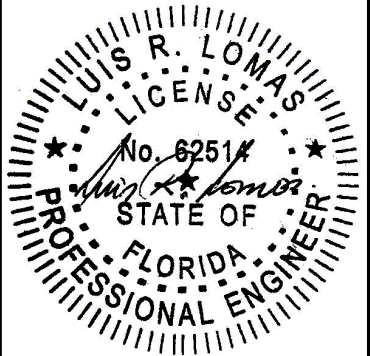

Luis R. Lomas P.E.  
FL No.: 62514

| REVISIONS |                              |            |          |
|-----------|------------------------------|------------|----------|
| REV       | DESCRIPTION                  | DATE       | APPROVED |
| C         | REVISED PER NEW REQUIREMENTS | 12/04/2023 | R.L.     |

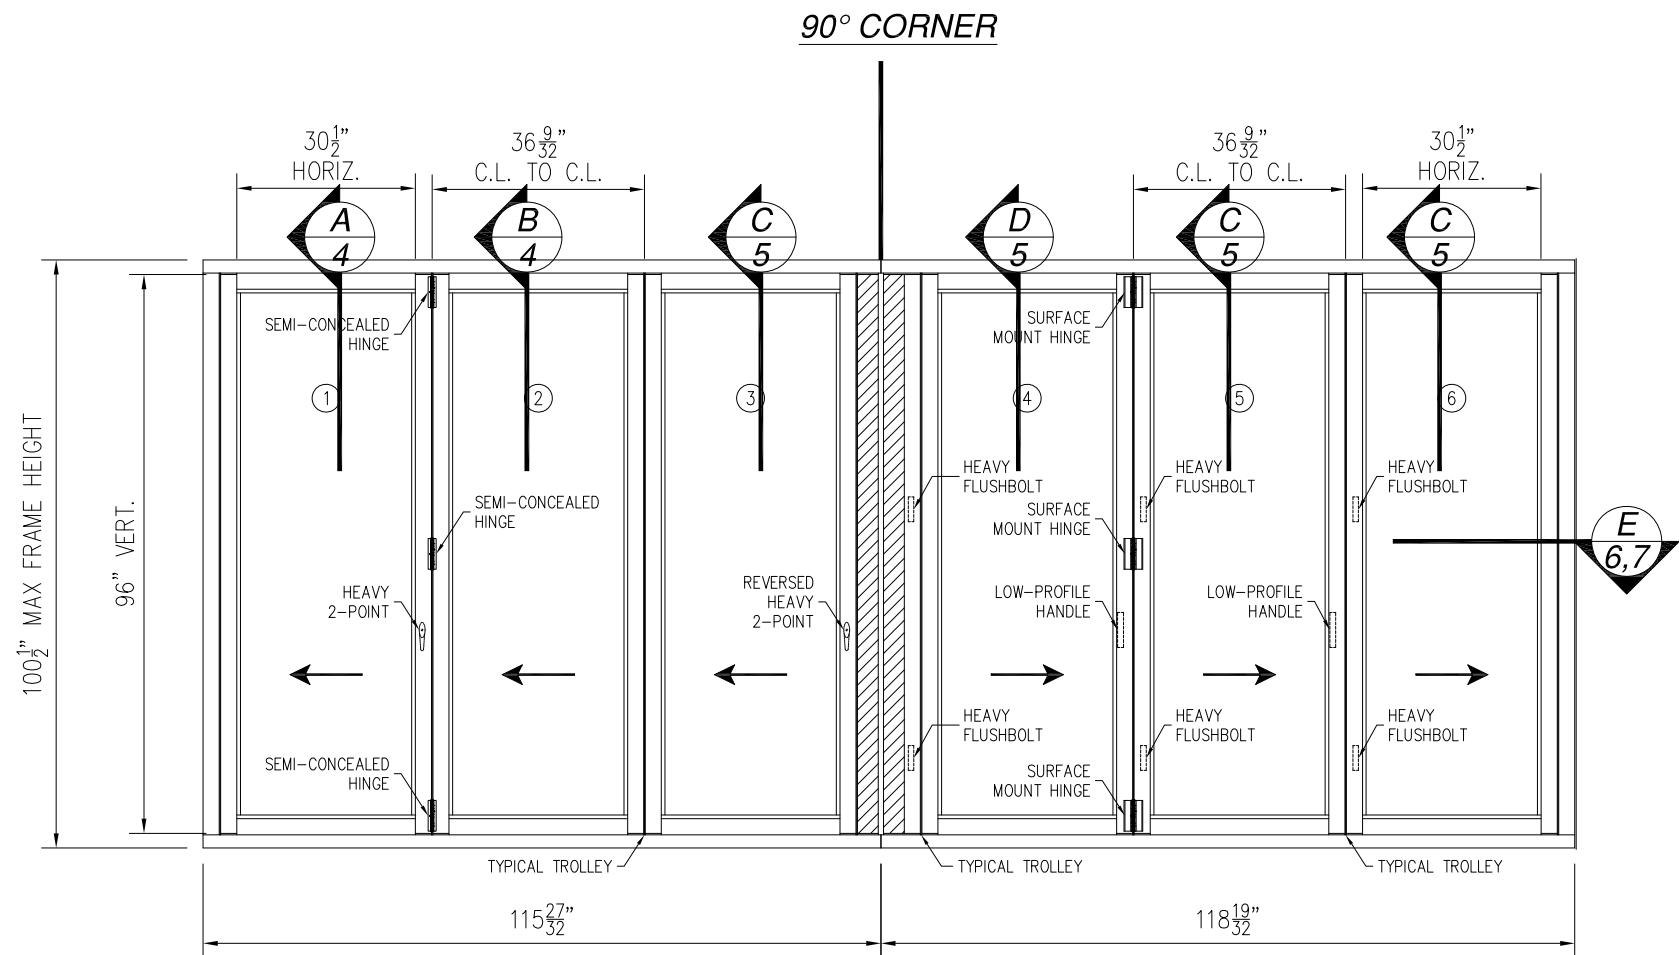

**SERIES SI3000 FGW 3X8 PANEL 90° CORNER NO POST INFOLD**

**EXTERIOR VIEW**

UNLIMITED NUMBER OF PANELS IN UNLIMITED CONFIGURATION ARE APPROVED  
AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 24.06 FT<sup>2</sup> AND USES VERTICAL CONDITIONS AS SHOWN.

| DESIGN PRESSURE RATING | IMPACT RATING |
|------------------------|---------------|
| +60.0/-80.0PSF         | NONE          |

WHERE WATER RESISTANCE IS REQUIRED  
SEE CHART #1 SHEET 3

| DESIGN PRESSURE RATING | IMPACT RATING |
|------------------------|---------------|
| ±80.0PSF               | NONE          |


WHERE WATER RESISTANCE IS NOT REQUIRED  
SEE CHART #2 SHEET 3

| DESIGN PRESSURE RATING | IMPACT RATING |
|------------------------|---------------|
| +60.0/-70.0PSF         | NONE          |

WITH FLUSH SILL  
SEE CHART #3 SHEET 3

**HARDWARE SCHEDULE**

|                                                          |
|----------------------------------------------------------|
| A. SEMI- CONCEALED HINGE BY SOLAR INNOVATIONS            |
| B 2 POINT HANDLE & LOCK MS000487-XX BY SOLAR INNOVATIONS |
| C HEAVY FLUSH BOLTS MS000442-00-XX BY SOLAR INNOVATIONS  |

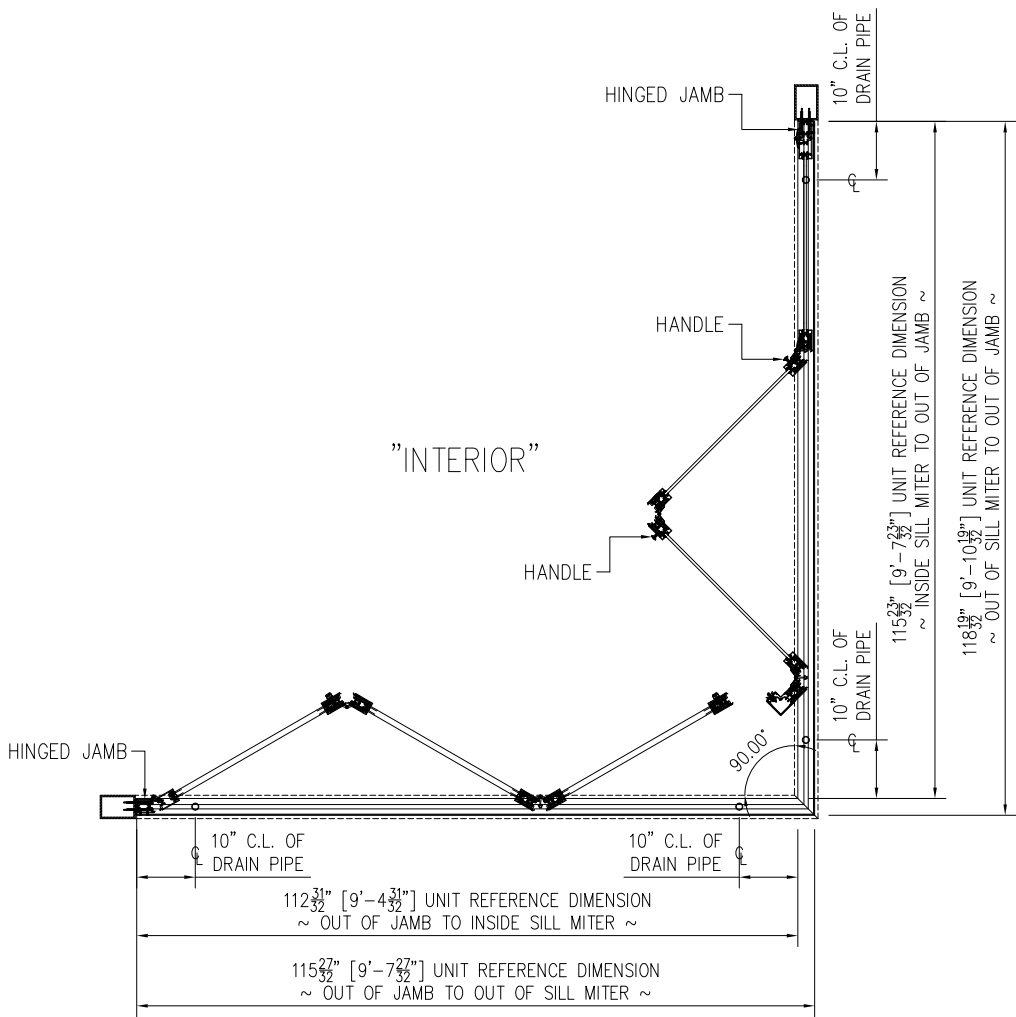

**SERIES SI3000 FGW 3X8 PANEL 90° CORNER NO POST INFOLD**

**PLAN VIEW**

SIGNED: 12/12/2023


SOLAR INNOVATIONS, INC.

31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 FGW 3X8 PANEL 90° CORNER  
NO POST INFOLD-NON IMPACT  
ELEVATION

|                |                     |               |
|----------------|---------------------|---------------|
| DRAWN:<br>J.L. | DWG NO.<br>08-01959 | REV<br>C      |
| SCALE NTS      | DATE 04/19/13       | SHEET 2 OF 13 |

L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@rlomaspe.com

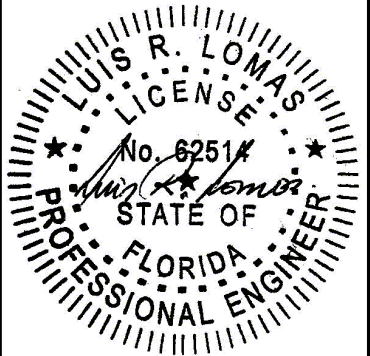

Luis R. Lomas P.E.  
FL No.: 62514

| REVISIONS |                              |            |          |
|-----------|------------------------------|------------|----------|
| REV       | DESCRIPTION                  | DATE       | APPROVED |
| C         | REVISED PER NEW REQUIREMENTS | 12/04/2023 | R.L.     |

Chart # 1

| Panel Height (in) | Maximum Design pressure (psf) |       |      |       |        |      |      |      |      |      |
|-------------------|-------------------------------|-------|------|-------|--------|------|------|------|------|------|
|                   | Single Panel Width (in)       |       |      |       |        |      |      |      |      |      |
|                   | 24.0                          |       | 30.0 |       | 36.281 |      | 42.0 |      | 44.0 |      |
|                   | Pos                           | Neg   | Pos  | Neg   | Pos    | Neg  | Pos  | Neg  | Pos  | Neg  |
| 78.0              | 60.0                          | 120.0 | 60.0 | 119.1 | 60.0   | 98.5 | 60.0 | 85.1 | 60.0 | 81.2 |
| 84.0              | 60.0                          | 120.0 | 60.0 | 109.2 | 60.0   | 91.4 | -    | -    | -    | -    |
| 90.0              | 60.0                          | 120.0 | 60.0 | 100.4 | 60.0   | 85.3 | -    | -    | -    | -    |
| 96.0              | 60.0                          | 112.1 | 60.0 | 93.0  | 60.0   | 80.0 | -    | -    | -    | -    |
| 102.0             | 60.0                          | 97.3  | 60.0 | 78.8  | -      | -    | -    | -    | -    | -    |
| 108.0             | 60.0                          | 81.8  | 60.0 | 66.1  | -      | -    | -    | -    | -    | -    |
| 114.0             | 60.0                          | 69.4  | 56.1 | 56.1  | -      | -    | -    | -    | -    | -    |
| 120.0             | 59.4                          | 59.4  | -    | -     | -      | -    | -    | -    | -    | -    |
| 126.0             | 51.2                          | 51.2  | -    | -     | -      | -    | -    | -    | -    | -    |
| 132.0             | 44.5                          | 44.5  | -    | -     | -      | -    | -    | -    | -    | -    |
| 138.0             | 38.9                          | 38.9  | -    | -     | -      | -    | -    | -    | -    | -    |
| 144.0             | 34.2                          | 34.2  | -    | -     | -      | -    | -    | -    | -    | -    |

Chart # 2

| Panel Height (in) | Maximum Design pressure (psf) |       |       |       |        |      |      |      |      |      |
|-------------------|-------------------------------|-------|-------|-------|--------|------|------|------|------|------|
|                   | Single Panel Width (in)       |       |       |       |        |      |      |      |      |      |
|                   | 24.0                          |       | 30.0  |       | 36.281 |      | 42.0 |      | 44.0 |      |
|                   | Pos                           | Neg   | Pos   | Neg   | Pos    | Neg  | Pos  | Neg  | Pos  | Neg  |
| 78.0              | 120.0                         | 120.0 | 119.1 | 119.1 | 98.5   | 98.5 | 85.1 | 85.1 | 81.2 | 81.2 |
| 84.0              | 120.0                         | 120.0 | 109.2 | 109.2 | 91.4   | 91.4 | -    | -    | -    | -    |
| 90.0              | 120.0                         | 120.0 | 100.4 | 100.4 | 85.3   | 85.3 | -    | -    | -    | -    |
| 96.0              | 112.1                         | 112.1 | 93.0  | 93.0  | 80.0   | 80.0 | -    | -    | -    | -    |
| 102.0             | 97.3                          | 97.3  | 78.8  | 78.8  | -      | -    | -    | -    | -    | -    |
| 108.0             | 81.8                          | 81.8  | 66.1  | 66.1  | -      | -    | -    | -    | -    | -    |
| 114.0             | 69.4                          | 69.4  | 56.1  | 56.1  | -      | -    | -    | -    | -    | -    |
| 120.0             | 59.4                          | 59.4  | -     | -     | -      | -    | -    | -    | -    | -    |
| 126.0             | 51.2                          | 51.2  | -     | -     | -      | -    | -    | -    | -    | -    |
| 132.0             | 44.5                          | 44.5  | -     | -     | -      | -    | -    | -    | -    | -    |
| 138.0             | 38.9                          | 38.9  | -     | -     | -      | -    | -    | -    | -    | -    |
| 144.0             | 34.2                          | 34.2  | -     | -     | -      | -    | -    | -    | -    | -    |

SOLAR INNOVATIONS, INC.

31 ROBERTS RD  
PINE GROVE, PA 17963SERIES SI3000 FGW 3X8 PANEL 90° CORNER  
NO POST INFOLD-NON IMPACT  
ANCHORING LAYOUT AND DESIGN PRESSURE CHARTS

|                |                     |               |
|----------------|---------------------|---------------|
| DRAWN:<br>J.L. | DWG NO.<br>08-01959 | REV<br>C      |
| SCALE NTS      | DATE 04/19/13       | SHEET 3 OF 13 |

L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 12/12/2023





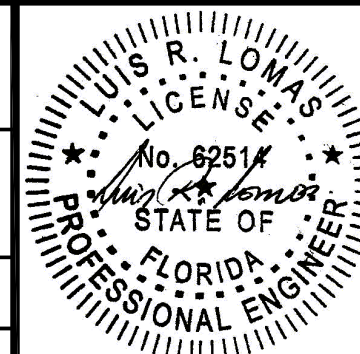
Luis R. Lomas P.E.  
FL No.: 62514ANCHOR LAYOUT  
APPLICABLE TO ALL CONFIGURATIONS.SILL AND HEAD  
CLUSTER DETAILSILL AND HEAD  
END DETAIL



Chart # 3

| Panel Height (in) | Maximum Design pressure (psf) |       |      |       |        |      |      |      |      |      |
|-------------------|-------------------------------|-------|------|-------|--------|------|------|------|------|------|
|                   | Single Panel Width (in)       |       |      |       |        |      |      |      |      |      |
|                   | 24.0                          |       | 30.0 |       | 36.281 |      | 42.0 |      | 44.0 |      |
|                   | Pos                           | Neg   | Pos  | Neg   | Pos    | Neg  | Pos  | Neg  | Pos  | Neg  |
| 78.0              | 60.0                          | 105.0 | 60.0 | 104.2 | 60.0   | 86.2 | 60.0 | 74.4 | 60.0 | 71.0 |
| 84.0              | 60.0                          | 105.0 | 60.0 | 95.5  | 60.0   | 80.0 | -    | -    | -    | -    |
| 90.0              | 60.0                          | 105.0 | 60.0 | 87.9  | 60.0   | 74.7 | -    | -    | -    | -    |
| 96.0              | 60.0                          | 98.1  | 60.0 | 81.4  | 60.0   | 70.0 | -    | -    | -    | -    |
| 102.0             | 60.0                          | 85.1  | 60.0 | 69.0  | -      | -    | -    | -    | -    | -    |
| 108.0             | 60.0                          | 71.5  | 57.9 | 57.9  | -      | -    | -    | -    | -    | -    |
| 114.0             | 60.0                          | 60.7  | 49.1 | 49.1  | -      | -    | -    | -    | -    | -    |
| 120.0             | 52.0                          | 52.0  | -    | -     | -      | -    | -    | -    | -    | -    |
| 126.0             | 44.8                          | 44.8  | -    | -     | -      | -    | -    | -    | -    | -    |
| 132.0             | 38.9                          | 38.9  | -    | -     | -      | -    | -    | -    | -    | -    |
| 138.0             | 34.0                          | 34.0  | -    | -     | -      | -    | -    | -    | -    | -    |
| 144.0             | 29.9                          | 29.9  | -    | -     | -      | -    | -    | -    | -    | -    |



| REVISIONS |                              |            |          |
|-----------|------------------------------|------------|----------|
| REV       | DESCRIPTION                  | DATE       | APPROVED |
| C         | REVISED PER NEW REQUIREMENTS | 12/04/2023 | R.L.     |

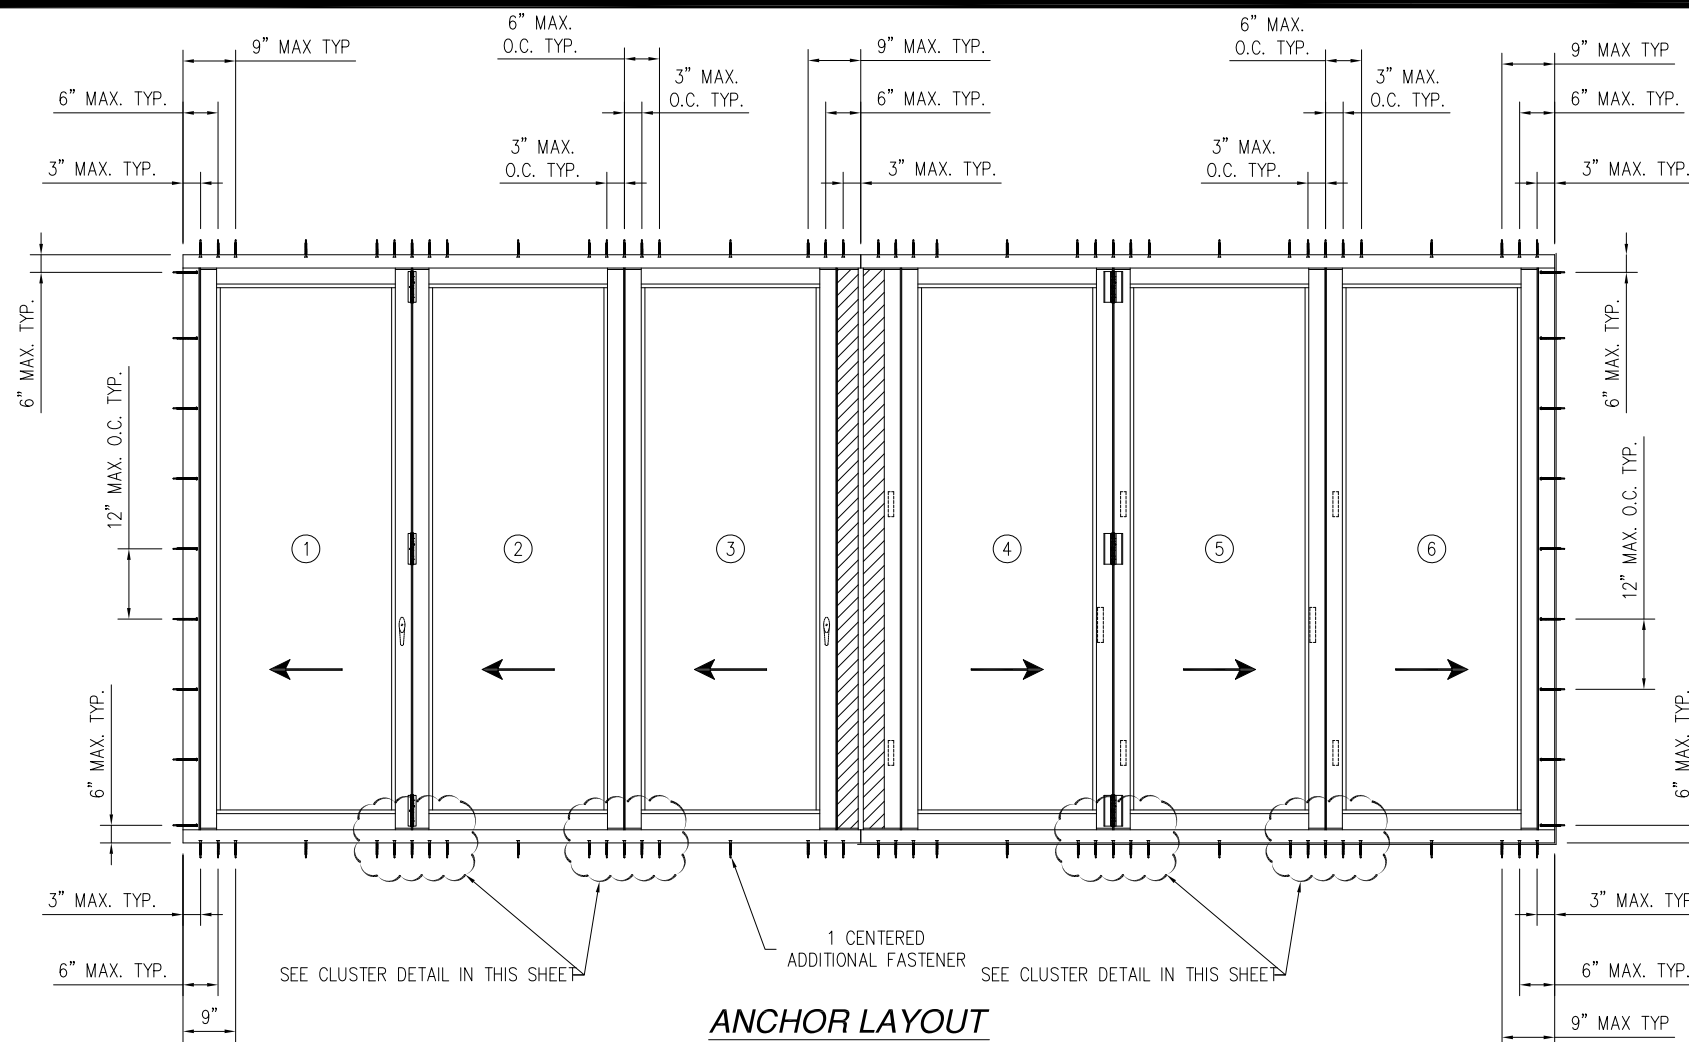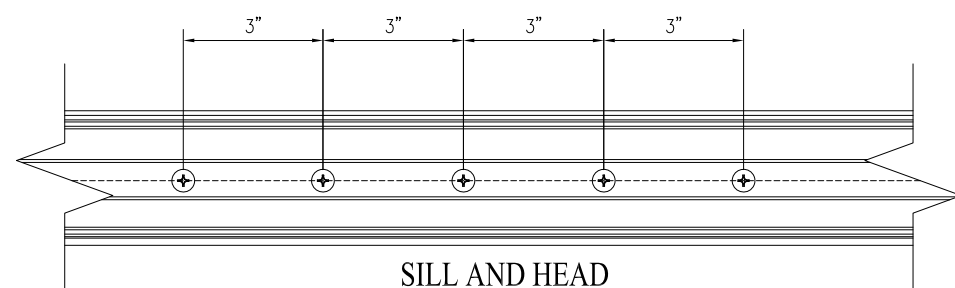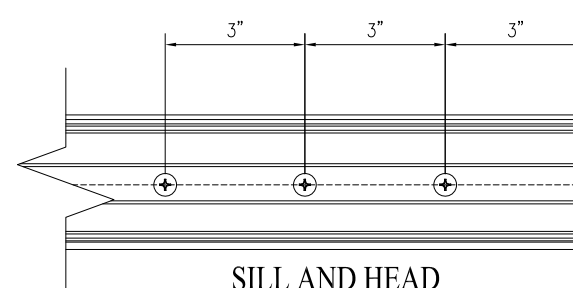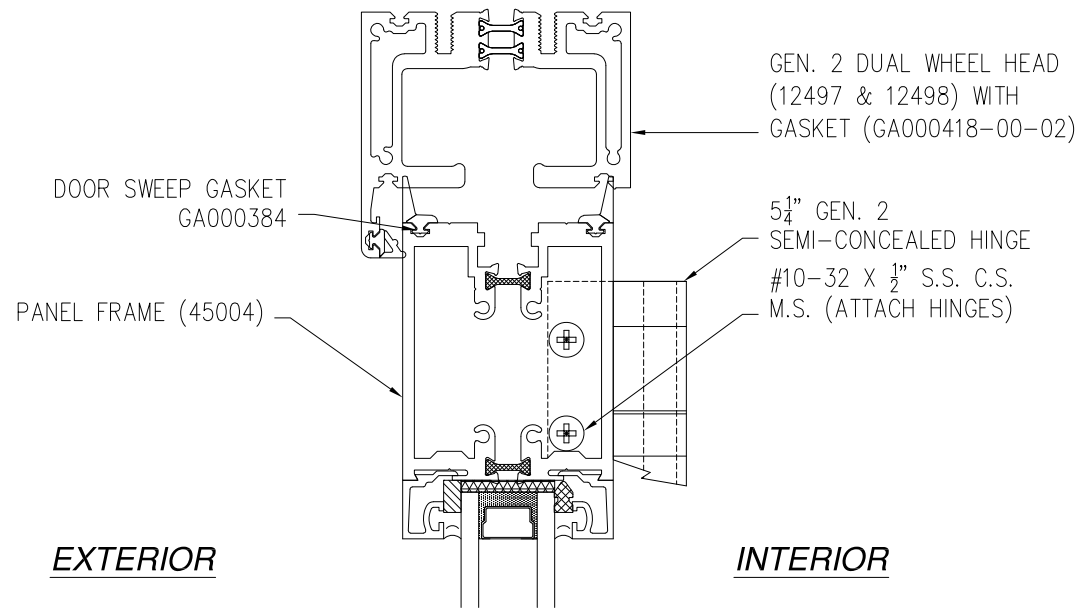

**A**  
4  
**VERTICAL CROSS SECTION**  
WET GLAZED

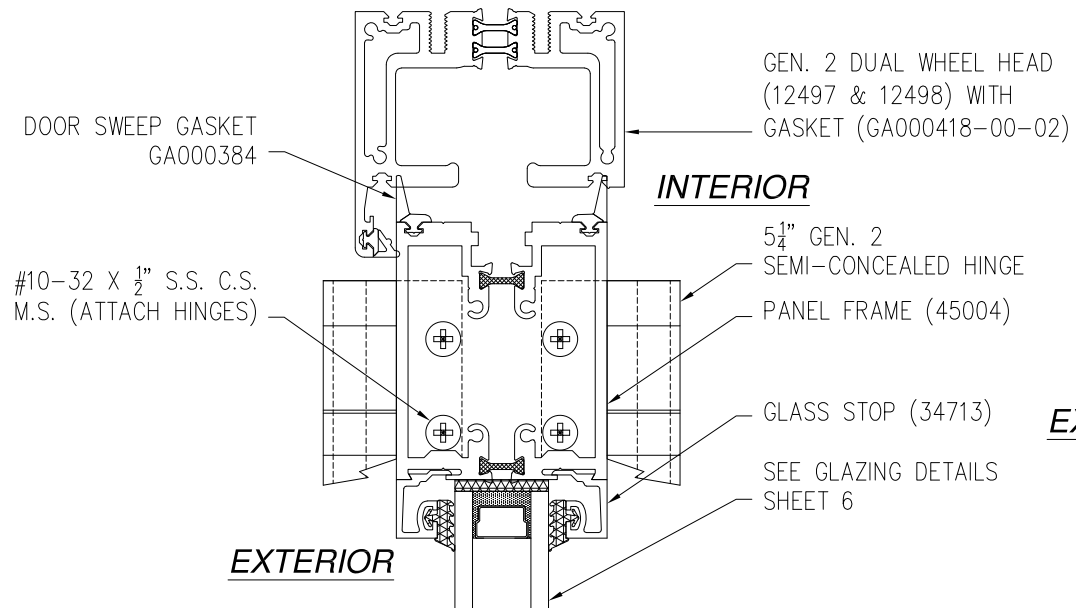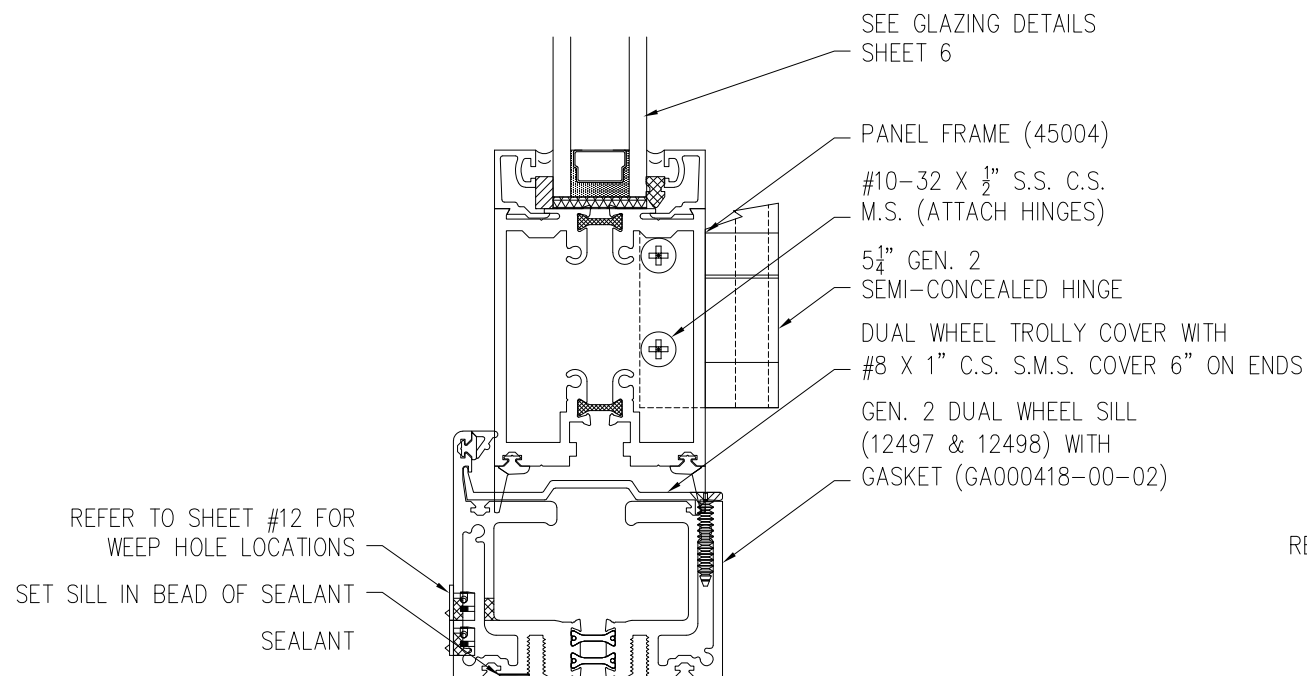

**B**  
4  
**VERTICAL CROSS SECTION**  
DRY GLAZED

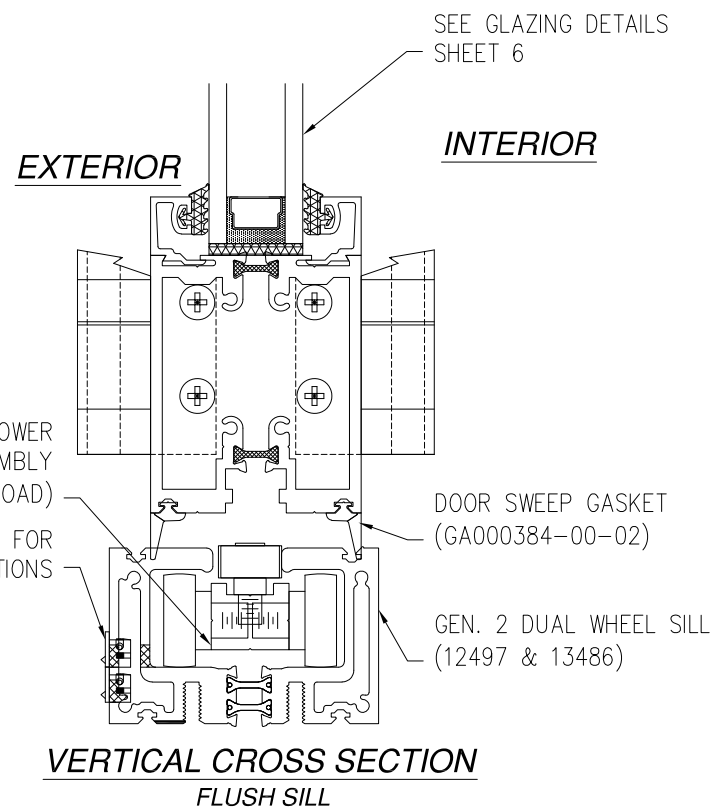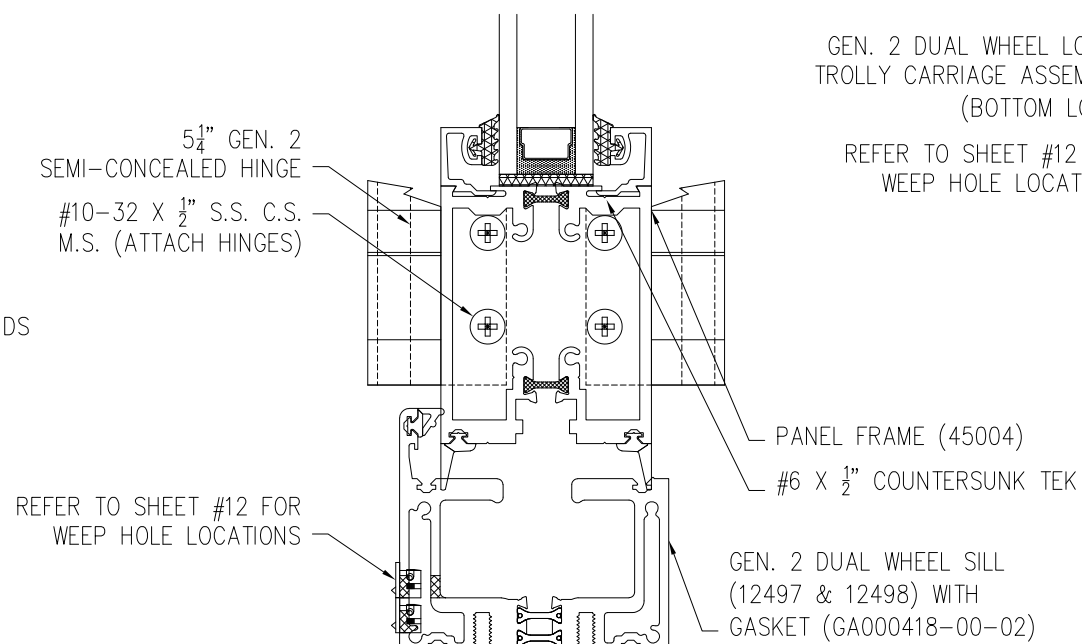

**VERTICAL CROSS SECTION**  
FLUSH SILL

SOLAR INNOVATIONS, INC.


31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 FGW 3X8 PANEL 90° CORNER  
NO POST INFOLD-NON IMPACT  
VERTICAL CROSS SECTIONS

|                |                     |               |
|----------------|---------------------|---------------|
| DRAWN:<br>J.L. | DWG NO.<br>08-01959 | REV<br>C      |
| SCALE NTS      | DATE 04/19/13       | SHEET 4 OF 13 |



L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 12/12/2023

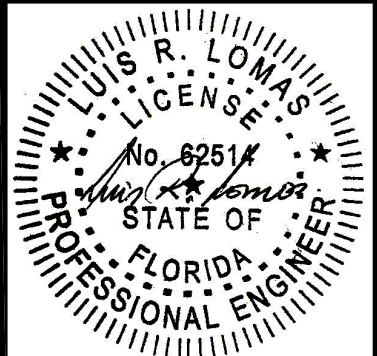

Luis R. Lomas P.E.  
FL No.: 62514

| REVISIONS |                              |            |          |
|-----------|------------------------------|------------|----------|
| REV       | DESCRIPTION                  | DATE       | APPROVED |
| C         | REVISED PER NEW REQUIREMENTS | 12/04/2023 | R.L.     |

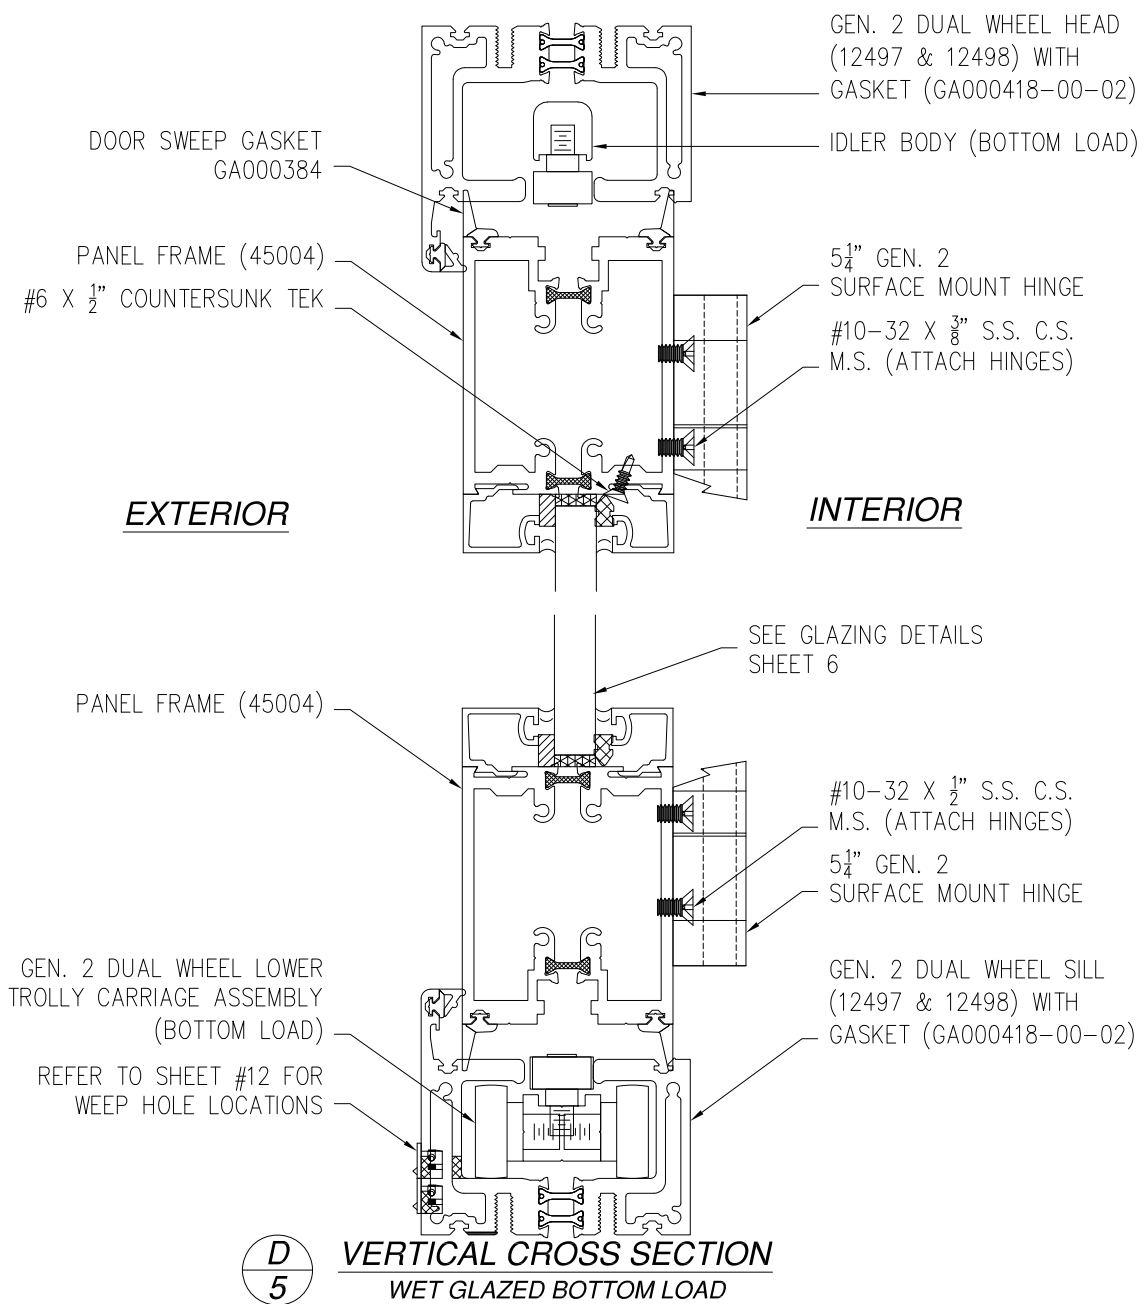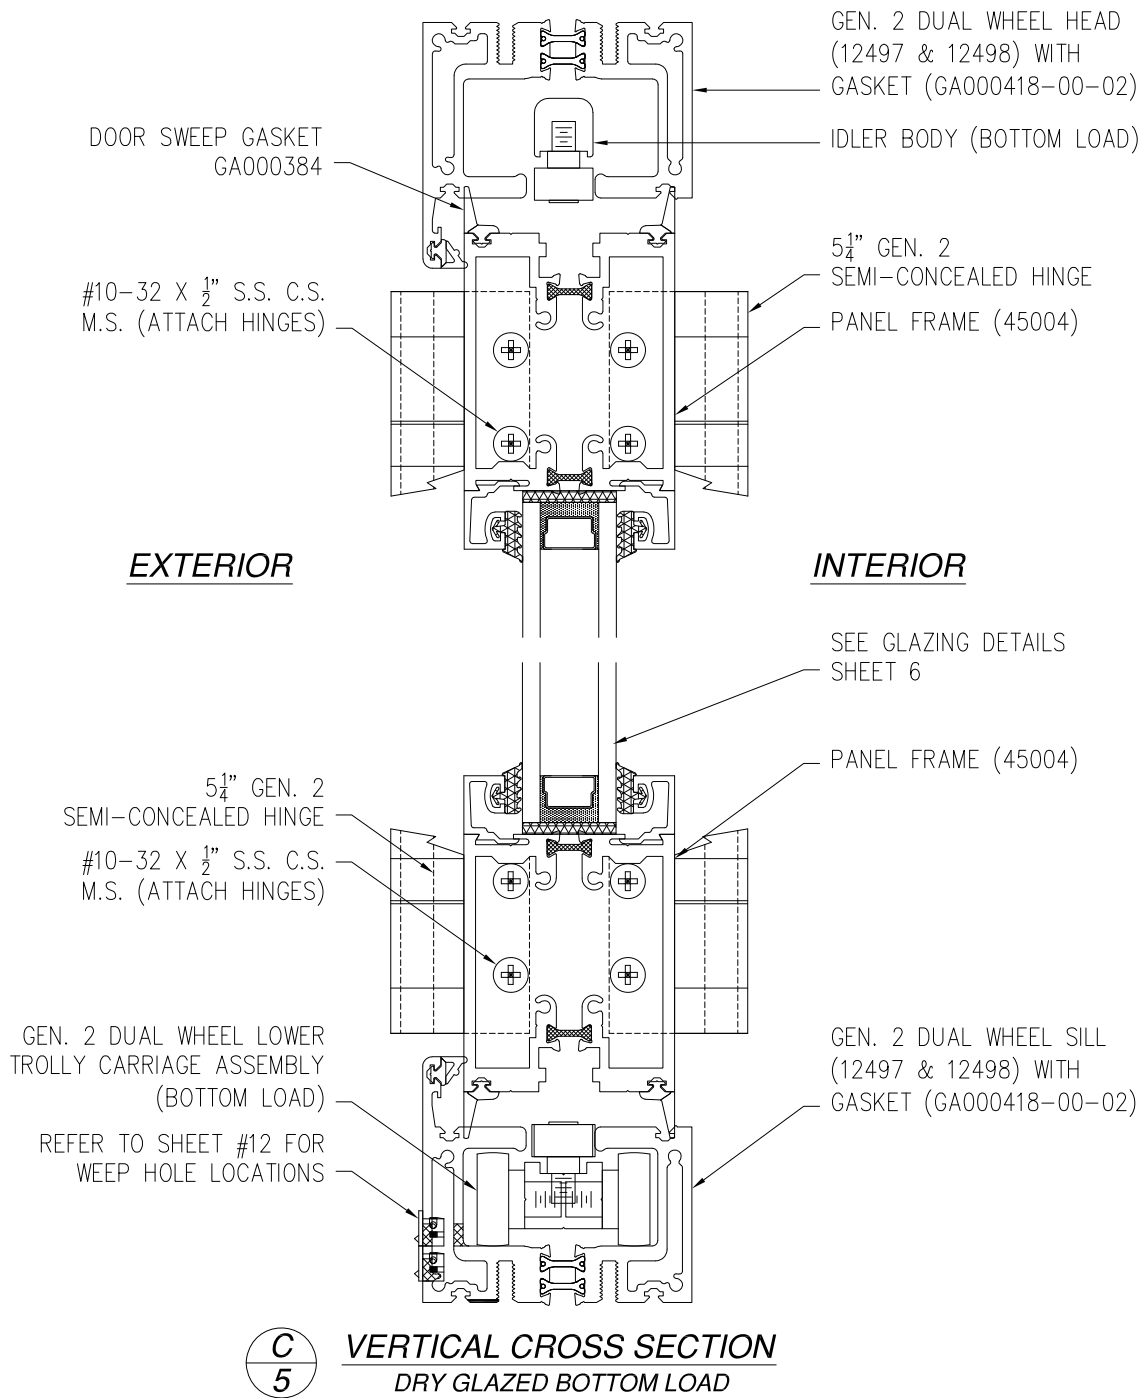

SOLAR INNOVATIONS, INC.


31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 FGW 3X8 PANEL 90° CORNER  
NO POST INFOLD-NON IMPACT  
VERTICAL CROSS SECTIONS

|                |                     |               |
|----------------|---------------------|---------------|
| DRAWN:<br>J.L. | DWG NO.<br>08-01959 | REV<br>C      |
| SCALE NTS      | DATE 04/19/13       | SHEET 5 OF 13 |






L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 12/12/2023

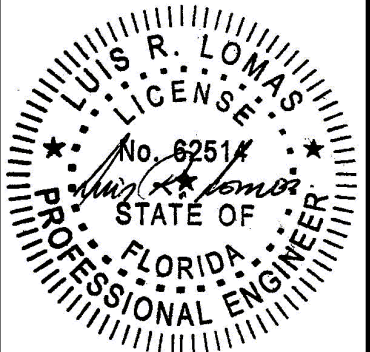

Luis R. Lomas P.E.  
FL No.: 62514

| REVISIONS |                              |            |          |
|-----------|------------------------------|------------|----------|
| REV       | DESCRIPTION                  | DATE       | APPROVED |
| C         | REVISED PER NEW REQUIREMENTS | 12/04/2023 | R.L.     |

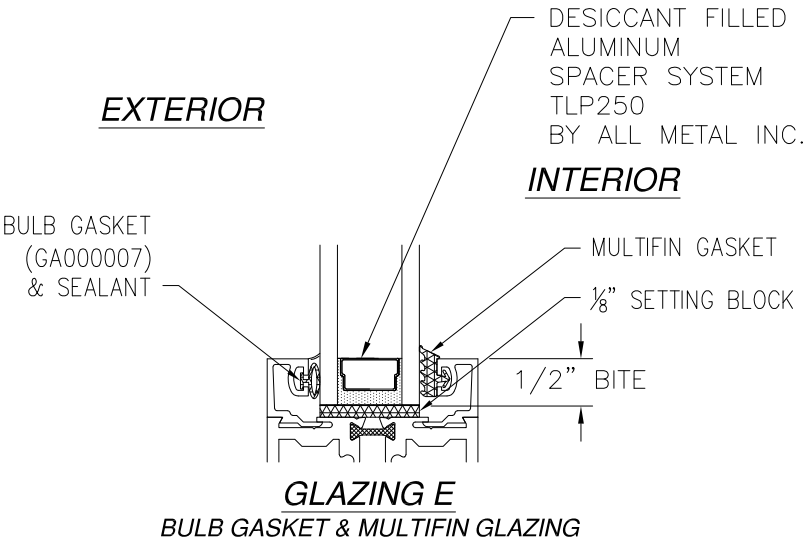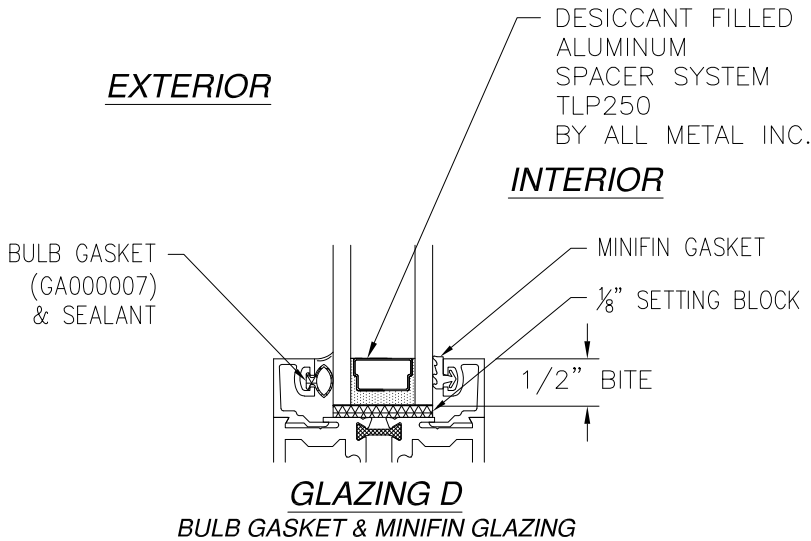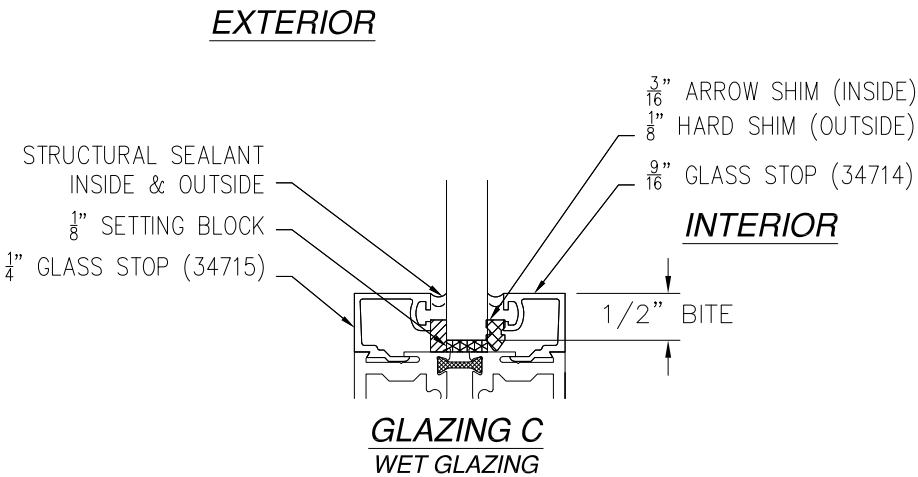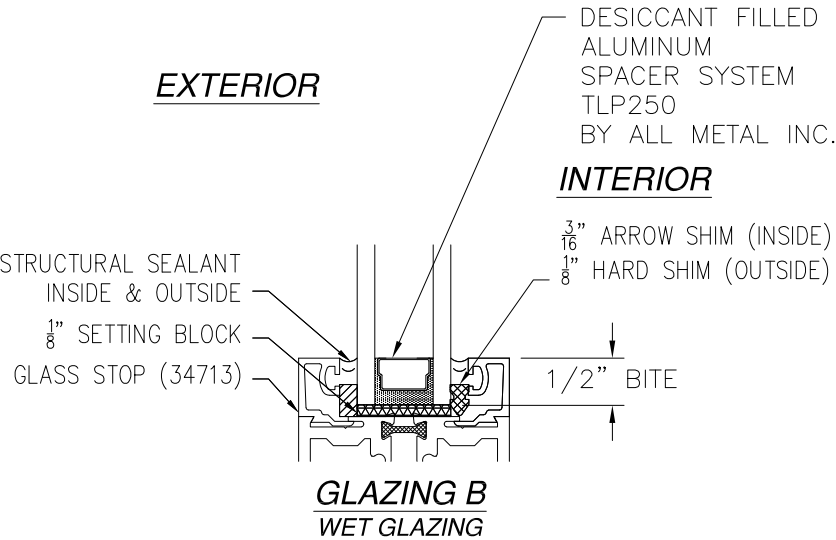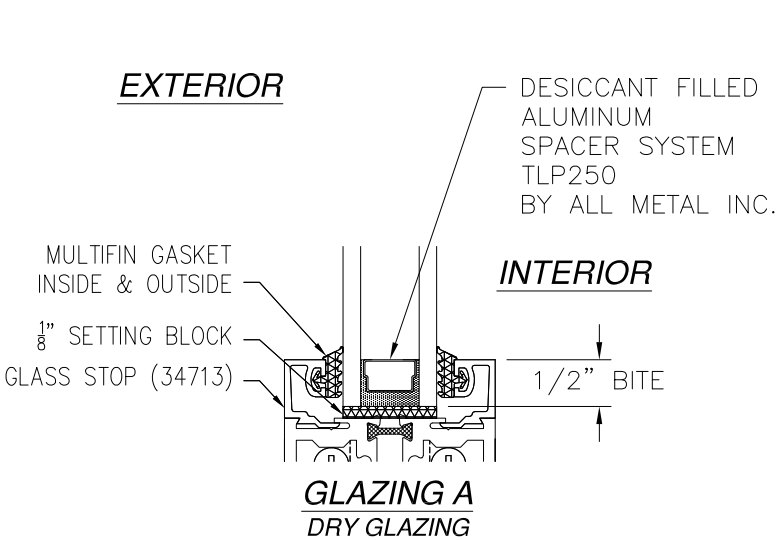

NOTES:  
GLASS TO BE USED IN ALL CONFIGURATIONS MUST BE SAFETY GLASS


SIGNED: 12/12/2023

SOLAR INNOVATIONS, INC.  
31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 FGW 3X8 PANEL 90° CORNER  
NO POST INFOLD-NON IMPACT  
GLAZING DETAILS


|                |                     |                  |
|----------------|---------------------|------------------|
| DRAWN:<br>J.L. | DWG NO.<br>08-01959 | REV<br>C         |
| SCALE<br>NTS   | DATE<br>04/19/13    | SHEET<br>6 OF 13 |

L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

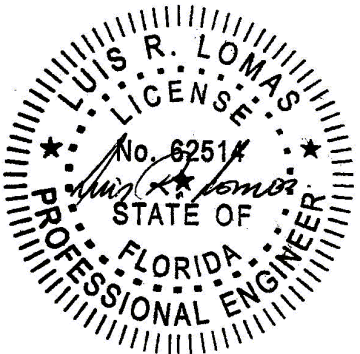

Luis R. Lomas P.E.  
FL No.: 62514

| REVISIONS |                              |            |          |
|-----------|------------------------------|------------|----------|
| REV       | DESCRIPTION                  | DATE       | APPROVED |
| C         | REVISED PER NEW REQUIREMENTS | 12/04/2023 | R.L.     |

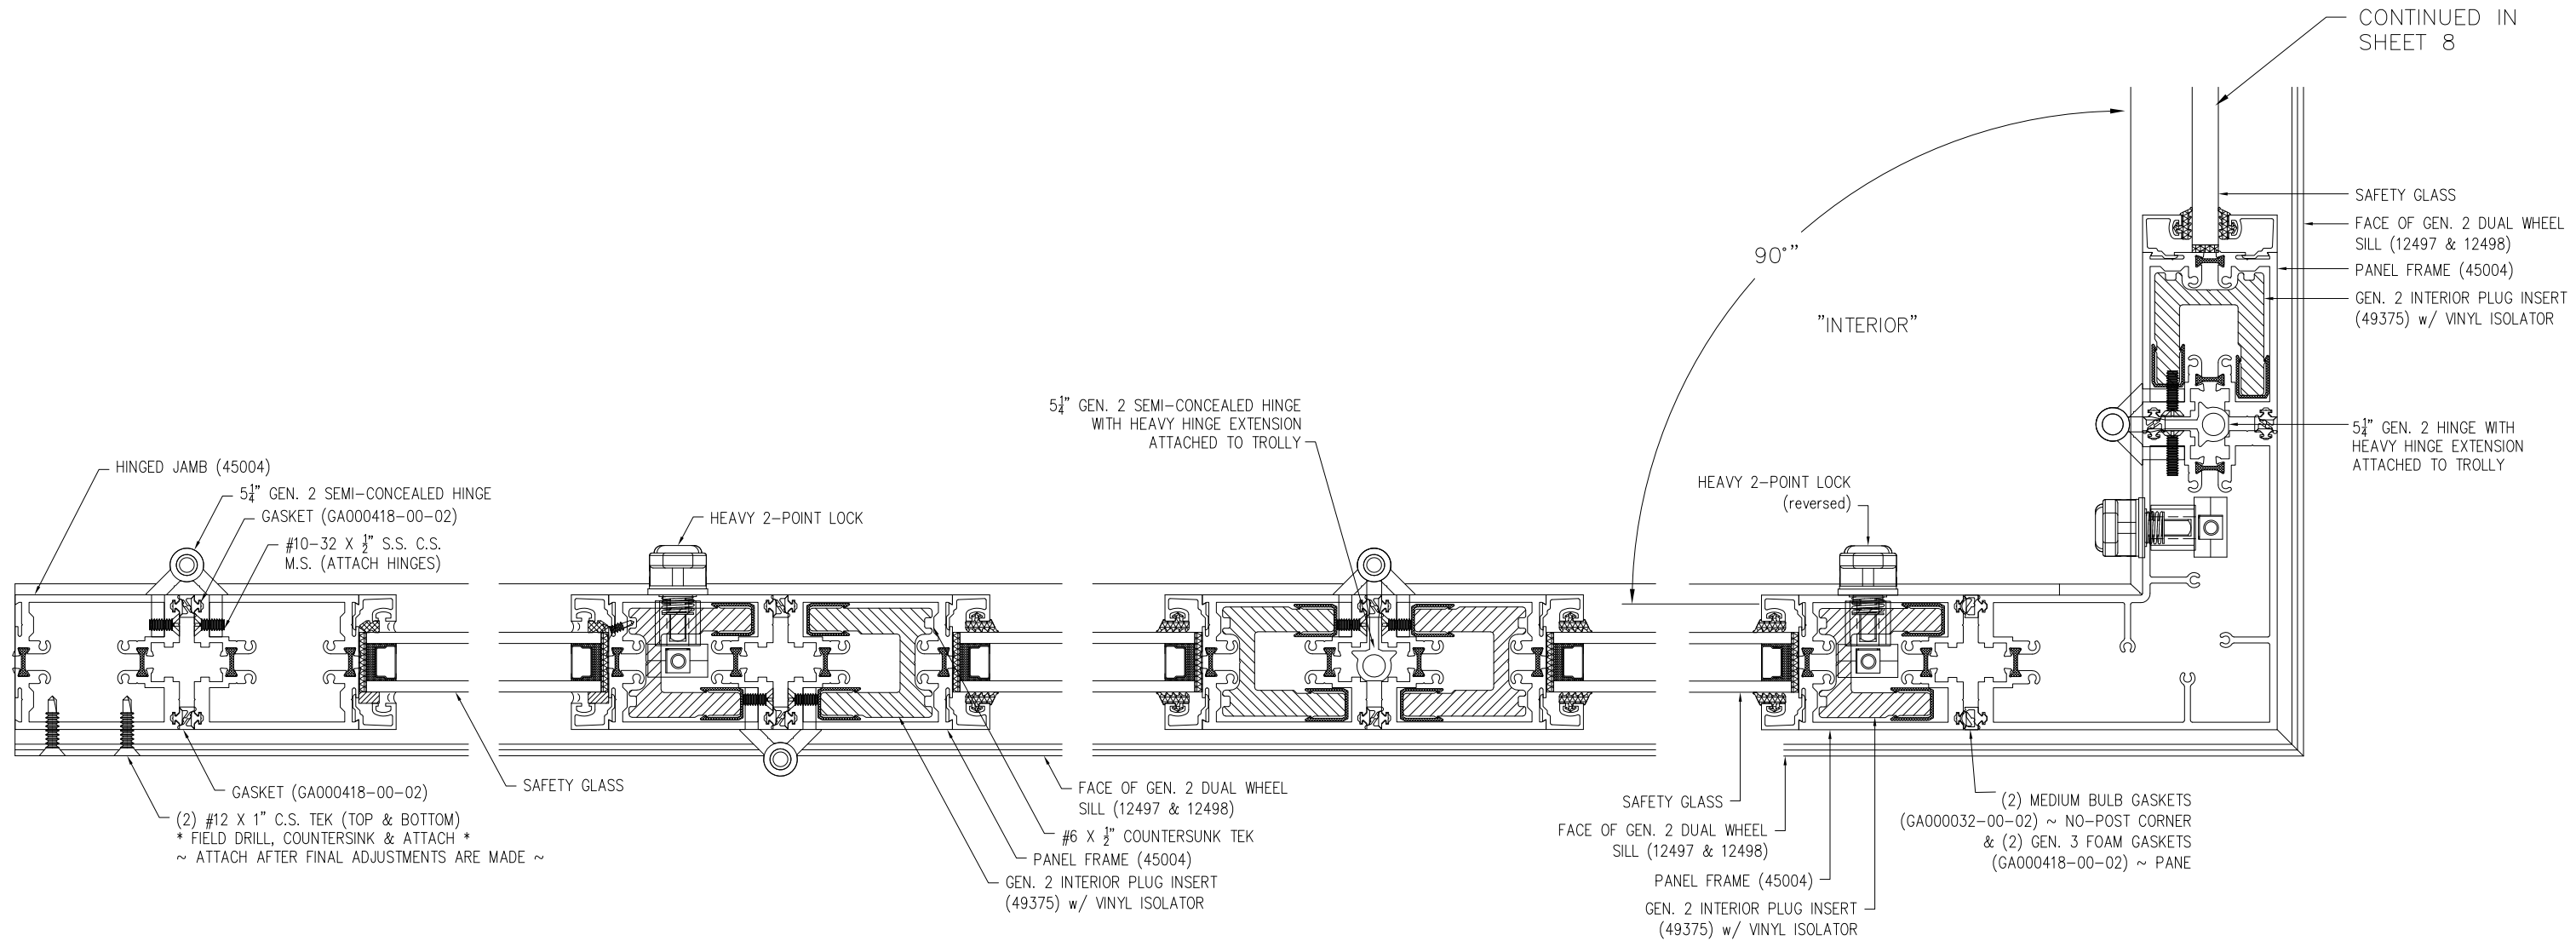


E  
6

HORIZONTAL CROSS SECTION

SIGNED: 12/12/2023


|                                                                                                   |                     |                  |
|---------------------------------------------------------------------------------------------------|---------------------|------------------|
| SOLAR INNOVATIONS, INC.                                                                           |                     |                  |
| 31 ROBERTS RD<br>PINE GROVE, PA 17963                                                             |                     |                  |
| SERIES SI3000 FGW 3X8 PANEL 90° CORNER<br>NO POST INFOLD-NON IMPACT<br>HORIZONTAL CROSS SECTIONS  |                     |                  |
| DRAWN:<br>J.L.                                                                                    | DWG NO.<br>08-01959 | REV<br>C         |
| SCALE<br>NTS                                                                                      | DATE<br>04/19/13    | SHEET<br>7 OF 13 |
| L. ROBERTO LOMAS P.E.<br>208 7th Ave, INDIALANTIC, FL 32903<br>434-688-0609 rllomas@lrlomaspe.com |                     |                  |

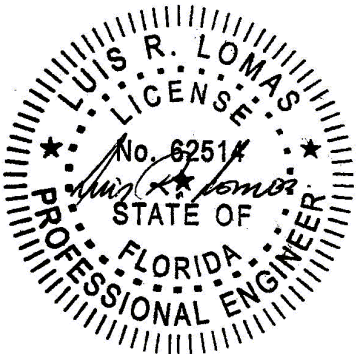

Luis R. Lomas P.E.  
FL No.: 62514

| REVISIONS |                              |            |          |
|-----------|------------------------------|------------|----------|
| REV       | DESCRIPTION                  | DATE       | APPROVED |
| C         | REVISED PER NEW REQUIREMENTS | 12/04/2023 | R.L.     |

CONTINUED  
FROM SHEET 7

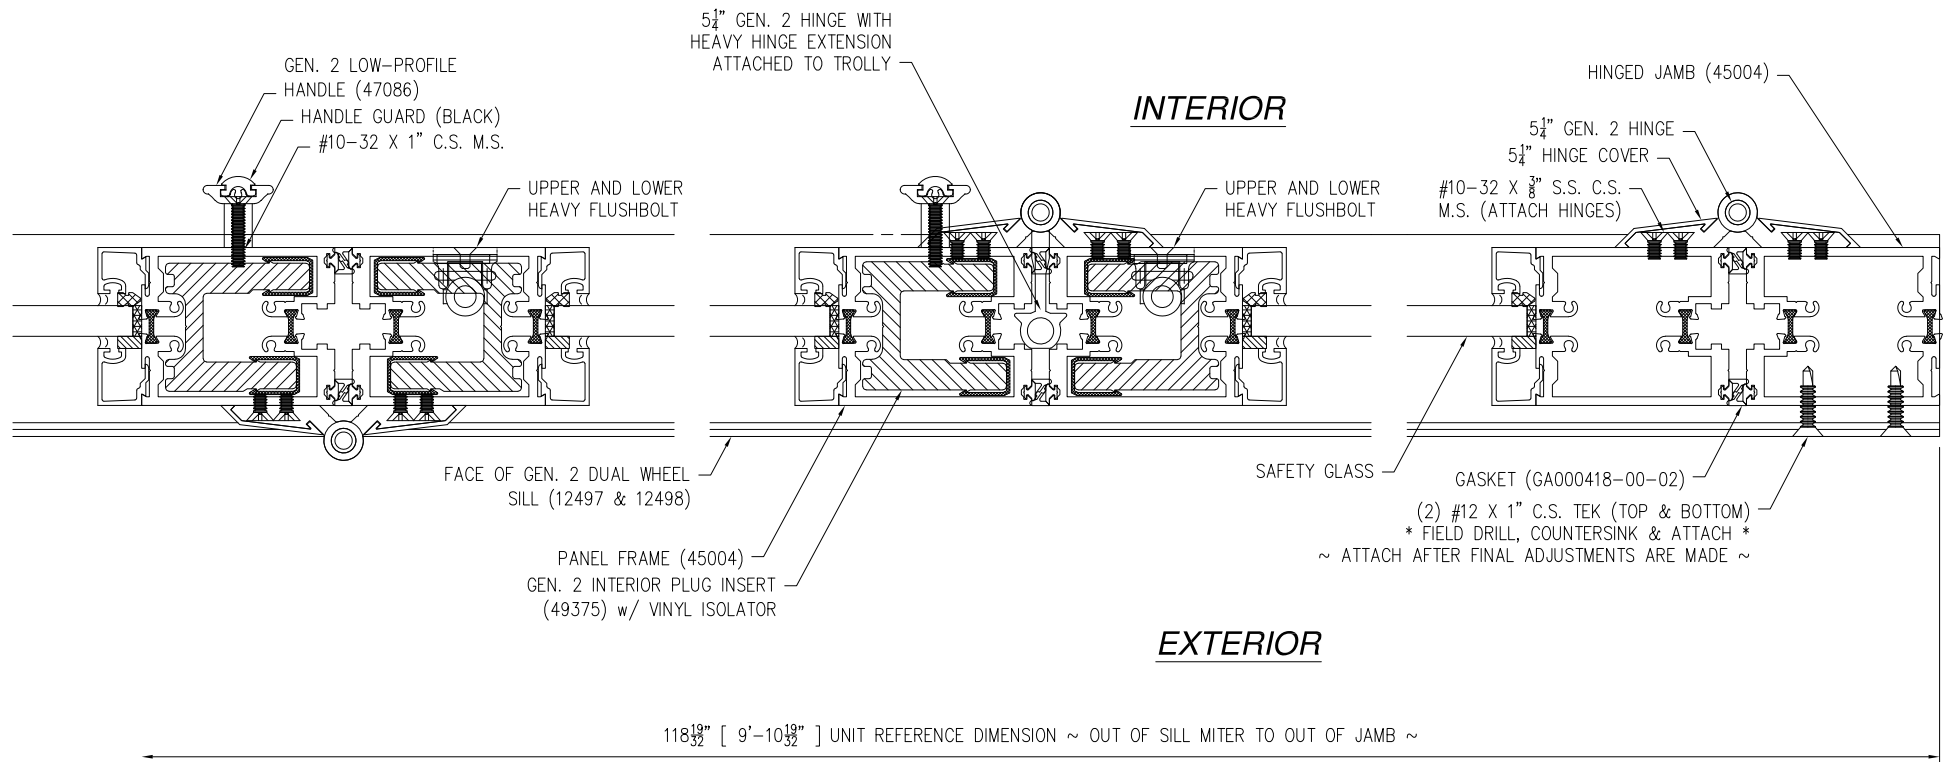


$\frac{E}{7}$


HORIZONTAL CROSS SECTION

SIGNED: 12/12/2023

|                                                                                                   |                     |                  |
|---------------------------------------------------------------------------------------------------|---------------------|------------------|
| SOLAR INNOVATIONS, INC.<br>31 ROBERTS RD<br>PINE GROVE, PA 17963                                  |                     |                  |
| SERIES SI3000 FGW 3X8 PANEL 90° CORNER<br>NO POST INFOLD-NON IMPACT<br>HORIZONTAL CROSS SECTION   |                     |                  |
| DRAWN:<br>J.L.                                                                                    | DWG NO.<br>08-01959 | REV<br>C         |
| SCALE<br>NTS                                                                                      | DATE<br>04/19/13    | SHEET<br>8 OF 13 |
| L. ROBERTO LOMAS P.E.<br>208 7th Ave, INDIALANTIC, FL 32903<br>434-688-0609 rllomas@lrlomaspe.com |                     |                  |

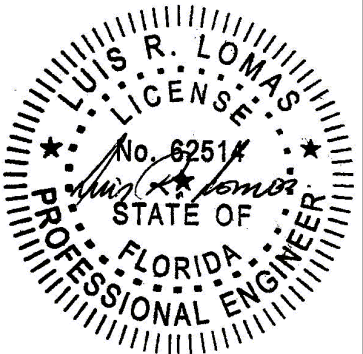

Luis R. Lomas P.E.  
FL No.: 62514

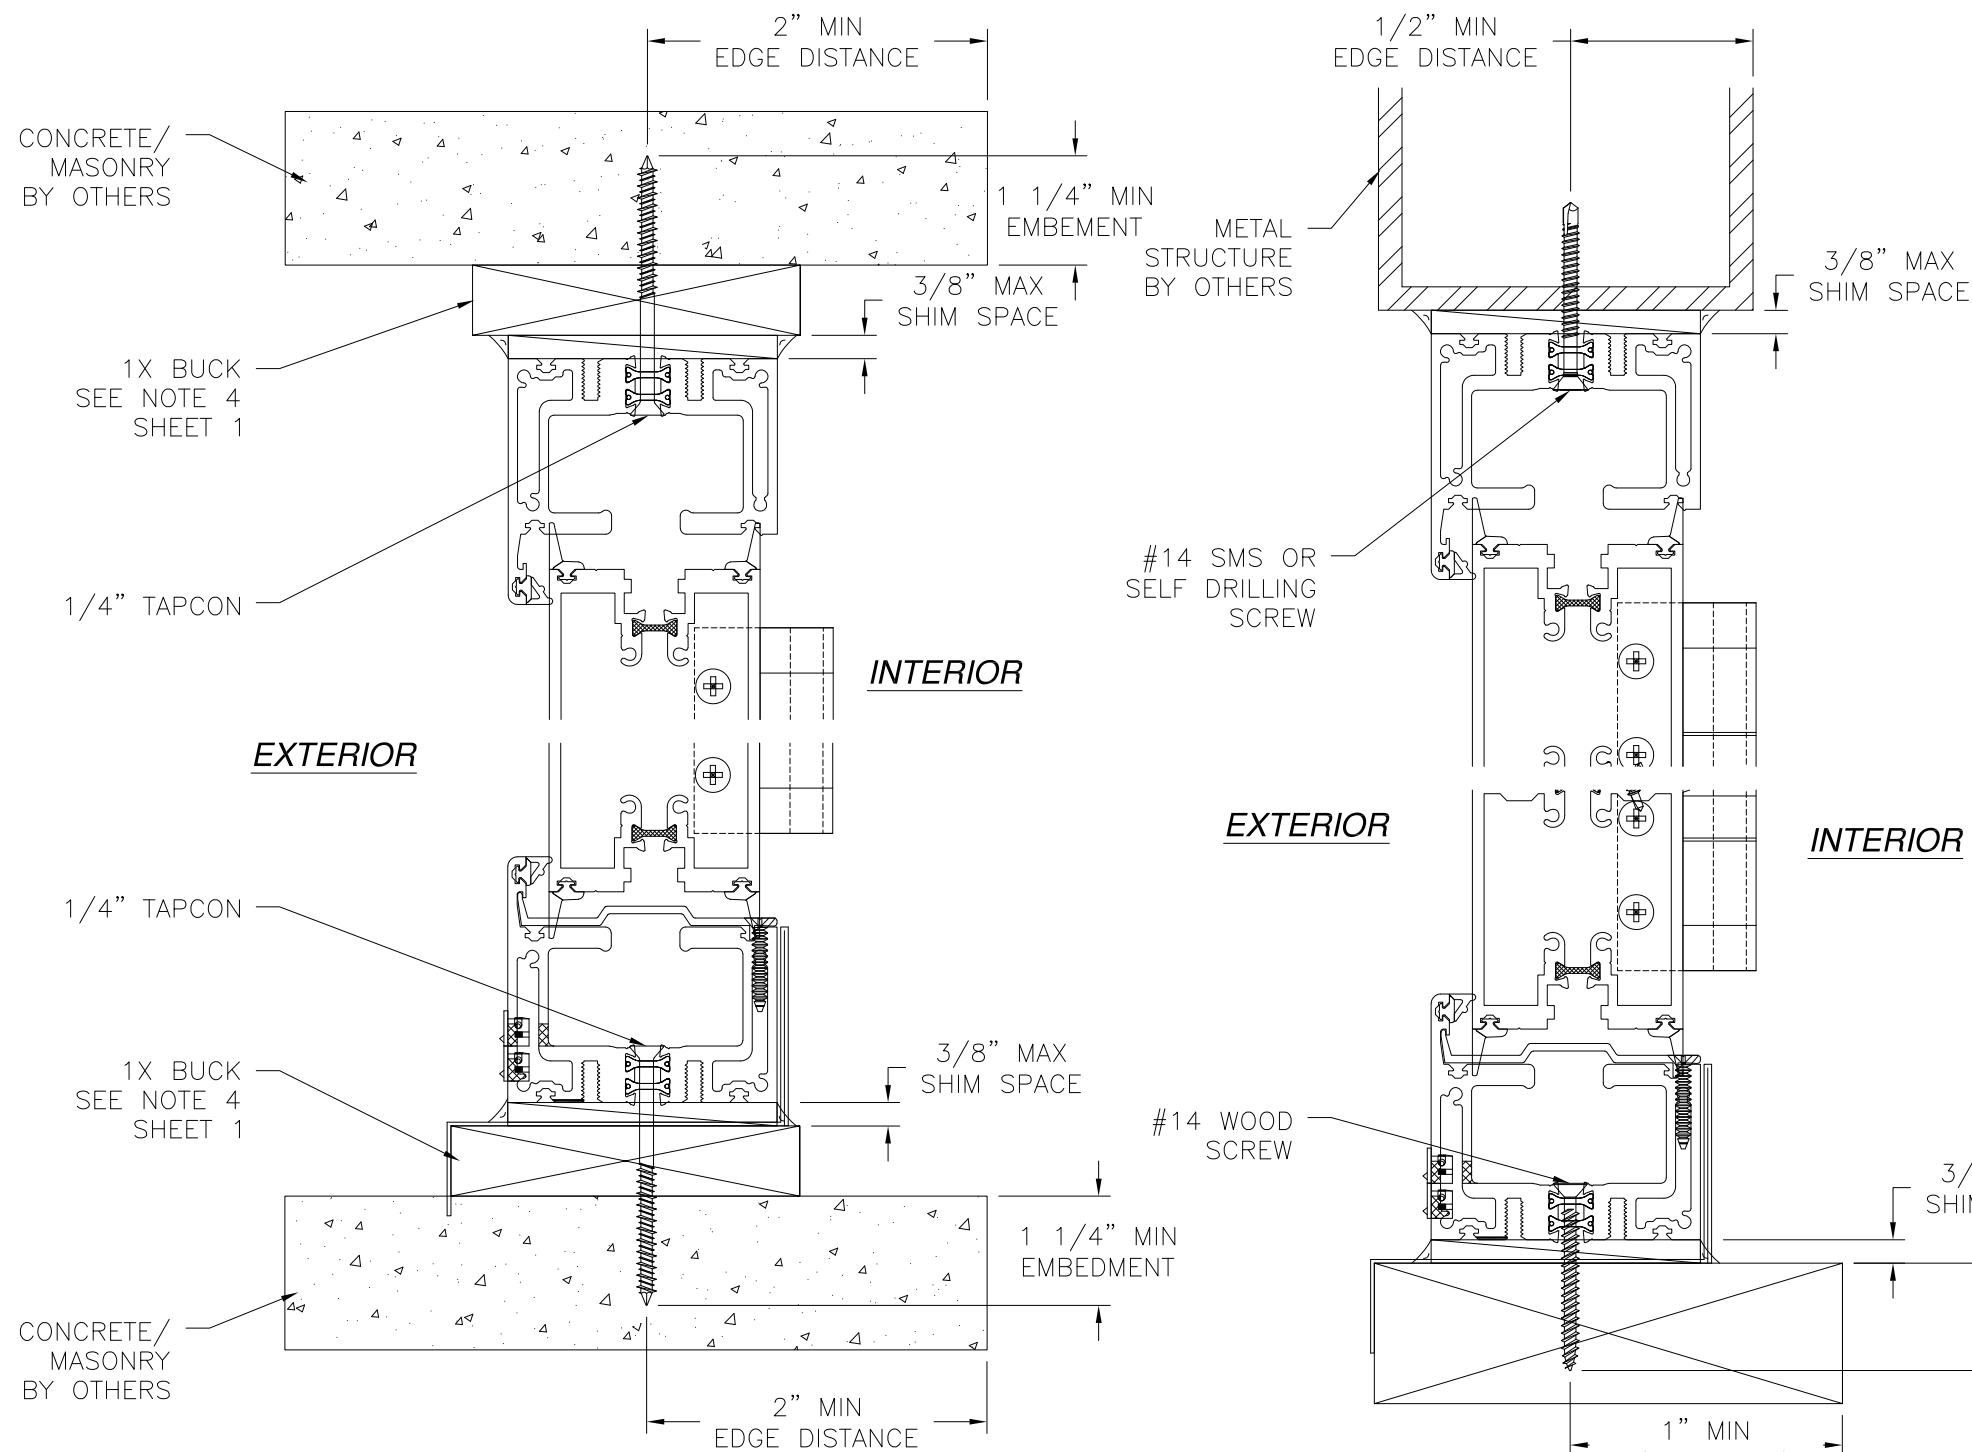

| REVISIONS |                              |            |          |
|-----------|------------------------------|------------|----------|
| REV       | DESCRIPTION                  | DATE       | APPROVED |
| C         | REVISED PER NEW REQUIREMENTS | 12/04/2023 | R.L.     |

NOTES:  
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.  
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

VERTICAL CROSS SECTION  
CONCRETE/MASONRY INSTALLATION  
STANDARD SILL SHOWN  
FLUSH SILL SIMILAR

VERTICAL CROSS SECTION  
WOOD FRAMING OR 2X BUCK  
OR METAL STRUCTURE INSTALLATION  
STANDARD SILL SHOWN  
FLUSH SILL SIMILAR


SOLAR INNOVATIONS, INC.  
31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 FGW 3X8 PANEL 90° CORNER  
NO POST INFOLD-NON IMPACT  
INSTALLATION DETAILS

|                |                     |               |
|----------------|---------------------|---------------|
| DRAWN:<br>J.L. | DWG NO.<br>08-01959 | REV<br>C      |
| SCALE NTS      | DATE 04/19/13       | SHEET 9 OF 13 |


L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 12/12/2023

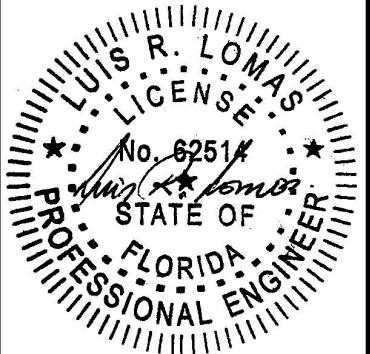


Luis R. Lomas P.E.  
FL No.: 62514


| REVISIONS |                              |            |          |
|-----------|------------------------------|------------|----------|
| REV       | DESCRIPTION                  | DATE       | APPROVED |
| C         | REVISED PER NEW REQUIREMENTS | 12/04/2023 | R.L.     |

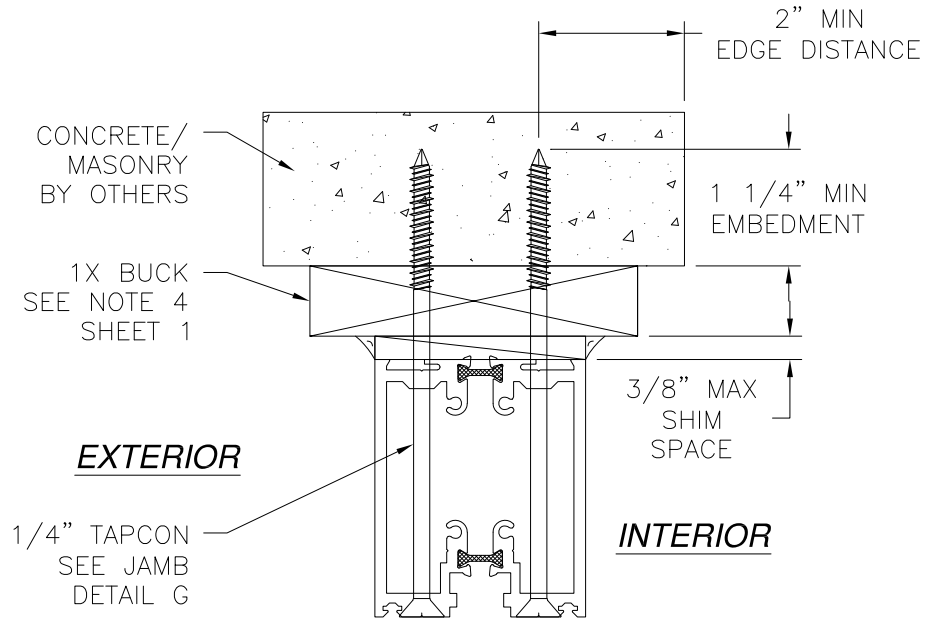

**JAMB INSTALLATION DETAIL**  
CONCRETE/MASONRY  
S45004 NO REINFORCEMENT

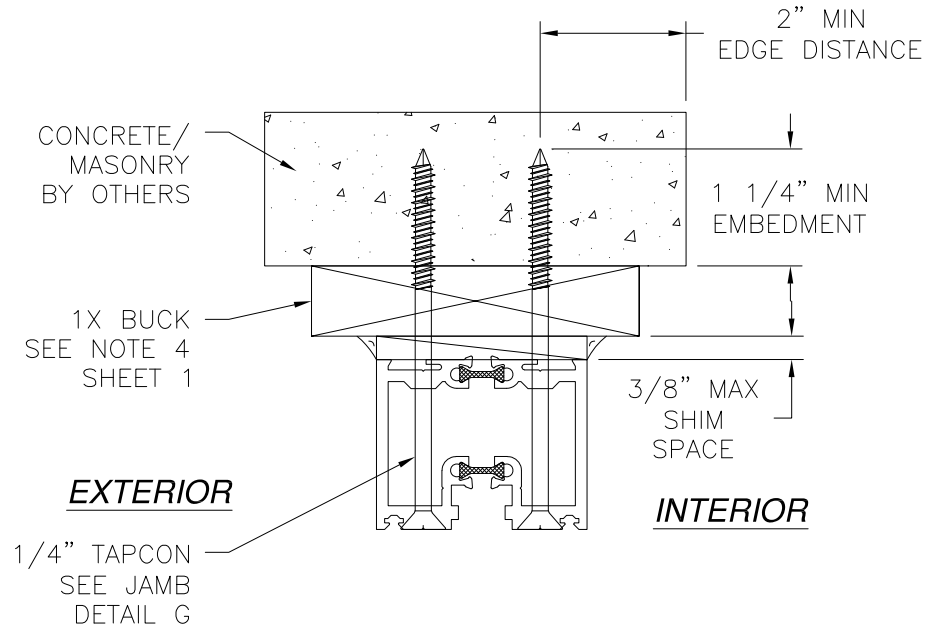

**JAMB INSTALLATION DETAIL**  
CONCRETE/MASONRY  
S47543 NO REINFORCEMENT

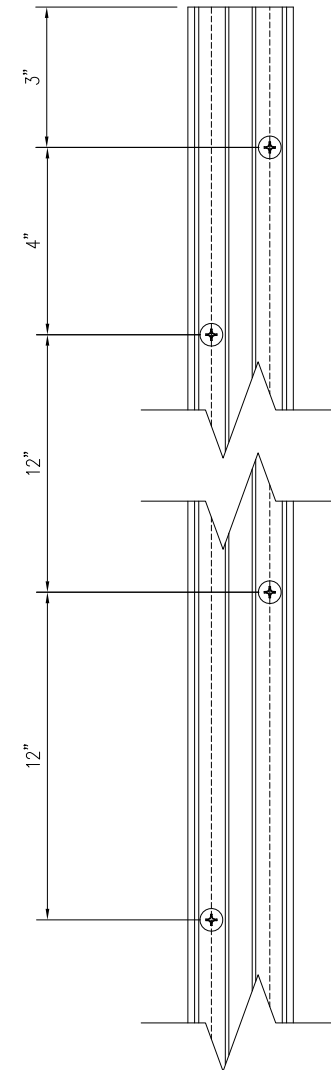


**JAMB INSTALLATION DETAIL G**  
JAMB WITHOUT REINFORCEMENT

NOTES:  
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS,  
NOT SHOWN FOR CLARITY.  
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE  
DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 12/12/2023

|                                                                                                   |                     |                   |
|---------------------------------------------------------------------------------------------------|---------------------|-------------------|
| SOLAR INNOVATIONS, INC.<br>31 ROBERTS RD<br>PINE GROVE, PA 17963                                  |                     |                   |
| SERIES SI3000 FGW 3X8 PANEL 90° CORNER<br>NO POST INFOLD-NON IMPACT<br>INSTALLATION DETAILS       |                     |                   |
| DRAWN:<br>J.L.                                                                                    | DWG NO.<br>08-01959 | REV<br>C          |
| SCALE<br>NTS                                                                                      | DATE<br>04/19/13    | SHEET<br>10 OF 13 |
| L. ROBERTO LOMAS P.E.<br>208 7th Ave, INDIALANTIC, FL 32903<br>434-688-0609 rllomas@lrlomaspe.com |                     |                   |

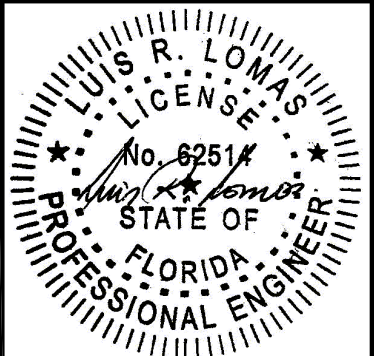


Luis R. Lomas P.E.  
FL No.: 62514


| REVISIONS |                              |            |          |
|-----------|------------------------------|------------|----------|
| REV       | DESCRIPTION                  | DATE       | APPROVED |
| C         | REVISED PER NEW REQUIREMENTS | 12/04/2023 | R.L.     |

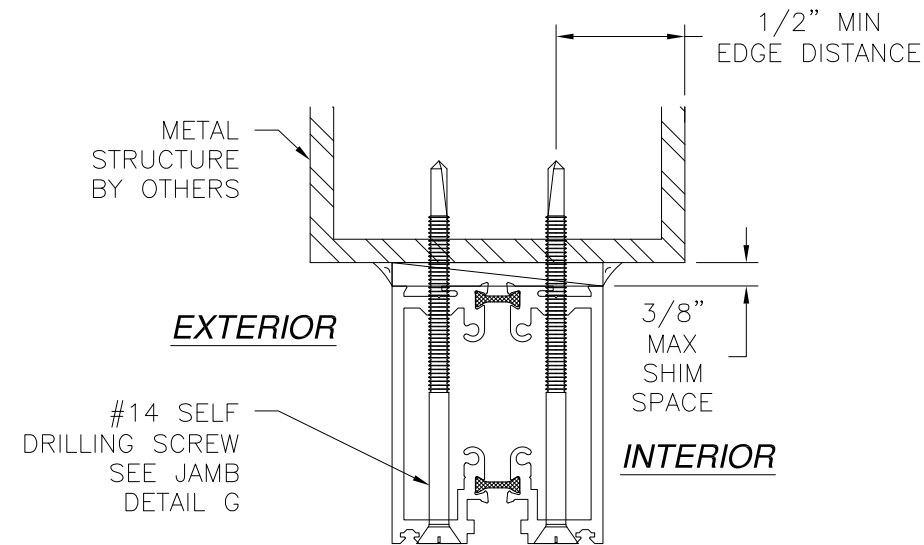


**JAMB INSTALLATION DETAIL**  
METAL STRUCTURE  
S45004 NO REINFORCEMENT

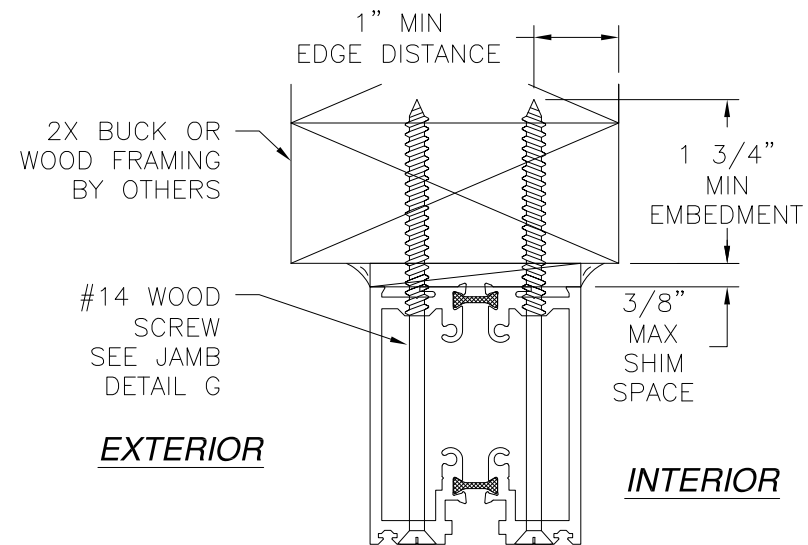

**JAMB INSTALLATION DETAIL**  
2X BUCK OR WOOD FRAMING  
S45004 NO REINFORCEMENT

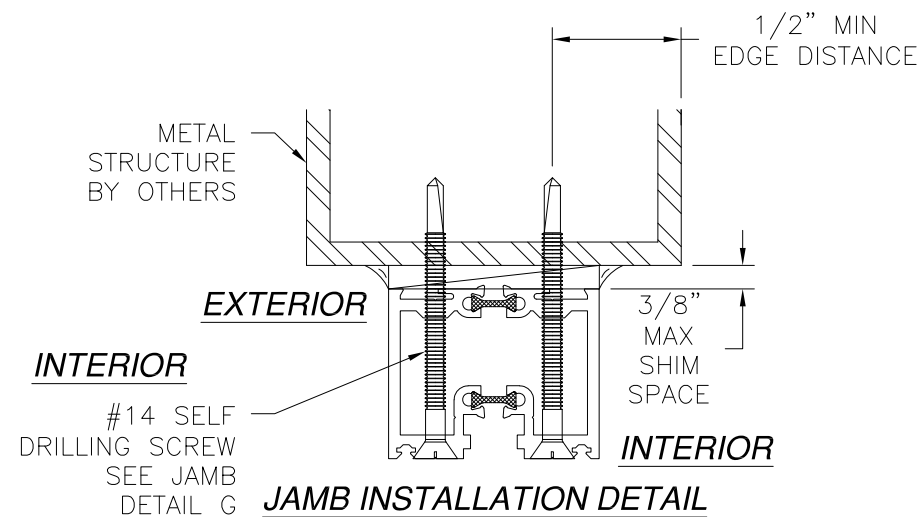

**JAMB INSTALLATION DETAIL**  
METAL STRUCTURE  
S47543 NO REINFORCEMENT

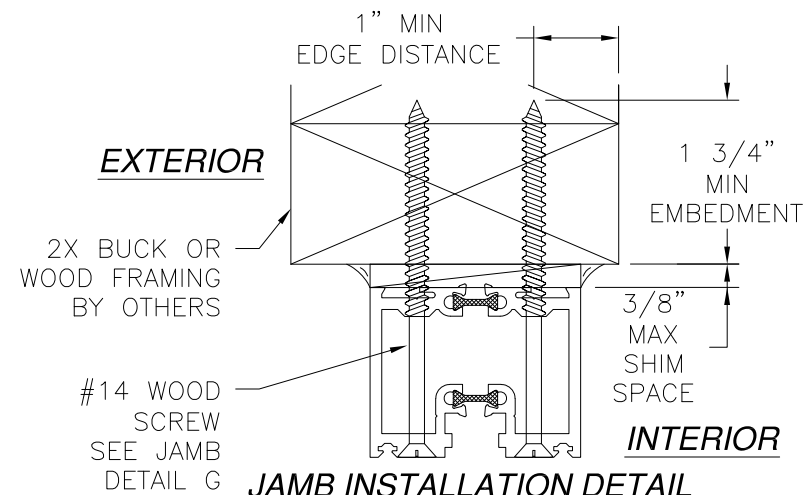

**JAMB INSTALLATION DETAIL**  
2X BUCK OR WOOD FRAMING  
S47543 NO REINFORCEMENT

NOTES:  
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS,  
NOT SHOWN FOR CLARITY.  
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE  
DESIGNED IN ACCORDANCE WITH ASTM E2112

SOLAR INNOVATIONS, INC.


31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 FGW 3X8 PANEL 90° CORNER  
NO POST INFOLD-NON IMPACT  
INSTALLATION DETAILS

|                |                     |                |
|----------------|---------------------|----------------|
| DRAWN:<br>J.L. | DWG NO.<br>08-01959 | REV<br>C       |
| SCALE NTS      | DATE 04/19/13       | SHEET 11 OF 13 |


L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 12/12/2023

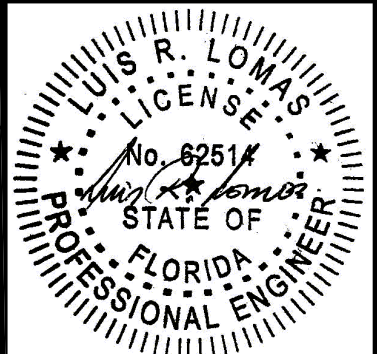


Luis R. Lomas P.E.  
FL No.: 62514


| REVISIONS |                              |            |          |
|-----------|------------------------------|------------|----------|
| REV       | DESCRIPTION                  | DATE       | APPROVED |
| C         | REVISED PER NEW REQUIREMENTS | 12/04/2023 | R.L.     |

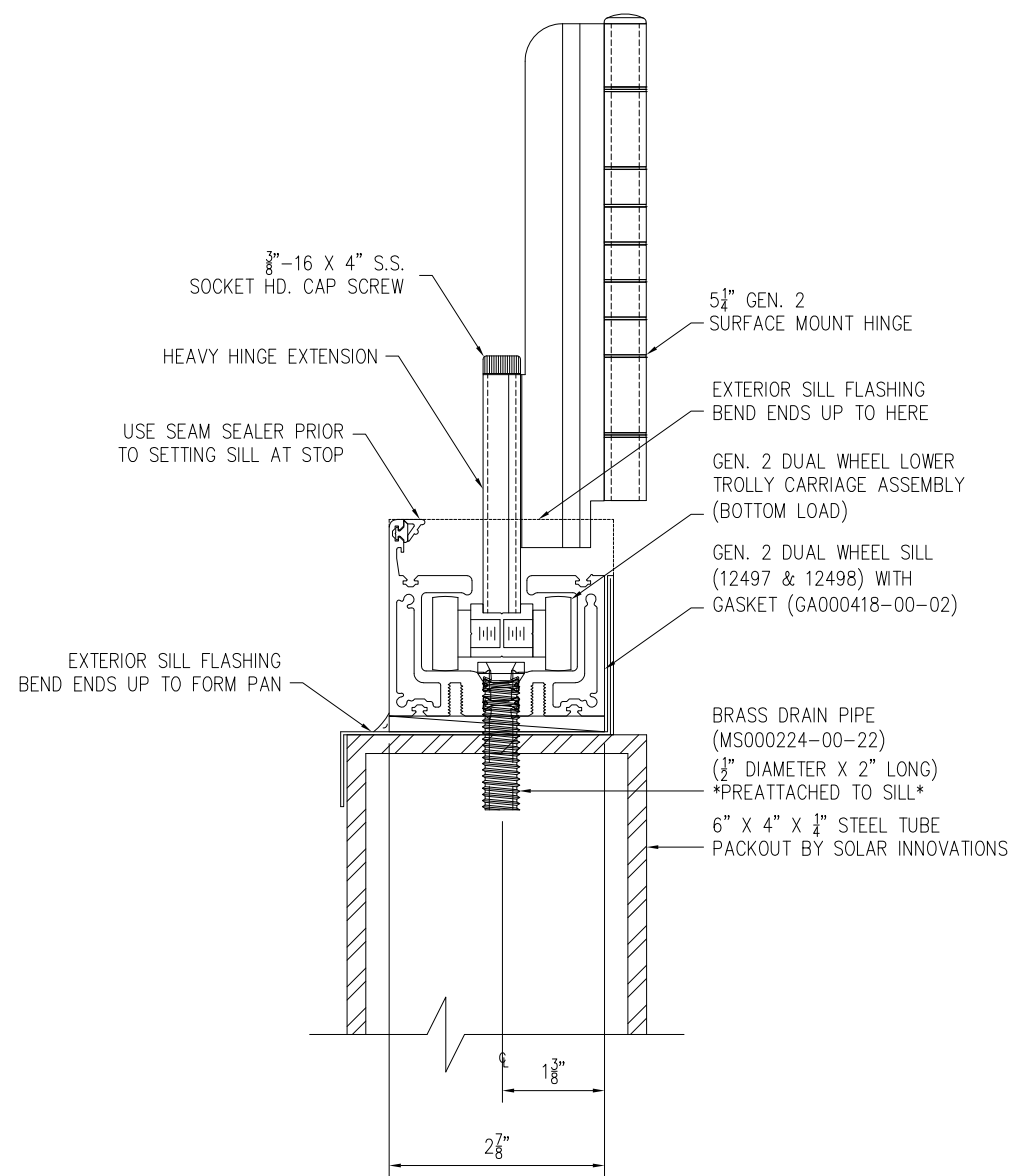

**DRAIN PIPE AND HINGE EXTENSION  
DETAIL**

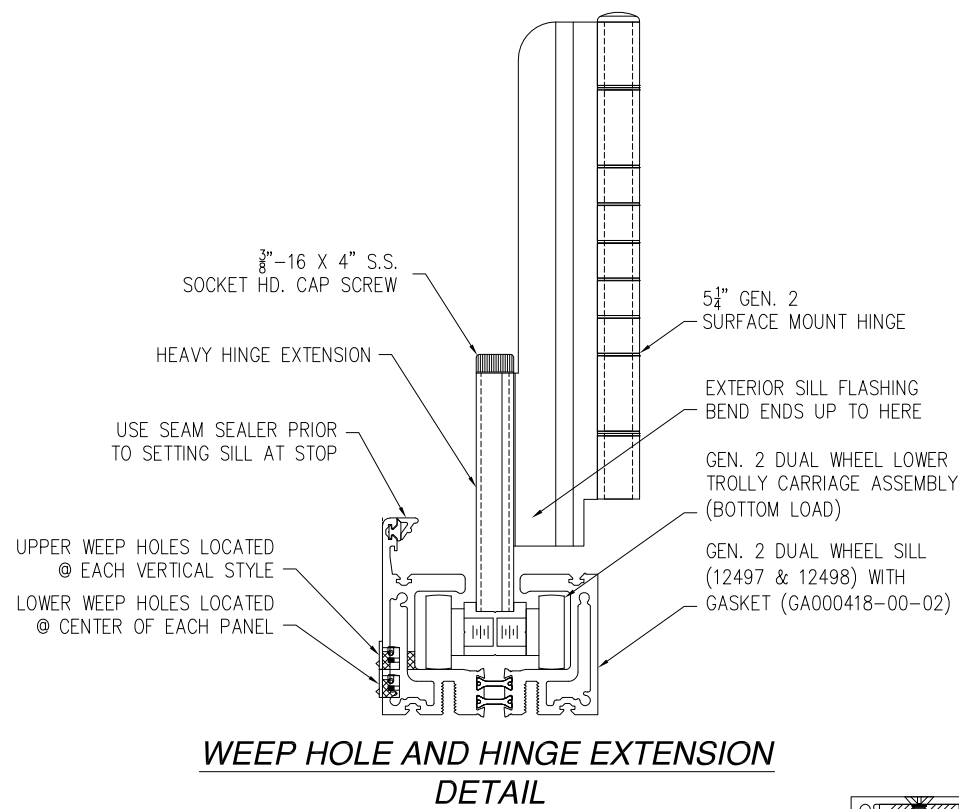

**WEEP HOLE AND HINGE EXTENSION  
DETAIL**

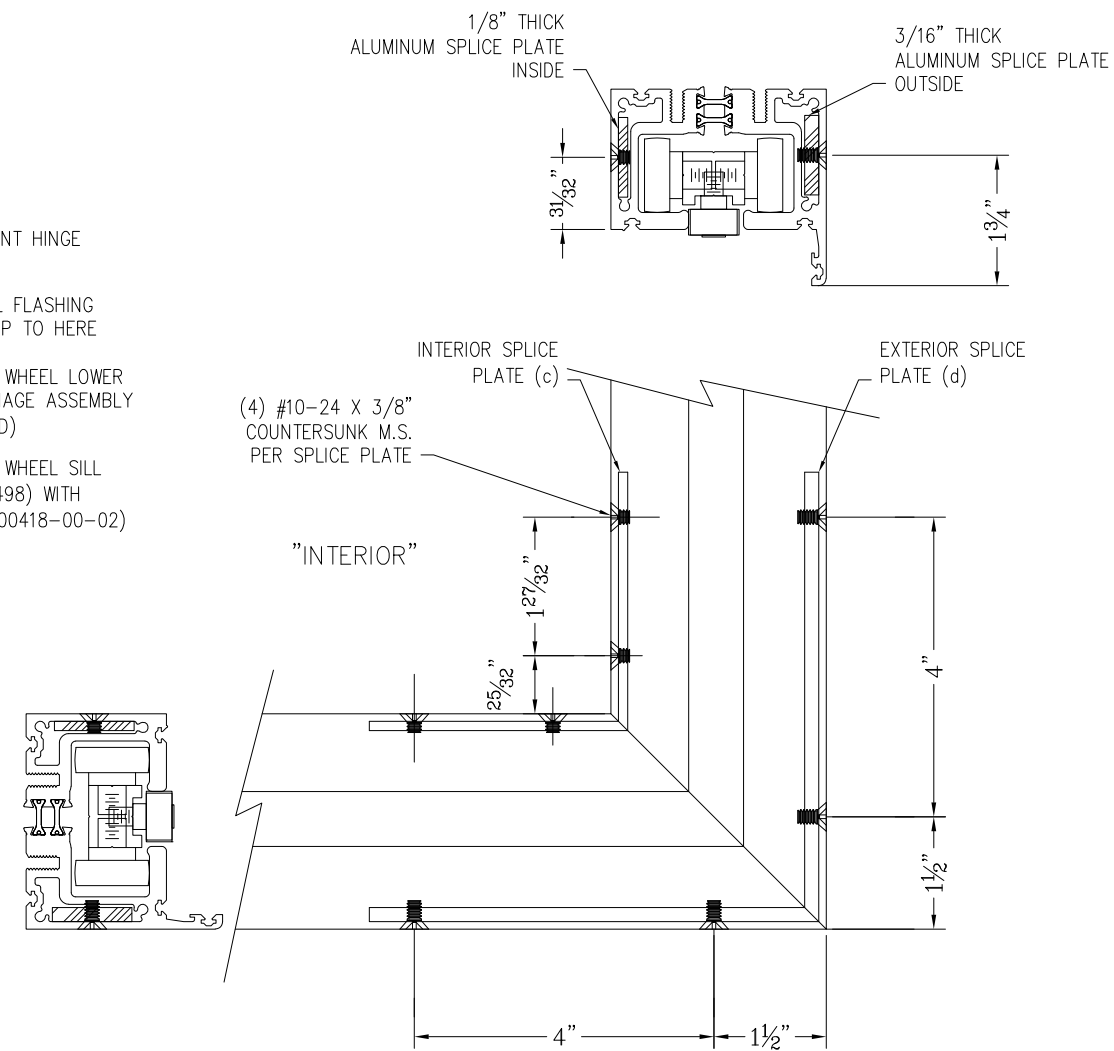

**SPLICE PLATES INSTALLATION DETAIL**

SOLAR INNOVATIONS, INC.


31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 FGW 3X8 PANEL 90° CORNER  
NO POST INFOLD-NON IMPACT  
WEEP DETAIL

|                |                     |                   |
|----------------|---------------------|-------------------|
| DRAWN:<br>J.L. | DWG NO.<br>08-01959 | REV<br>C          |
| SCALE<br>NTS   | DATE<br>04/19/13    | SHEET<br>12 OF 13 |




L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 12/12/2023

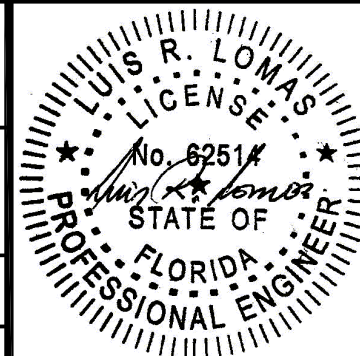

Luis R. Lomas P.E.  
FL No.: 62514

| REVISIONS |                              |            |          |
|-----------|------------------------------|------------|----------|
| REV       | DESCRIPTION                  | DATE       | APPROVED |
| C         | REVISED PER NEW REQUIREMENTS | 12/04/2023 | R.L.     |

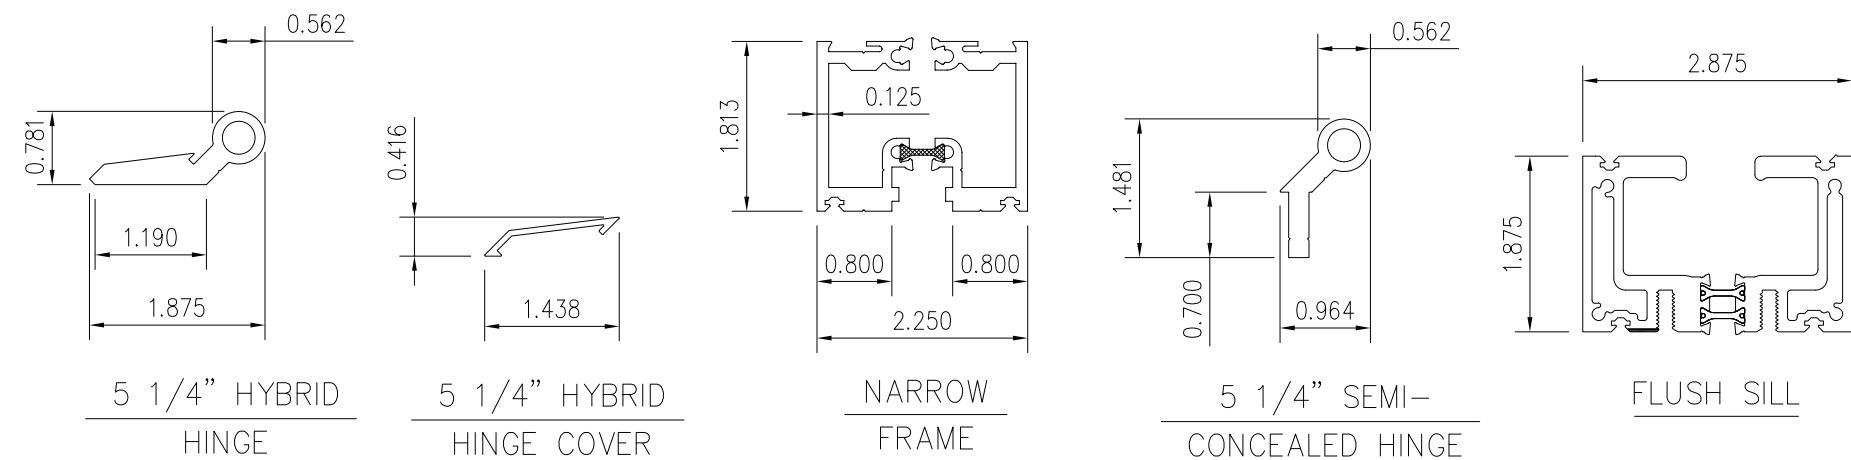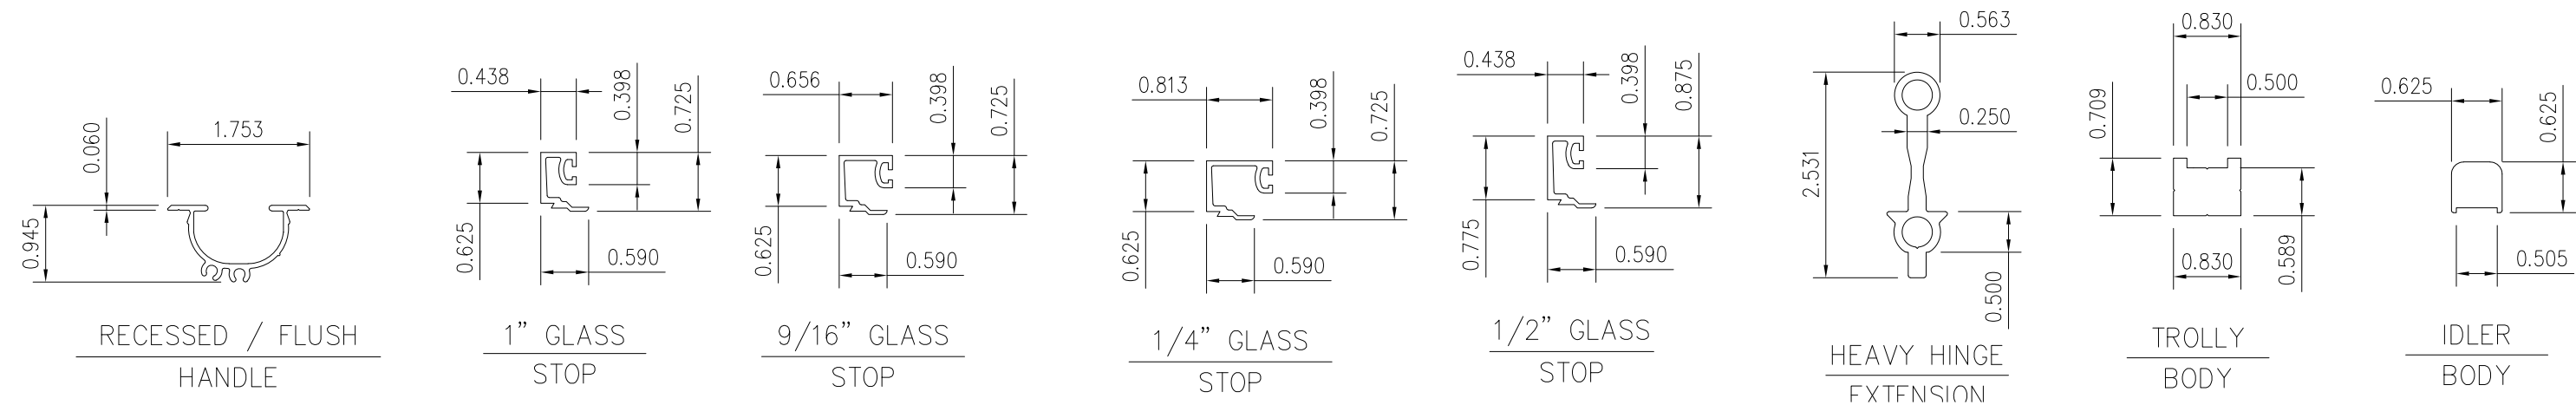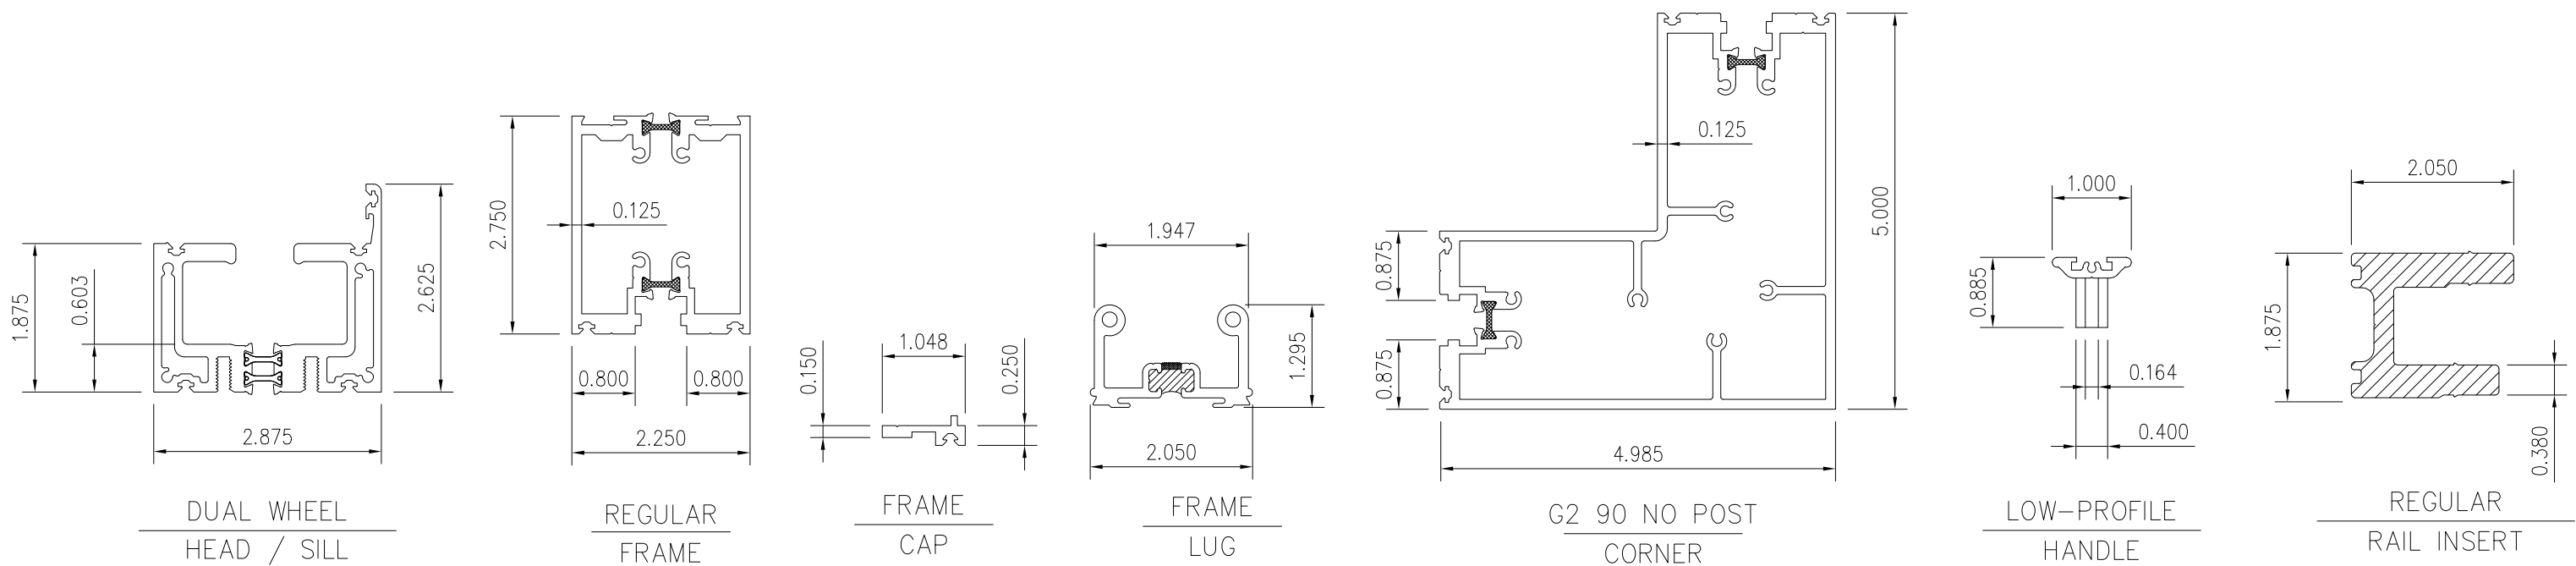


SOLAR INNOVATIONS, INC.  
31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 FGW 3X8 PANEL 90° CORNER  
NO POST INFOLD-NON IMPACT  
COMPONENTS

|                |                     |                   |
|----------------|---------------------|-------------------|
| DRAWN:<br>J.L. | DWG NO.<br>08-01959 | REV<br>C          |
| SCALE<br>NTS   | DATE<br>04/19/13    | SHEET<br>13 OF 13 |

L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 12/12/2023

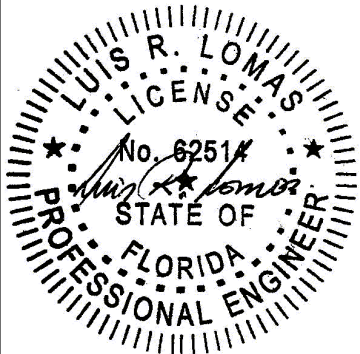

Luis R. Lomas P.E.  
FL No.: 62514