

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED DETAILS	04/23/26	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING, STEEL FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
4. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
5. ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
6. FRAME MATERIAL: ALUMINUM 6063-T6.
7. UNITS MUST BE GLAZED PER ASTM E1300 WITH SAFETY GLAZING.
8. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
9. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8".

10. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #14 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 7/16" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
11. FOR ANCHORING INTO MASONRY/CONCRETE USE 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
12. FOR ANCHORING INTO 16GA. (.060" MIN.) STEEL FRAMING USE #14 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
13. ALL FASTENERS TO BE CORROSION RESISTANT.
14. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
- 14.1. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42
- 14.2. CONCRETE – MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI.
- 14.3. MASONRY – STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
- 14.4. STEEL FRAMING – 16GA. (.060" MIN.) THICKNESS.

SIGNED: 04/23/2026

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION AND DESIGN PRESSURE CHART
3	ANCHORING LAYOUT
4 – 5	CROSS SECTIONS
6 – 8	INSTALLATION DETAILS
9	COMPONENTS

SOLAR INNOVATIONS. INC.
31 ROBERTS ROAD
PINE GROVE, PA 17963

SERIES SI3200 STACK WALL THERMALLY BROKEN AL
FOLDING WALL NON-IMPACT
NOTES

DRAWN:
TJH

DWG NO.
08-01147


REV
E

SCALE NTS


DATE 10/18/10

SHEET 1 OF 9

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

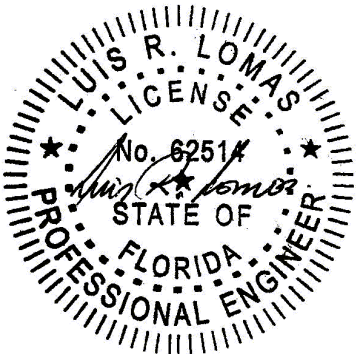


Luis R. Lomas P.E.
FL No.: 62514

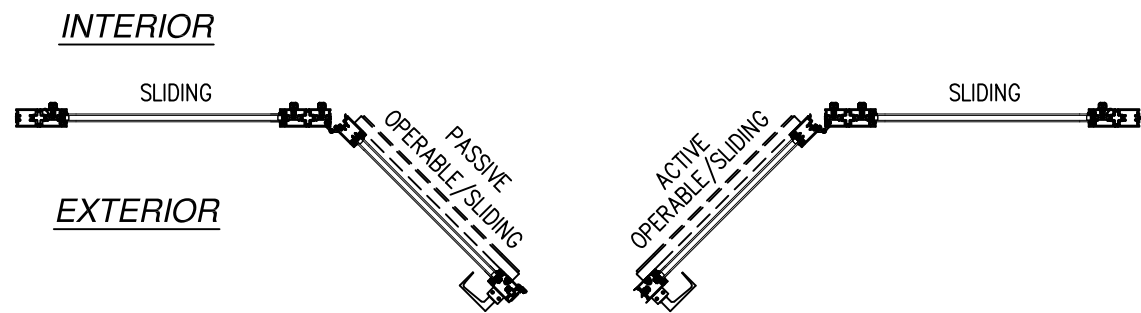

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED DETAILS	04/23/26	R.L.

Chart #1 Maximum Design pressure (psf)										
Panel Height (in)	Single Panel Width (in)									
	24.0		30.0		34.06		36.0		42.0	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
66.0	40.0	60.0	40.0	60.0	40.0	54.8	40.0	51.9	40.0	44.5
72.0	40.0	60.0	40.0	57.0	40.0	50.2	40.0	47.5	40.0	40.7
78.0	40.0	60.0	40.0	52.7	40.0	46.4	40.0	43.9	-	-
84.0	40.0	57.9	40.0	48.3	40.0	43.1	40.0	40.7	-	-
90.44	40.0	53.1	40.0	44.2	40.0	40.0	-	-	-	-
96.0	40.0	45.9	37.3	37.3	-	-	-	-	-	-
102.0	38.2	38.2	30.9	30.9	-	-	-	-	-	-
108.0	32.1	32.1	-	-	-	-	-	-	-	-
114.0	27.2	27.2	-	-	-	-	-	-	-	-
120.0	23.3	23.3	-	-	-	-	-	-	-	-
126.0	20.1	20.1	-	-	-	-	-	-	-	-

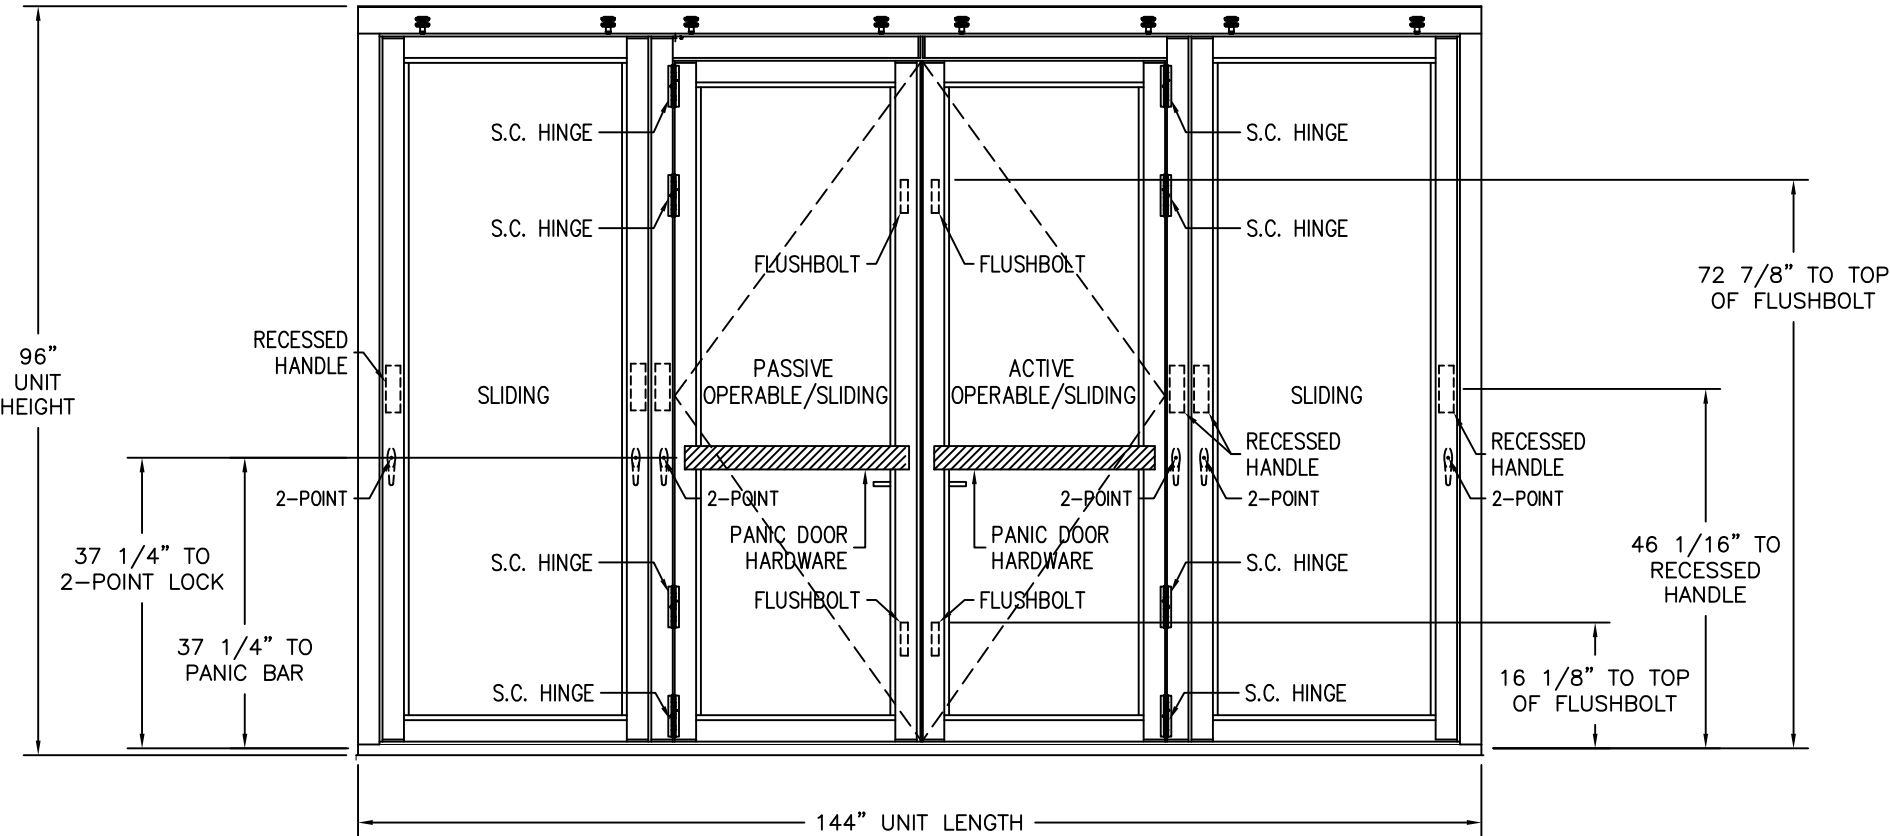

SERIES SI3200 STACK WALL THERMALLY BROKEN ALUMINUM FOLDING WALL

EXTERIOR VIEW

FOUR PANEL UNIT SHOWN. UNLIMITED PANELS IN UNLIMITED CONFIGURATIONS ARE APPROVED AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 21.4 FT² AND USES VERTICAL CONDITIONS AS SHOWN HEREIN

- NOTES:
1. OPERABLE/SLIDING PANEL SIZE: 34 1/2" x 87 3/8"
 2. OPERABLE/SLIDING PANEL D.L.O.: 31 1/2" x 80 1/2"
 3. SLIDING PANEL SIZE: 34 1/16" x 90 7/16"
 4. SLIDING PANEL D.L.O.: 31 1/16" x 83 9/16"

DESIGN PRESSURE RATING	IMPACT RATING
±40PSF	NONE

SEE CHART #1 THIS SHEET

HARDWARE SCHEDULE

- A. (4) 5 1/4" BUTT TYPE HINGES BY SOLAR INNOVATIONS
- B. PULL HANDLE BY SOLAR INNOVATIONS
- C. 2 POINT LOCK WITH HANDLE SYSTEM BY SOLAR INNOVATIONS
- D. FLUSH BOLT BY SOLAR INNOVATIONS
- E. PUSH BAR (INTERIOR) BY SOLAR INNOVATIONS

SOLAR INNOVATIONS. INC.


31 ROBERTS ROAD
PINE GROVE, PA 17963

SERIES SI3200 STACK WALL THERMALLY BROKEN AL
FOLDING WALL NON-IMPACT
ELEVATION AND DESIGN PRESSURE CHART

DRAWN: TJH	DWG NO. 08-01147	REV E
SCALE NTS	DATE 10/18/10	SHEET 2 OF 9



L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 04/23/2026

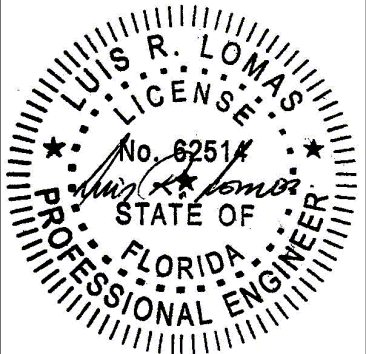

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED DETAILS	04/23/26	R.L.

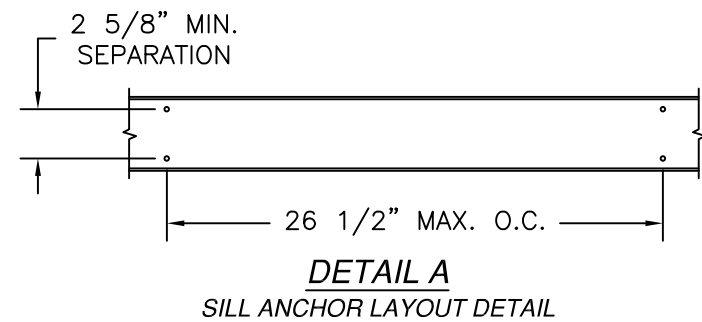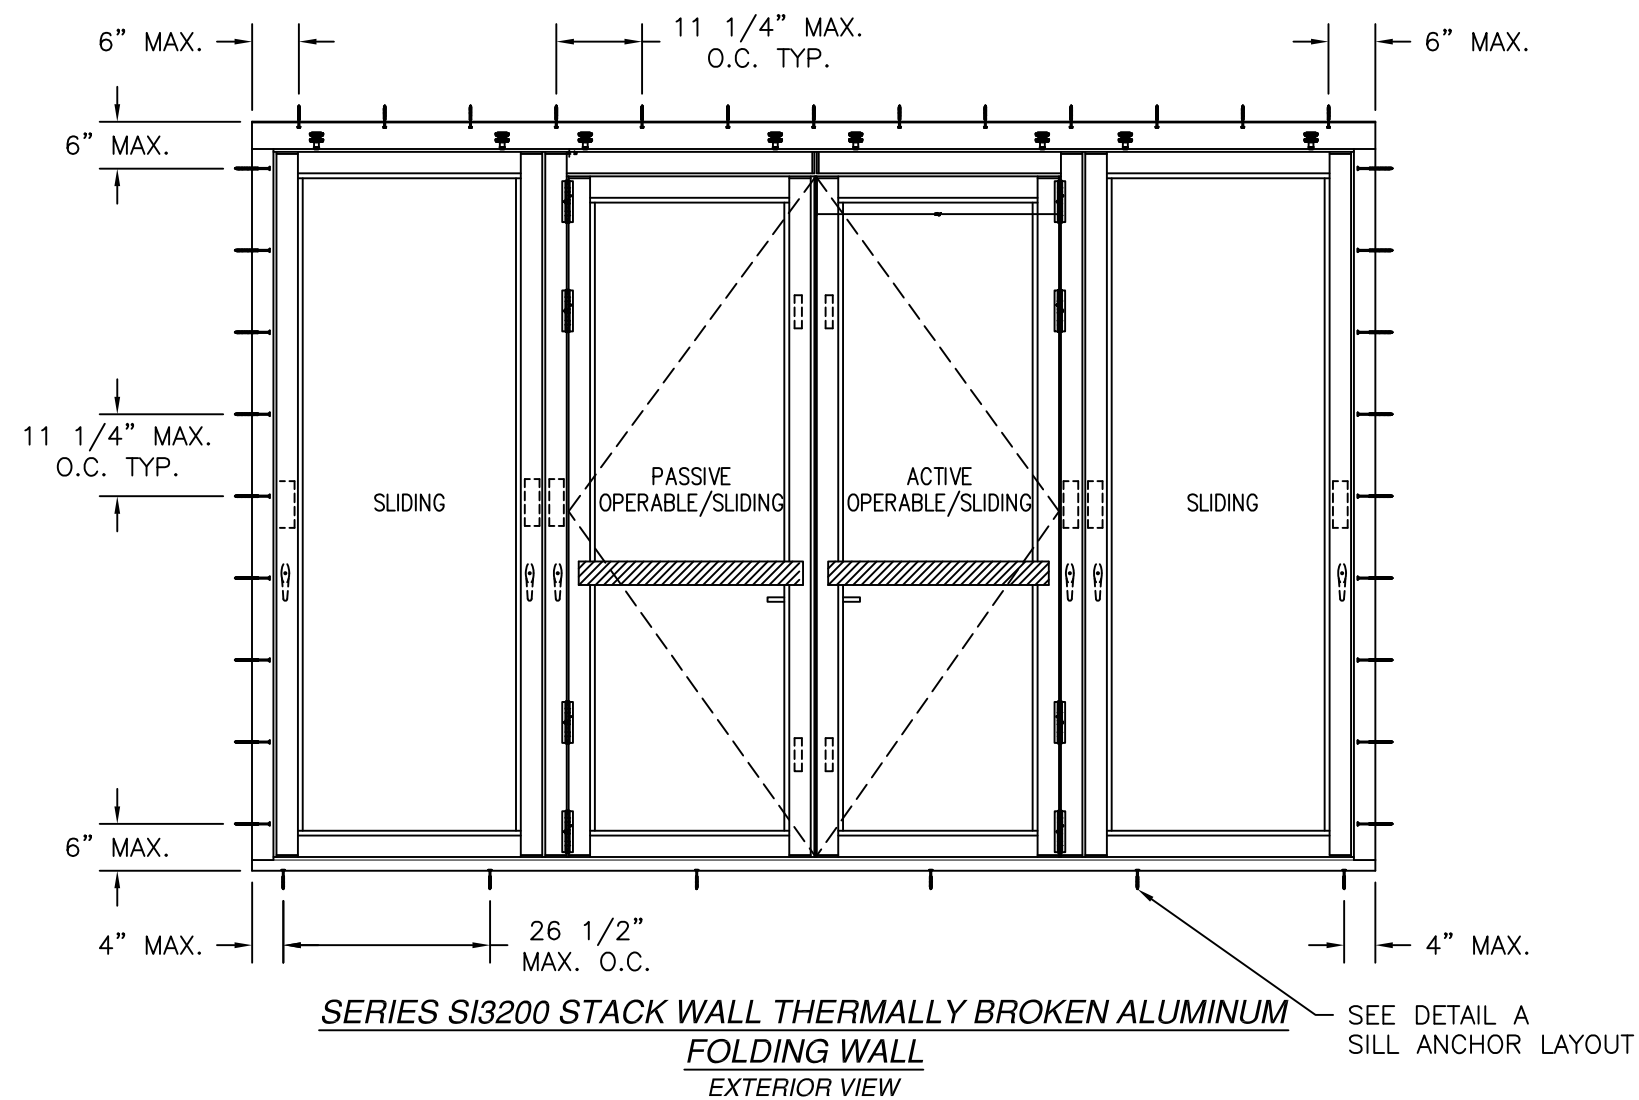

SOLAR INNOVATIONS. INC.

31 ROBERTS ROAD
PINE GROVE, PA 17963

SERIES SI3200 STACK WALL THERMALLY BROKEN AL

FOLDING WALL NON-IMPACT

ANCHORING LAYOUT

DRAWN: TJH

DWG NO. 08-01147

REV E

SCALE NTS

DATE 10/18/10


SHEET 3 OF 9

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903



434-688-0609 rllomas@lrlomaspe.com

SIGNED: 04/23/2026

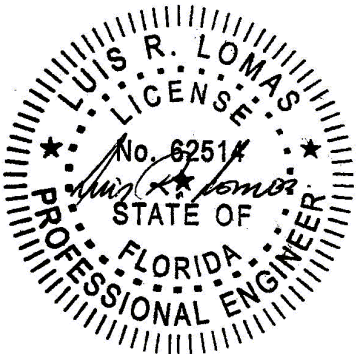


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED DETAILS	04/23/26	R.L.

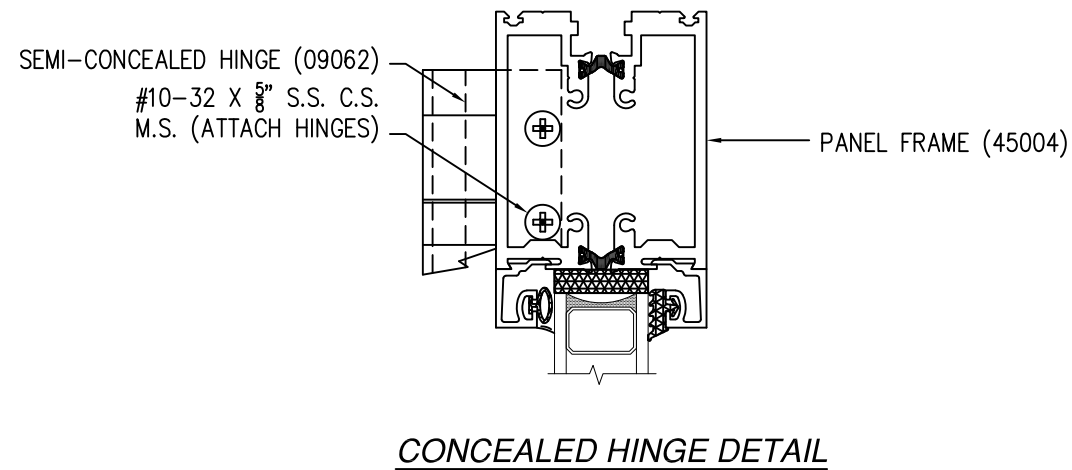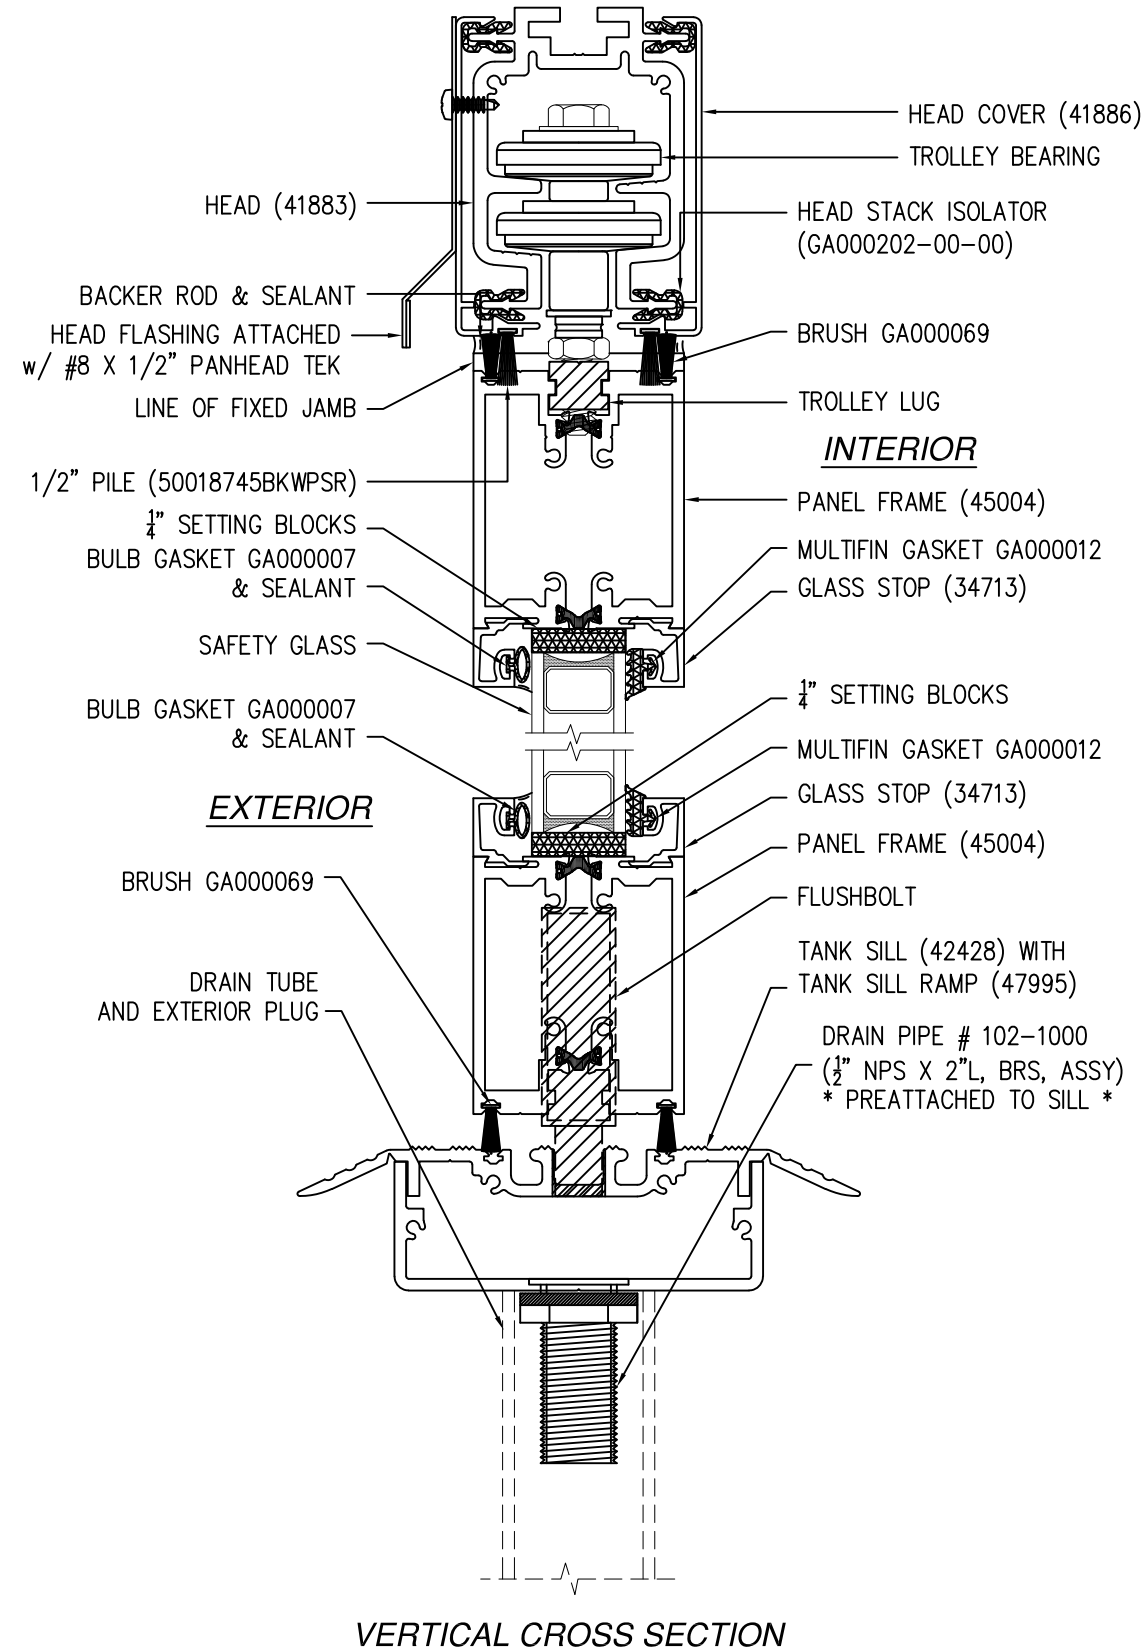


SIGNED: 04/23/2026

SOLAR INNOVATIONS. INC. 31 ROBERTS ROAD PINE GROVE, PA 17963		
SERIES SI3200 STACK WALL THERMALLY BROKEN AL FOLDING WALL NON-IMPACT VERTICAL CROSS SECTIONS		
DRAWN: TJH	DWG NO. 08-01147	REV E
SCALE NTS	DATE 10/18/10	SHEET 4 OF 9
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

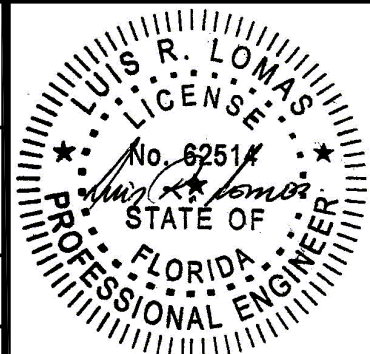

Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED DETAILS	04/23/26	R.L.

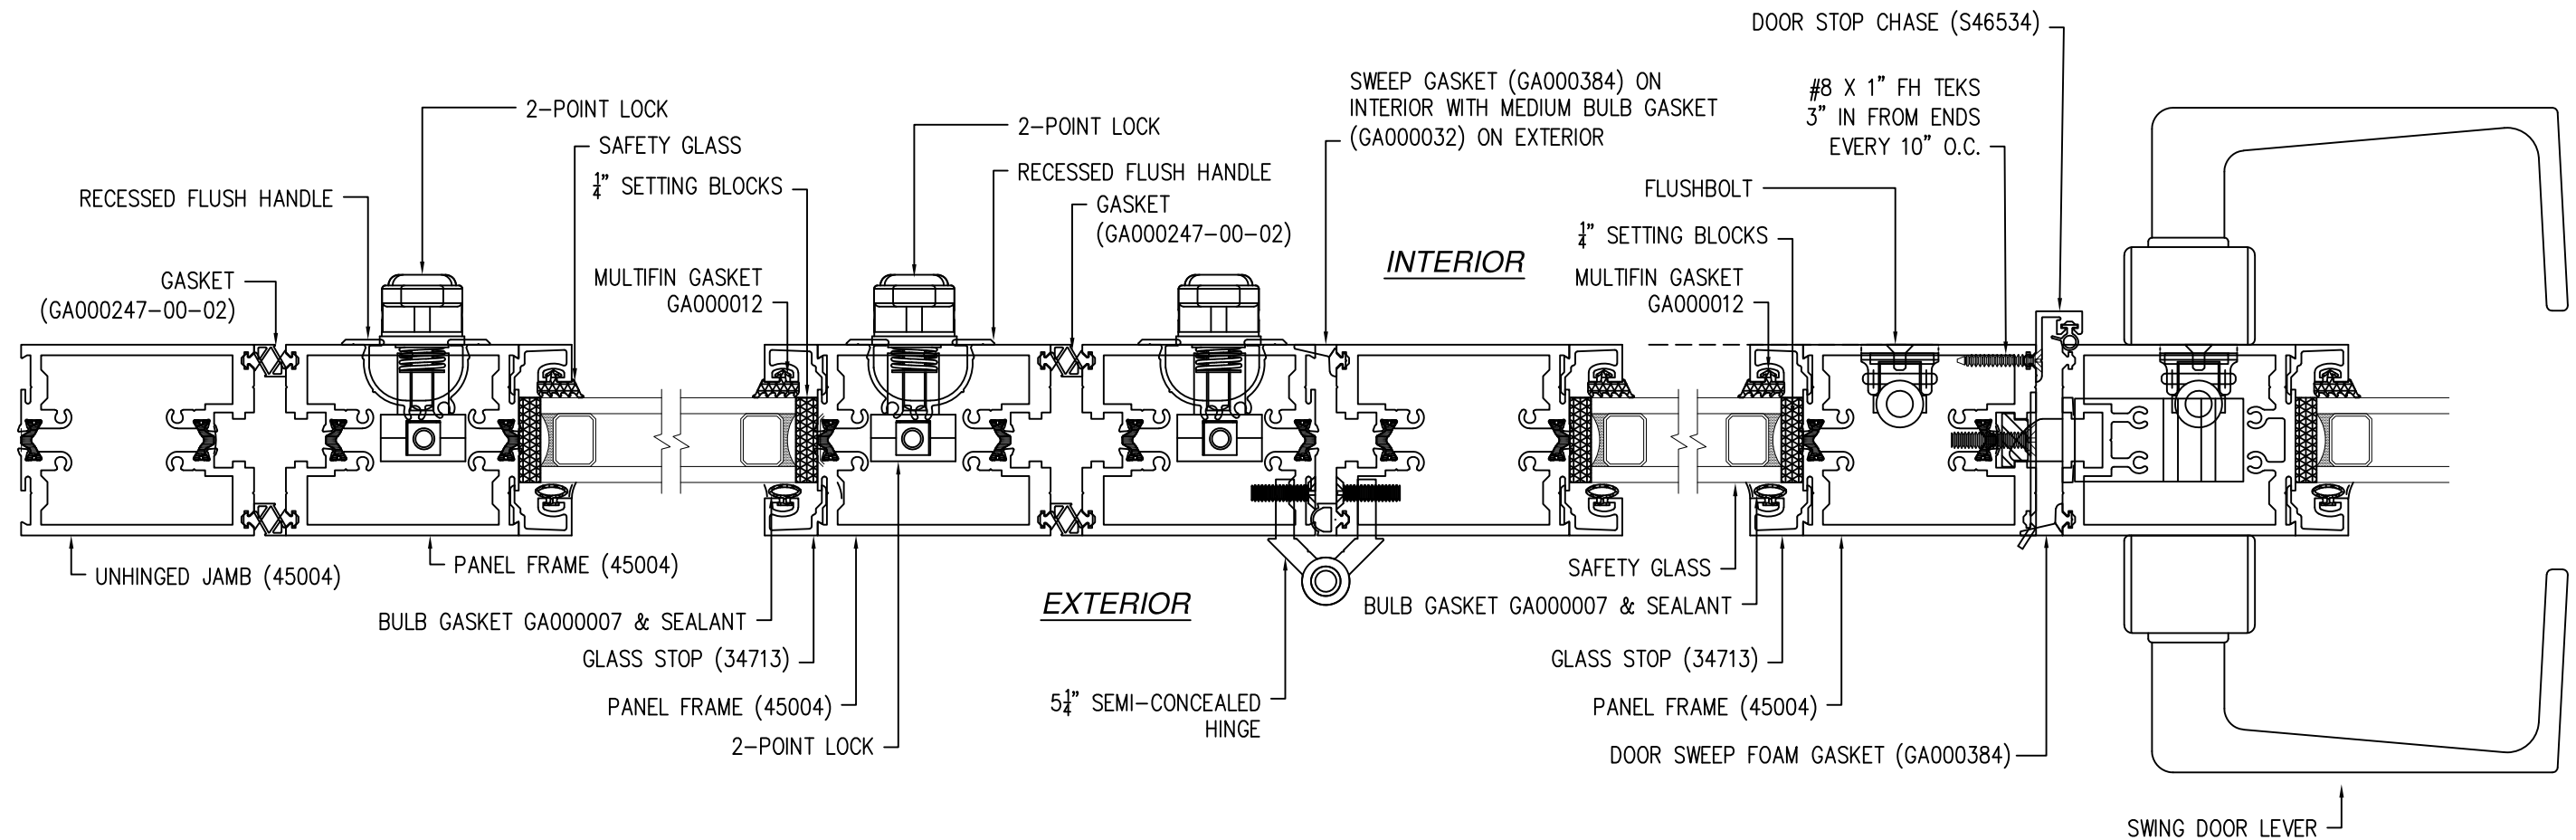

HORIZONTAL CROSS SECTION



SIGNED: 04/23/2026

SOLAR INNOVATIONS. INC. 31 ROBERTS ROAD PINE GROVE, PA 17963		
SERIES SI3200 STACK WALL THERMALLY BROKEN AL FOLDING WALL NON-IMPACT HORIZONTAL CROSS SECTIONS		
DRAWN: TJH	DWG NO. 08-01147	REV E
SCALE NTS	DATE 10/18/10	SHEET 5 OF 9
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

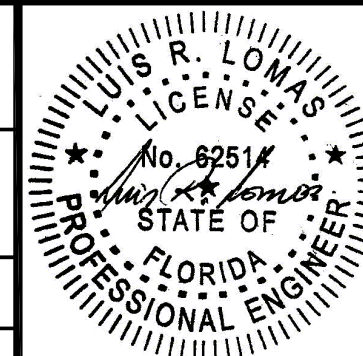

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED DETAILS	04/23/26	R.L.

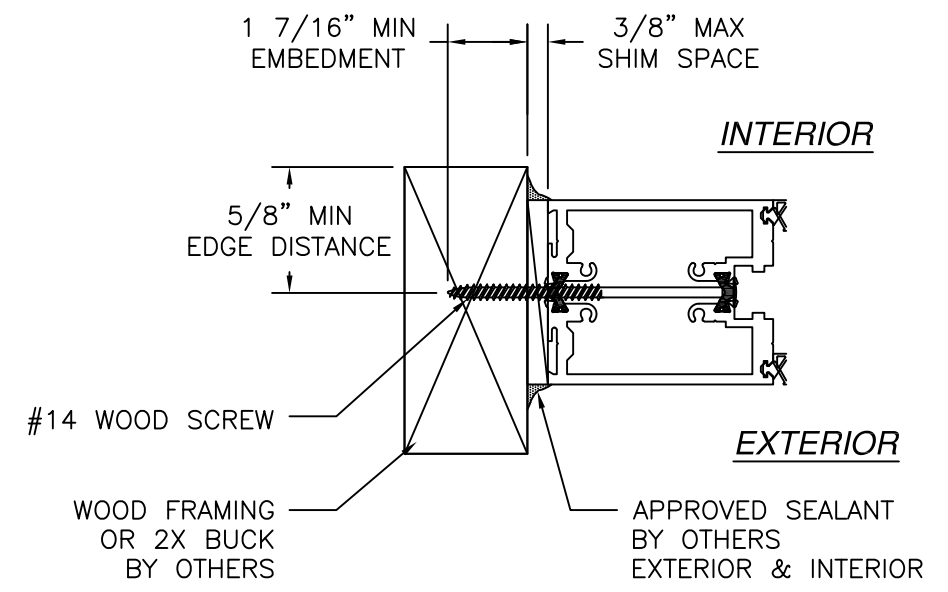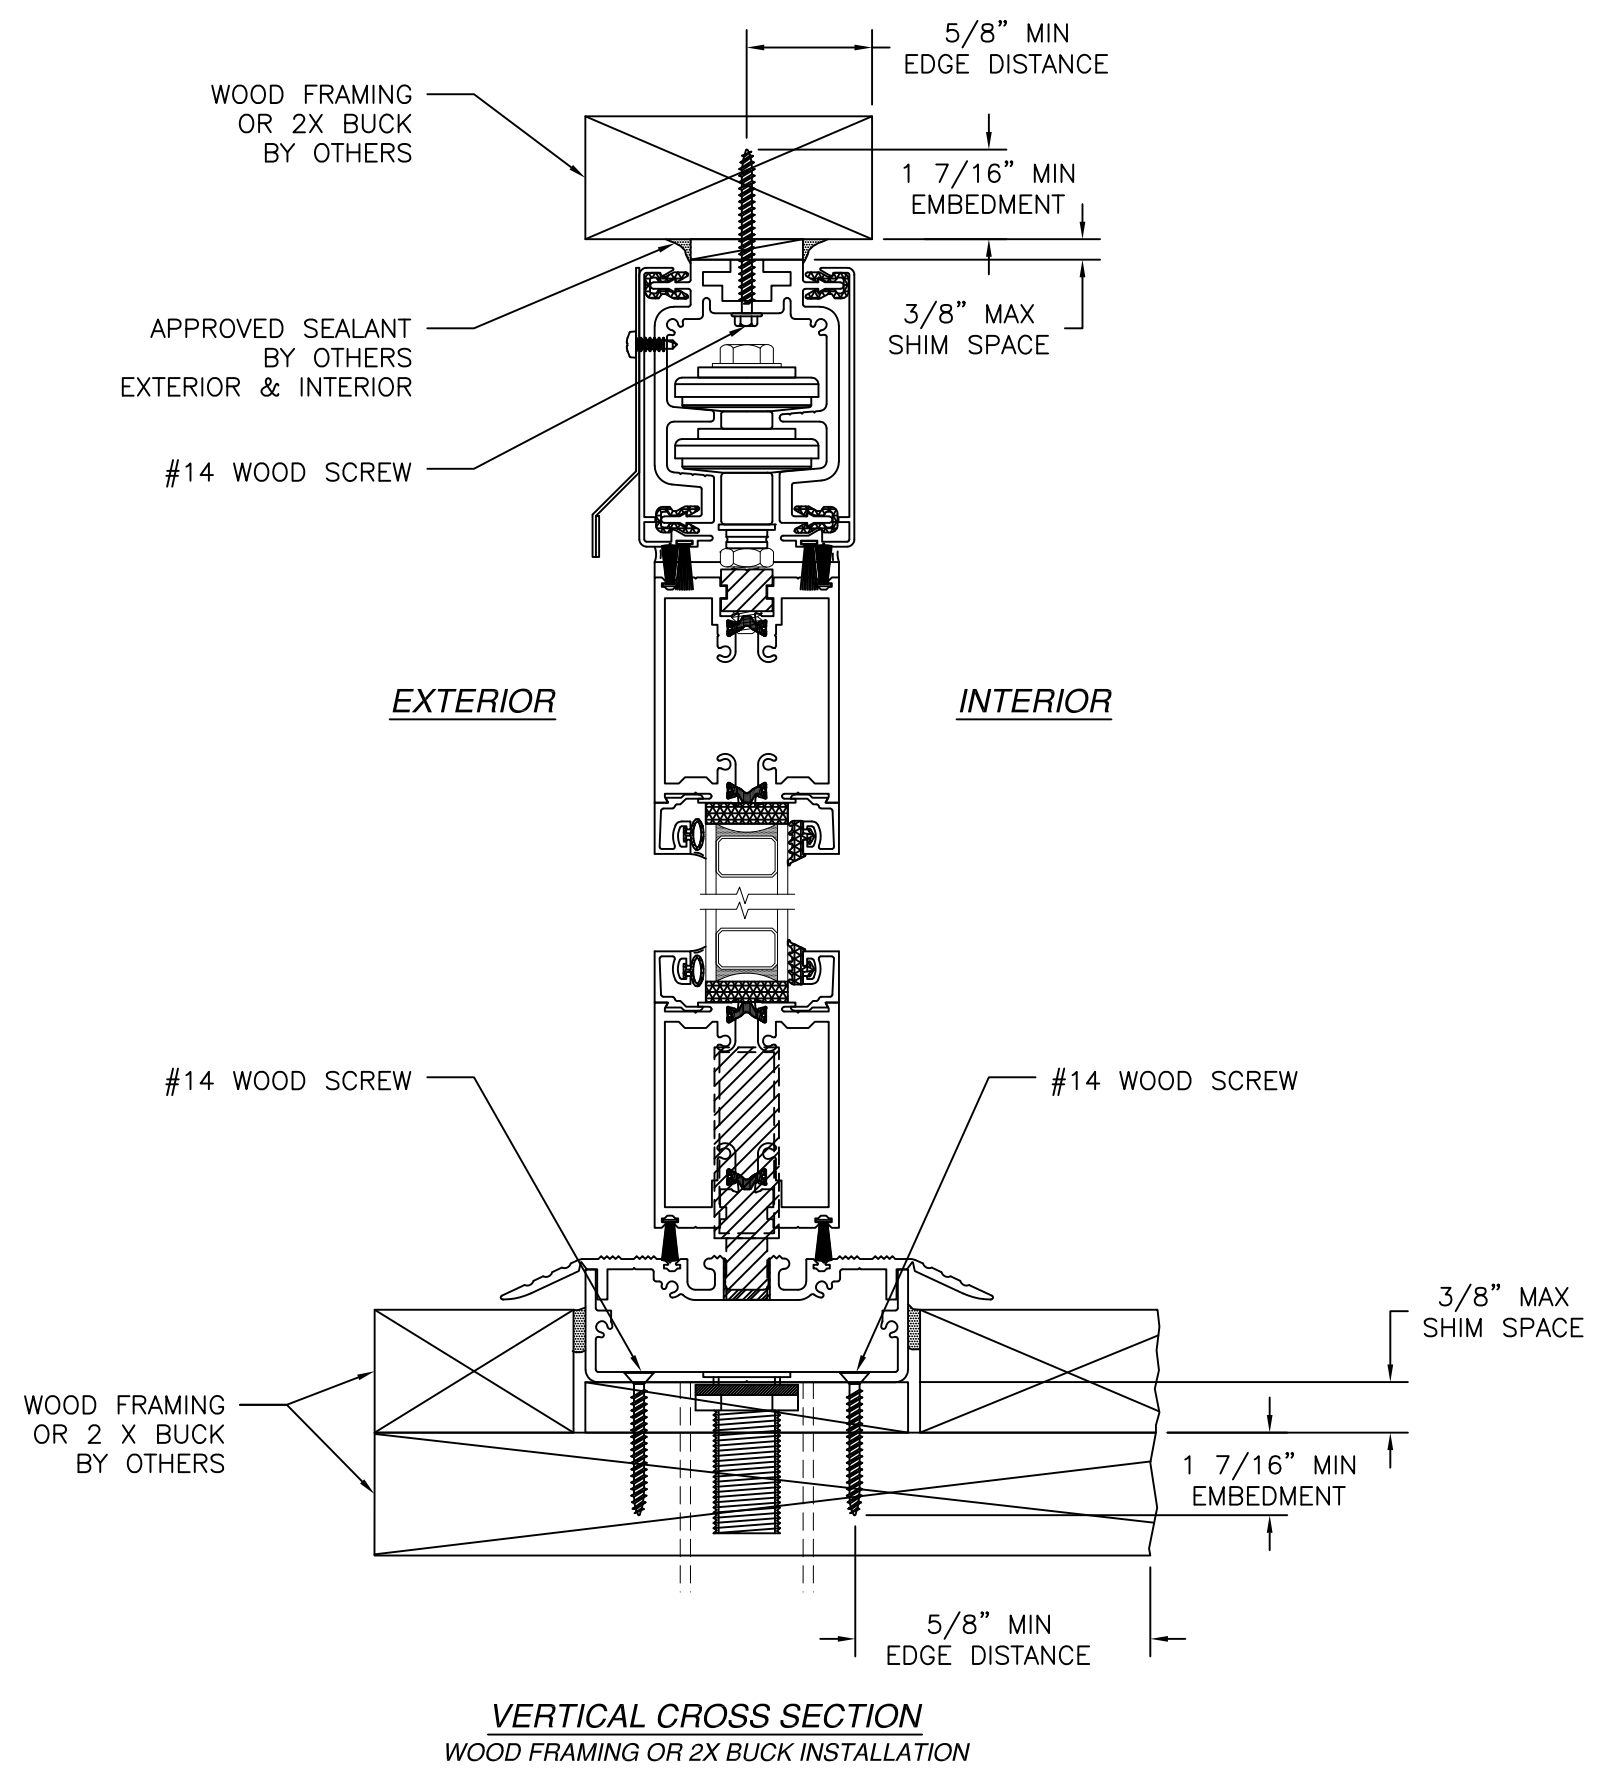

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SOLAR INNOVATIONS. INC.

31 ROBERTS ROAD
PINE GROVE, PA 17963

SERIES SI3200 STACK WALL THERMALLY BROKEN AL
FOLDING WALL NON-IMPACT
INSTALLATION DETAILS

DRAWN: TJH

DWG NO. 08-01147

REV E

SCALE NTS

DATE 10/18/10

SHEET 6 OF 9

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

SIGNED: 04/23/2026

LUIS R. LOMAS

LICENS. M.E.S.


No. 62514

STATE OF FLORIDA


PROFESSIONAL ENGINEER

Luis R. Lomas P.E.

FL No.: 62514

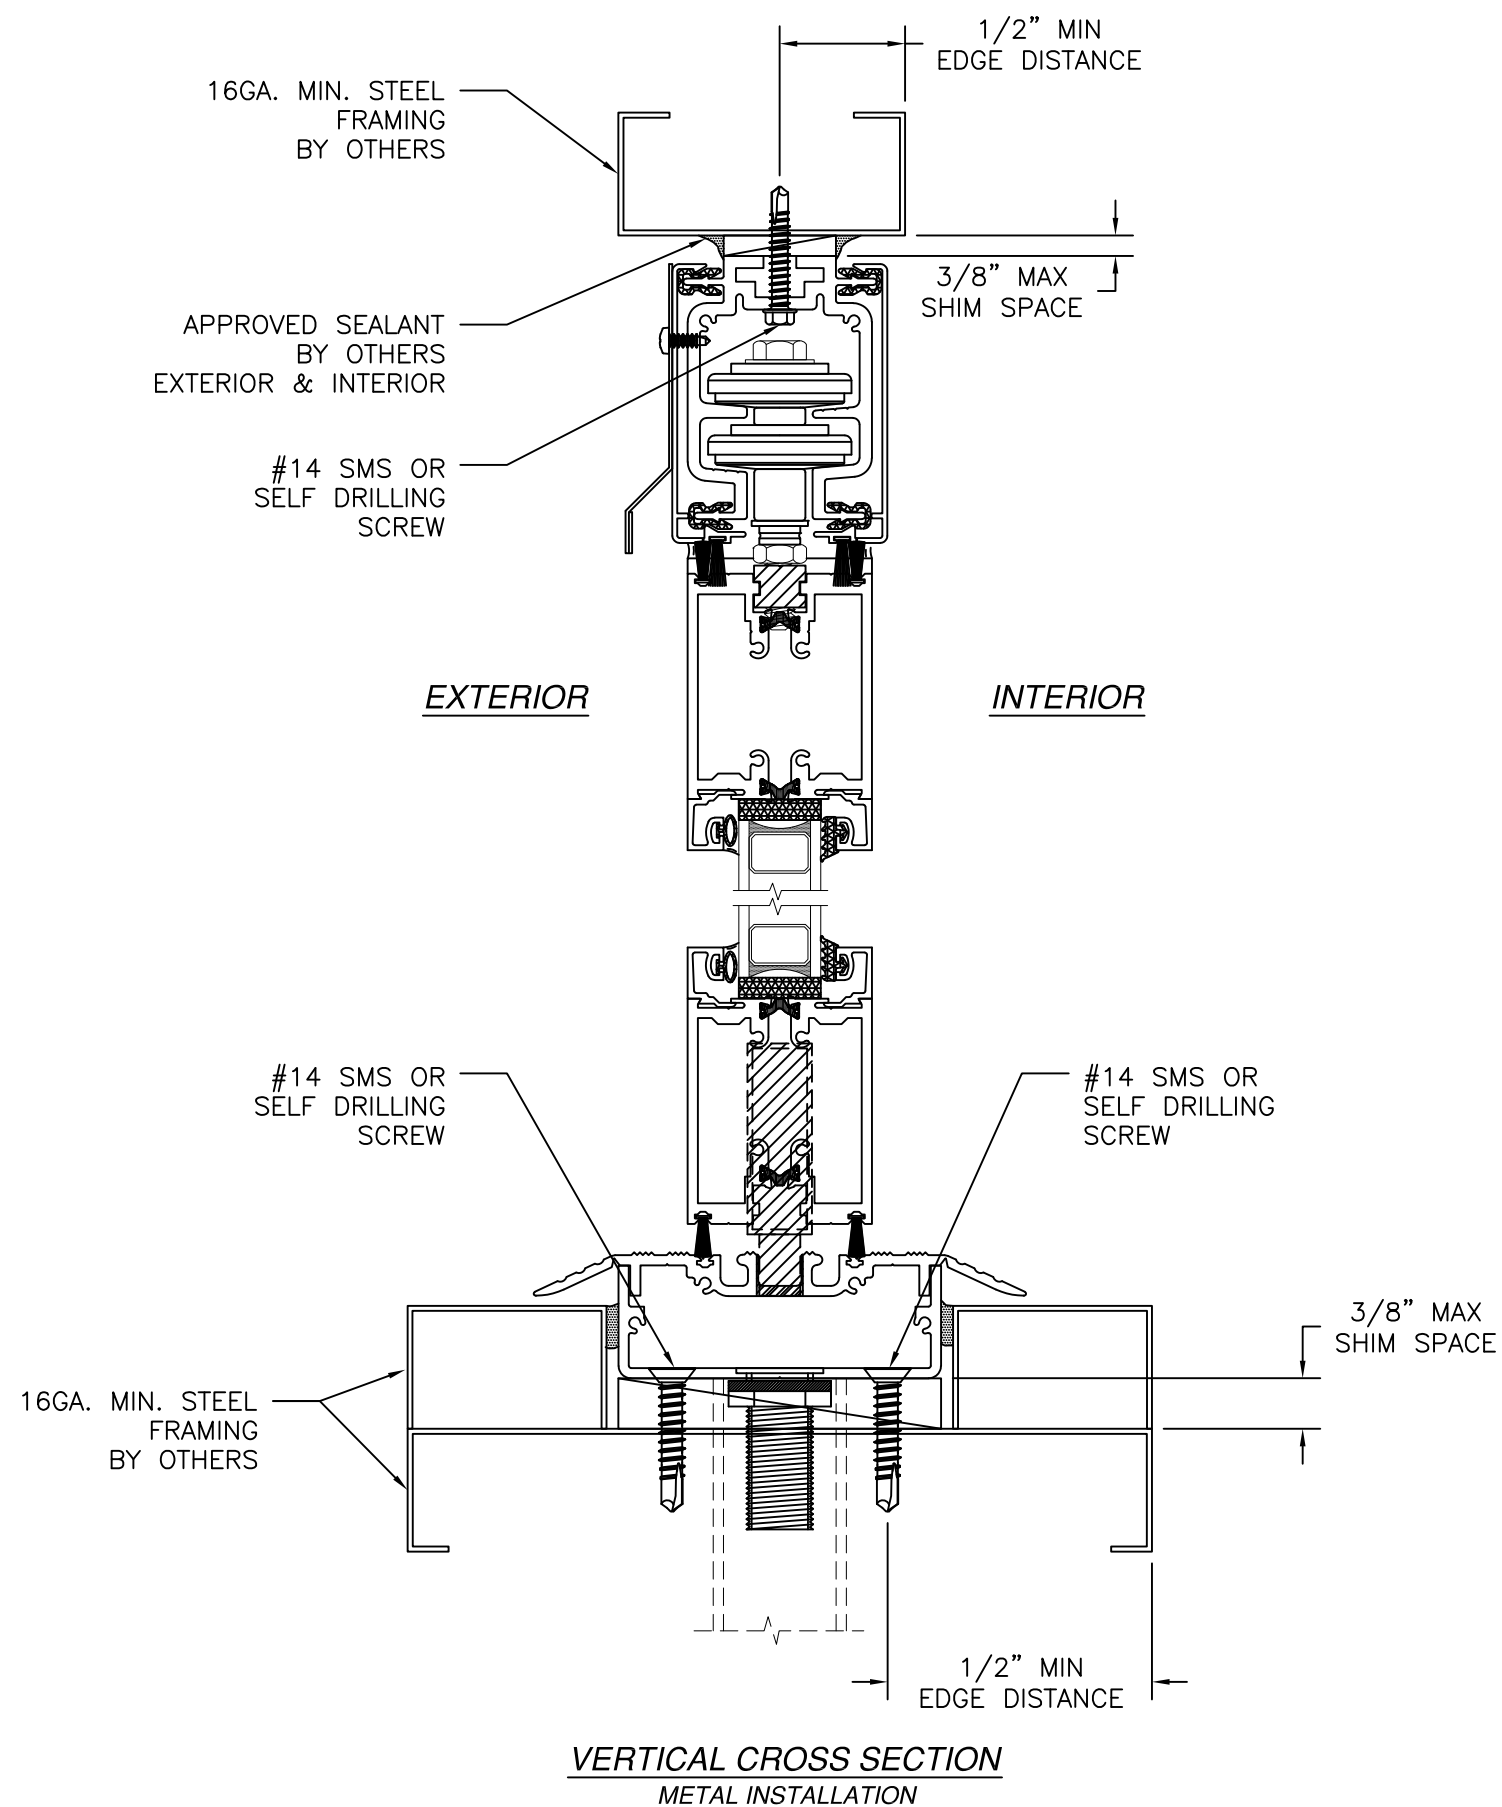

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED DETAILS	04/23/26	R.L.

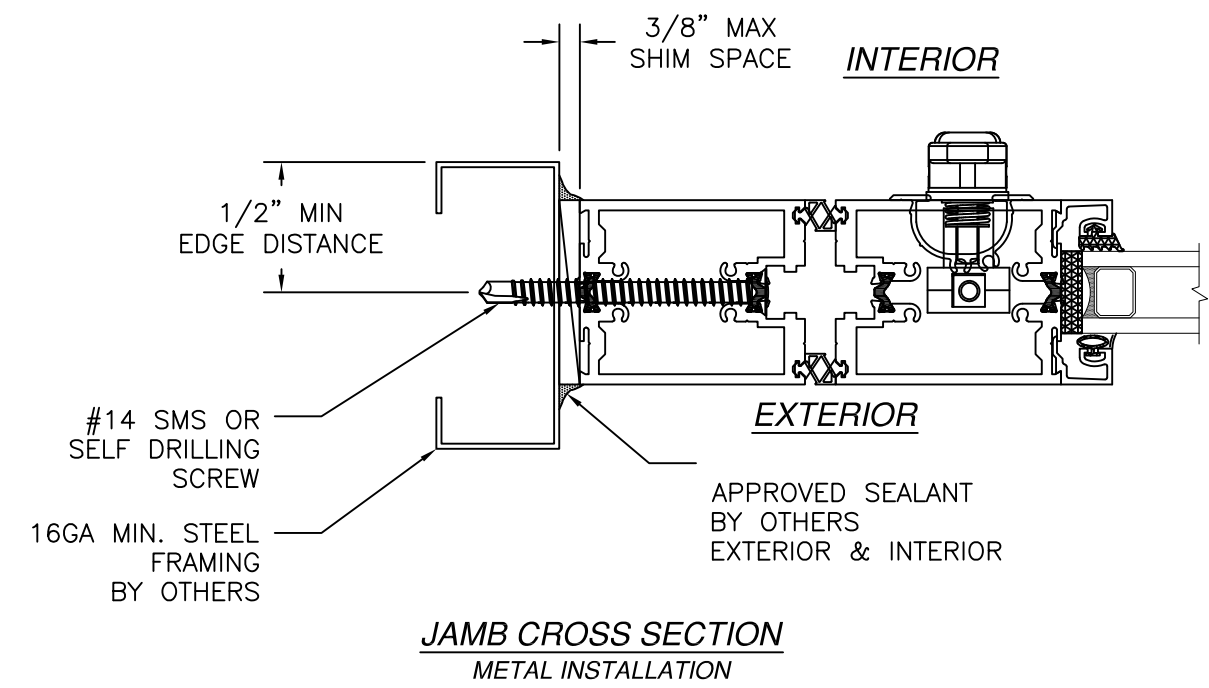

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 04/23/2026

SOLAR INNOVATIONS. INC.
31 ROBERTS ROAD
PINE GROVE, PA 17963

SERIES SI3200 STACK WALL THERMALLY BROKEN AL FOLDING WALL NON-IMPACT INSTALLATION DETAILS


DRAWN: TJH	DWG NO. 08-01147	REV E
SCALE NTS	DATE 10/18/10	SHEET 7 OF 9

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com


L. ROBERTO LOMAS
P.E.
No. 62514
STATE OF FLORIDA
PROFESSIONAL ENGINEER

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED DETAILS	04/23/26	R.L.

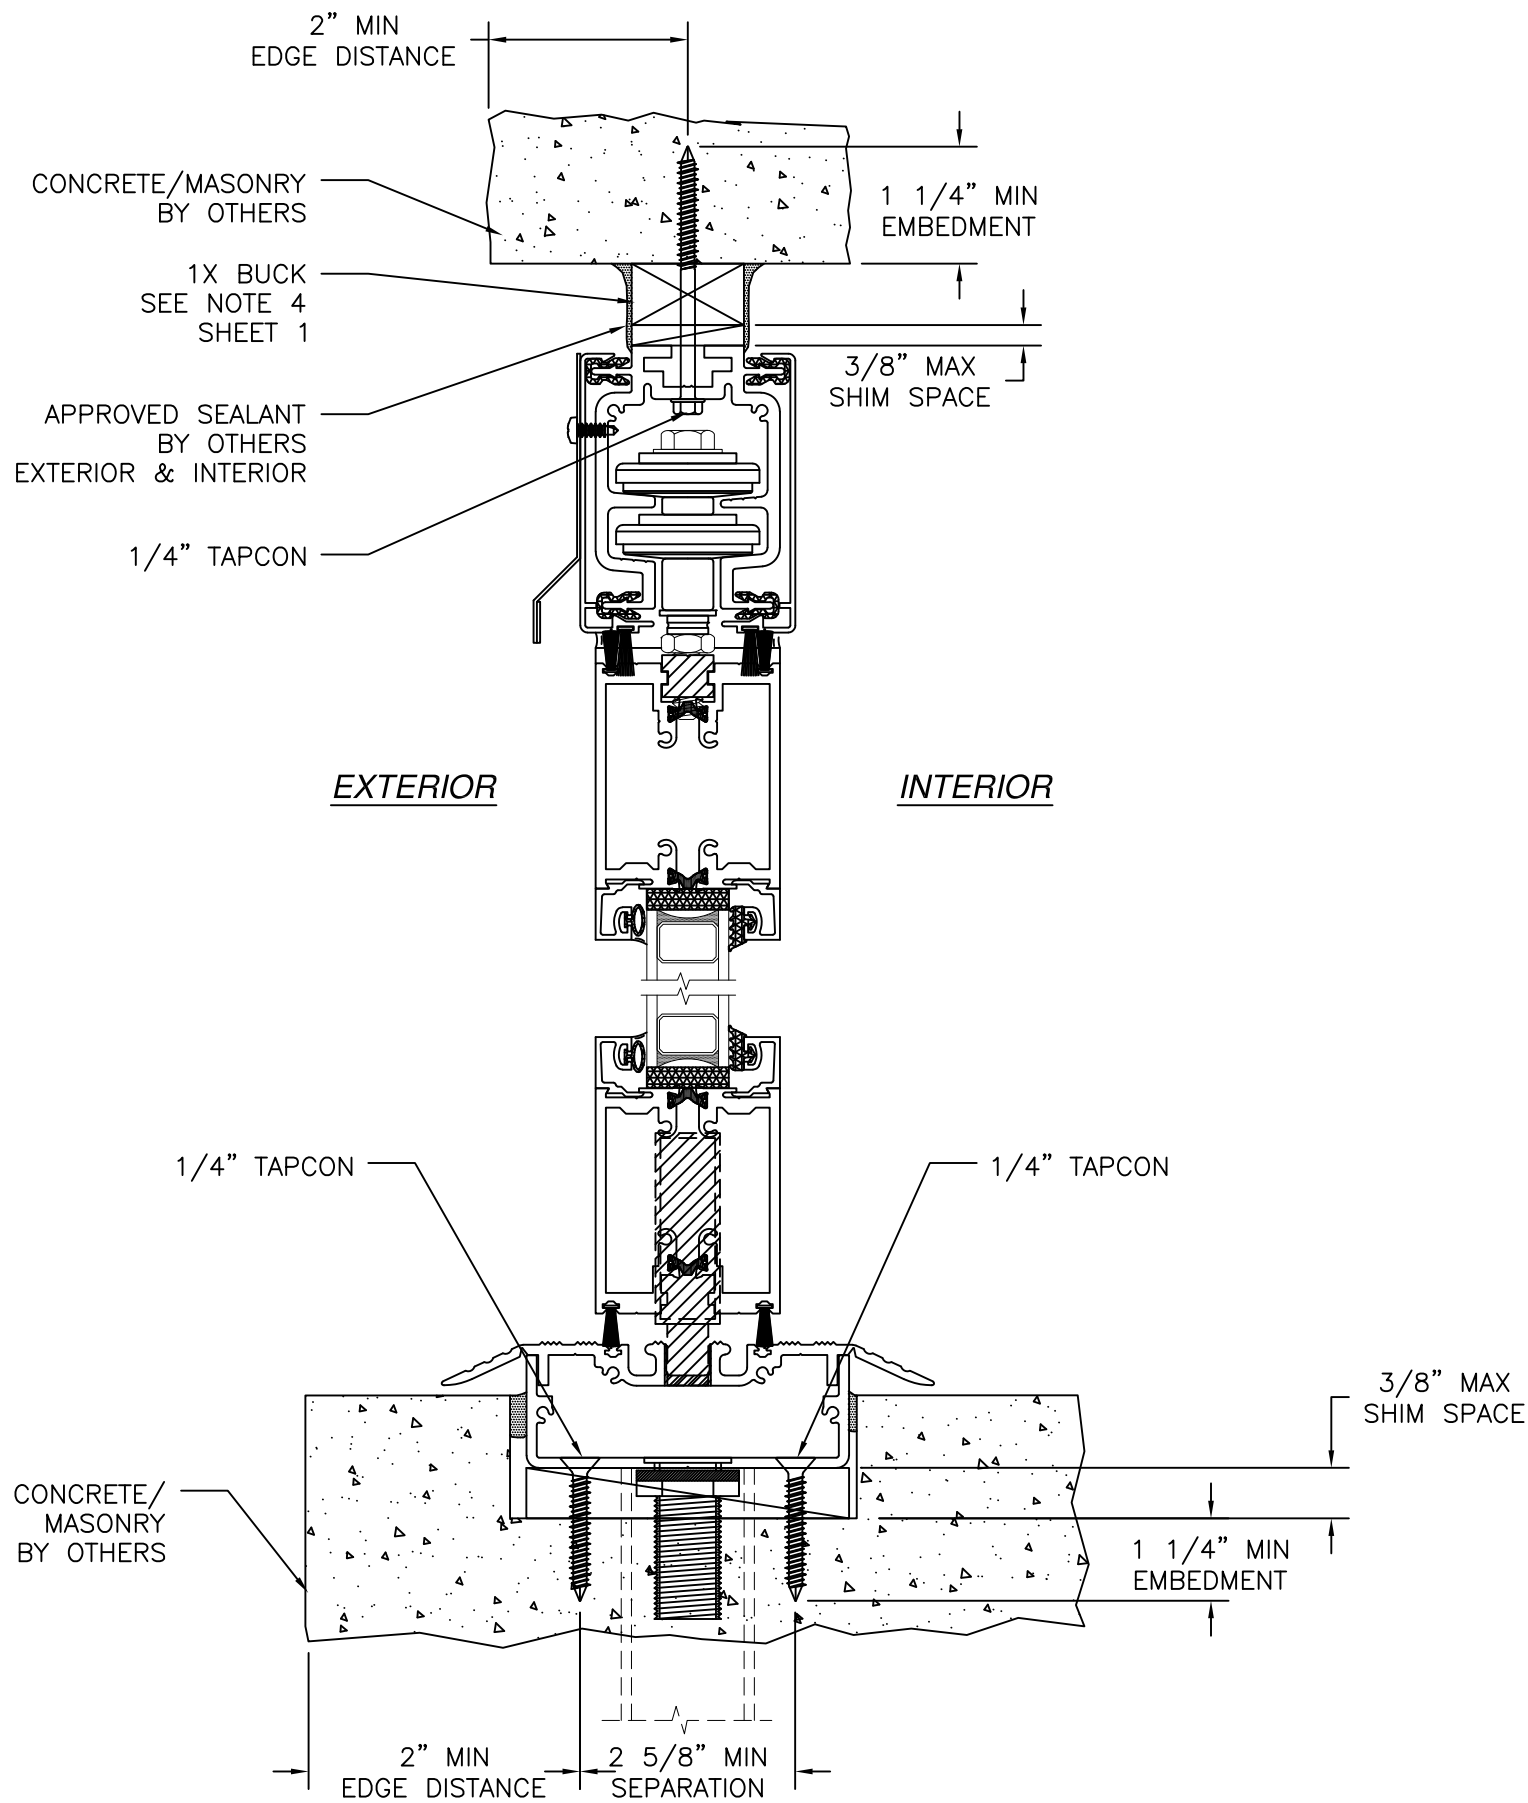

VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION

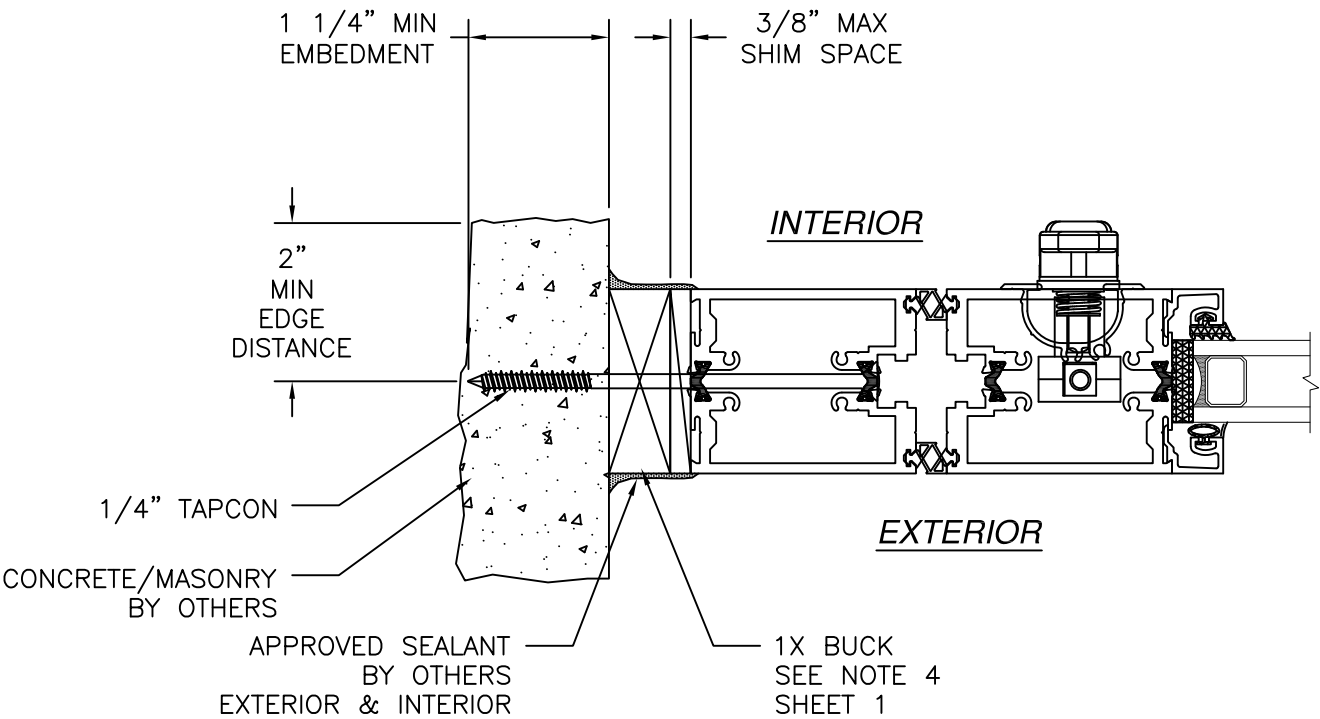

JAMB CROSS SECTION
CONCRETE/MASONRY INSTALLATION

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 04/23/2026

SOLAR INNOVATIONS. INC.

31 ROBERTS ROAD
PINE GROVE, PA 17963

SERIES SI3200 STACK WALL THERMALLY BROKEN AL
FOLDING WALL NON-IMPACT
INSTALLATION DETAILS

DRAWN: TJH

DWG NO. 08-01147

REV E

SCALE NTS


DATE 10/18/10

SHEET 8 OF 9


L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903


434-688-0609 rllomas@lrlomaspe.com

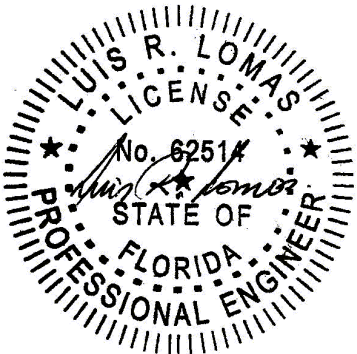


Luis R. Lomas P.E.
FL No.: 62514

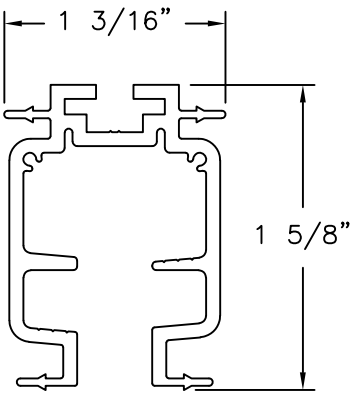


HEAD

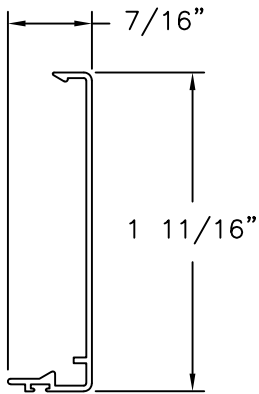


HEAD COVER

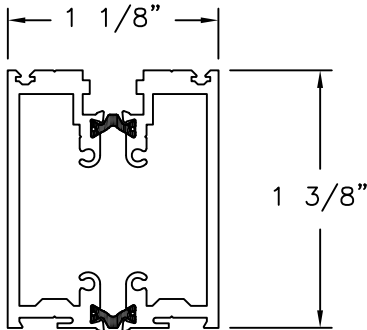


FRAME




GLAZING BEAD

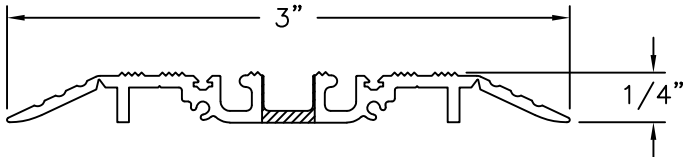


SILL

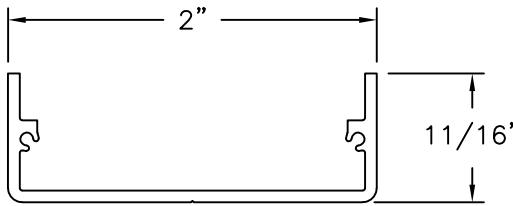


SILL ADAPTER

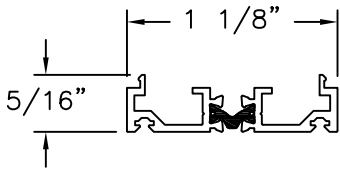

ADAPTER



DOOR STOP CHASE



DOOR STOP CAP

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED DETAILS	04/23/26	R.L.

SOLAR INNOVATIONS. INC.

31 ROBERTS ROAD
PINE GROVE, PA 17963


SERIES SI3200 STACK WALL THERMALLY BROKEN AL
FOLDING WALL NON-IMPACT
COMPONENTS

DRAWN: TJH DWG NO. 08-01147 REV E

SCALE NTS DATE 10/18/10 SHEET 9 OF 9

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 04/23/2026

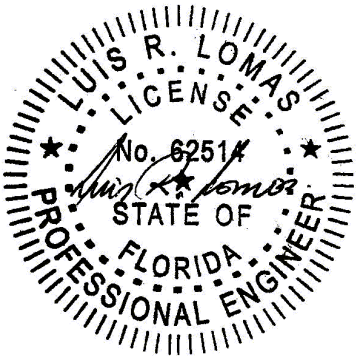

Luis R. Lomas P.E.
FL No.: 62514