

YKK AP AMERICA RESIDENTIAL

PRECEDENCE HORIZONTAL SLIDING WINDOW

(NON-HVHZ) (NON-IMPACT)

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- FOR INSTALLATION INTO WOOD FRAMING USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- FOR INSTALLATION INTO METAL STUD USE #10 SELF-TAPPING SCREWS THROUGH THE FRAME OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
- FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 3/16 INCH DIAMETER ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.
 - CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, MIN. F'm = 2000 PSI.

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-08
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: VINYL
- DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:
 - X: OPERABLE PANEL
 - O: FIXED PANEL
- GLAZING SHALL MEETS ASTM E1300 REQUIREMENTS, SEE SHEET 3 FOR GLAZING DETAIL.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATION & ANCHOR LAYOUT
3	VERTICAL SECTION & GLAZING DETAIL
4	HORIZONTAL DETAILS

UNIT DIMENSIONS			
CONFIGURATION	DESIGN PRESSURE	MAXIMUM SIZE	MISSILE IMPACT RATING
XX	+35 / -35 PSF	96" (W) X 60" (H)	NON-IMPACT
XOX	+35 / -35 PSF	107.5" (W) X 59.5" (H)	NON-IMPACT



YKK AP AMERICA, INC.
101 Marietta St NW Suite 2700
Atlanta, GA 30303
PH: (404) 502-8854 Ext 6044

TITLE: PRECEDENCE HORIZONTAL SLIDING WINDOW (NON-HVHZ) (NON-IMPACT) INSTALLATION & GENERAL NOTES


PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A. XOX UNIT ADDED	LS	08.11.16
B. 7TH FBC CODE CHANGE	MS	04.24.20
C. REINFORCEMENT REV.	LS	05.28.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.06.04 10:22:28 -0400

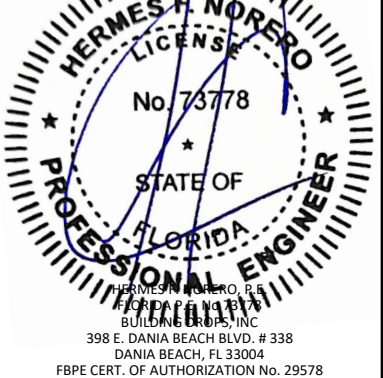

FL #: **FL12286**

DATE: **06.04.15**


DWG. BY: **BB** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **YKK146**

SHEET: **1** OF **4**


c:\users\lucianosanchez\building drops, inc\building drops, inc\document\3\common\projects\ykk ap america, inc\fbc-26-0583 - fl12286 horizontal sliding windows - reinforcement revision\dwgs\ykk146.dwg 6/3/2026 3:08 PM

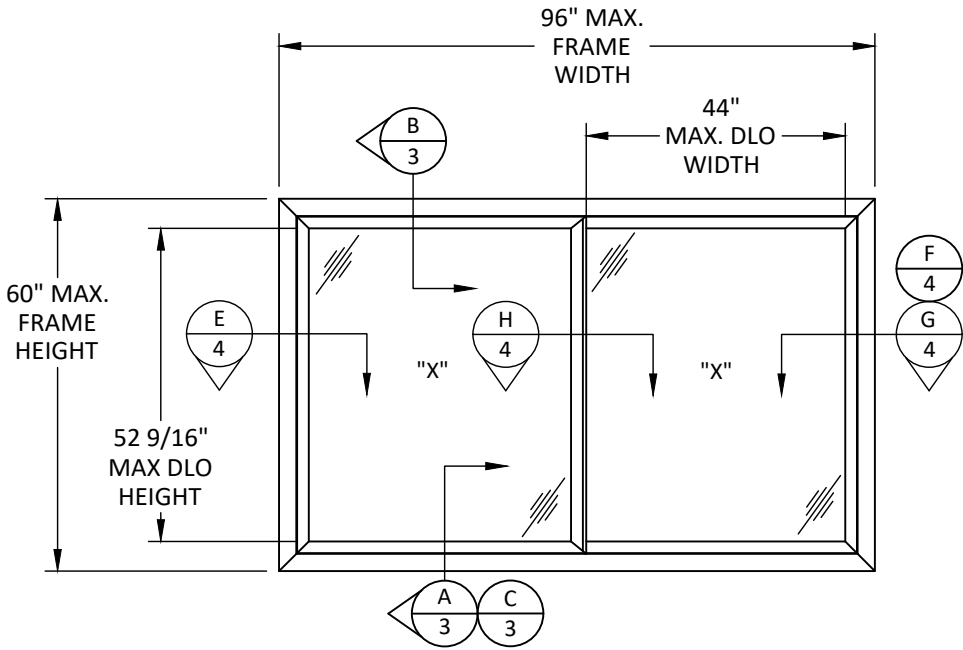


TYPICAL ELEVATION
XX UNIT

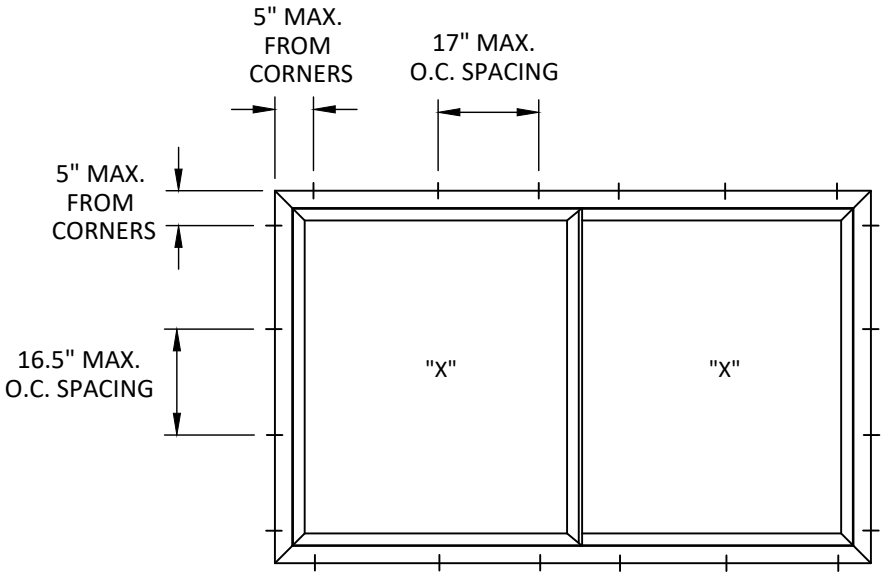

ANCHOR LAYOUT
THROUGH FRAME

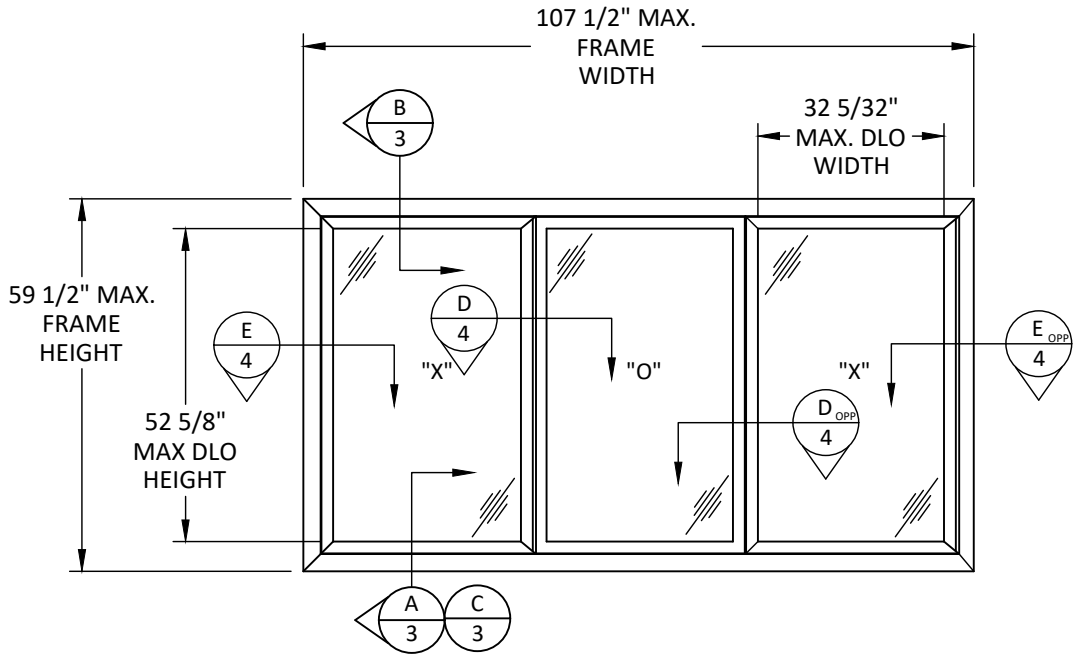

TYPICAL ELEVATION
XOX UNIT

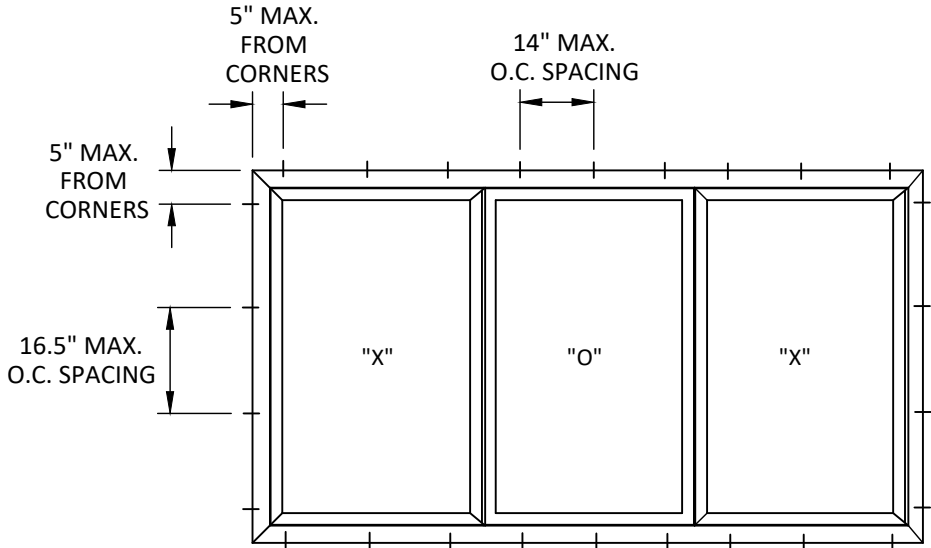

ANCHOR LAYOUT
THROUGH FRAME



YKK AP AMERICA, INC.
101 Marietta St NW Suite 2700
Atlanta, GA 30303
PH: (404) 502-8854 Ext 6044

TITLE: PRECEDENCE HORIZONTAL
SLIDING WINDOW
(NON-HVHZ) (NON-IMPACT)
ELEVATION & ANCHOR LAYOUT

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A. XOX UNIT ADDED	LS	08.11.16
B. 7TH FBC CODE CHANGE	MS	04.24.20
C. REINFORCEMENT REV.	LS	05.28.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:
FL12286

DATE: **06.04.15**

DWG. BY: **BB** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **YKK146**

SHEET:


2

OF 4

c:\users\lucianosanchez\building drops, inc\building drops, inc\projects\ykk ap america, inc\fb-26-0583 - fl12286 horizontal sliding windows - reinforcement revision\dwgs\ykk146.dwg
6/3/2026 3:08 PM
c:\users\lucianosanchez\building drops, inc\building drops, inc\projects\ykk ap america, inc\fb-26-0583 - fl12286 horizontal sliding windows - reinforcement revision\dwgs\ykk146.dwg

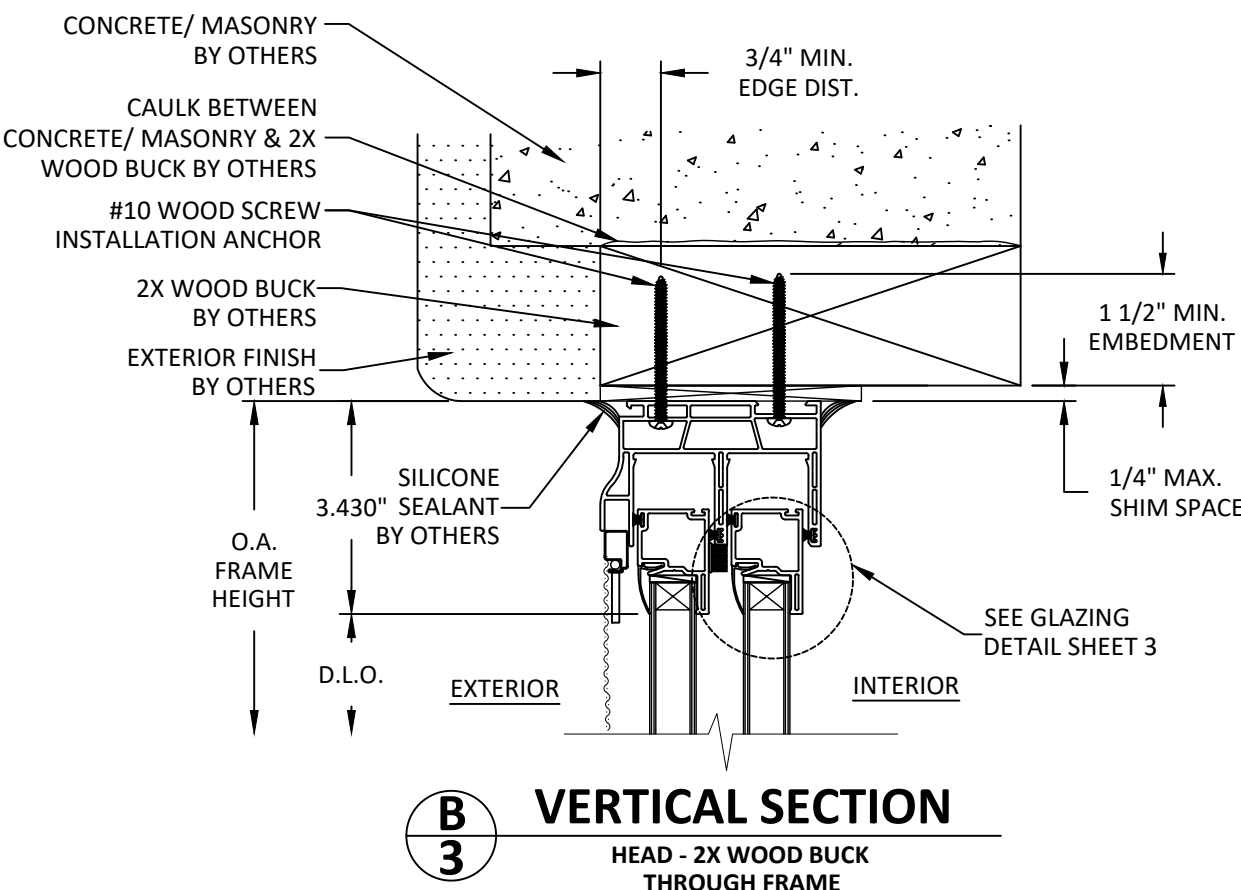


B
3
VERTICAL SECTION
HEAD - 2X WOOD BUCK
THROUGH FRAME

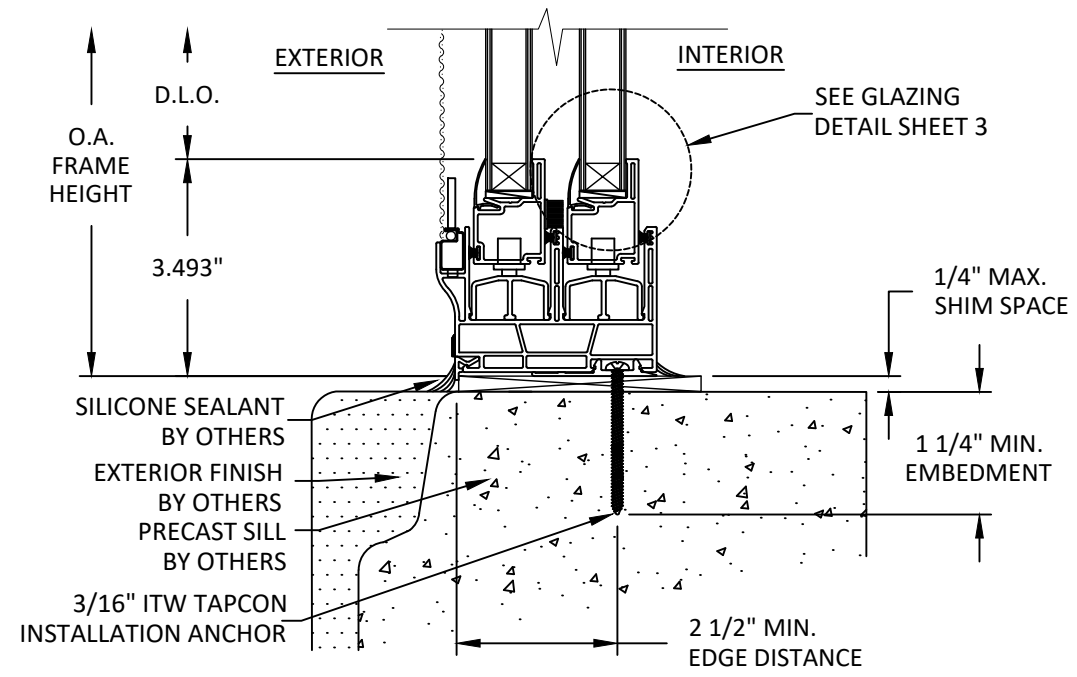

A
3
VERTICAL SECTION
SILL - CONCRETE/MASONRY
THROUGH FRAME

- GLAZING NOTES:**
1. GLASS THICKNESS AND TYPE SHALL COMPLY WITH ASTM E1300 GLASS STRENGTH REQUIREMENTS.
 2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 3. SETTING BLOCK TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" PER FBC CHAPTER 24.
 4. ALL GLAZING CONFIGURATIONS SHALL COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN CURRENT FBC.

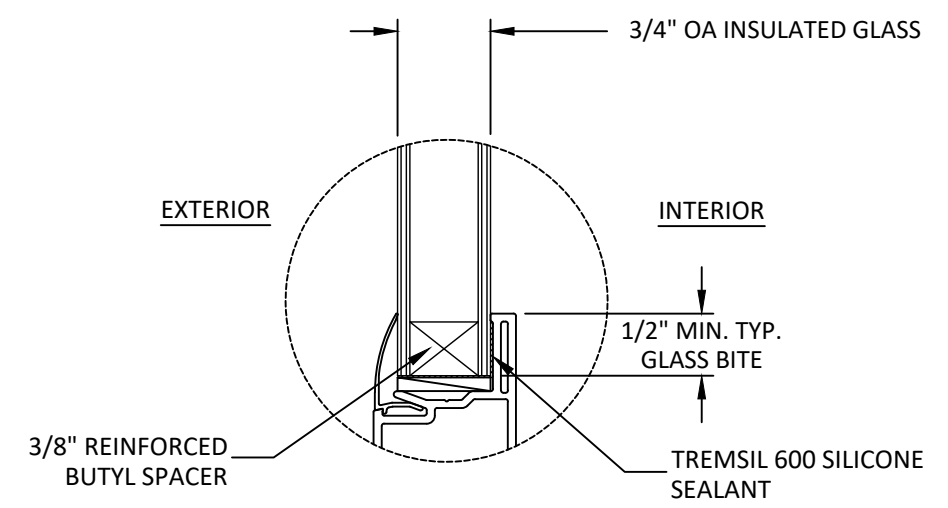


GLAZING DETAIL

INTERCEPT STAINLESS STEEL OR TIN PLATED SPACER:
AROUND THE PERIMETER OF THE GLASS

PRIMARY SEALANT:
POLYISOBUTYLENE (PIB)

SECONDARY SEALANT:
STRUCTURAL SILICONE INTENDED FOR FABRICATION OF INSULATED GLASS UNITS.

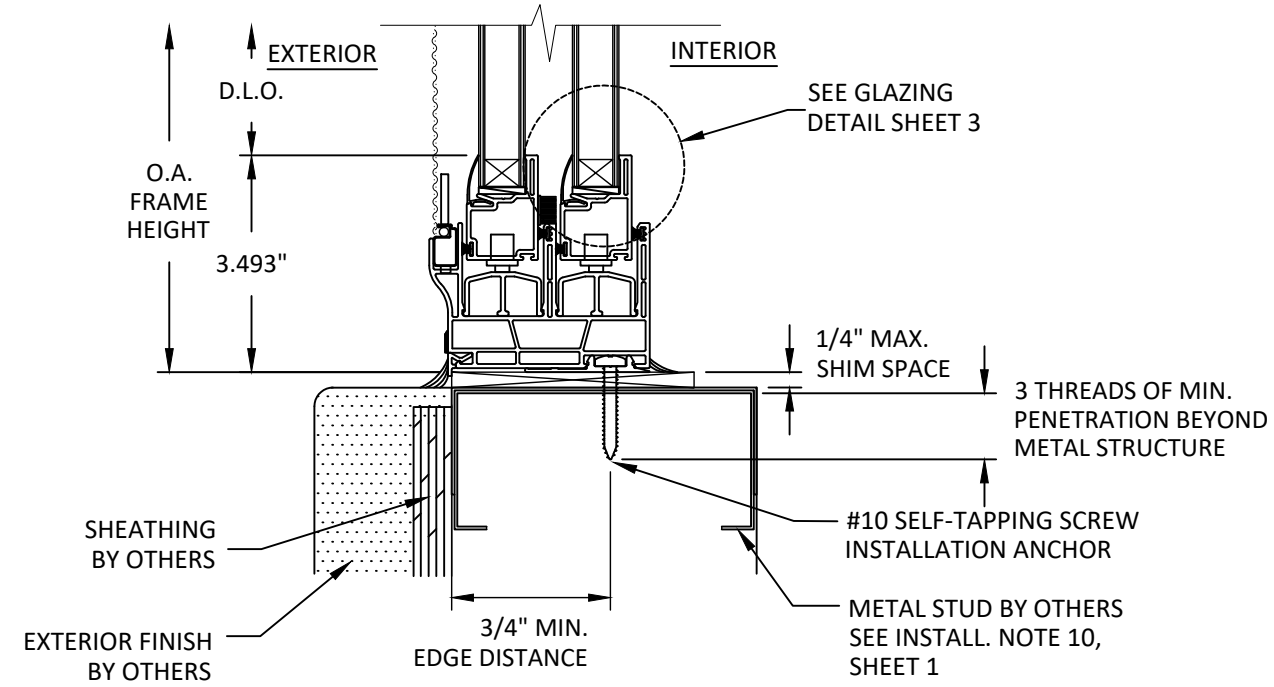

C
3
VERTICAL SECTION
SILL - METAL STUD
THROUGH FRAME



Quality
inspires™

YKK AP AMERICA, INC.
101 Marietta St NW Suite 2700
Atlanta, GA 30303
PH: (404) 502-8854 Ext 6044

TITLE: PRECEDENCE HORIZONTAL SLIDING WINDOW (NON-HVHZ) (NON-IMPACT)


VERTICAL SECTIONS & GLAZING DETAILS

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A. XOX UNIT ADDED	LS	08.11.16
B. 7TH FBC CODE CHANGE	MS	04.24.20
C. REINFORCEMENT REV.	LS	05.28.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

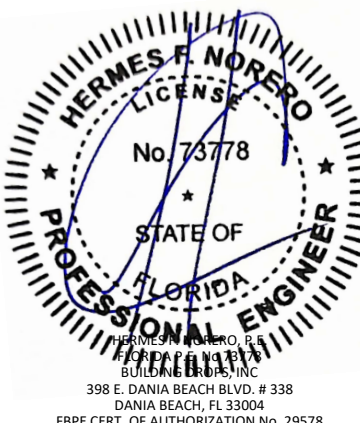

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL12286**

DATE: **06.04.15**

DWG. BY: BB	CHK. BY: HFN
--------------------	---------------------

SCALE: **NTS**

DWG. #: **YKK146**

SHEET: **3**

OF 4

PREPARED BY: BUILDING DROPS, INC.

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



DATE: 06.04.15

SCALE: NTS

DWG. #: YKK146

SHEET:

OF 4

