

7/31/2026 11:58 AM

c:\users\sebastianherrerros\desktop\ykk_res_2026 cc\112286\ykk128.dwg

YKK AP AMERICA RESIDENTIAL

STYLEVIEW HORIZONTAL SLIDING WINDOW

(NON-HVHZ) (NON-IMPACT)

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- FOR INSTALLATION TO 2X WOOD FRAMING USE #8 PH WOOD SCREW OF SUFFICIENT LENGTH TO ACHIEVE MINIMUM 1 1/2" EMBEDMENT.
- FOR INSTALLATION TO METAL STUD USE #8 SELF-TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE MINIMUM 3 THREADS PENETRATION BEYOND METAL STRUCTURE.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 0.033 MILS. (20 GAUGE).

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-22
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT. DOCUMENTS SHALL BE APPROVED BY AUTHORITY HAVING JURISDICTION (AHJ).
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: VINYL
- DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:
 - X: OPERABLE PANEL
 - O: FIXED PANEL
- GLAZING SHALL MEET ASTM E1300 REQUIREMENTS, SEE SHEET 4 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATION & ANCHOR LAYOUT
3	VERTICAL SECTIONS
4	HORIZONTAL SECTIONS & GLAZING DETAILS

UNIT DIMENSIONS			
CONFIGURATION	DESIGN PRESSURE	MAXIMUM SIZE	MISSILE IMPACT RATING
XO	+40 / -40 PSF	71.5" (W) X 59.5" (H)	NON-IMPACT
XOX	+35 / -35 PSF	107.5" (W) X 59.5" (H)	NON-IMPACT



YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2700
ATLANTA, GA 30303
PH: (866) 348-9091

TITLE:
STYLEVIEW HORIZONTAL
SLIDING WINDOW
(NON-HVHZ) (NON-IMPACT)
INSTALLATION & GENERAL NOTES


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
7TH FBC CODE CHANGE	MS	04.24.20
9TH FBC CODE CHANGE	SH	07.31.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.01 12:27:29 -04'00'

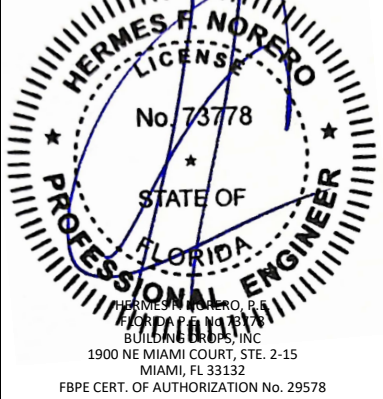


FL #:		FL12286	
DATE:		01.20.15	
DWG. BY:	SM	CHK. BY:	HFN
SCALE:		NTS	
DWG. #:		YKK128	
SHEET:		REV.	
1		B	
OF 4			


c:\users\sebastianherrerros\desktop\ykk_res 2026 cc\fl12286\ykk128.dwg 7/31/2026 11:58 AM

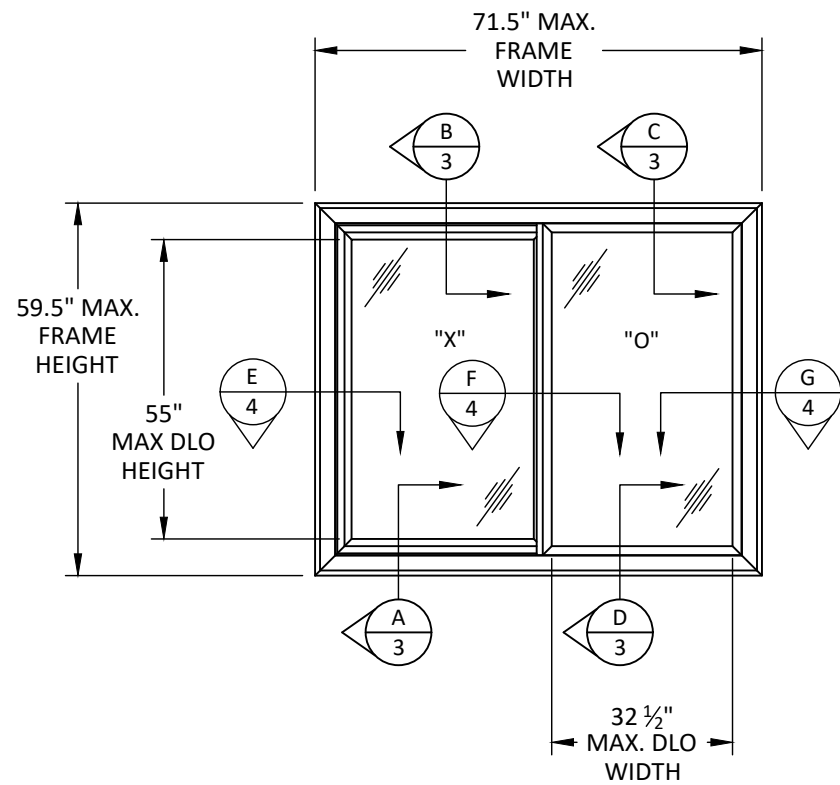


TYPICAL ELEVATION
XO UNIT

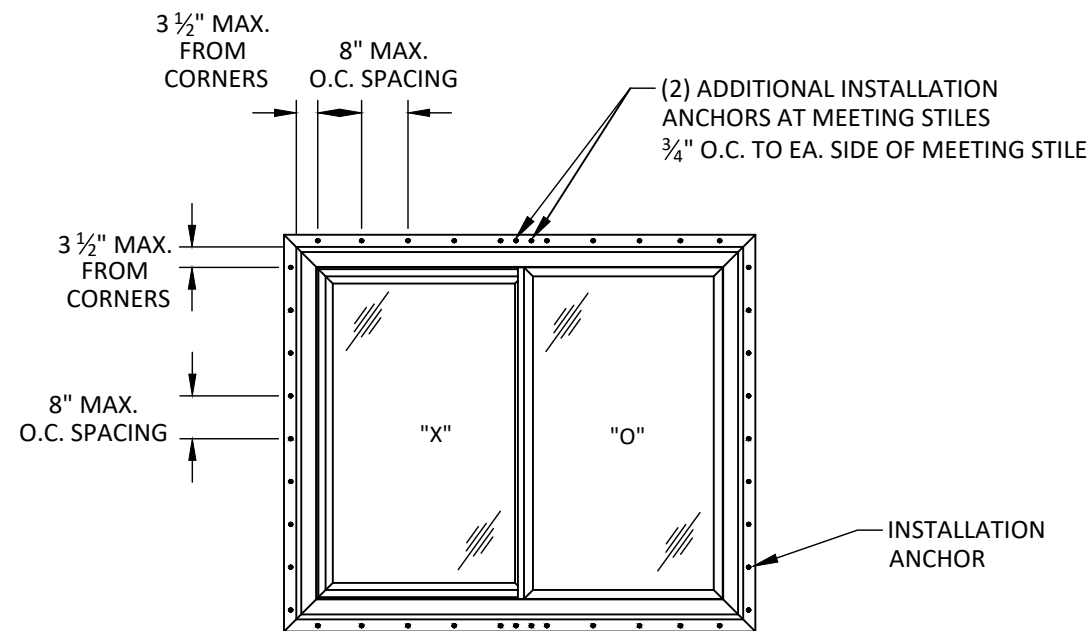

ANCHOR LAYOUT
NAILING FIN

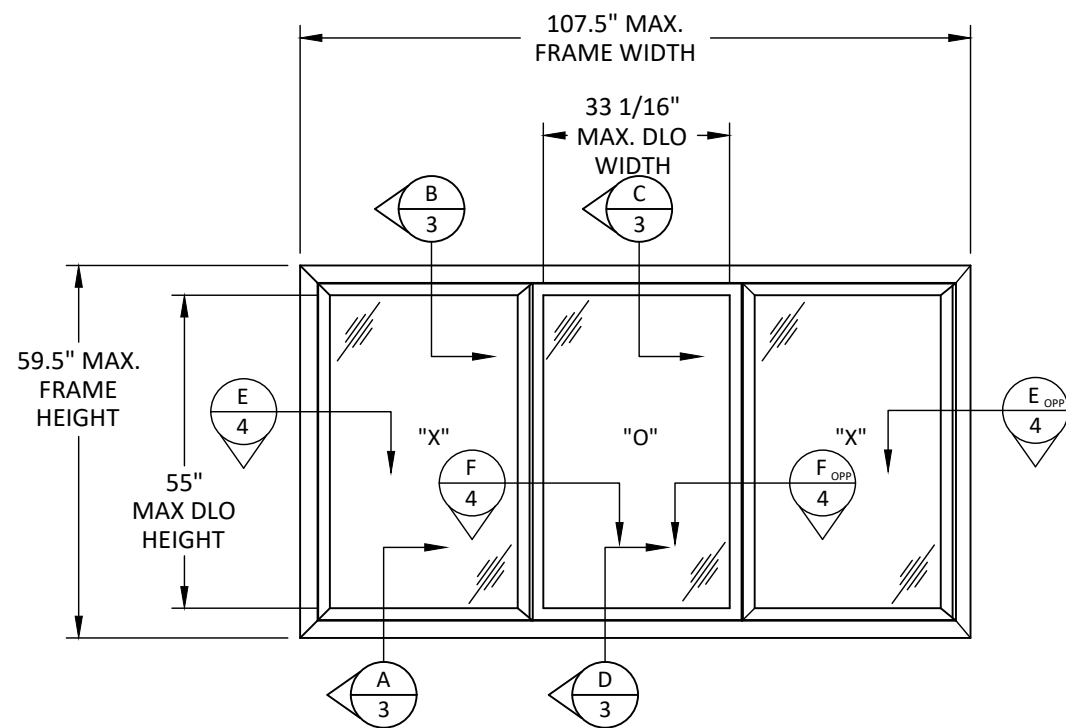

TYPICAL ELEVATION
XOX UNIT

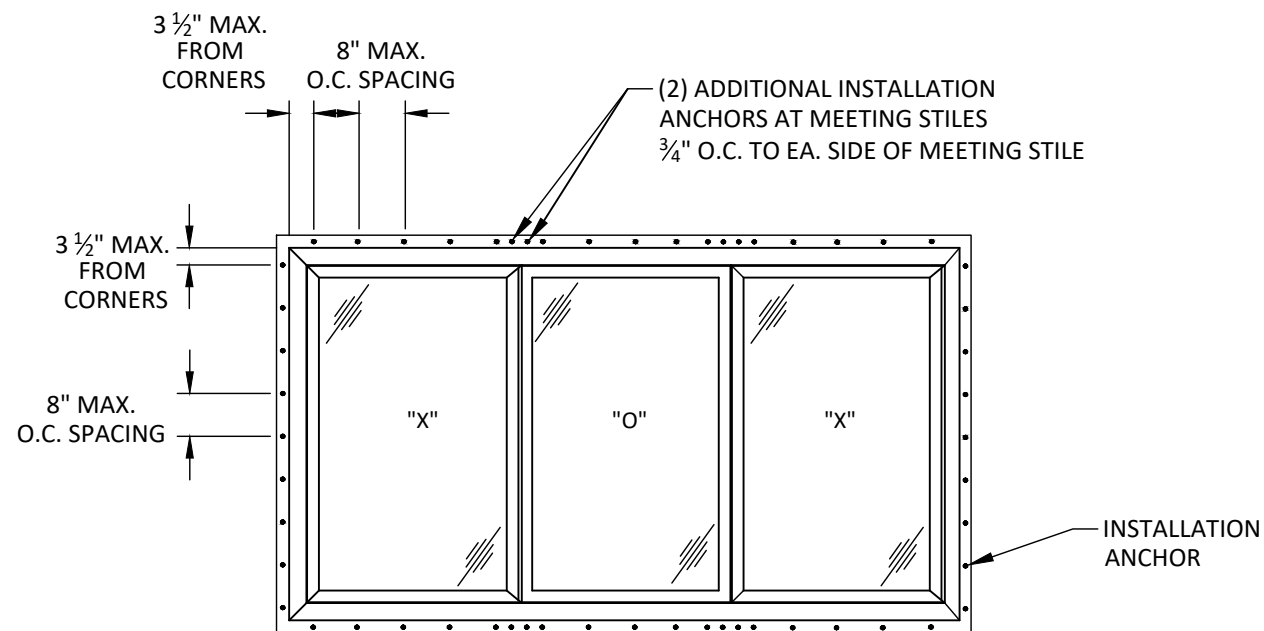

ANCHOR LAYOUT
NAILING FIN




YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2700
ATLANTA, GA 30303
PH: (866) 348-9091

TITLE:
STYLEVIEW HORIZONTAL
SLIDING WINDOW
(NON-HVHZ) (NON-IMPACT)
ELEVATION & ANCHOR LAYOUT

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
7TH FBC CODE CHANGE	MS	04.24.20
9TH FBC CODE CHANGE	SH	07.31.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

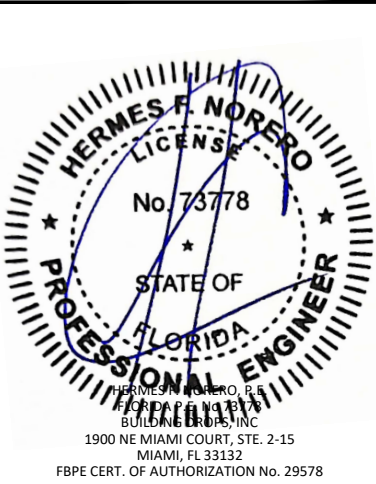


FL #:	FL12286
DATE:	01.20.15
DWG. BY:	CHK. BY:
SM	HFN
SCALE:	NTS
DWG. #:	YKK128
SHEET:	REV.
2	B
OF 4	

7/31/2026 11:58 AM


c:\users\sebastianherrerros\desktop\ykk res 2026 cc\fl12286\ykk128.dwg

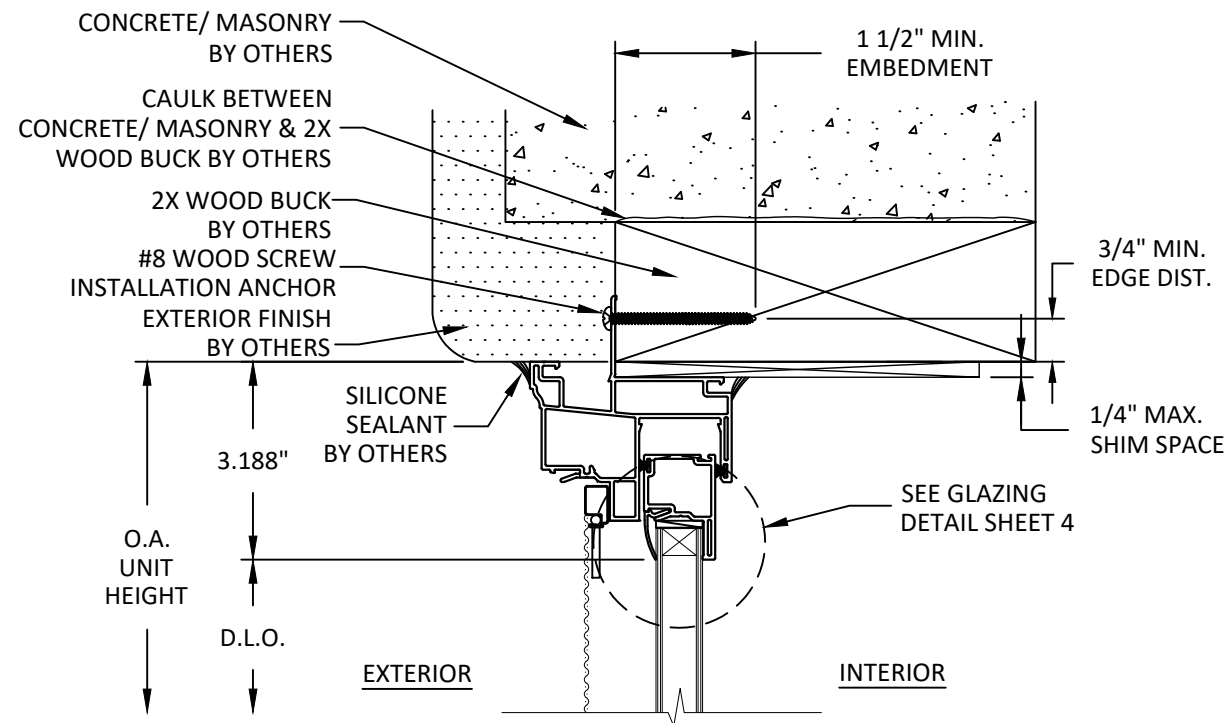


B
3 **VERTICAL SECTION**
SASH HEAD - 2X WOOD BUCK
NAILING FIN

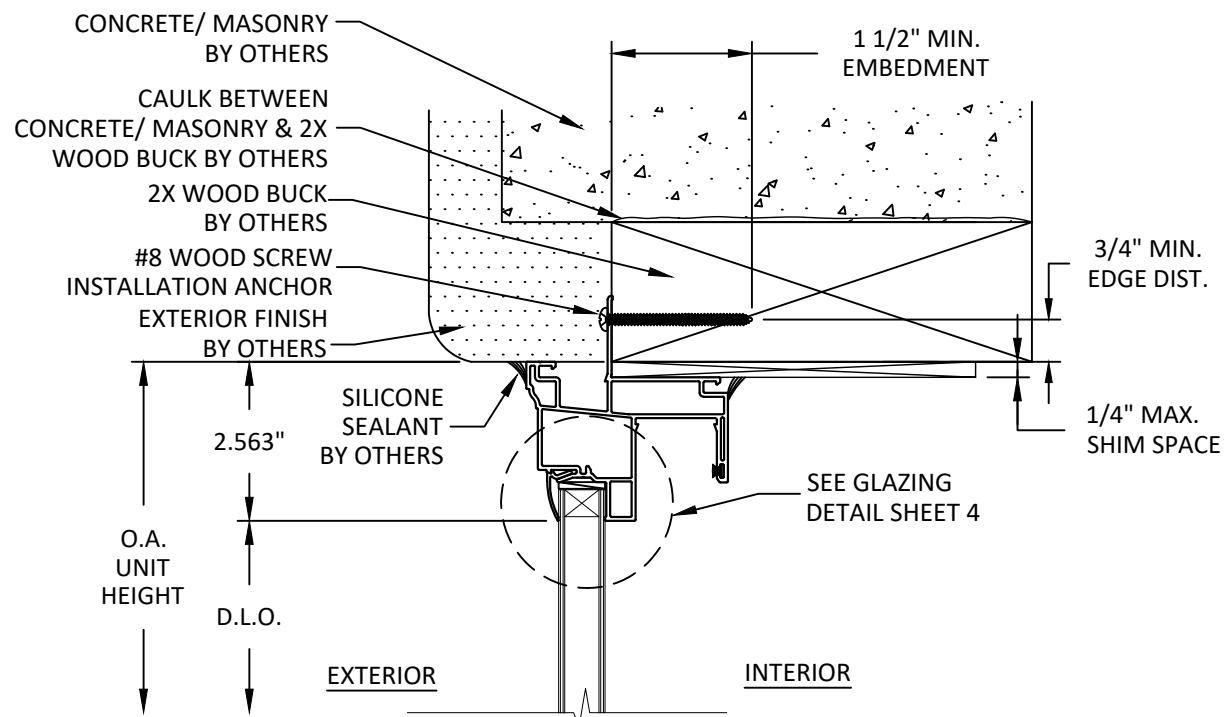

C
3 **VERTICAL SECTION**
FIXED HEAD - 2X WOOD BUCK
NAILING FIN

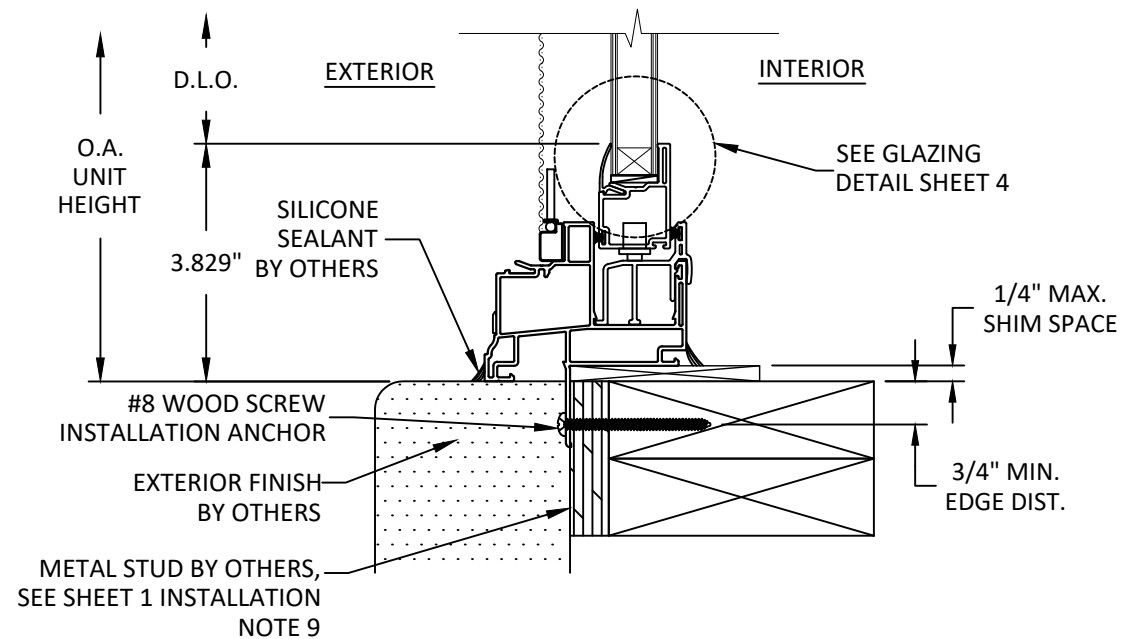

A
3 **VERTICAL SECTION**
SASH SILL - 2X WOOD FRAMING
NAILING FIN

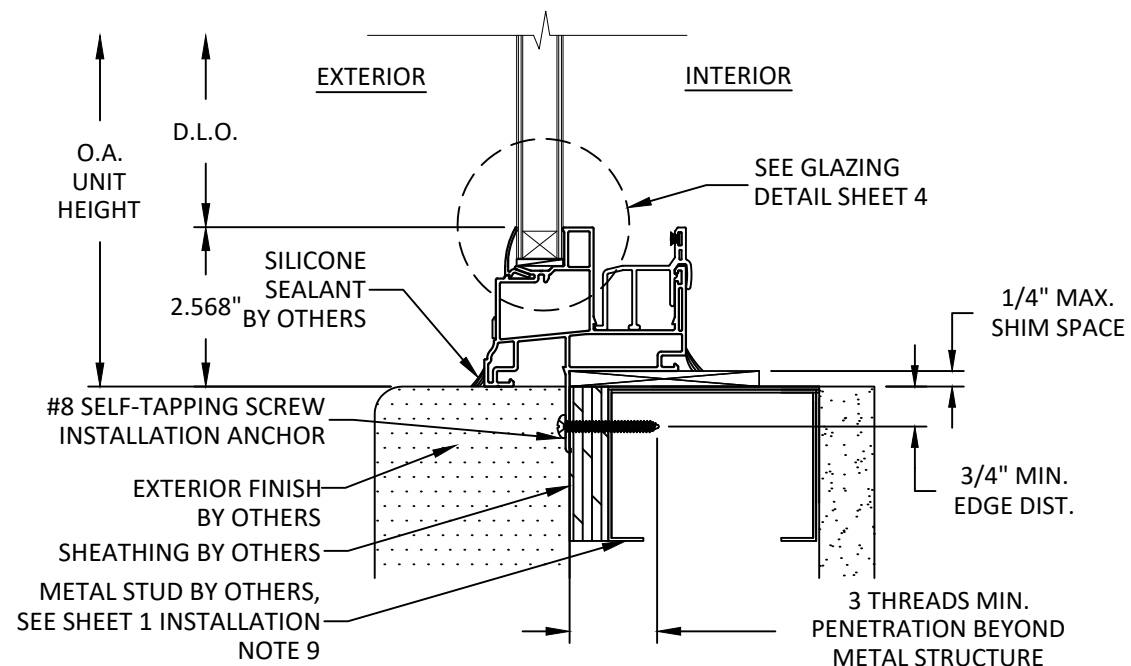

D
3 **VERTICAL SECTION**
FIXED SILL - METAL STUD
NAILING FIN




YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2700
ATLANTA, GA 30303
PH: (866) 348-9091

TITLE: STYLEVIEW HORIZONTAL SLIDING WINDOW (NON-HVHZ) (NON-IMPACT) VERTICAL SECTIONS	PREPARED BY: BUILDING DROPS, INC. 1900 NE MIAMI COURT, STE. 2-15 MIAMI, FL 33132 PH: (954) 399-8478 FAX: (954) 744-4738 WEB: www.buildingdrops.com	




REMARKS	BY	DATE
7TH FBC CODE CHANGE	MS	04.24.20
9TH FBC CODE CHANGE	SH	07.31.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

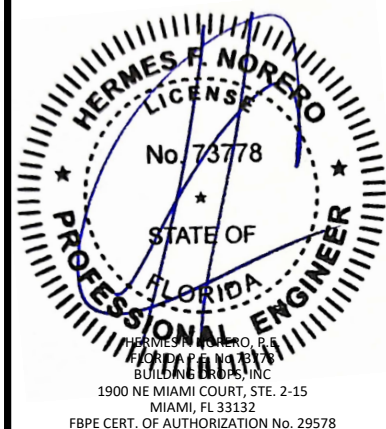


FL #:	FL12286	
DATE:	01.20.15	
DWG. BY:	SM	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	YKK128	
SHEET:	3	REV. B
OF 4		

7/31/2026 11:58 AM
c:\users\sebastianherrerros\desktop\ykk_res 2026 cc\112286\ykk128.dwg

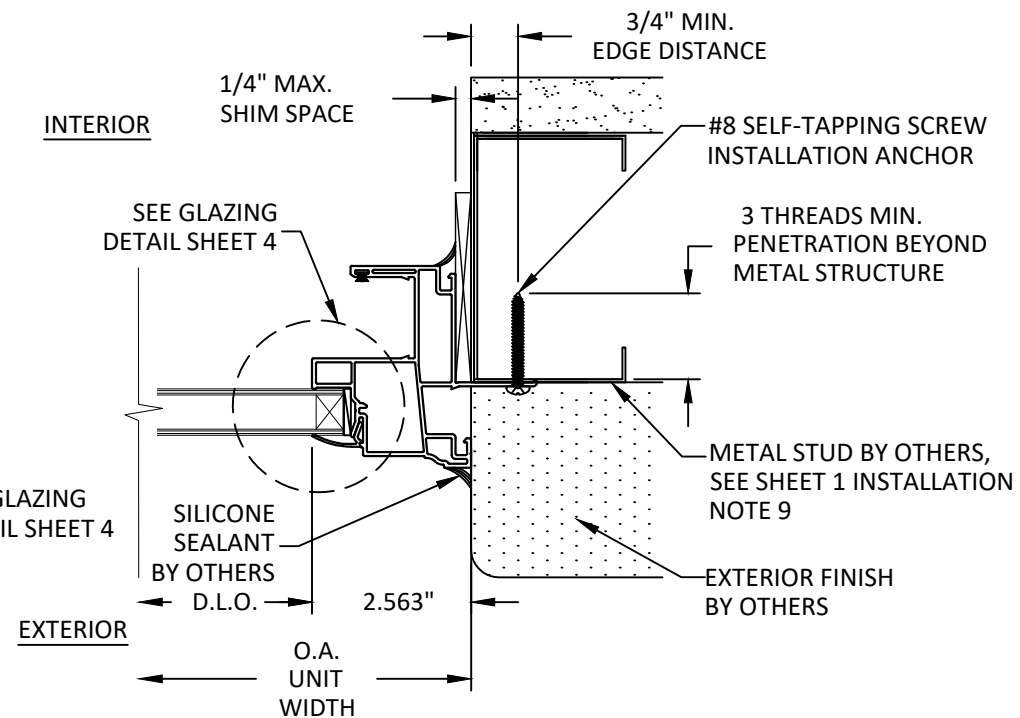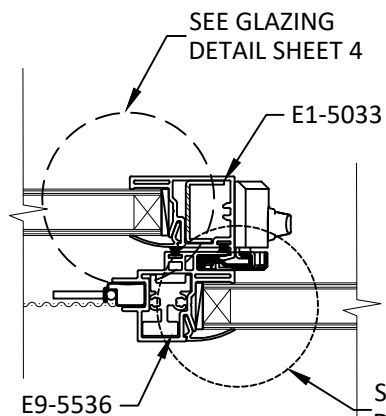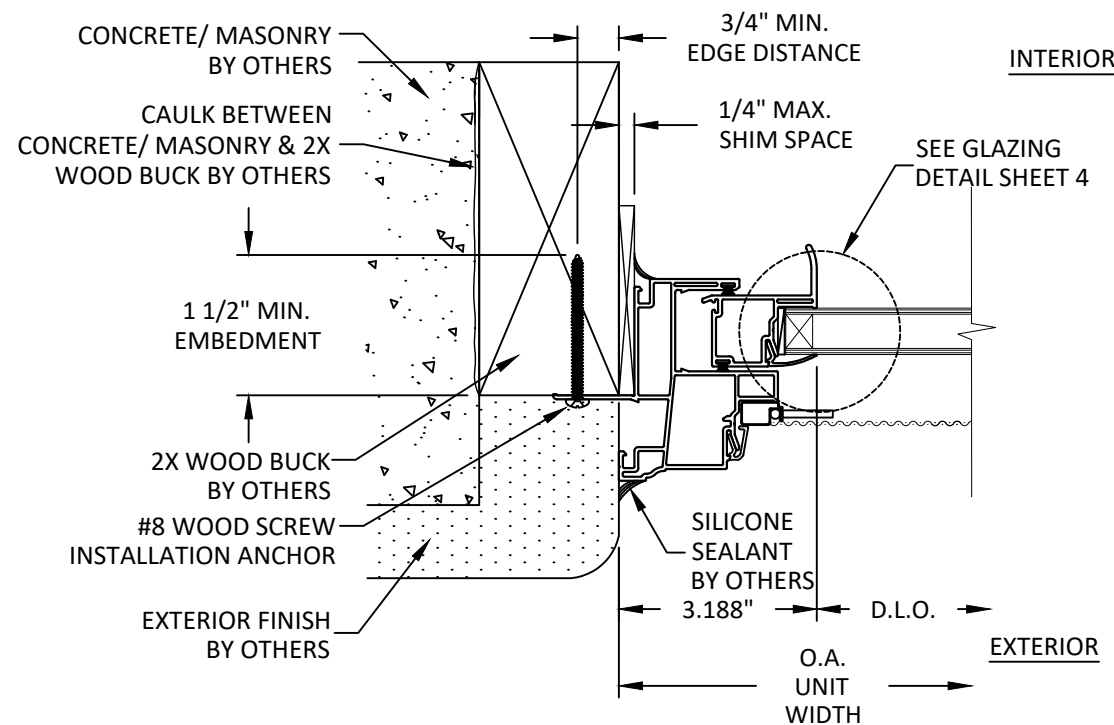

F HORIZONTAL SECTION

MEETING STILES OPERABLE TO FIXED

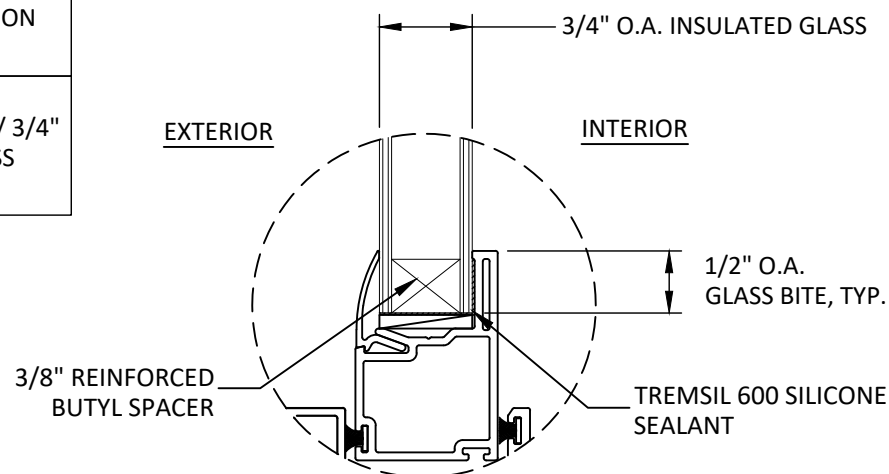

GLAZING DETAIL

G HORIZONTAL SECTION

FIXED JAMB - METAL STUD NAILING FIN

GLAZING NOTES:

1. GLASS THICKNESS AND TYPE SHALL COMPLY WITH ASTM E1300 GLASS STRENGTH REQUIREMENTS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCK TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" PER FBC CHAPTER 24.
4. ALL GLAZING CONFIGURATIONS SHALL COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN CURRENT FBC.

INTERCEPT STAINLESS STEEL OR TIN PLATED SPACER:
AROUND THE PERIMETER OF THE GLASS

PRIMARY SEALANT:
POLYISOBUTYLENE (PIB)

SECONDARY SEALANT:
STRUCTURAL SILICONE INTENDED FOR FABRICATION
OF INSULATED GLASS UNITS.

E HORIZONTAL SECTION

SASH JAMB - 2X WOOD BUCK NAILING FIN

LOCK STILE REINFORCEMENT ATTACHMENT TO FRAME EXTENSION: USE TWO (2) #8 X 1/2" STAINLESS STEEL FLAT HEAD SMS (ONE ANCHOR AT EACH END, 2" FROM EACH INSIDE CORNER) INSTALL THROUGH THE EXTRUSION BEHIND THE GLAZING POCKET

FIXED MEETING STILE REINFORCEMENT ATTACHMENT TO FRAME EXTENSION: USE FOUR (4) #8 X 2" STAINLESS STEEL PAN HEAD SMS W/ 3/4" WASHERS (TWO ANCHOR AT HEAD AND TWO ANCHOR AT SILL) ACCESS HOLE SHALL BE SEALED WITH WINDOW TAPE.



YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2700
ATLANTA, GA 30303
PH: (866) 348-9091


TITLE: STYLEVIEW HORIZONTAL SLIDING WINDOW (NON-HVHZ) (NON-IMPACT) HORIZONTAL SECTIONS & GLAZING DETAILS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BD BUILDING DROPS

REMARKS	BY	DATE
7TH FBC CODE CHANGE	MS	04.24.20
9TH FBC CODE CHANGE	SH	07.31.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

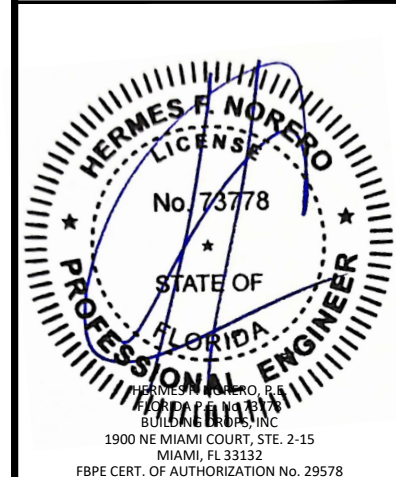

FL #:

FL12286

DATE: 01.20.15

DWG. BY:
SM

CHK. BY:
HFN

SCALE: NTS

DWG. #: YKK128

SHEET:

4

REV.
B

OF 4