

Z:\2023 FBC Drawings\Associated Materials, Inc\FL-12323 R9\FL-12323.13-17.dwg

MODEL 51"i"5/51"i"6/51"i"8


EXTRUDED VINYL
SLIDING PATIO DOORS

"NON-IMPACT"


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevation, design pressures & general notes
2	Horizontal and vertical cross sections
3	Horizontal and vertical cross sections
4	Buck and frame anchoring
5	Bill of materials, glazing details & components

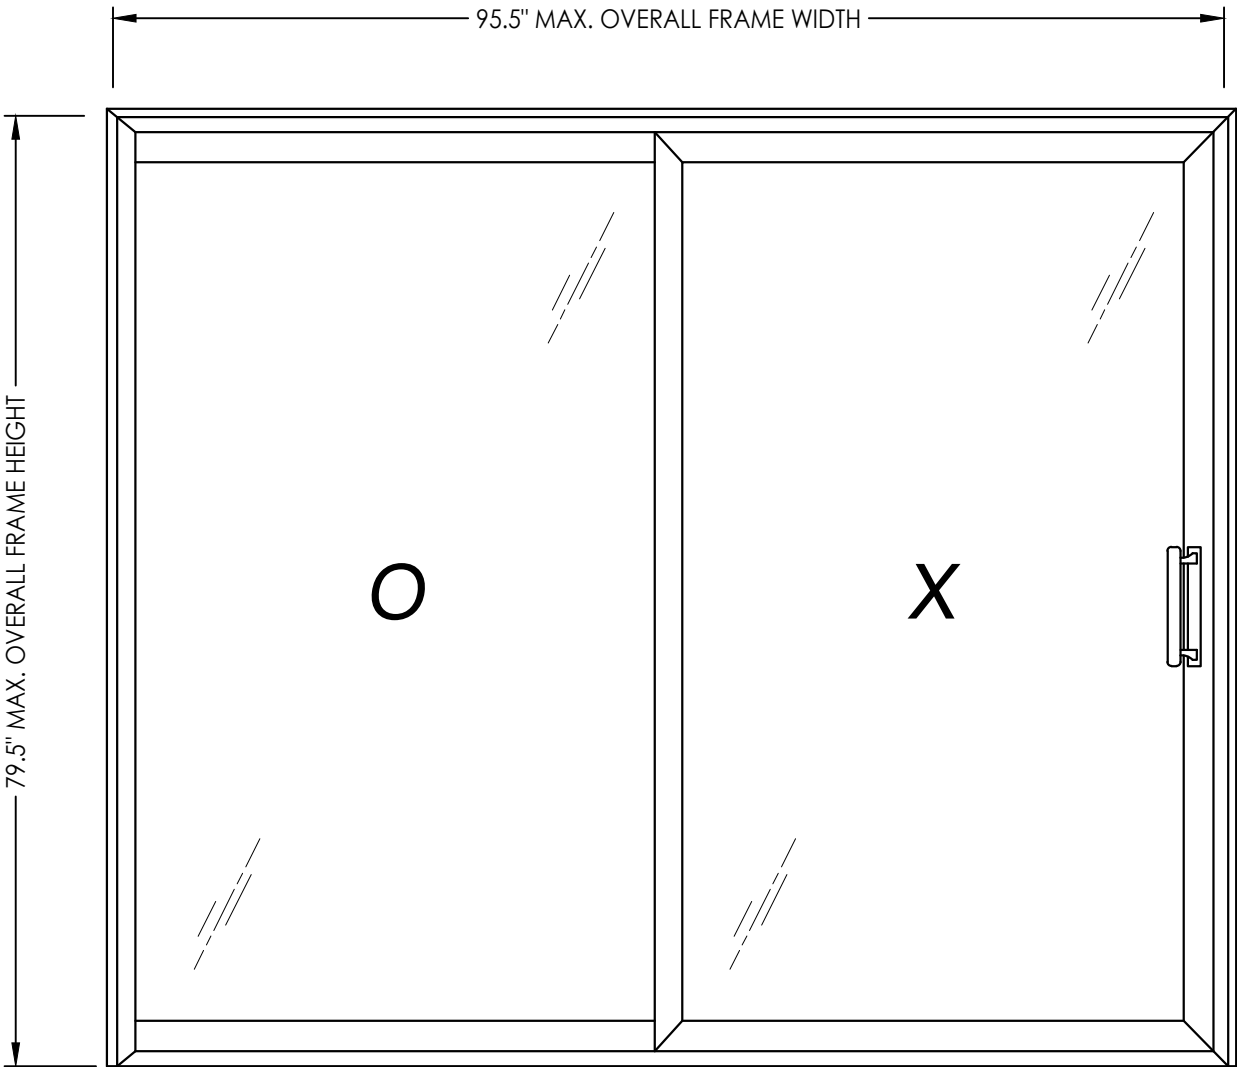

OVERALL FRAME DIMENSION	MAX. PANEL DIMENSION	MAX. D.L.O. DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)	
				POSITIVE	NEGATIVE
95.5" x 79.5"	48.5" x 76.375"	43.75" x 71.625"	G1	+50.0	-50.0

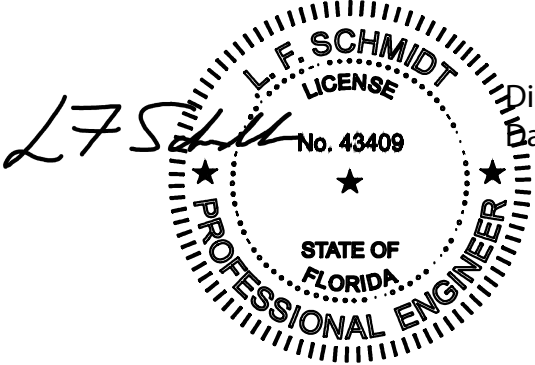



Digitally signed by Lyndon F Schmidt
Date: 2023.07.31 15:43:09 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.



THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813		
PRODUCT: EXTRUDED VINYL SLIDING PATIO DOORS		PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES		
5	7/31/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
4	8/20/20	UPDATE TO 7TH ED. (2020)	FBC	DAC
3	10/02/17	UPDATE TO 6TH ED. (2017)	FBC	LFS
2	1/27/15	UPDATE TO 5TH ED. (2014)	FBC	JK
1	9/21/11	UPDATED FOR 2010	FBC	JK
NO.	DATE			BY
REVISIONS				
DATE: 3/11/09				
SCALE: N.T.S.				
DWG. BY: AL				
CHK. BY: LFS				
DRAWING NO.: FL-12323.14				
SHEET 1 OF 5				

Z:\2023 FBC Drawings\Associated Materials, Inc\FL-12323 R9\FL-12323.13-17.dwg

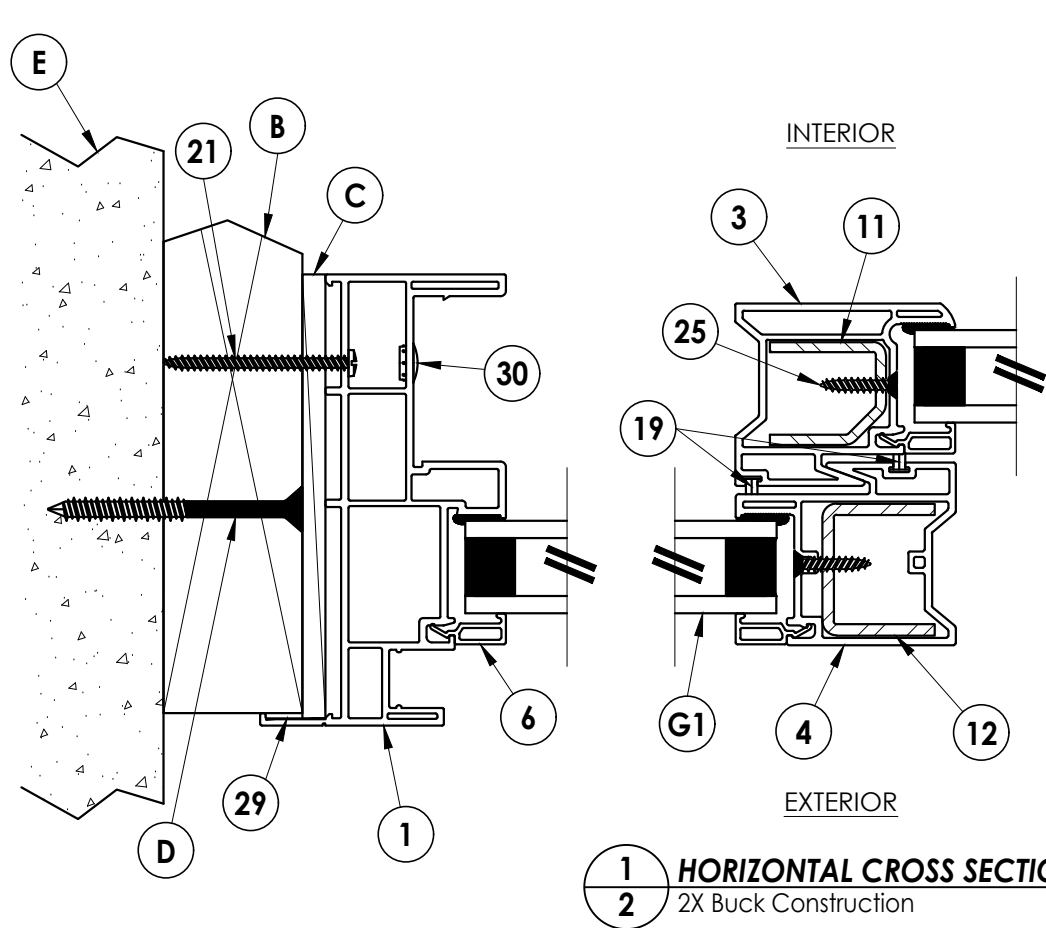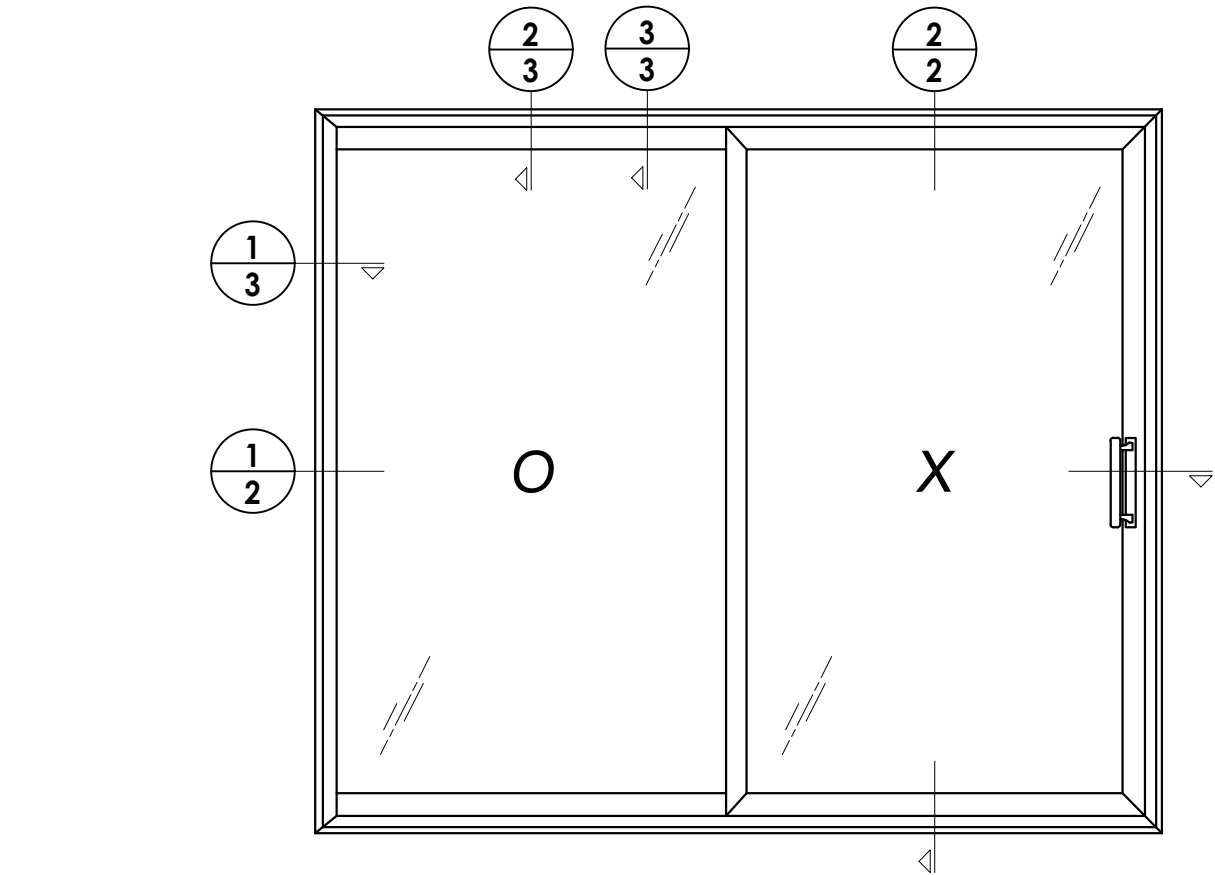




1 HORIZONTAL CROSS SECTION
2 2X Buck Construction

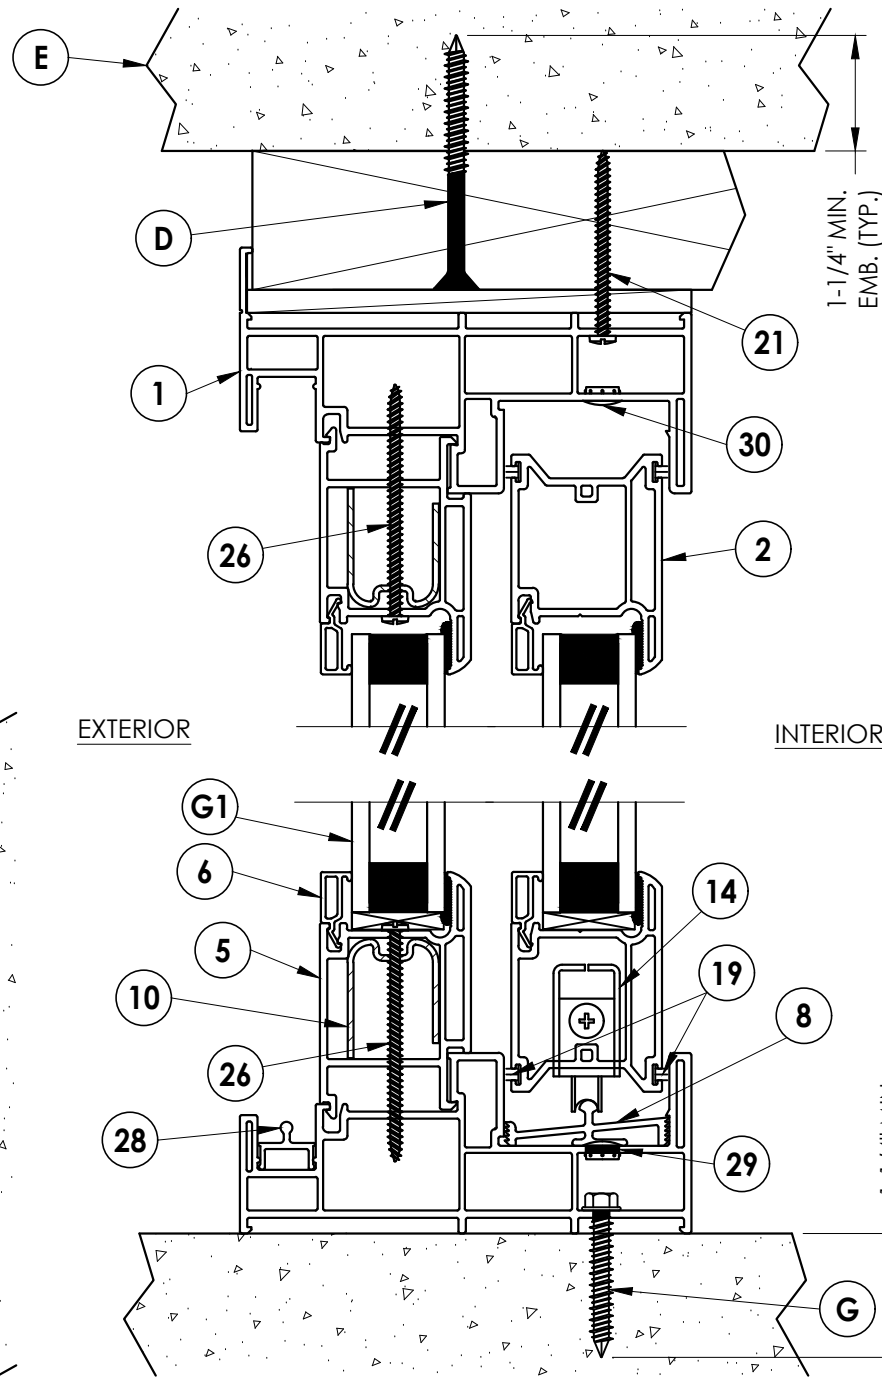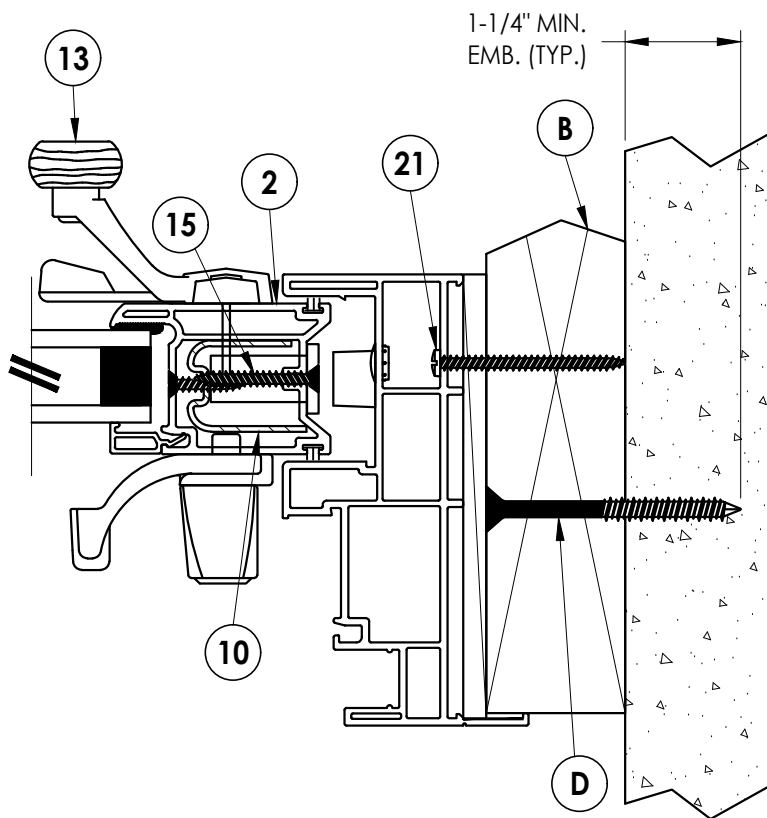

2 VERTICAL CROSS SECTION
2 2X Buck Construction

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		R ^W BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: EXTRUDED VINYL SLIDING PATIO DOORS		PART OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS	
5	7/31/23	UPDATE TO 8TH ED. (2023)	FBC
4	8/20/20	UPDATE TO 7TH ED. (2020)	FBC
3	10/02/17	UPDATE TO 6TH ED. (2017)	FBC
2	1/27/15	UPDATE TO 5TH ED. (2014)	FBC
1	9/21/11	UPDATED FOR 2010 FBC	FBC
NO.	DATE	REVISIONS	
DATE: 3/11/09			
SCALE: N.T.S.			
DWG. BY: AL			
CHK. BY: LFS			
DRAWING NO.: FL-12323.14			
SHEET 2 OF 5			

Z:\2023 FBC Drawings\Associated Materials, Inc\FL-12323 R9\FL-12323.13-17.dwg

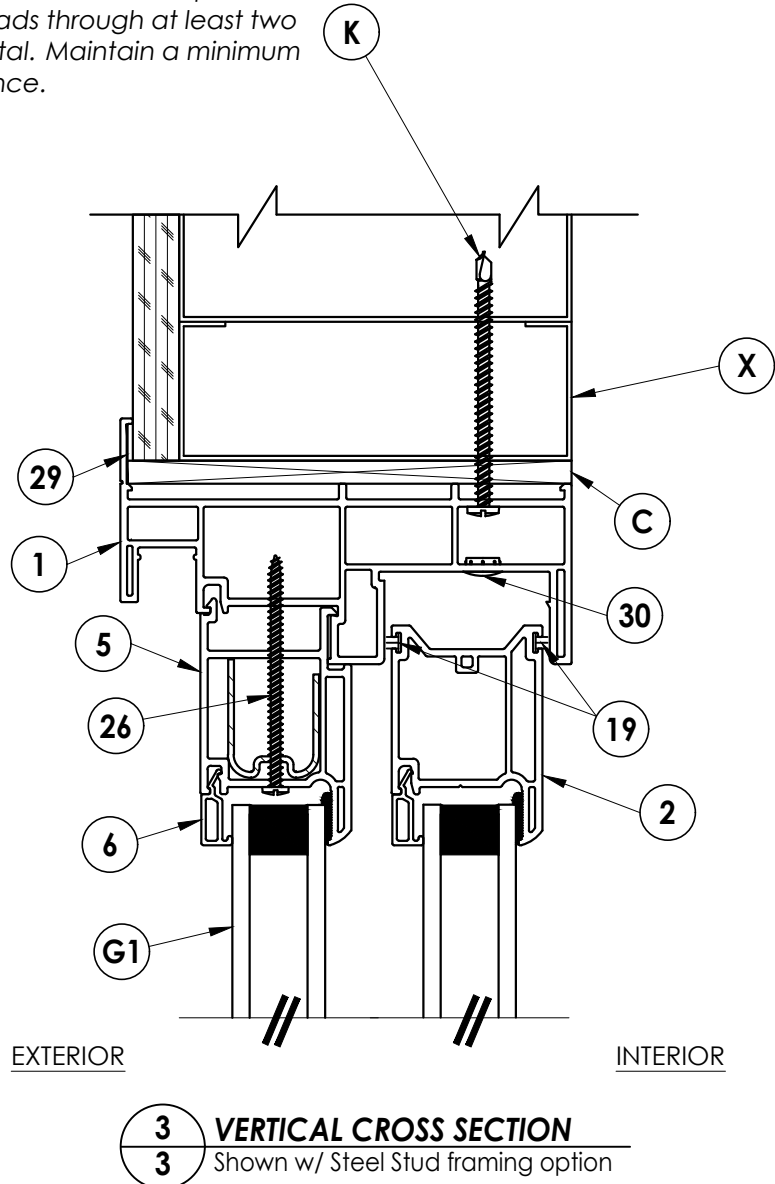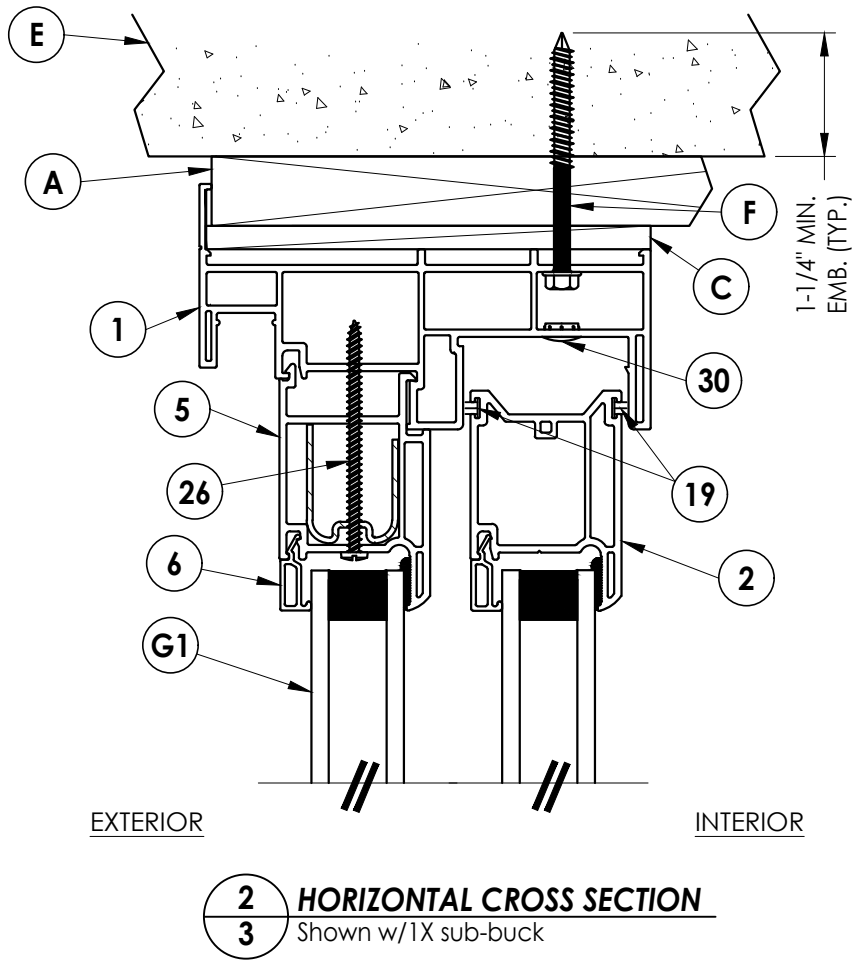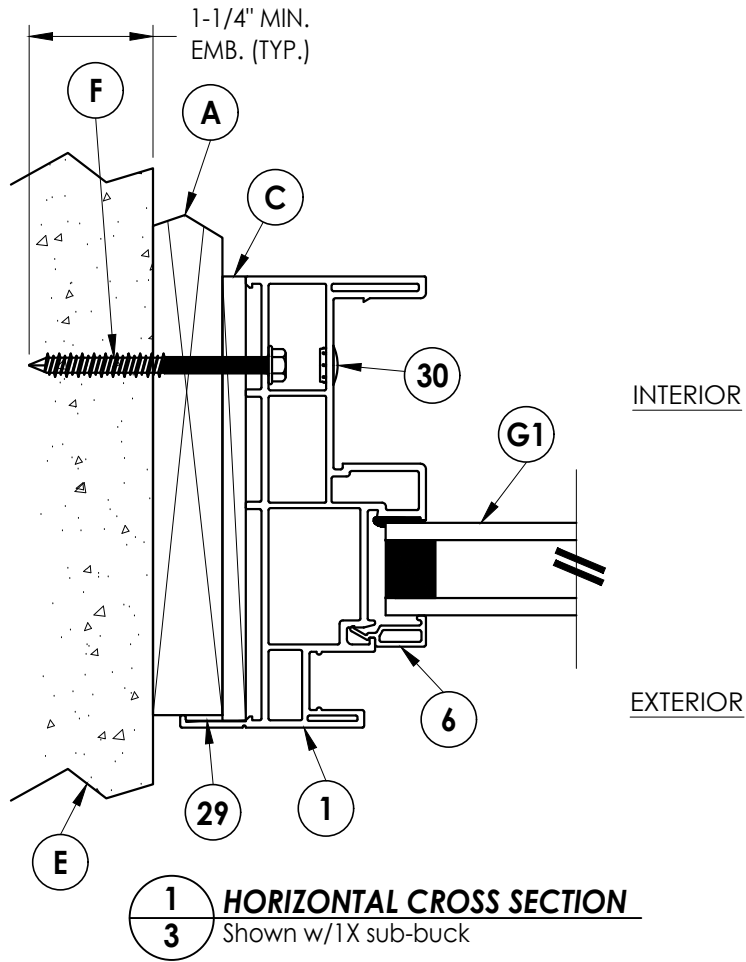

NOTE: Sheet Metal Screws must penetrate a min. of 3 threads through at least two (2) sheets of metal. Maintain a minimum 5/8" edge distance.

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: EXTRUDED VINYL SLIDING PATIO DOORS				PART OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS			
5	7/31/23	UPDATE TO 8TH ED. (2023) FBC	LFS				
4	8/20/20	UPDATE TO 7TH ED. (2020) FBC	DAC				
3	10/02/17	UPDATE TO 6TH ED. (2017) FBC	LFS				
2	1/27/15	UPDATE TO 5TH ED. (2014) FBC	JK				
1	9/21/11	UPDATED FOR 2010 FBC	JK				
NO. DATE		REVISIONS					
DATE: 3/11/09							
SCALE: N.T.S.							
DWG. BY: AL							
CHK. BY: LFS							
DRAWING NO.: FL-12323.14							
SHEET 3 OF 5							

Z:\2023 FBC Drawings\Associated Materials, Inc\FL-12323 R9\FL-12323.13-17.dwg

* INSTALL 2 SCREWS THROUGH KEEPER INTO SUBSTRATE AS FOLLOWS:
WOOD : #10 PH SMS (1.5" MIN. EMBEDMENT)
STEEL : #10 PH SMS (3 THREADS MIN. THROUGH STEEL)
CONCRETE: 3/16" Ø DeWALT ULTRA CON+ (1.25" MIN. EMBEDMENT)


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA CON+®	1/4"	1-1/4"	1"	4"
DeWALT ULTRA CON+®	3/16"	1-1/4"	2-1/2"	1-1/8"

WOOD SCREW INSTALLATION NOTES:


- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

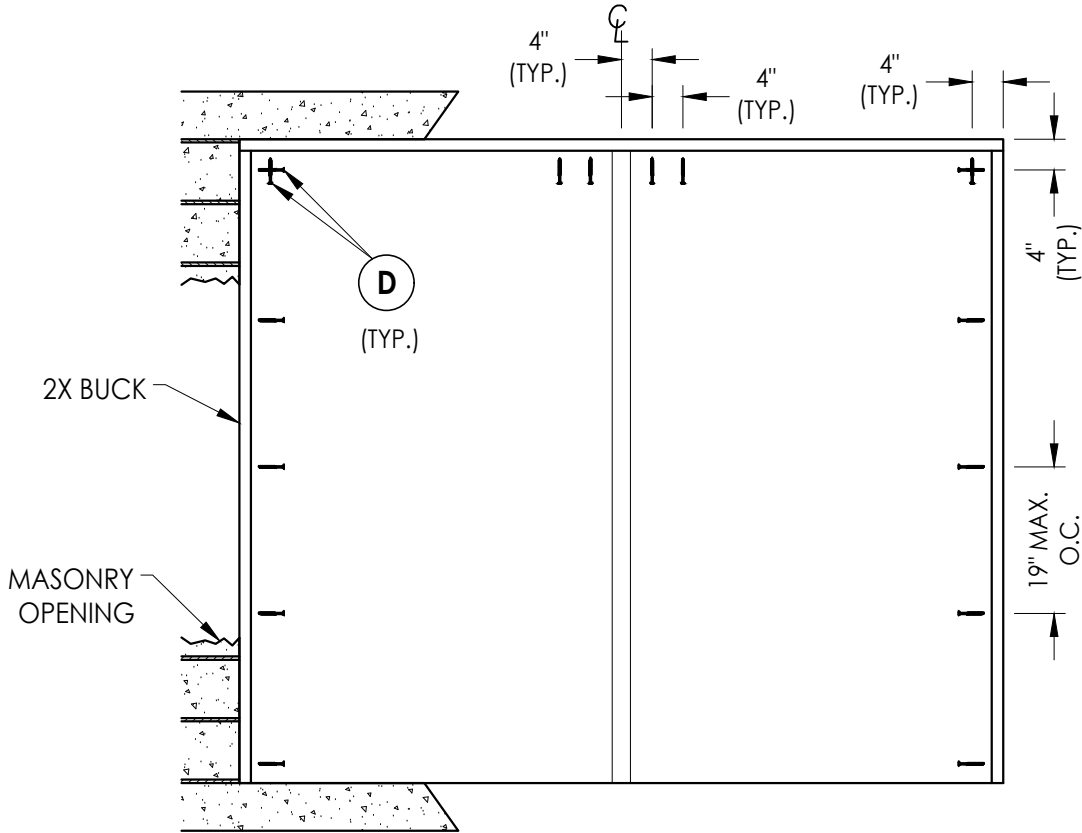

BUCK ANCHORING

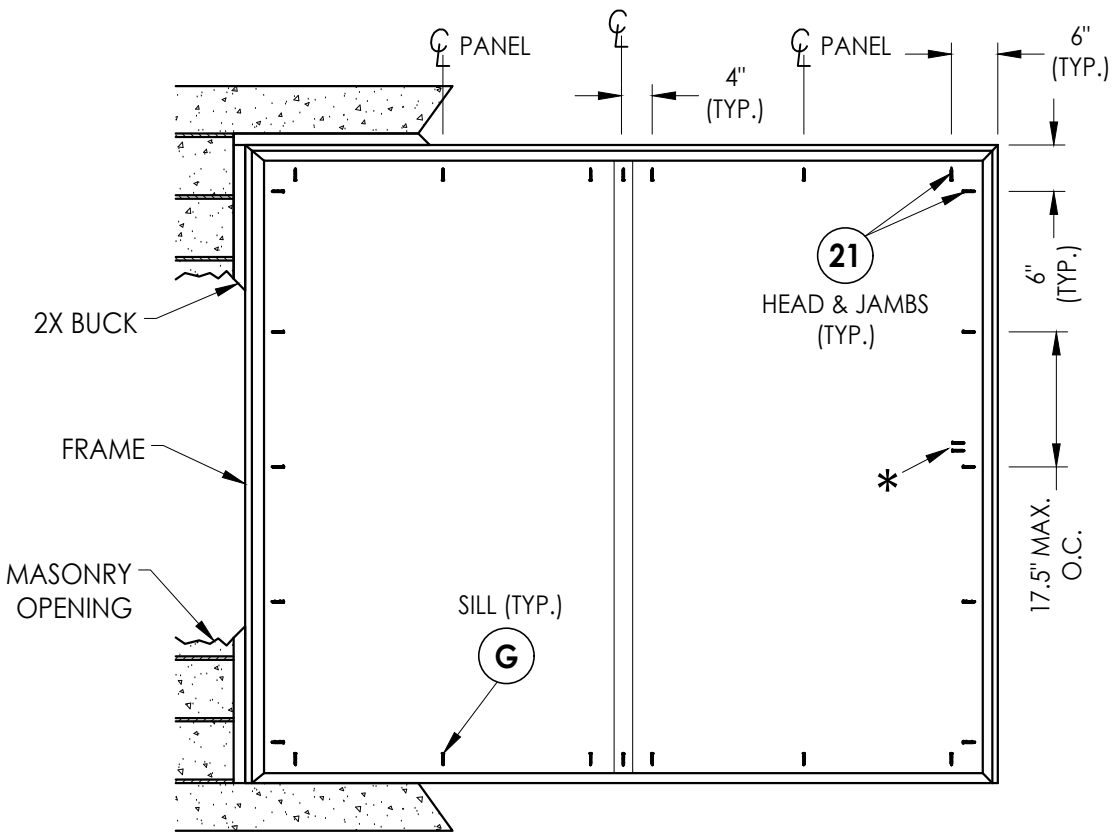

FRAME ANCHORING
2X BUCK

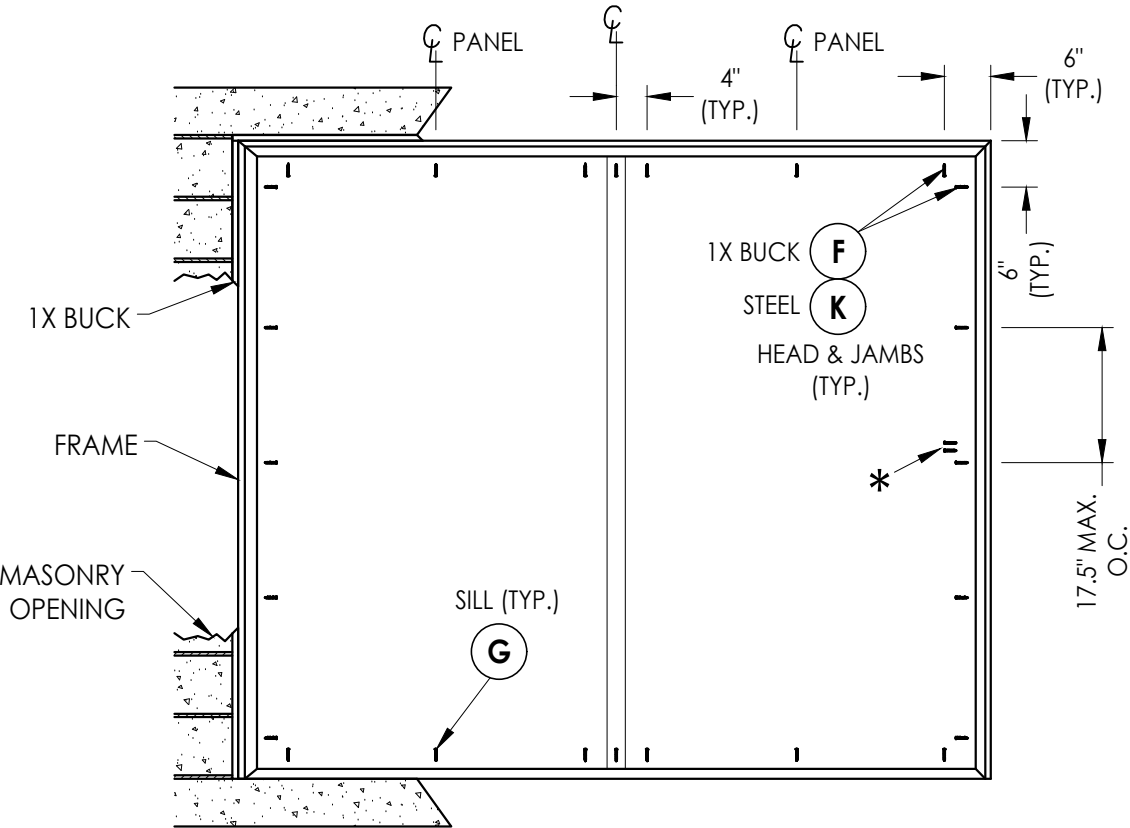

FRAME ANCHORING
(1X Buck, Steel Stud)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
EXTRUDED VINYL
SLIDING PATIO DOORS

PART OR ASSEMBLY:
BUCK & FRAME
ANCHORING

NO.	DATE	REVISIONS			
		DATE	BY	CHK	APP
5	7/31/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
4	8/20/20	UPDATE TO 7TH ED. (2020)	FBC	DAC	
3	10/02/17	UPDATE TO 6TH ED. (2017)	FBC	LFS	
2	1/27/15	UPDATE TO 5TH ED. (2014)	FBC	JK	
1	9/21/11	UPDATED FOR 2010 FBC	FBC	JK	

DATE: 3/11/09

SCALE: N.T.S.

DWG. BY: AL

CHK. BY: LFS


DRAWING NO.:
FL-12323.14

SHEET 4 OF 5


Z:\2023 FBC Drawings\Associated Materials, Inc\FL-12323 R9\FL-12323.13-17.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK SG ≥ 0.55	WOOD
B	2X BUCK (SG ≥ 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 2-3/4" HWH DeWALT OR ITW CONCRETE SCREW	WOOD
G	1/4" X 1-3/4" HWH DeWALT OR ITW CONCRETE SCREW	STEEL
K	#10 PPH SELF-DRILLING SMS	STEEL
X	STEEL STUD Min. Thk .033" (ASTM A653 GRADE 33 Fy=33 Ksi Min, Fu=45 Ksi Min)	STEEL
1	EXTRUDED VINYL HEAD / SILL & JAMB / FRAME (#PD1201)	* RIGID PVC
2	EXTRUDED VINYL STILE / RAIL SASH (#PD25)	* RIGID PVC
3	EXTRUDED VINYL SASH INTERLOCK (#PD24)	* RIGID PVC
4	EXTRUDED VINYL FIXED INTERLOCK (#PD34)	* RIGID PVC
5	EXTRUDED VINYL EQUAL GLASS ADAPTOR (#PD39)	* RIGID PVC
6	EXTRUDED VINYL 1" GLAZING BEAD (#BV22)	* RIGID PVC
7	FOAM GLAZING SPACER	-
8	ALUMINUM SILL TRACK (#PD22)	ALUMINUM
10	JAMB STILE (PD25) REINFORCEMENT ROLL FORMED STEEL (#RFPD03SOM)	STEEL
11	SASH INTERLOCK (PD24) REINFORCEMENT ROLL FORMED STEEL (#RFPD24SOM)	STEEL
12	FIXED INTERLOCK (PD34) REINFORCEMENT ROLL FORMED STEEL (#RFPD34SOM)	STEEL
13	SLIDING PATIO DOOR HANDLE SET #684 BY SASH CONTROLS	-
14	TANDEM ROLLER ASSEMBLY BY ULTRA #64266	STEEL
15	#10 X 1-1/4" PFH (MORTISE LOCK) SCREWS BY SASH CONTROLS	STEEL
18	PURFECT GLAZE 34-937A SEALANT BY NATIONAL ADHESIVES	SEALANT
19	WEATHERPILE .187" x .270" BY AMESBURY	-
21	#8 X 2" PPH SMS (1-1/2" MIN. EMBEDMENT)	STEEL
25	#8 X 3/4" PFH SELF-DRILLING SMS	STEEL
26	#8 X 2-1/2" PPH SMS (EQ. GLS. ADAPTOR) SCREWS BY MERCHANTS	STEEL
28	EXTRUDED VINYL SCREEN TRACK (#PDT58)	* RIGID PVC
29	SILICONE SEALANT (NOVAFLEX) BY NOVAGUARD	SILICONE
30	HOLE PLUGS BY ASHLAND (I 3034)	PLASTIC


* THE APPROVED WHITE RIGID PVC EXTERIOR EXTRUSIONS FOR WINDOWS ARE TO BE PRODUCED BY EXTRUDERS LICENSEES IN "AAMA CERTIFICATION PROGRAMS FOR RIGID PVC EXTRUSIONS".




2 STILE / RAIL
Extruded vinyl




10 M JAMB STILE (PD25)
Reinforcement
Roll formed steel

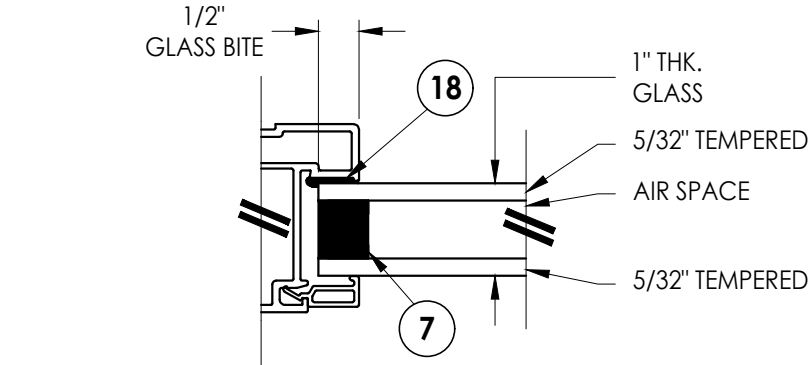


G1 GLAZING DETAIL




5 EQUAL GLASS ADAPTOR
Extruded vinyl




30 HOLE PLUG




6 GLAZING BEAD
Extruded vinyl

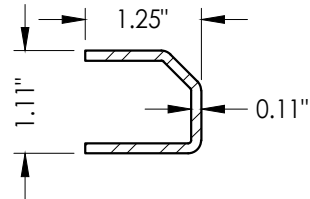


11 SASH INTERLOCK (PD24)
Roll formed steel




3 SASH INTERLOCK
Extruded vinyl

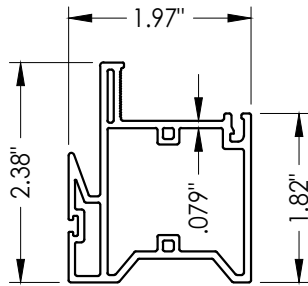


4 FIXED INTERLOCK
Extruded vinyl




8 SILL TRACK
Extruded aluminum



12 FIXED INTERLOCK (PD34)
Roll formed steel



28 SCREEN TRACK
Extruded vinyl

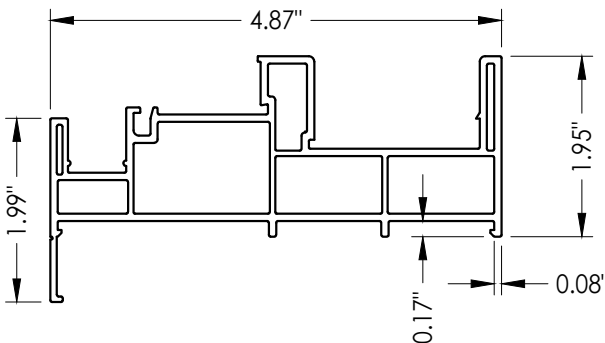

1 HEAD / SILL / JAMB
Extruded vinyl

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
EXTRUDED VINYL
SLIDING PATIO DOORS

PART OR ASSEMBLY:
BILL OF MATERIALS, GLAZING
DETAIL & COMPONENTS

		LFS	FBC	FBC	FBC	FBC	FBC	FBC	REVISIONS
5	7/31/23	UPDATE TO 8TH ED. (2023)							
4	8/20/20	UPDATE TO 7TH ED. (2020)							
3	10/02/17	UPDATE TO 6TH ED. (2017)							
2	1/27/15	UPDATE TO 5TH ED. (2014)							
1	9/21/11	UPDATED FOR 2010 FBC							
NO.	DATE								

DATE: 3/11/09

SCALE: N.T.S.

DWG. BY: AL

CHK. BY: LFS

DRAWING NO.: FL-12323.14

SHEET 5 OF 5

© 2009 R.W. BUILDING CONSULTANTS INC.