

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING, METAL STRUCTURE AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
4. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
5. ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
6. FRAME MATERIAL: WOOD WITH G=.46 MINIMUM SPECIFIC GRAVITY, OR COMPOSITE, OR FRAMESAVER, OR FUSION FRAME.
DOOR SKIN MATERIAL: STEEL .033" THICK (MINIMUM) AND FIBERGLASS .085" THICK (MINIMUM)
SIDELITE SKIN MATERIAL: STEEL .022" THICK (MINIMUM)
7. UNITS MUST BE GLAZED PER ASTM E1300, WITH SAFETY GLAZING.
8. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
9. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".

10. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/8" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
11. FOR ANCHORING INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
12. FOR ANCHORING INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
13. ALL FASTENERS TO BE CORROSION RESISTANT.
14. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - 14.1. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42
 - 14.2. CONCRETE – MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
 - 14.3. MASONRY – GROUT FILLED STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
 - 14.4. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 .048" THICK MINIMUM
15. DOOR CONSTRUCTION MAYBE CONTINUOUS HEAD FRAME AND CONTINUOUS THRESHOLD OR BOX CONSTRUCTION.

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2 – 4	ELEVATIONS AND APPROVED CONFIGURATIONS
5	ANCHORING LAYOUT
6 – 12	INSTALLATION DETAILS
13 – 17	COMPONENTS

PROVIA, LLC.
2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR
W/SIDELITES & TRANSOM NON-IMPACT
NOTES

DRAWN:
N.G.

DWG NO.
08-02079

REV
L


SCALE
NTS

DATE
06/19/13

SHEET
1 OF 18


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 09/09/2026

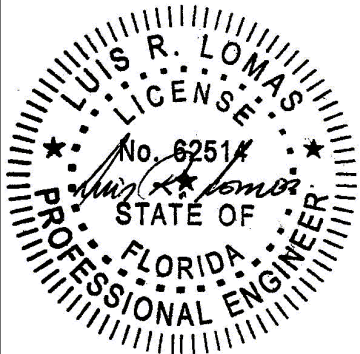


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

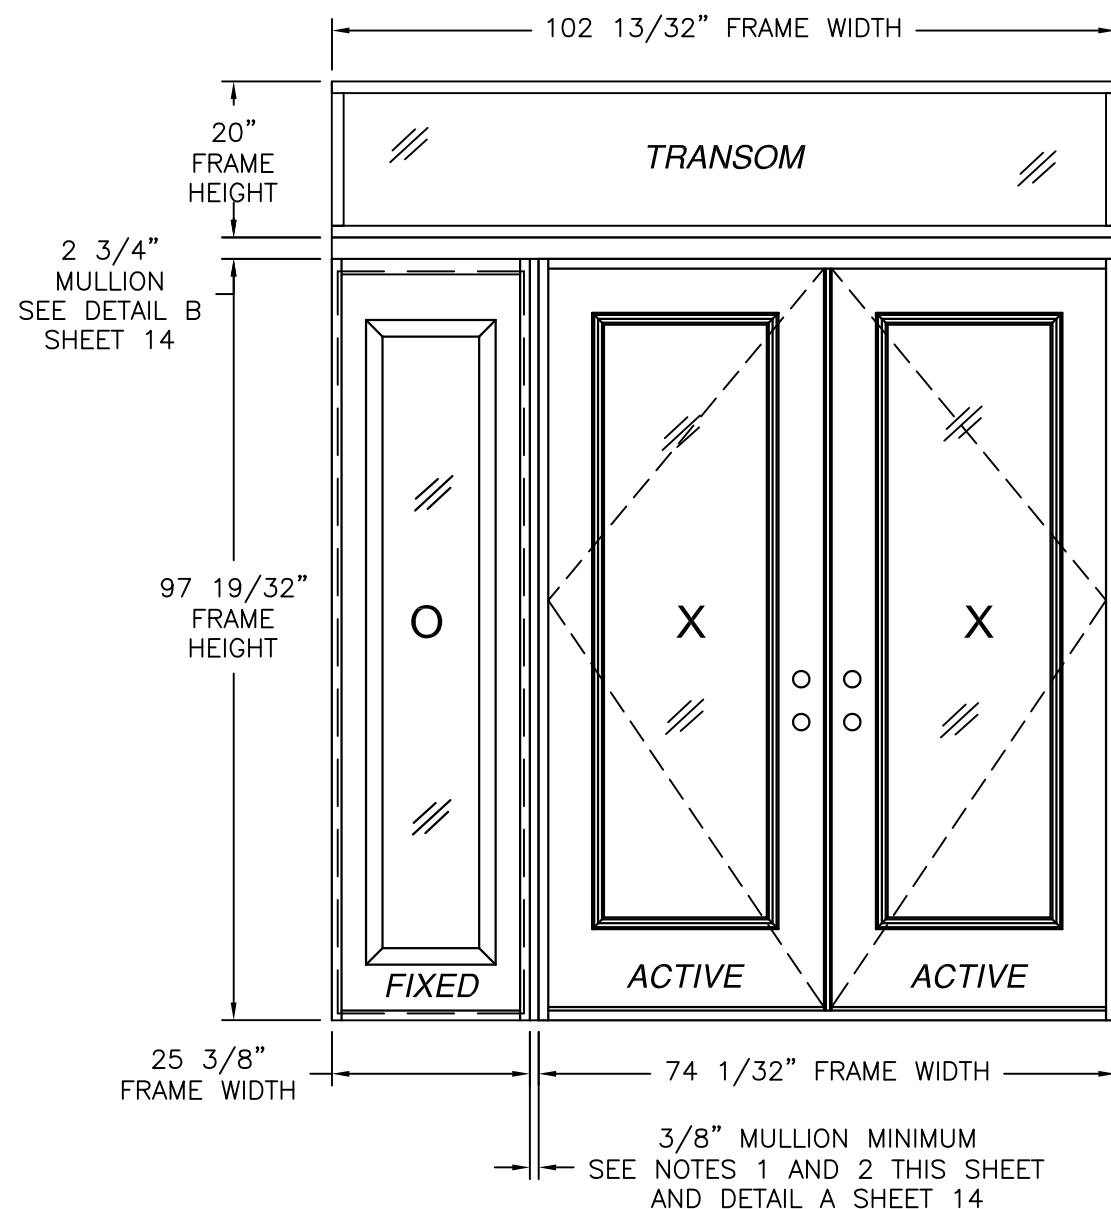

DOUBLE W/ STD SIDELITE AND TRANSOM
EXTERIOR VIEW
OXX SHOWN XXO ALSO APPROVED

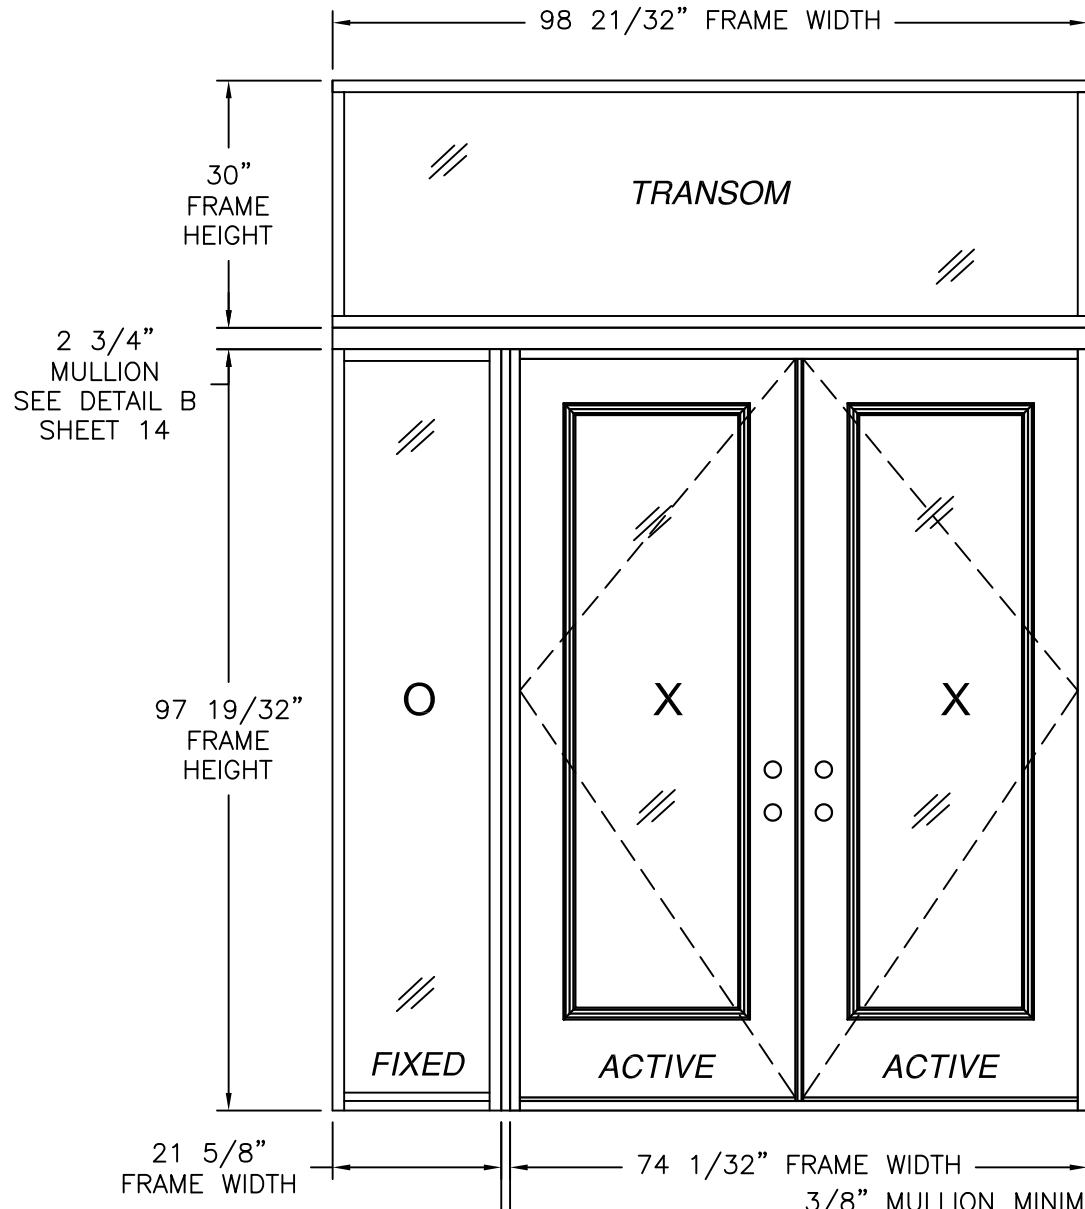

DOUBLE W/ DIRECT SET SIDELITE AND TRANSOM
EXTERIOR VIEW
OXX SHOWN XXO ALSO APPROVED

DESIGN PRESSURE RATING	IMPACT RATING
±55.0PSF	NONE
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE WATER RESISTANCE IS NOT REQUIRED	

WITH STEEL SLAB

DESIGN PRESSURE RATING	IMPACT RATING
+48.0/-52.0	NONE
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE WATER RESISTANCE IS NOT REQUIRED	

WITH FIBERGLASS SLAB

DESIGN PRESSURE RATING	IMPACT RATING
±50.0PSF	NONE
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE WATER RESISTANCE IS NOT REQUIRED	

WITH STEEL SLAB AND PANOLOCK MULTI-POINT

DESIGN PRESSURE RATING	IMPACT RATING
+48.0/-50.0	NONE
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE WATER RESISTANCE IS NOT REQUIRED	

WITH FIBERGLASS SLAB AND PANOLOCK MULTI-POINT

- D.L.O. NOTES:
1. DOOR D.L.O.: 20 3/8" X 78 1/2"
 2. STD. SIDELITE D.L.O.: 12 3/8" X 78 3/8"
 3. DIRECT SET SIDELITE D.L.O.: 18 5/8" X 93 3/4"
 4. TRANSOM D.L.O. WIDTH: 127 25/32"
 5. TRANSOM D.L.O. HEIGHT: 27"


- NOTES:
1. MAXIMUM ALLOWED BUILDUP TO BE 3" AT VERTICAL MULLION.
 2. IF SIDELITE WIDTH IS 16" OR LESS NO VERTICAL MULLION IS REQUIRED.

35 3/4" x 94 15/16" PANEL SIZE SHOWN. OTHER SIZES ARE APPROVED AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 23.56 FT²


HARDWARE SCHEDULE	
A.	F-SERIES & FC-SERIES LOCK ASSEMBLY DOOR KNOB BY SCHLAGE
B.	B-SERIES DEADBOLT ASSEMBLY BY SCHLAGE
C.	F-SERIES & FC-SERIES DEADBOLT ASSEMBLY BY SCHAGE
D.	RESIDENTIAL GRADE DOOR HANDLE ASSEMBLY BY EMTEK (ALTERNATE)
E.	MULTI-POINT HANDLE ASSEMBLY BY TRILENNIUM (ALTERNATE)
F.	PANOLOCK MULTI-POINT LOCK ASSEMBLY (ALTERNATE)
G.	(3) 4" X 4" BALL BEARING HINGES BY PENROD
H.	(3) 4" X 4" SPRING BOMMER HINGES BY PENROD (ALTERNATE)

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR W/SIDELITES & TRANSOM NON-IMPACT ELEVATIONS		
DRAWN: N.G.	DWG NO. 08-02079	REV L
SCALE NTS	DATE 06/19/13	SHEET 2 OF 18
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 09/09/2026

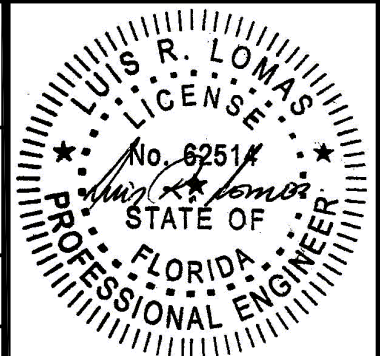

Luis R. Lomas P.E.
FL No.: 62514

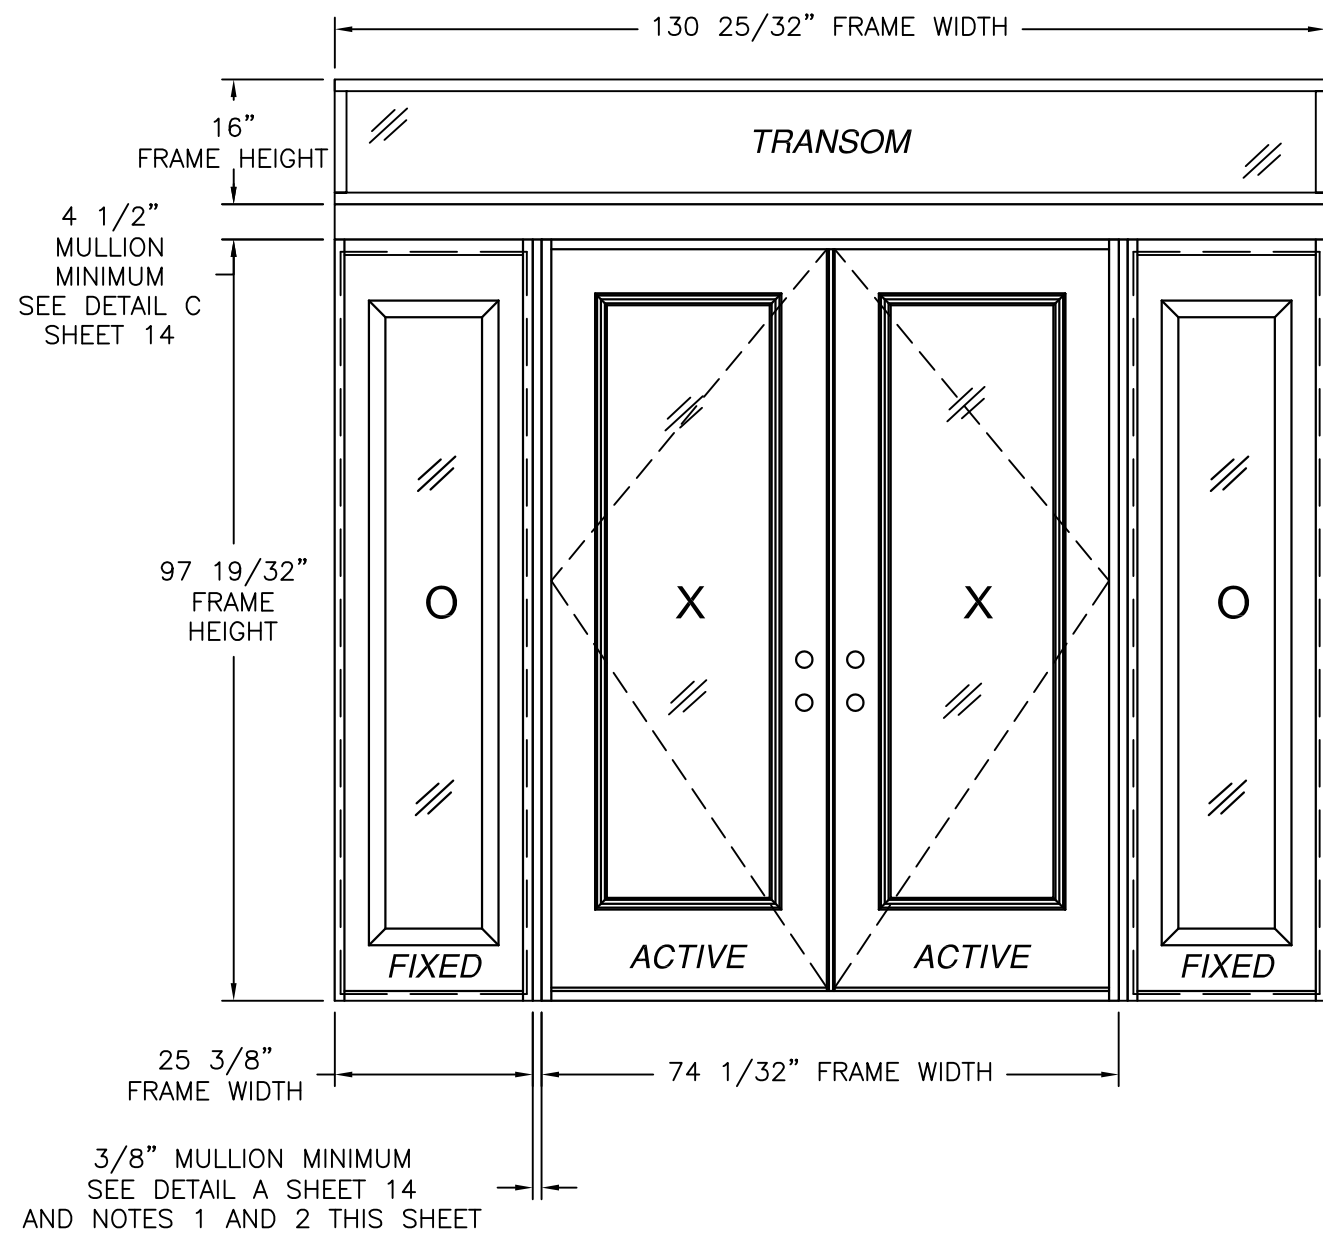

DOUBLE W/ STD SIDELITES AND TRANSOM
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
±55.0PSF	NONE
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE WATER RESISTANCE IS NOT REQUIRED	

WITH STEEL SLAB

DESIGN PRESSURE RATING	IMPACT RATING
+48.0/-52.0	NONE
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE WATER RESISTANCE IS NOT REQUIRED	

WITH FIBERGLASS SLAB

DESIGN PRESSURE RATING	IMPACT RATING
±50.0PSF	NONE
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE WATER RESISTANCE IS NOT REQUIRED	


WITH STEEL SLAB AND PANOLOCK MULTI-POINT

DESIGN PRESSURE RATING	IMPACT RATING
+48.0/-50.0	NONE
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE WATER RESISTANCE IS NOT REQUIRED	

WITH FIBERGLASS SLAB AND PANOLOCK MULTI-POINT

35 3/4" x 94 15/16" PANEL SIZE SHOWN. OTHER SIZES ARE APPROVED
AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 23.56 FT²

- NOTES:
1. MAXIMUM ALLOWED BUILDUP TO BE 3" AT VERTICAL MULLION.
 2. IF SIDELITE WIDTH IS 16" OR LESS NO VERTICAL MULLION IS REQUIRED.

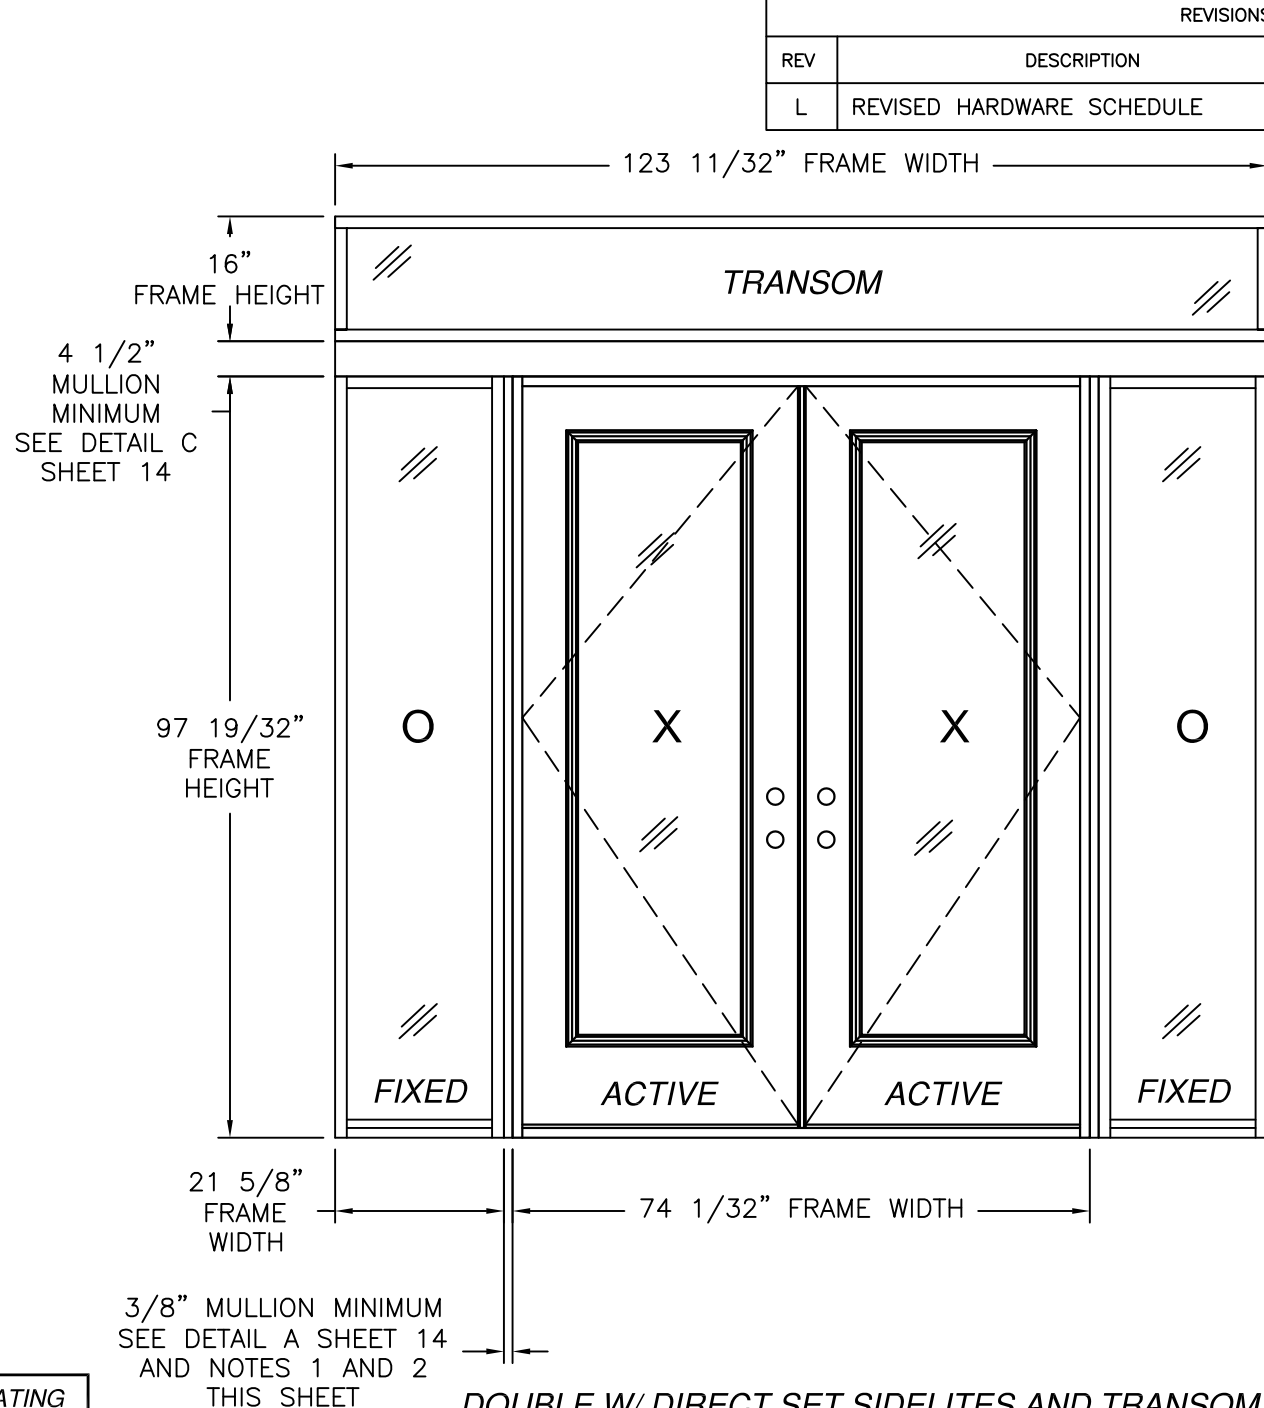


DOUBLE W/ DIRECT SET SIDELITES AND TRANSOM
EXTERIOR VIEW


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR W/SIDELITES & TRANSOM NON-IMPACT ELEVATIONS		
DRAWN: N.G.	DWG NO. 08-02079	REV L
SCALE NTS	DATE 06/19/13	SHEET 3 OF 18
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 09/09/2026

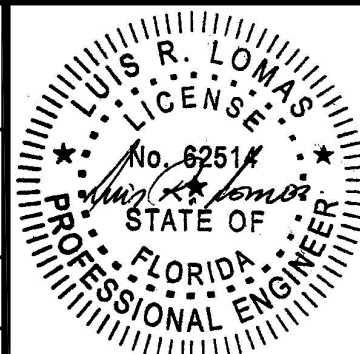

Luis R. Lomas P.E.
FL No.: 62514

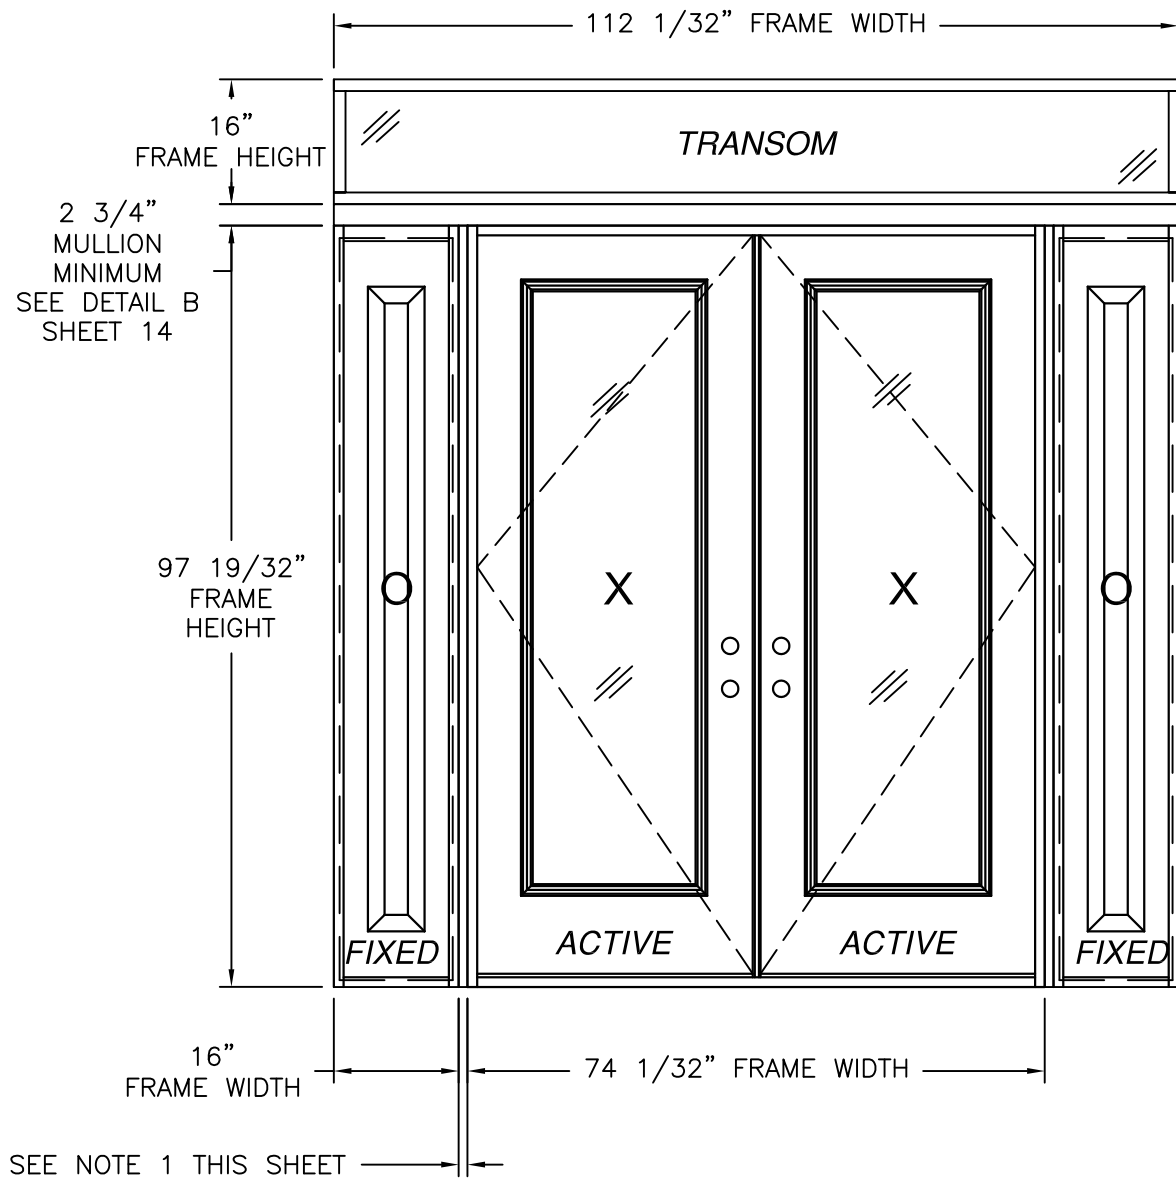

DOUBLE W/ STD SIDELITES AND TRANSOM
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
±55.0PSF	NONE
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE WATER RESISTANCE IS NOT REQUIRED	

WITH STEEL SLAB

DESIGN PRESSURE RATING	IMPACT RATING
+48.0/-52.0	NONE
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE WATER RESISTANCE IS NOT REQUIRED	

WITH FIBERGLASS SLAB

DESIGN PRESSURE RATING	IMPACT RATING
±50.0PSF	NONE
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE WATER RESISTANCE IS NOT REQUIRED	


WITH STEEL SLAB AND PANOLOCK MULTI-POINT

DESIGN PRESSURE RATING	IMPACT RATING
+48.0/-50.0	NONE
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE WATER RESISTANCE IS NOT REQUIRED	

WITH FIBERGLASS SLAB AND PANOLOCK MULTI-POINT

NOTES:
1. MAXIMUM ALLOWED BUILDUP TO BE 3"
AT VERTICAL MULLION.


35 3/4" x 94 15/16" PANEL SIZE SHOWN. OTHER SIZES ARE APPROVED
AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 23.56 FT²

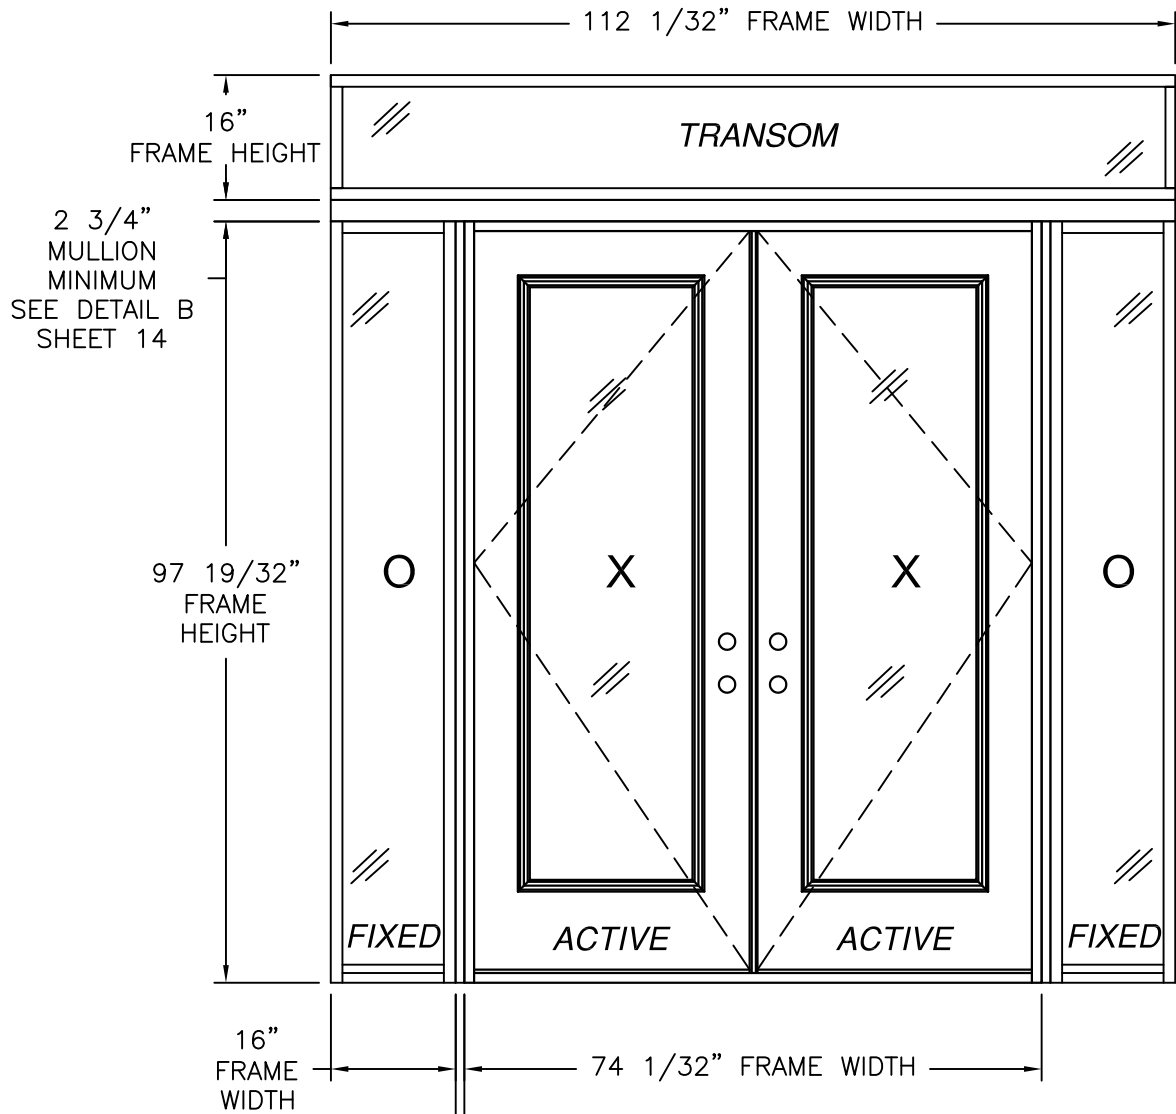

DOUBLE W/ DIRECT SET SIDELITES AND TRANSOM
EXTERIOR VIEW

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR W/SIDELITES & TRANSOM NON-IMPACT ELEVATIONS		
DRAWN: N.G.	DWG NO. 08-02079	REV L
SCALE NTS	DATE 06/19/13	SHEET 4 OF 18
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 09/09/2026

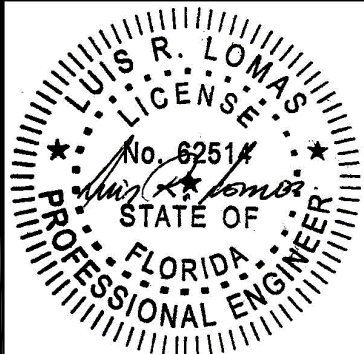

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

8" MAX
16" MAX O.C.
8" MAX

9" MAX

16" MAX O.C.

9" MAX

3" MAX
6" MAX
9" MAX
3" MAX
6" MAX
3" MAX

DOUBLE W/SIDELITE AND TRANSOM
ANCHORING LAYOUT

3" MAX TYP
6" MAX TYP
9" MAX TYP

8" MAX
16" MAX O.C.
8" MAX

9" MAX

16" MAX O.C.

9" MAX

3" MAX
6" MAX
9" MAX
3" MAX
6" MAX
3" MAX
6" MAX
9" MAX

DOUBLE W/SIDELITES & TRANSOM
ANCHORING LAYOUT

3" MAX TYP
6" MAX TYP
9" MAX TYP

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

Anchors and anchor connectors corrosion resistance chart		
Exposure	Distance from coastal shoreline	
	0' up to 300'	>300' up to 3000'
Exterior - partially sheltered	304 or A305 or 306 Stainless steel per ASTM A240	Galvanized per ASTM A153 class D or ASTM A641 class 3S
Exterior - open exposed	304 or A305 or 306 Stainless steel per ASTM A240	Galvanized per ASTM A153 class D or ASTM A641 class 3S
Unconditioned interior-vented enclosed	Galvanized per ASTM A153 class D or ASTM A641 class 3S	Galvanized per ASTM A153 class D or ASTM A641 class 3S
Unconditioned interior-unvented enclosed	Galvanized per ASTM A153 class D or ASTM A641 class 3S	Galvanized per ASTM A153 class D or ASTM A641 class 3S

PROVIA, LLC.


2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR
W/SIDELITES & TRANSOM NON-IMPACT
ANCHORING LAYOUTS



DRAWN: N.G.	DWG NO. 08-02079	REV L
SCALE NTS	DATE 06/19/13	SHEET 5 OF 18

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 09/09/2026

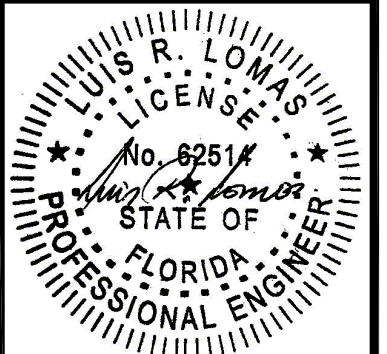

Luis R. Lomas P.E.
FL No.: 62514

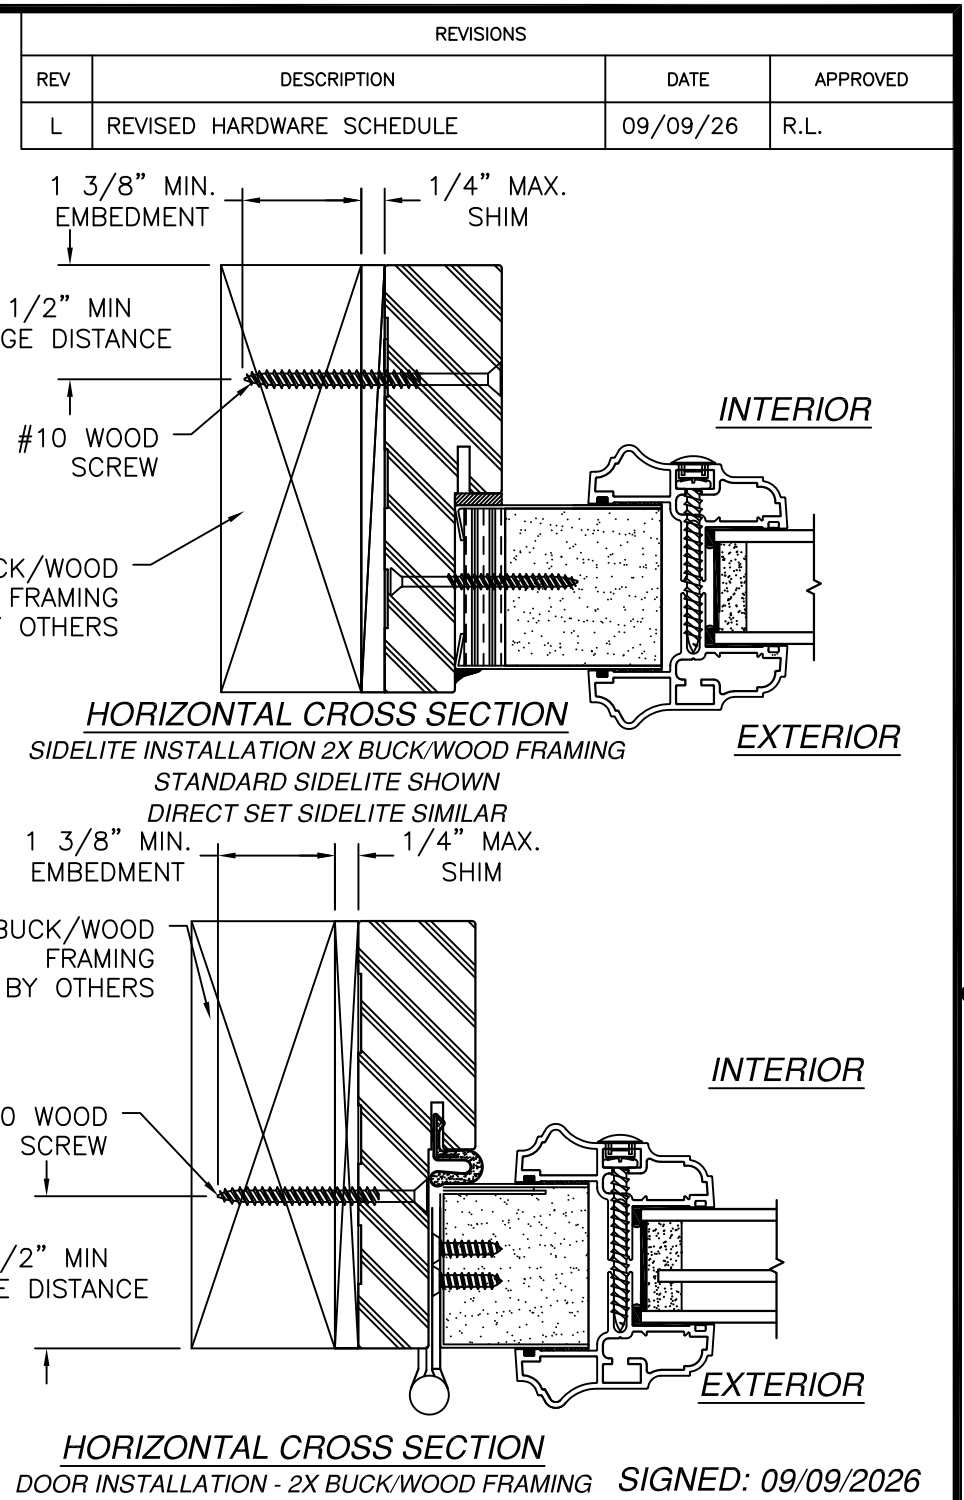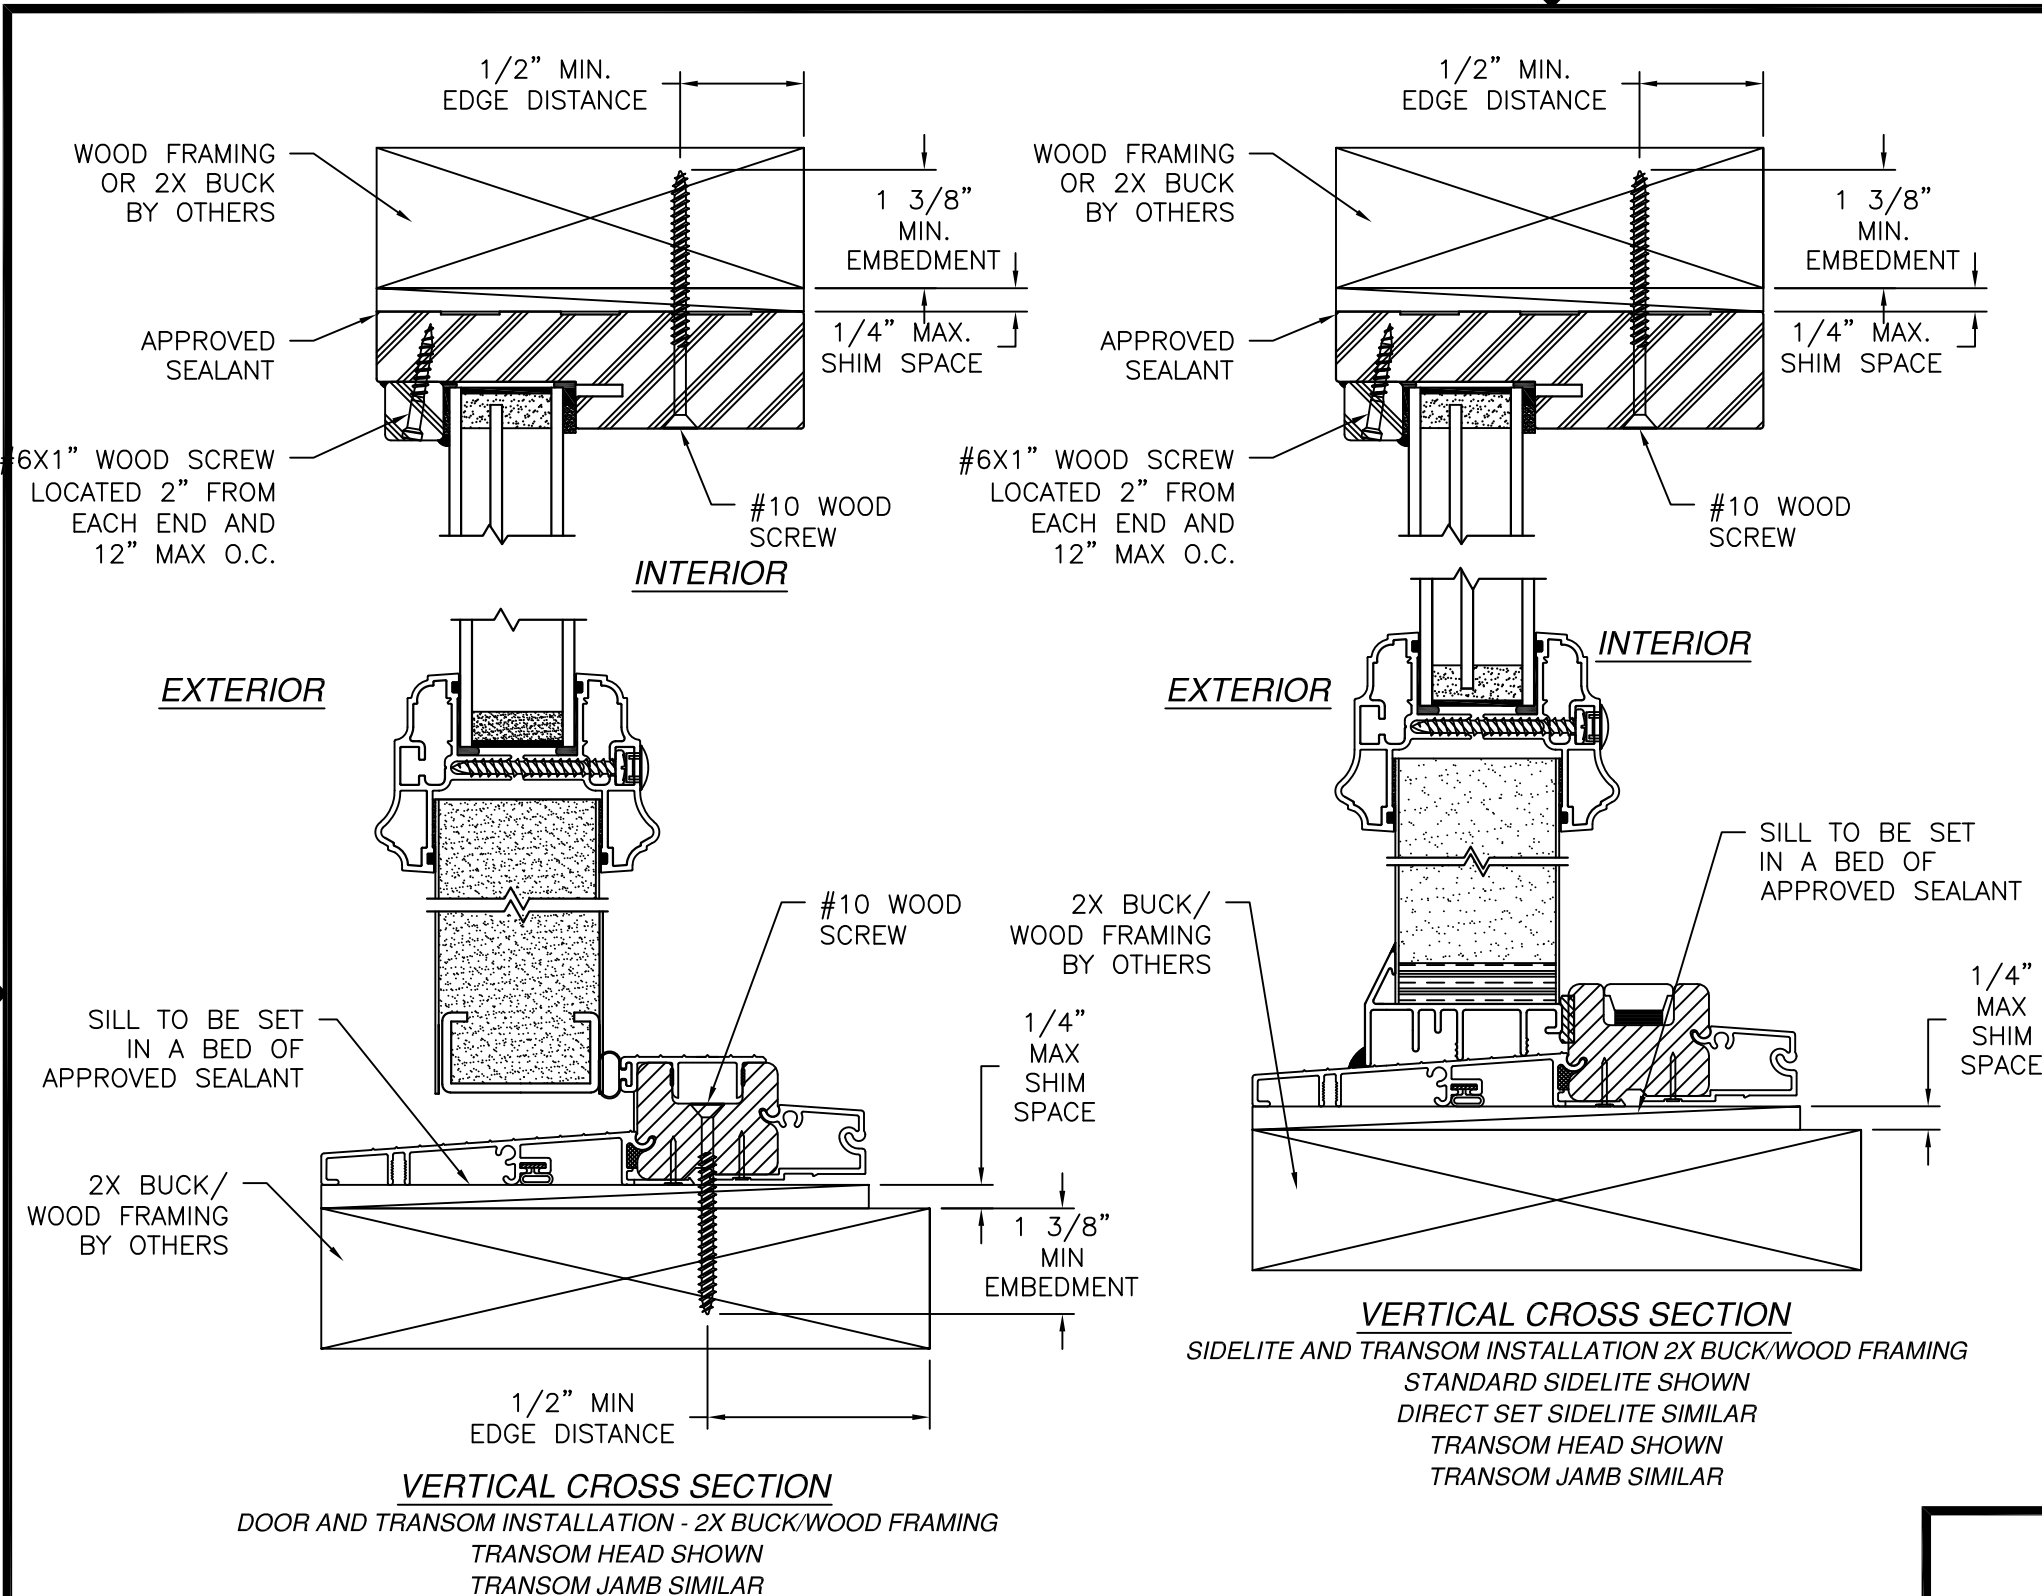

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

PROVIA, LLC.

2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR
W/SIDELITES & TRANSOM NON-IMPACT
INSTALLATION DETAILS

DRAWN: N.G.

DWG NO. 08-02079

REV L

SCALE NTS

DATE 06/19/13

SHEET 6 OF 18

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

LUIS R. LOMAS

LICENS. M.E.

No. 62514



STATE OF FLORIDA

PROFESSIONAL ENGINEER



Luis R. Lomas P.E.

FL No.: 62514



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

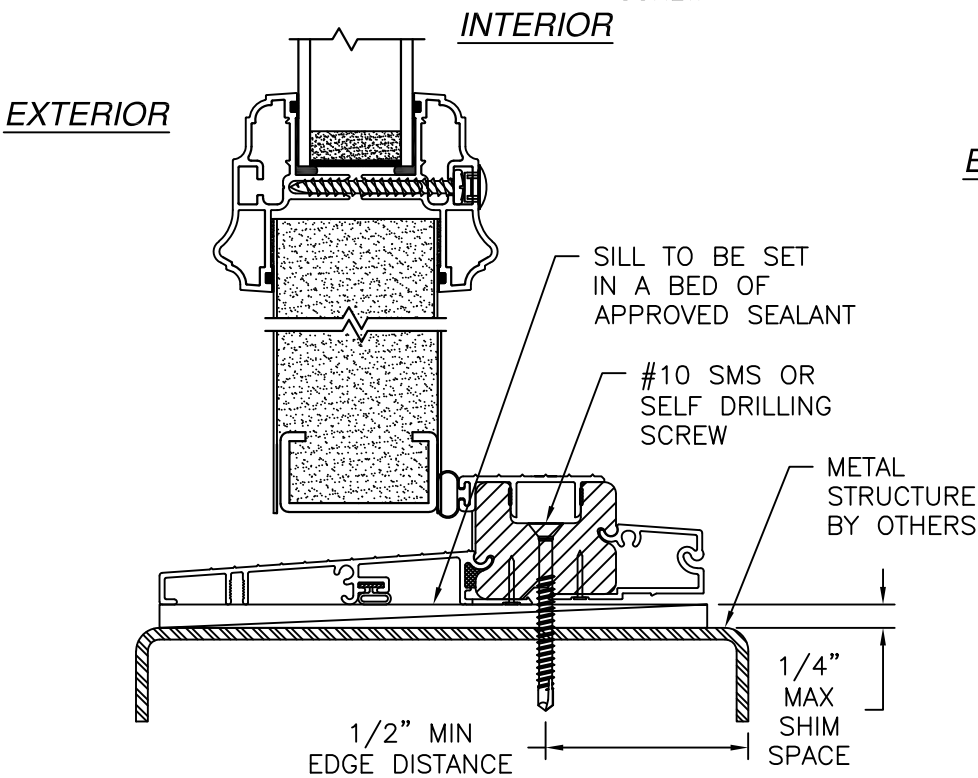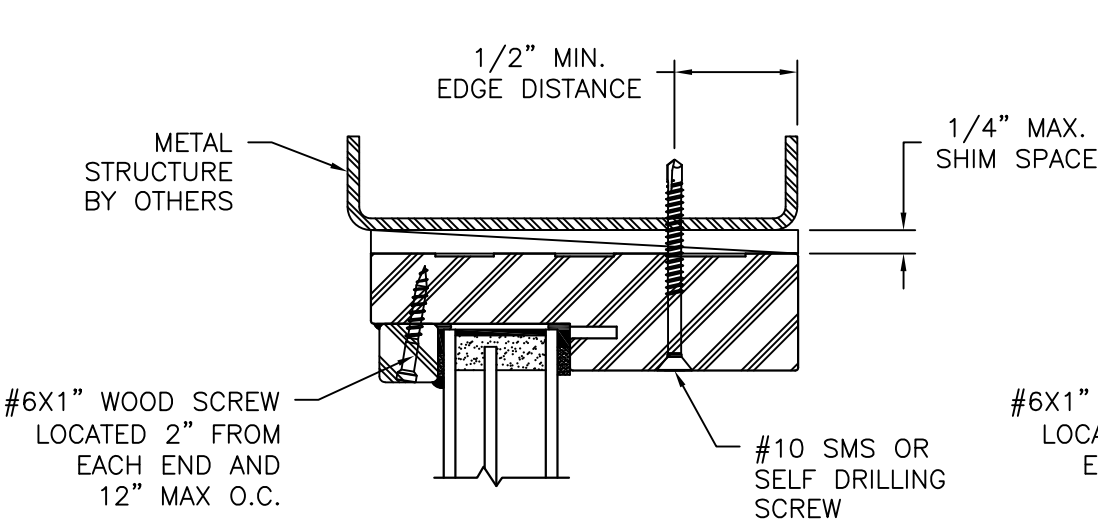

VERTICAL CROSS SECTION
DOOR AND TRANSOM INSTALLATION METAL STRUCTURE
TRANSOM HEAD SHOWN
TRANSOM JAMB SIMILAR

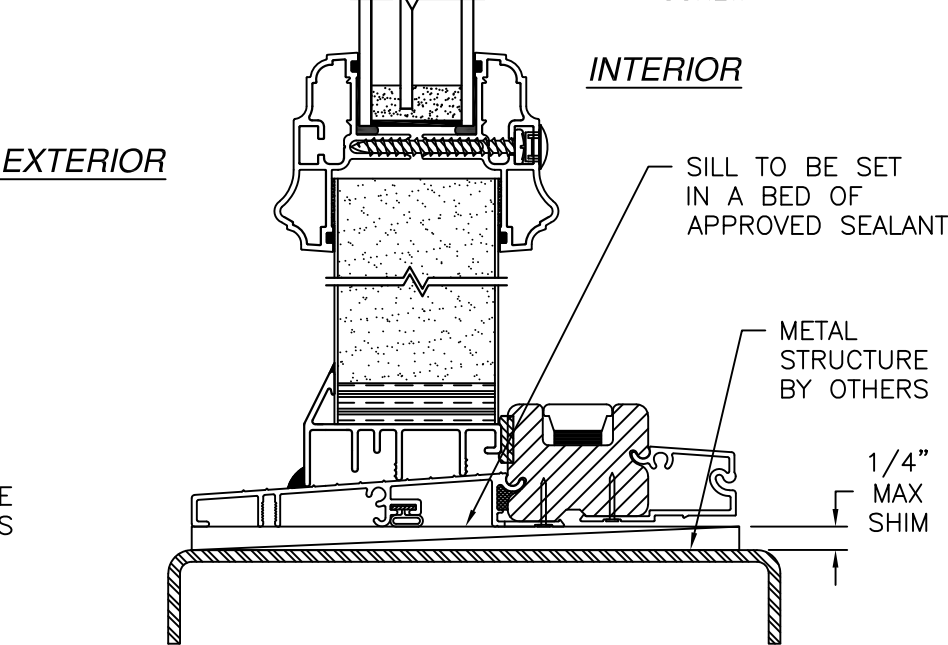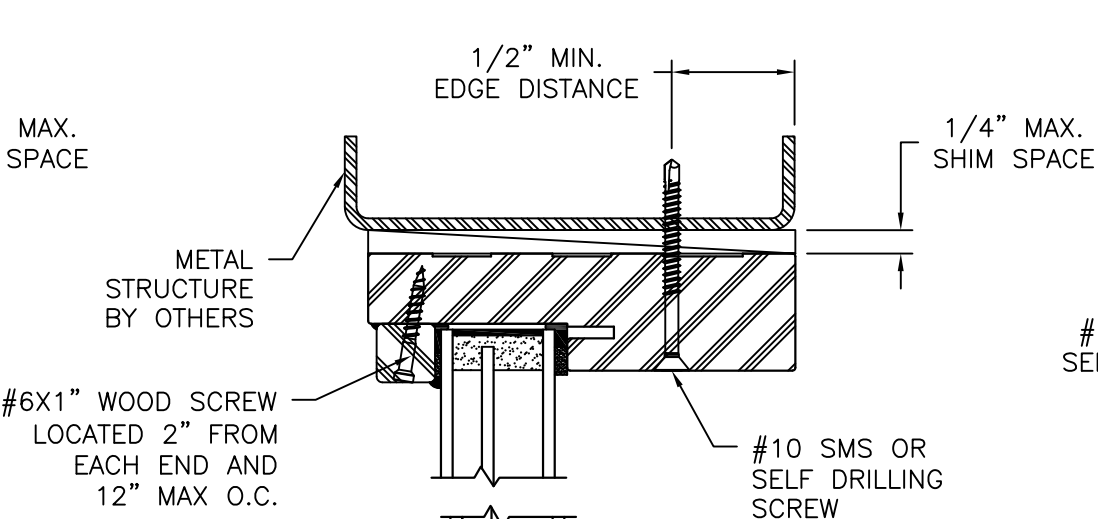

VERTICAL CROSS SECTION
SIDELITE AND TRANSOM INSTALLATION METAL STRUCTURE
STANDARD SIDELITE SHOWN
DIRECT SET SIDELITE SIMILAR
TRANSOM HEAD SHOWN
TRANSOM JAMB SIMILAR

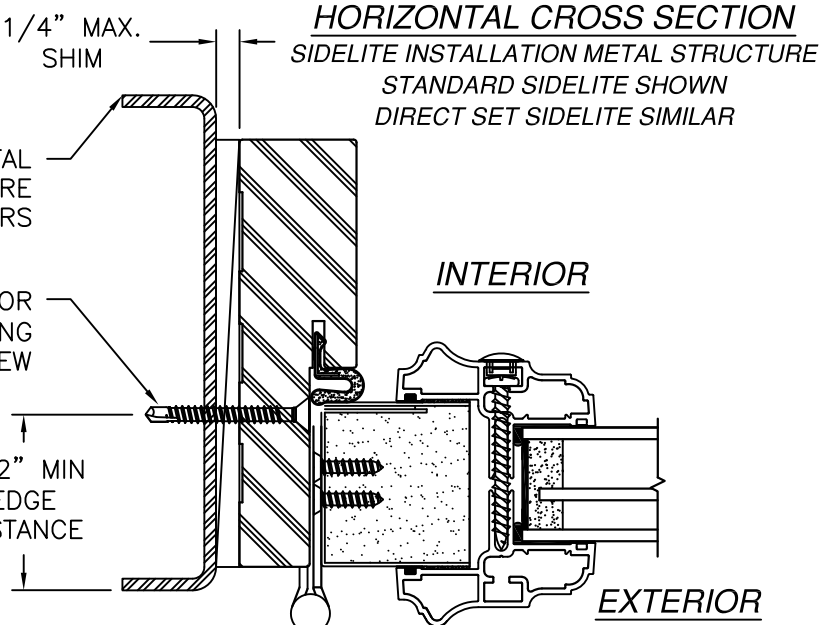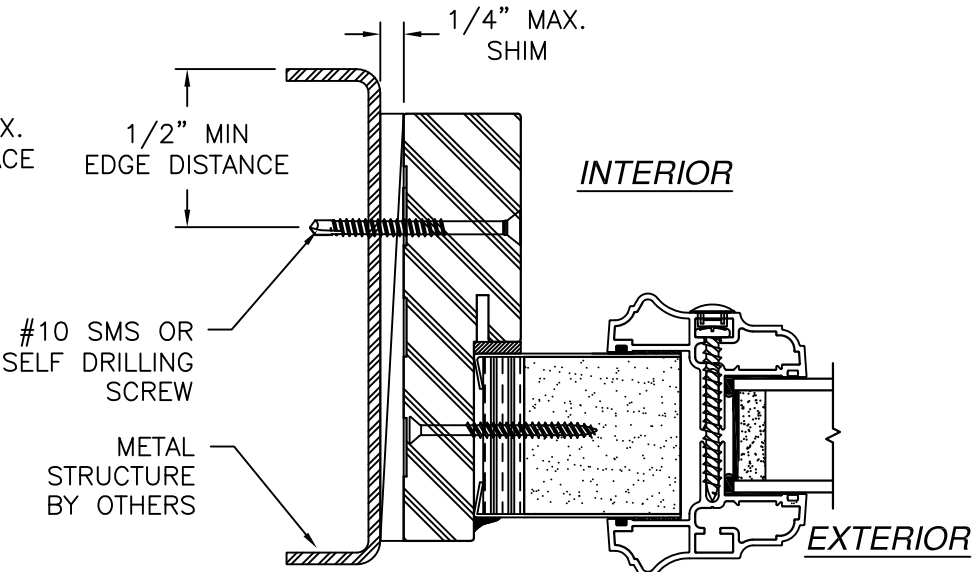

HORIZONTAL CROSS SECTION
DOOR INSTALLATION METAL STRUCTURE

SIGNED: 09/09/2026

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

PROVIA, LLC.

2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR
W/SIDELITES & TRANSOM NON-IMPACT
INSTALLATION DETAILS

DRAWN: N.G.

DWG NO. 08-02079

REV L

SCALE NTS


DATE 06/19/13

SHEET 7 OF 18

L. ROBERTO LOMAS P.E.


208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

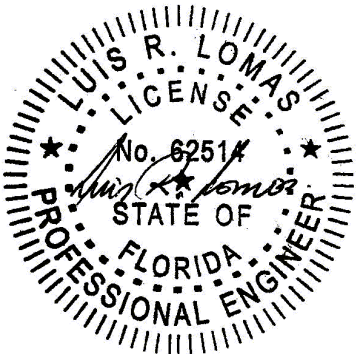


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

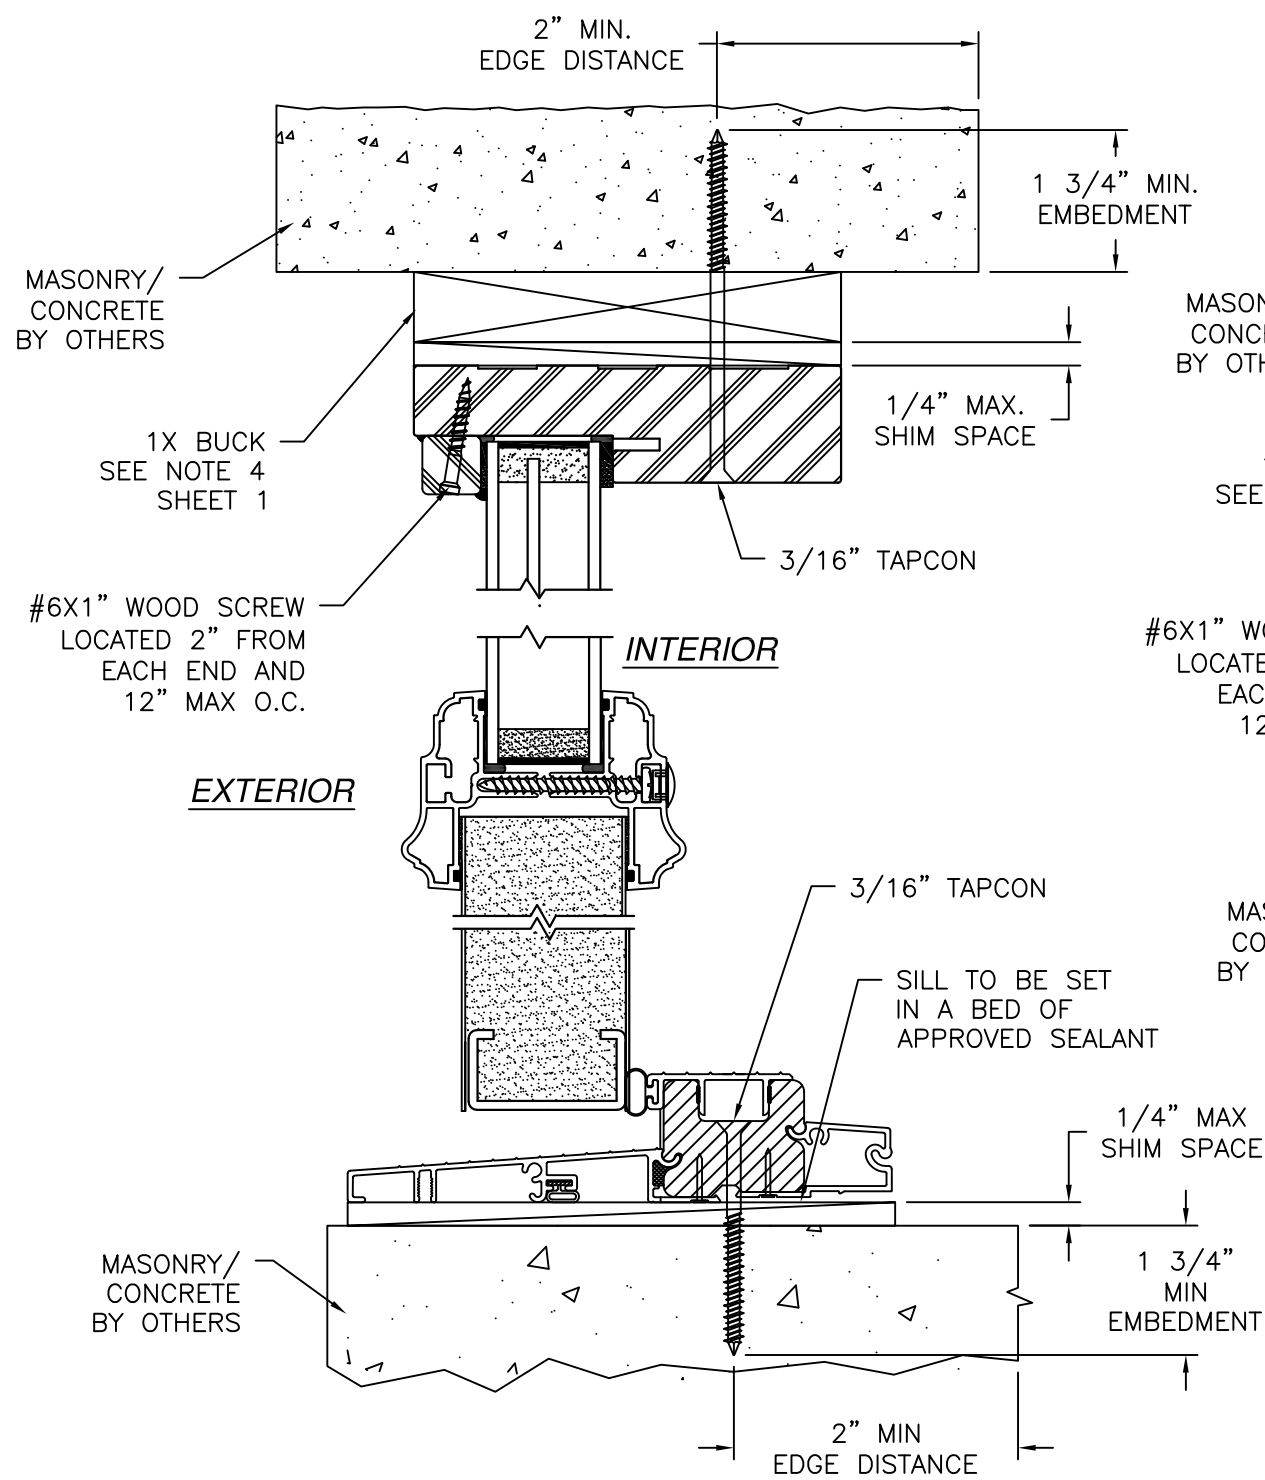

VERTICAL CROSS SECTION
DOOR AND TRANSOM INSTALLATION MASONRY/CONCRETE
TRANSOM HEAD SHOWN
TRANSOM JAMB SIMILAR

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

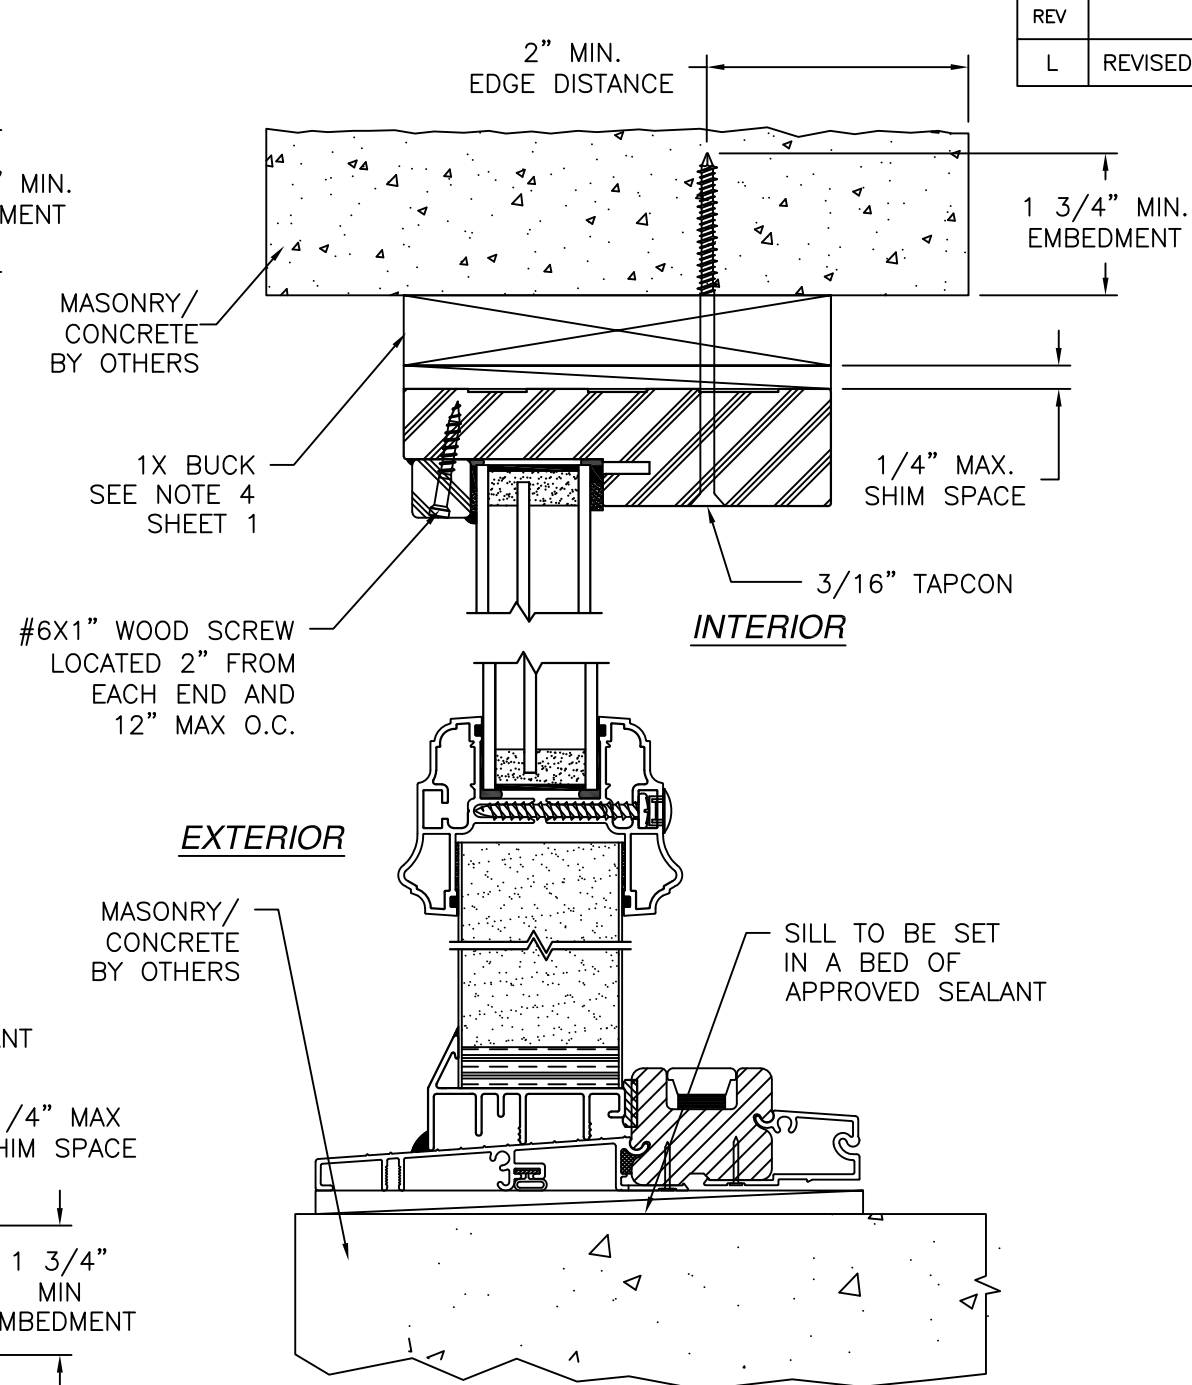

VERTICAL CROSS SECTION
SIDELITE AND TRANSOM INSTALLATION
MASONRY/CONCRETE
STANDARD SIDELITE SHOWN
DIRECT SET SIDELITE SIMILAR
TRANSOM HEAD SHOWN
TRANSOM JAMB SIMILAR

PROVIA, LLC.

2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR
W/SIDELITES & TRANSOM NON-IMPACT
INSTALLATION DETAILS

DRAWN: N.G.

DWG NO. 08-02079

REV L

SCALE NTS

DATE 06/19/13

SHEET 8 OF 18

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

SIGNED: 09/09/2026

LUIS R. LOMAS

LICENS. M. S.


No. 62514

STATE OF FLORIDA


PROFESSIONAL ENGINEER

Luis R. Lomas P.E.

FL No.: 62514

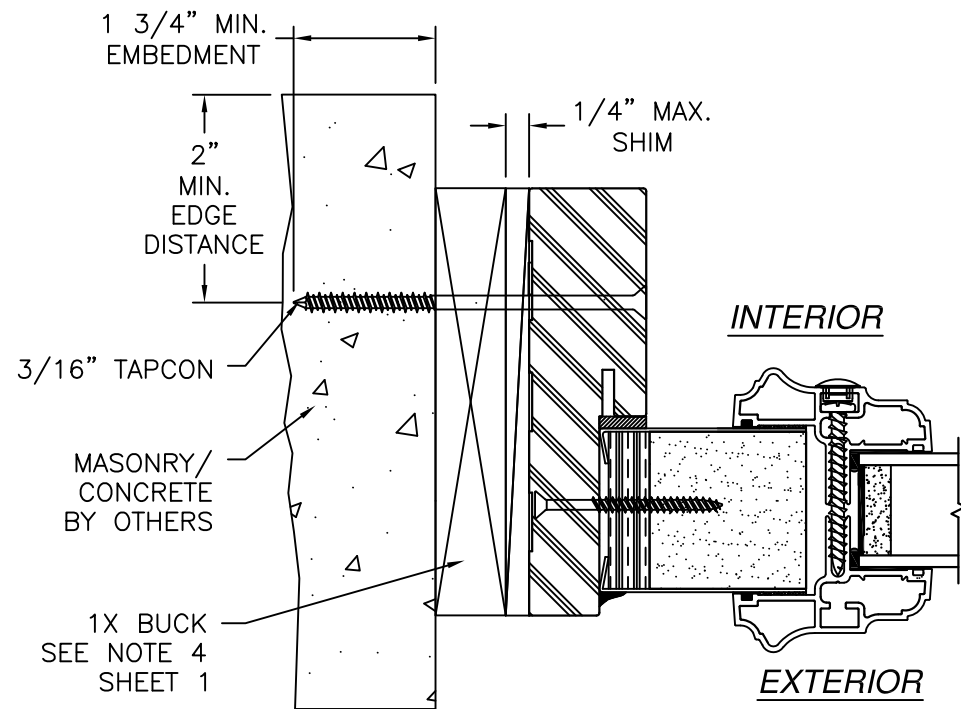

HORIZONTAL CROSS SECTION
SIDELITE INSTALLATION CONCRETE/MASONRY
STANDARD SIDELITE SHOWN
DIRECT SET SIDELITE SIMILAR

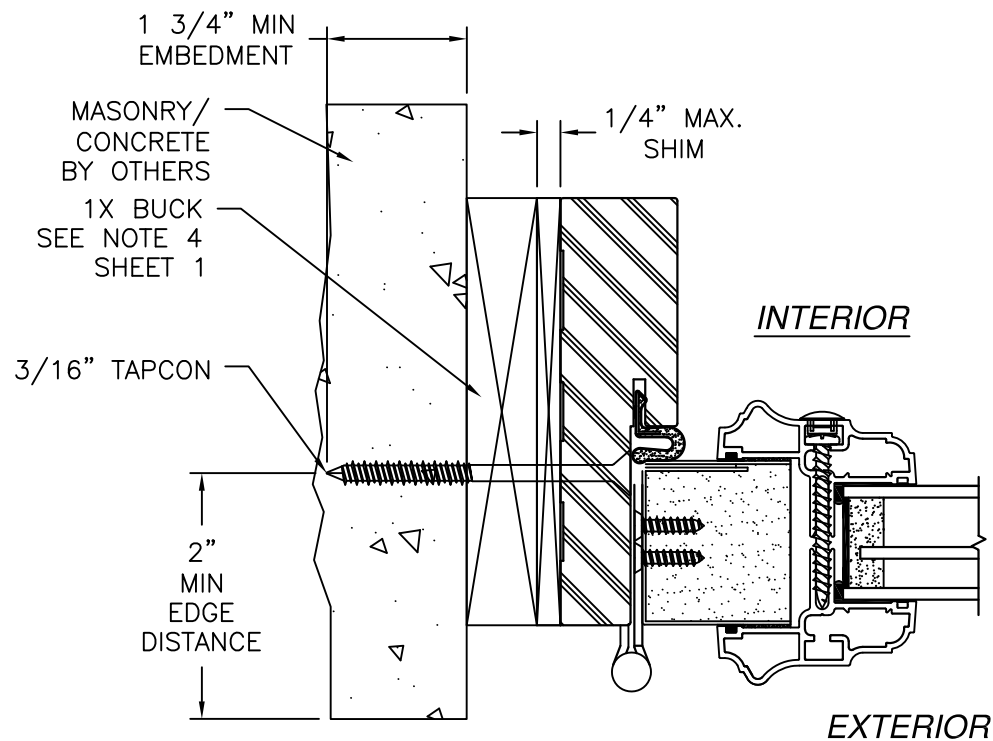

HORIZONTAL CROSS SECTION
DOOR INSTALLATION CONCRETE/MASONRY

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112




REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

SIGNED: 09/09/2026

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR W/SIDELITES & TRANSOM NON-IMPACT INSTALLATION DETAILS		
DRAWN: N.G.	DWG NO. 08-02079	REV L
SCALE NTS	DATE 06/19/13	SHEET 9 OF 18
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

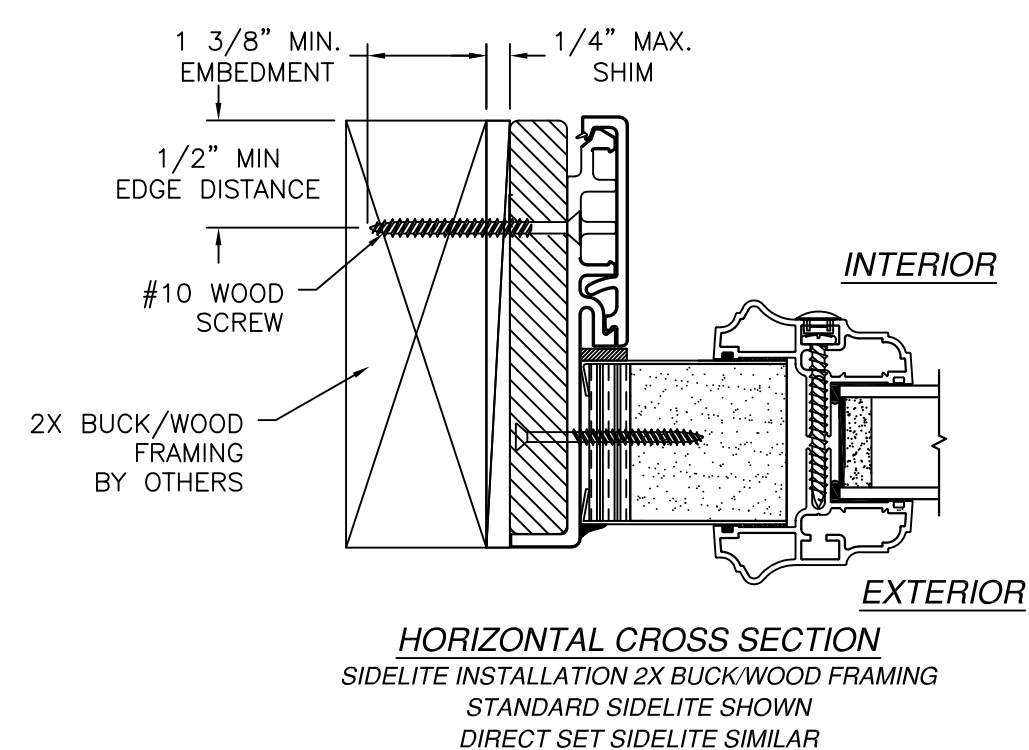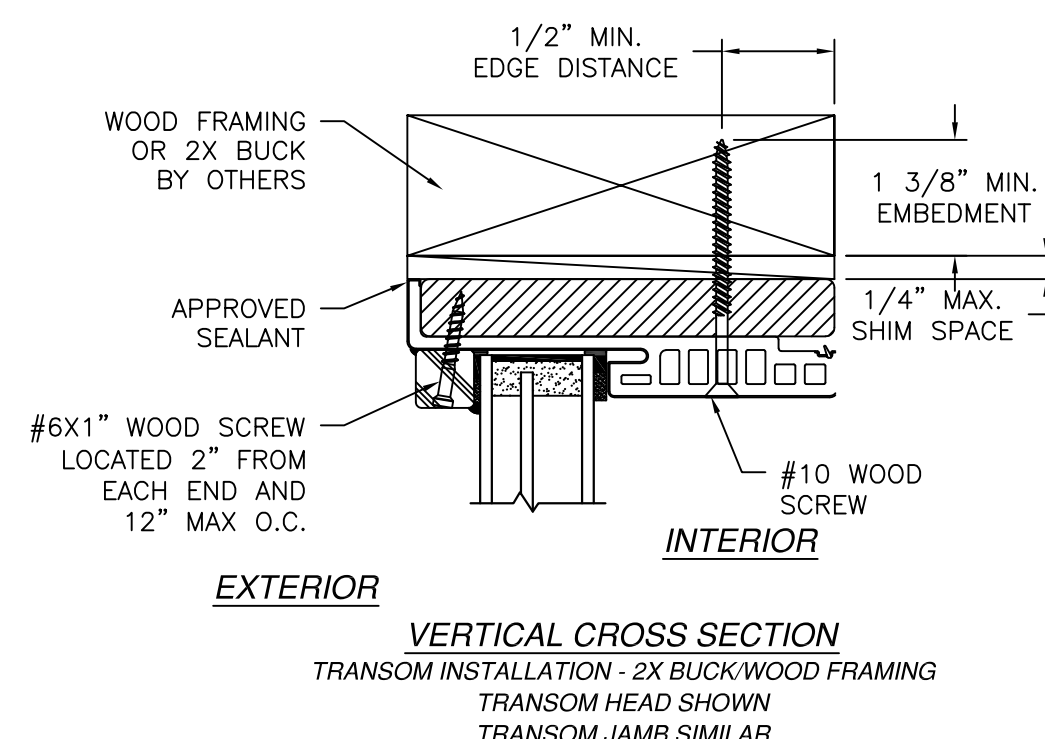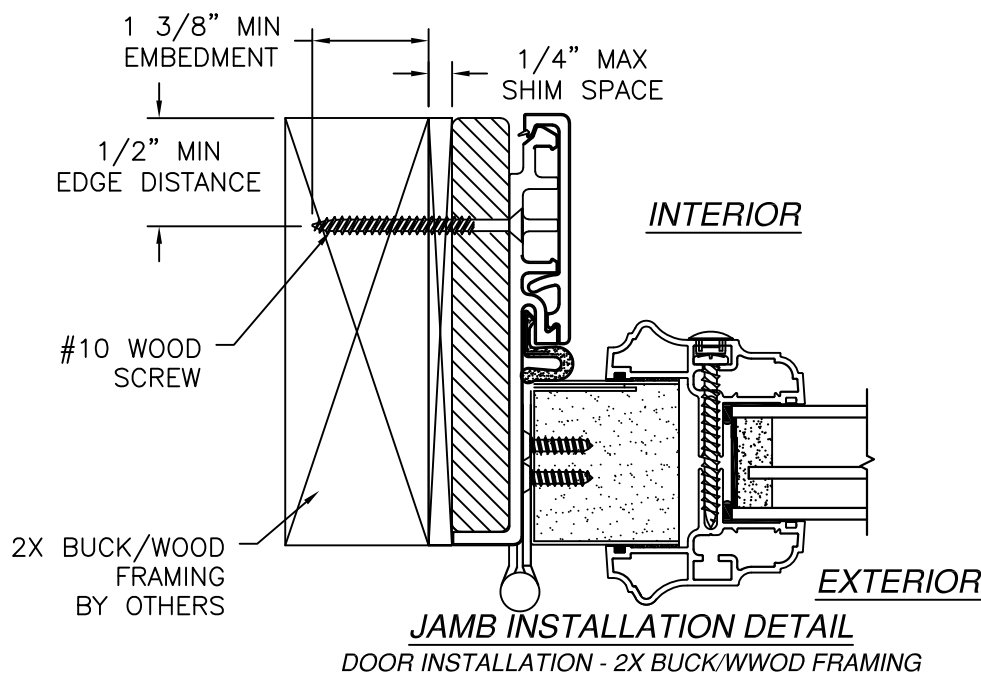

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

PROVIA, LLC.

2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR
W/SIDELITES & TRANSOM NON-IMPACT
INSTALLATION DETAILS W/FUSION FRAME

DRAWN: N.G.

DWG NO. 08-02079

REV L

SCALE NTS

DATE 06/19/13

SHEET 10 OF 18

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903


434-688-0609 rllomas@lrlomaspe.com

SIGNED: 09/09/2026


Luis R. Lomas P.E.

FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

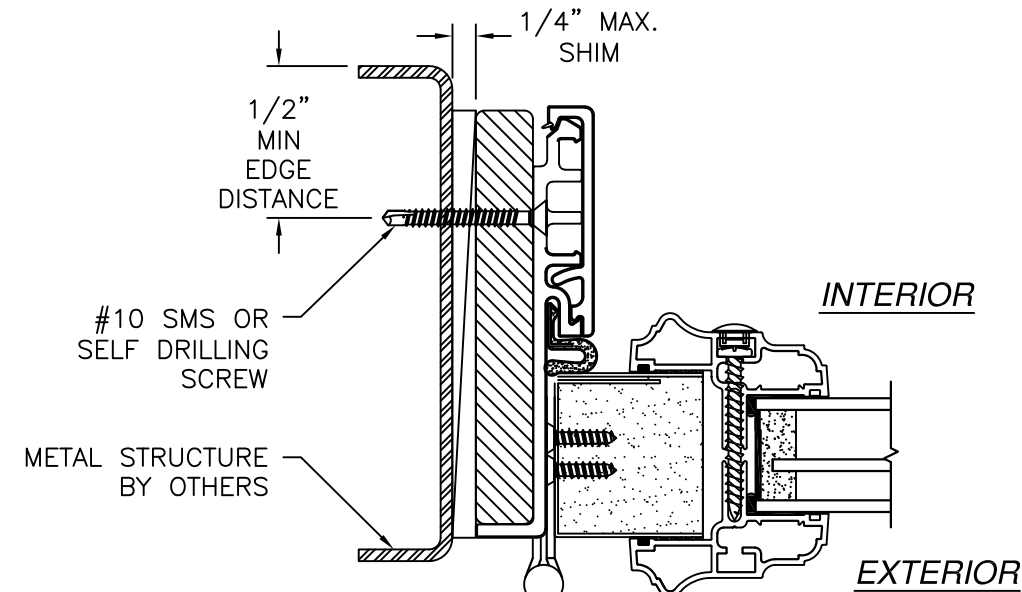

JAMB INSTALLATION DETAIL
DOOR INSTALLATION - METAL STRUCTURE

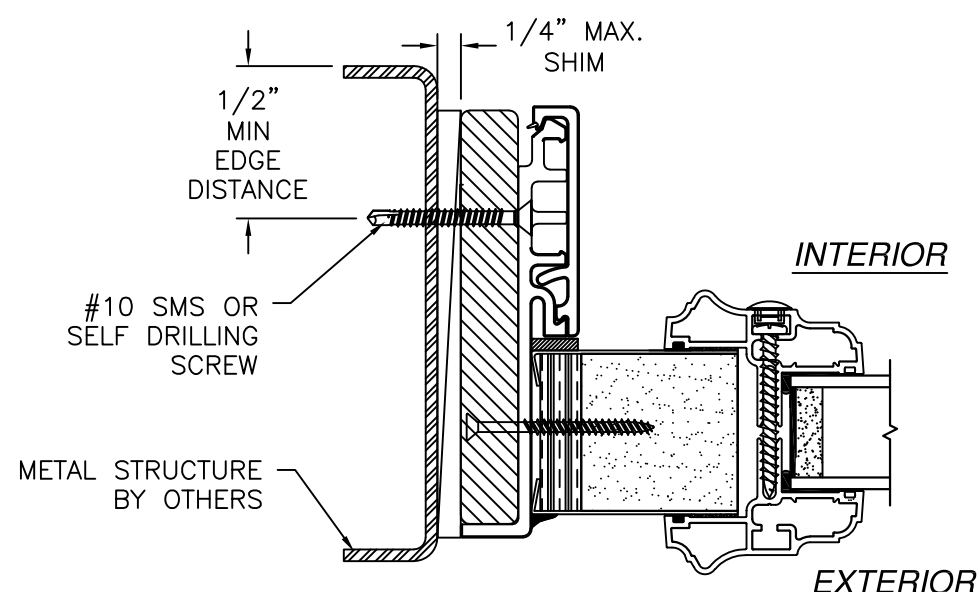

HORIZONTAL CROSS SECTION
SIDELITE INSTALLATION METAL STRUCTURE
STANDARD SIDELITE SHOWN
DIRECT SET SIDELITE SIMILAR

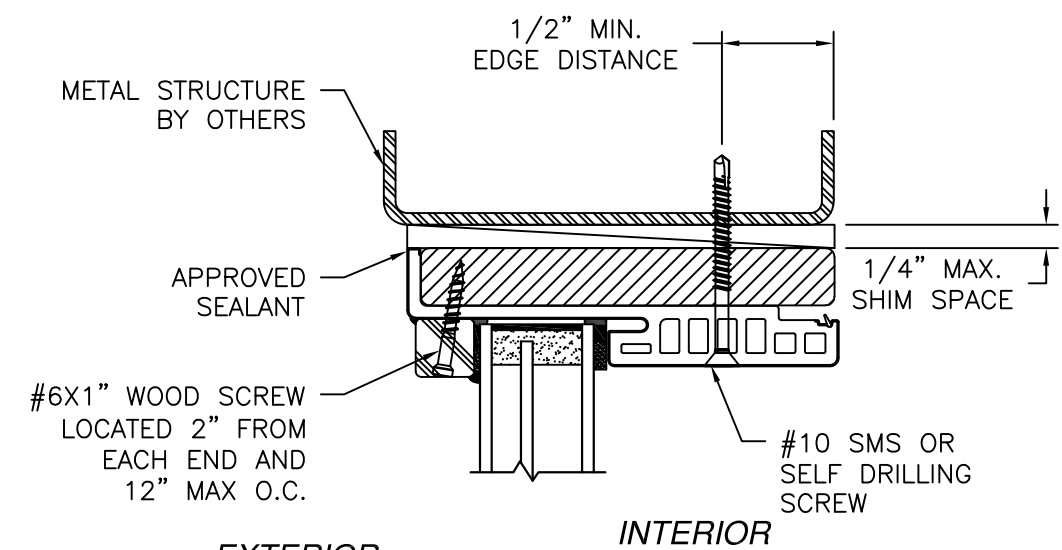


VERTICAL CROSS SECTION
TRANSOM INSTALLATION - METAL STRUCTURE
TRANSOM HEAD SHOWN
TRANSOM JAMB SIMILAR

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112



SIGNED: 09/09/2026

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR W/SIDELITES & TRANSOM NON-IMPACT INSTALLATION DETAILS W/FUSION FRAME		
DRAWN: N.G.	DWG NO. 08-02079	REV L
SCALE NTS	DATE 06/19/13	SHEET 11 OF 18
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

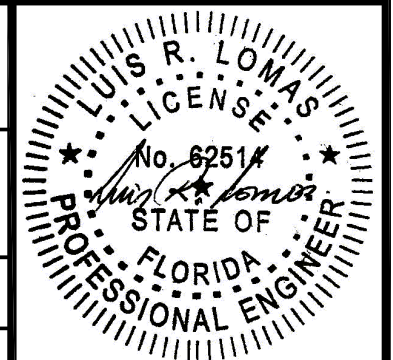


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

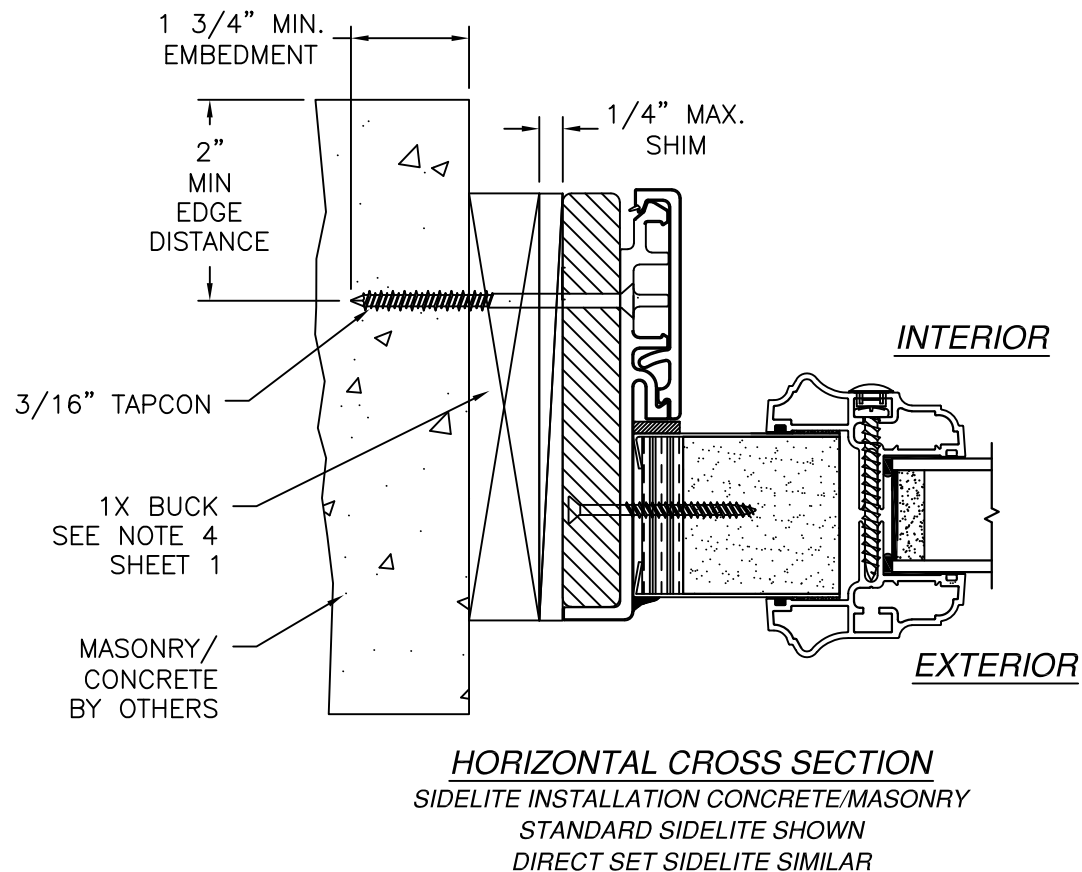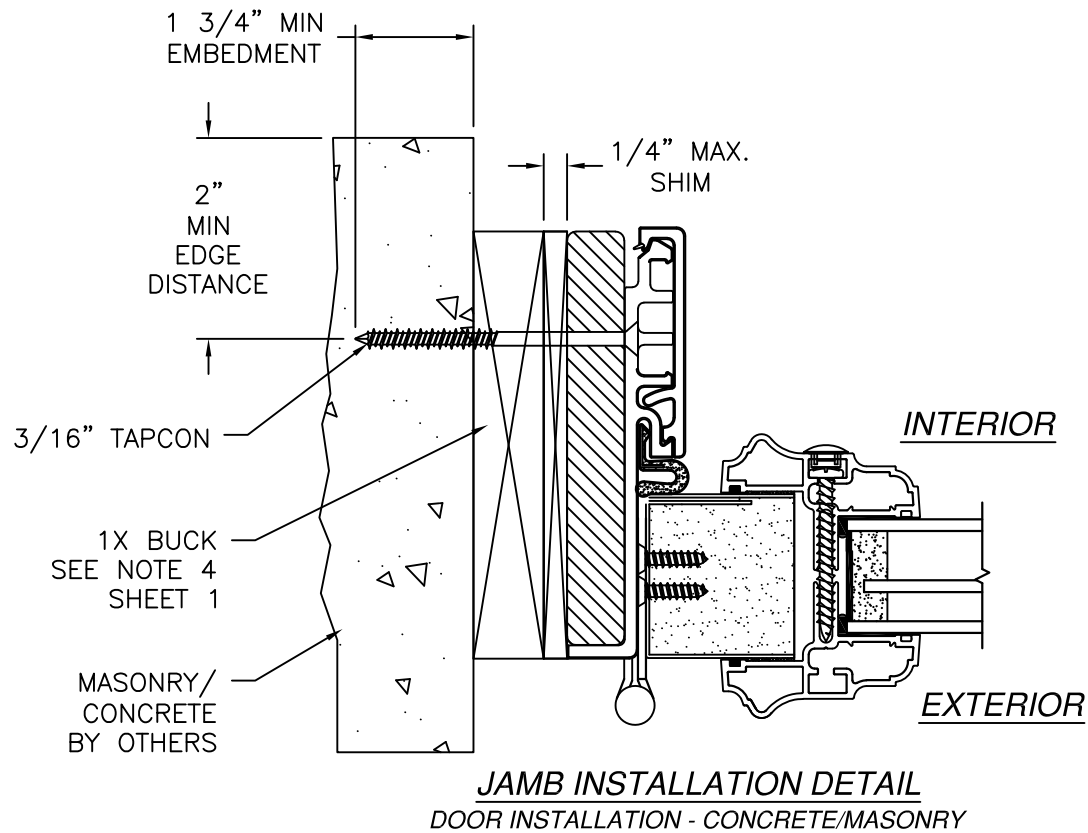


- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

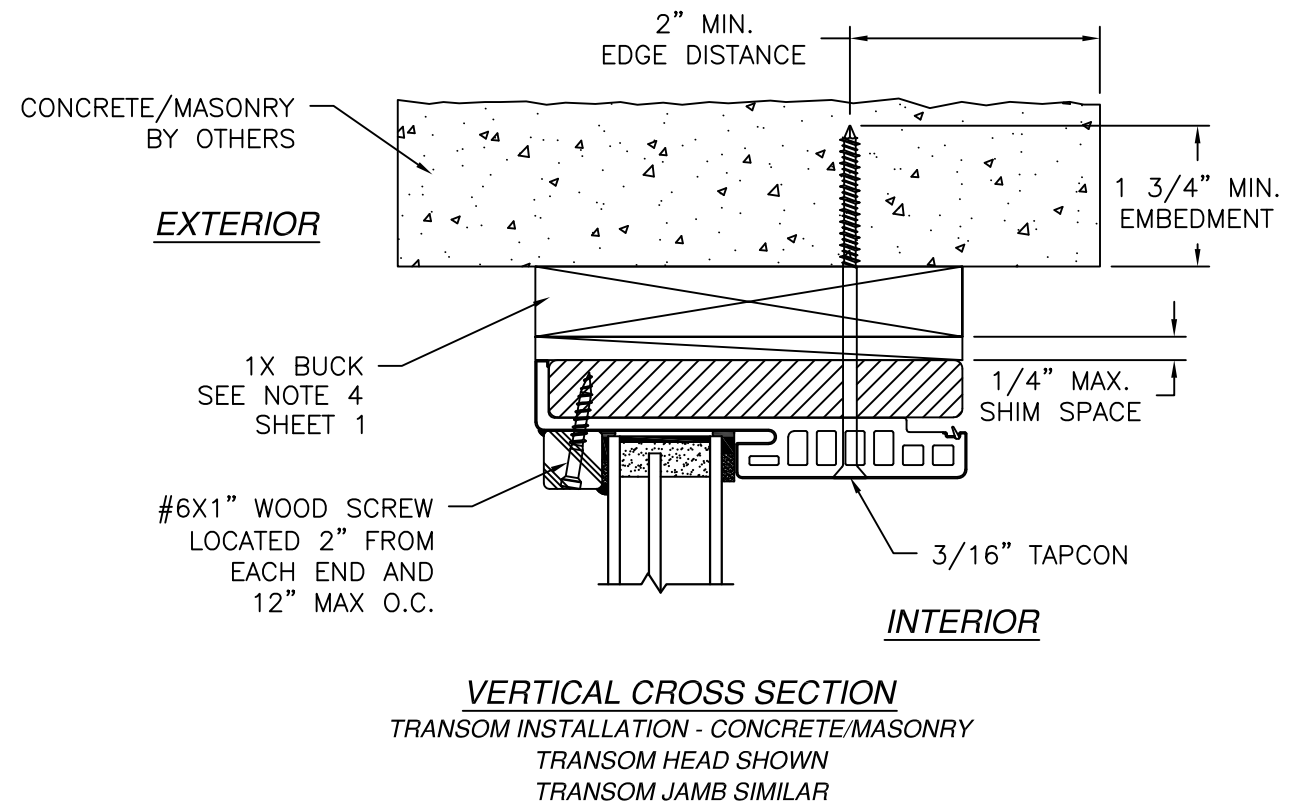


SIGNED: 09/09/2026

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR W/SIDELITES & TRANSOM NON-IMPACT INSTALLATION DETAILS W/FUSION FRAME		
DRAWN: N.G.	DWG NO. 08-02079	REV L
SCALE NTS	DATE 06/19/13	SHEET 12 OF 18
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

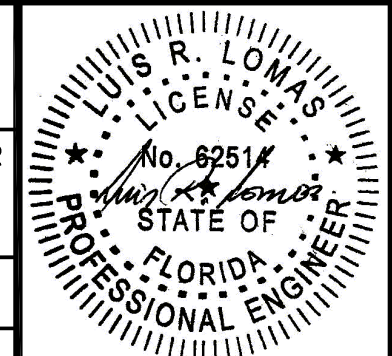


Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

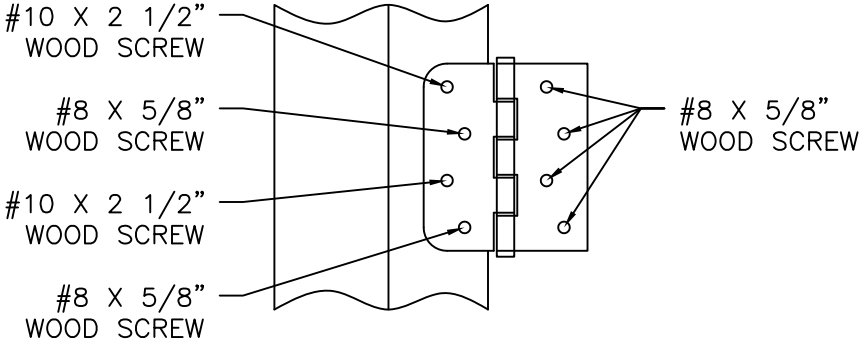


HINGE INSTALLATION DETAIL
2X BUCK/WOOD FRAMING

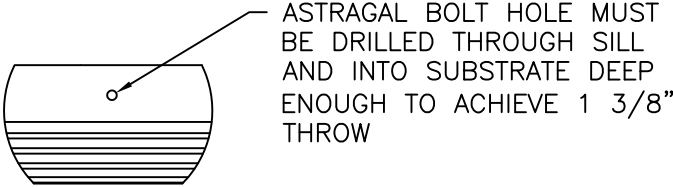


ASTRAGAL SILL DETAIL

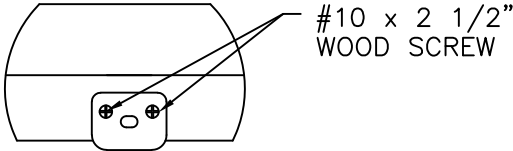

ASTRAGAL HEAD STRIKE DETAIL
2X BUCK/WOOD FRAMING

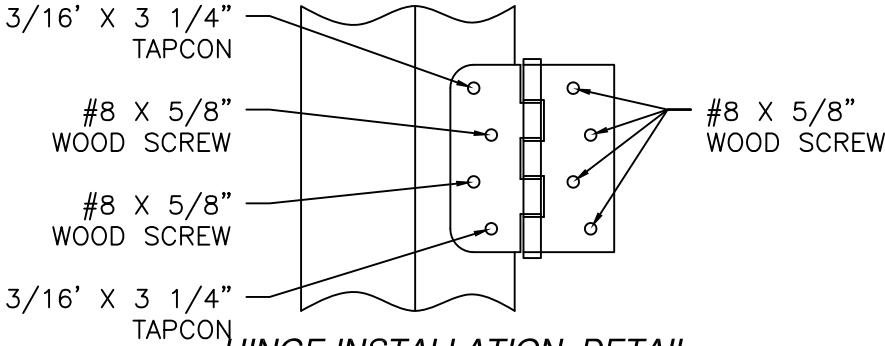


HINGE INSTALLATION DETAIL
MASONRY/CONCRETE

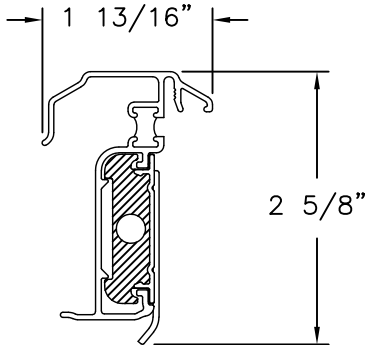


HURRICANE ASTRAGAL DETAIL

APPROVED LITE CONFIGURATIONS

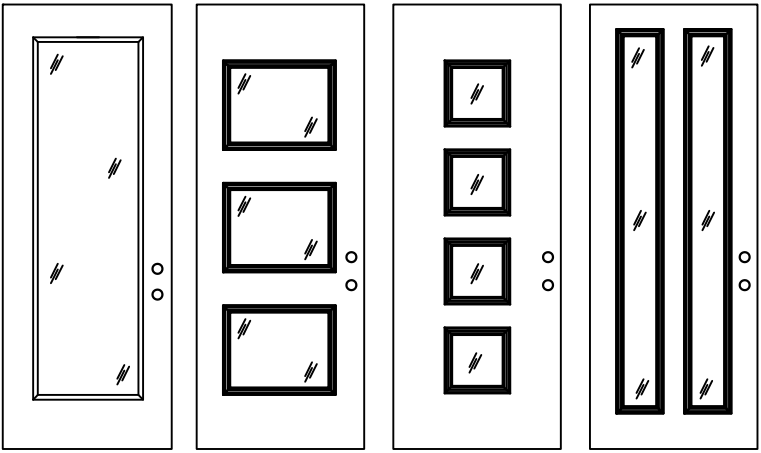

FULL LITE 3 LITE 4 LITE 2 LITE

LITE CONFIGURATIONS SHOWN ARE FOR REFERENCE ONLY. MULTIPLE LITE CONFIGURATIONS ARE APPROVED AS LONG AS LITE SIZE DOES NOT EXCEED 11.5 FT²

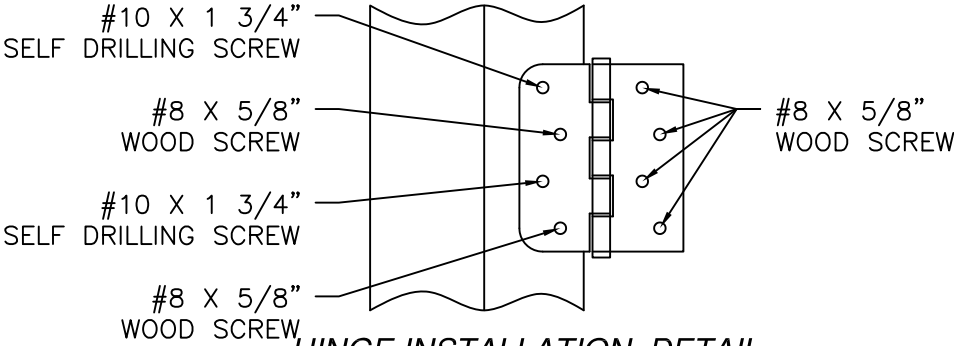

HINGE INSTALLATION DETAIL
METAL STRUCTURE

PROVIA, LLC.

2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR
W/SIDELITES & TRANSOM NON-IMPACT
COMPONENTS

DRAWN: N.G.

DWG NO. 08-02079

REV L

SCALE NTS

DATE 06/19/13


SHEET 13 OF 18

L. ROBERTO LOMAS P.E.


208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com




SIGNED: 09/09/2026

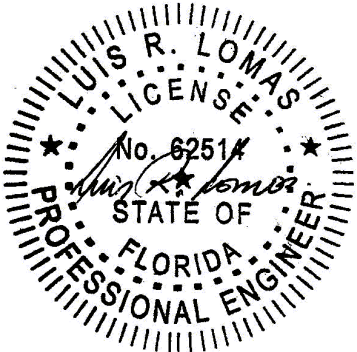

Luis R. Lomas P.E.
FL No.: 62514

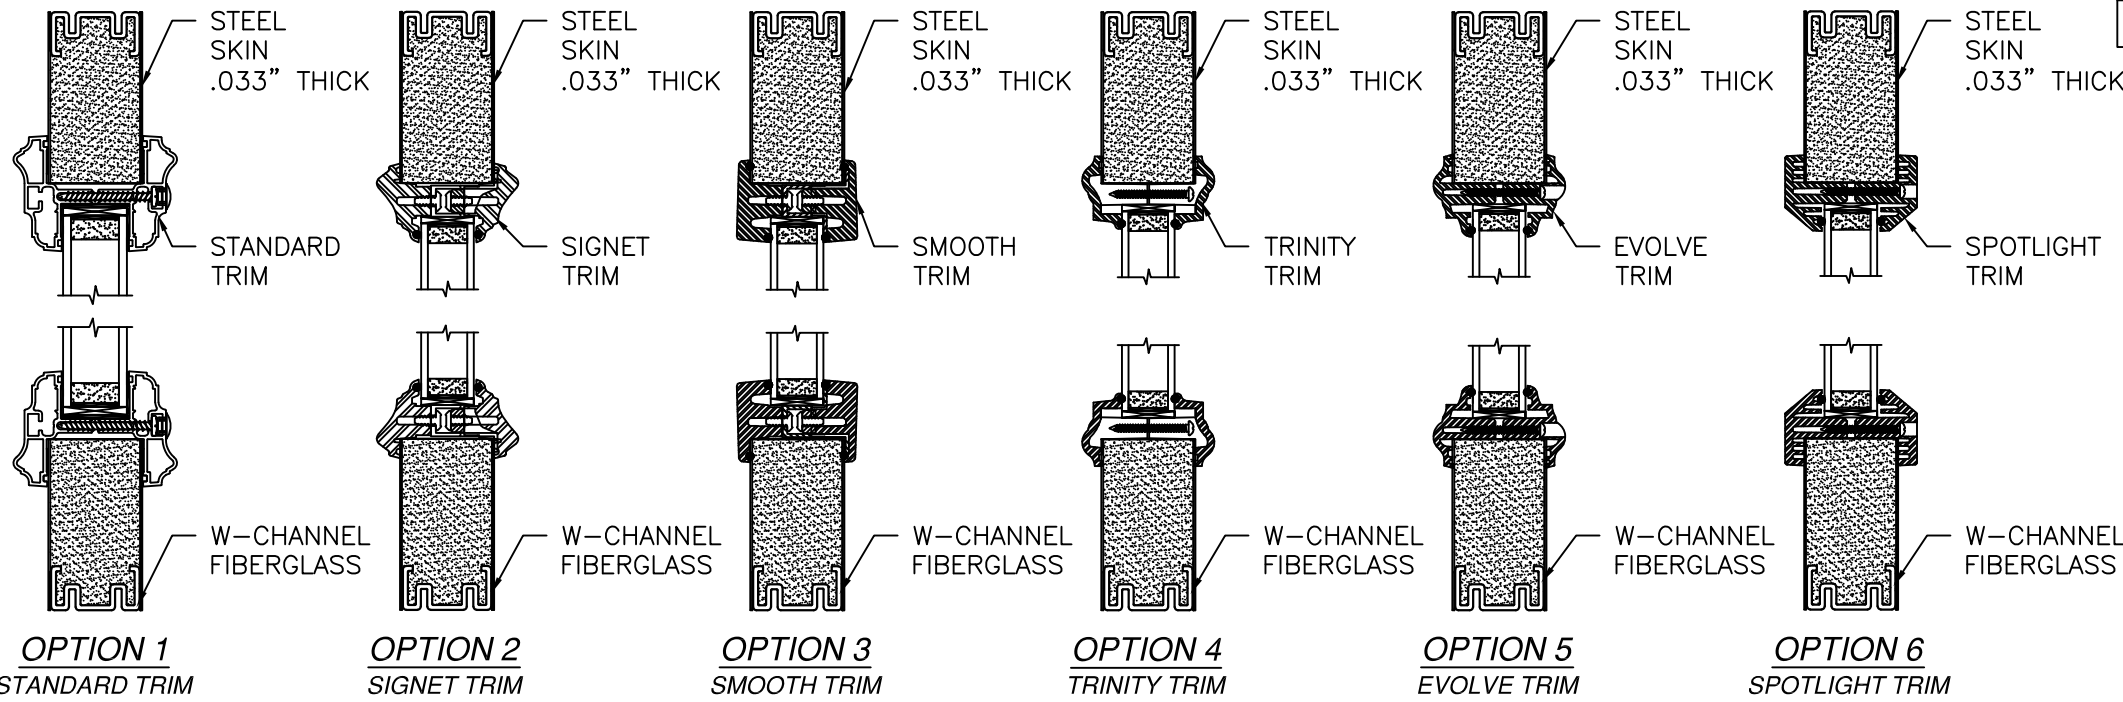

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

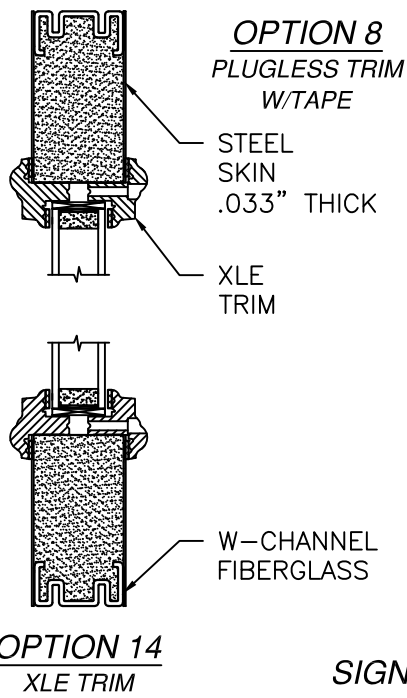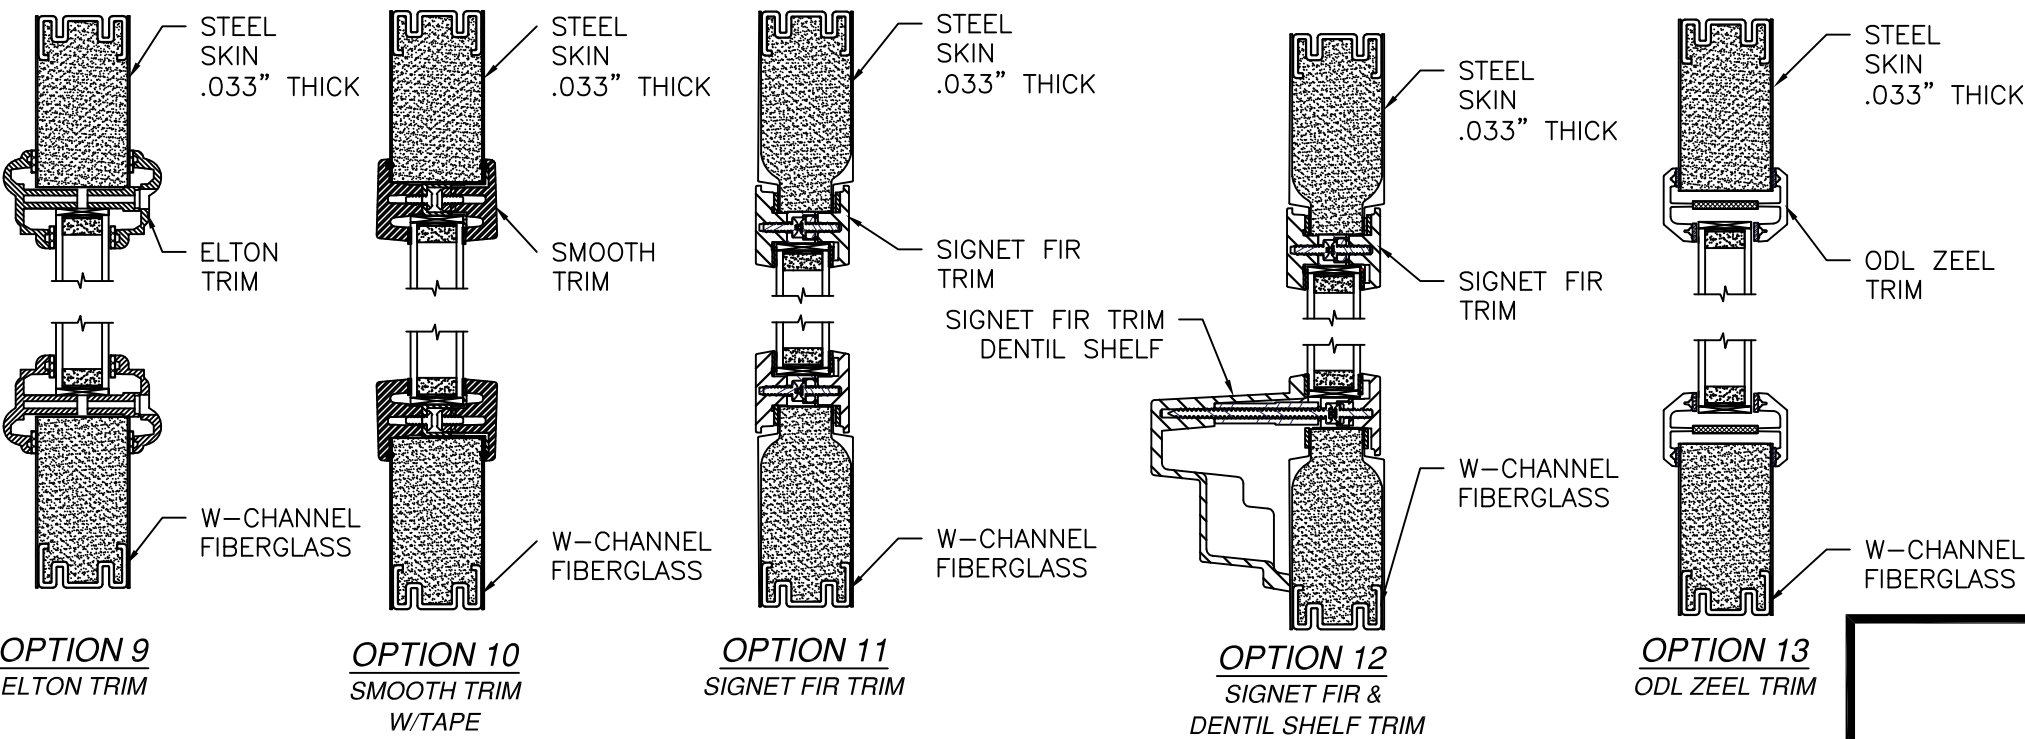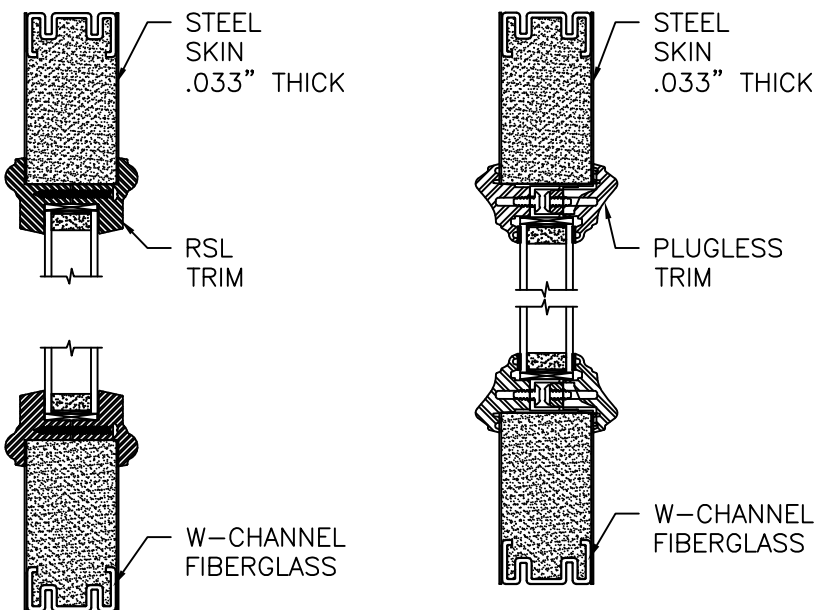

APPROVED SLABS AND TRIMS


PROVIA, LLC.
2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR
W/SIDELITES & TRANSOM NON-IMPACT
APPROVED SLABS AND TRIMS


DRAWN: N.G.	DWG NO. 08-02079	REV L
SCALE NTS	DATE 06/19/13	SHEET 15 OF 18

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com




SIGNED: 09/09/2026

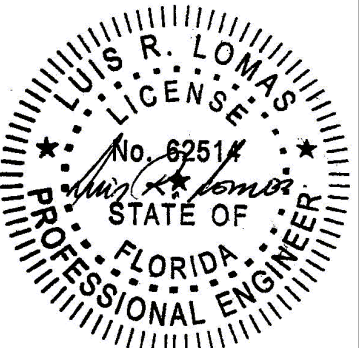

Luis R. Lomas P.E.
FL No.: 62514

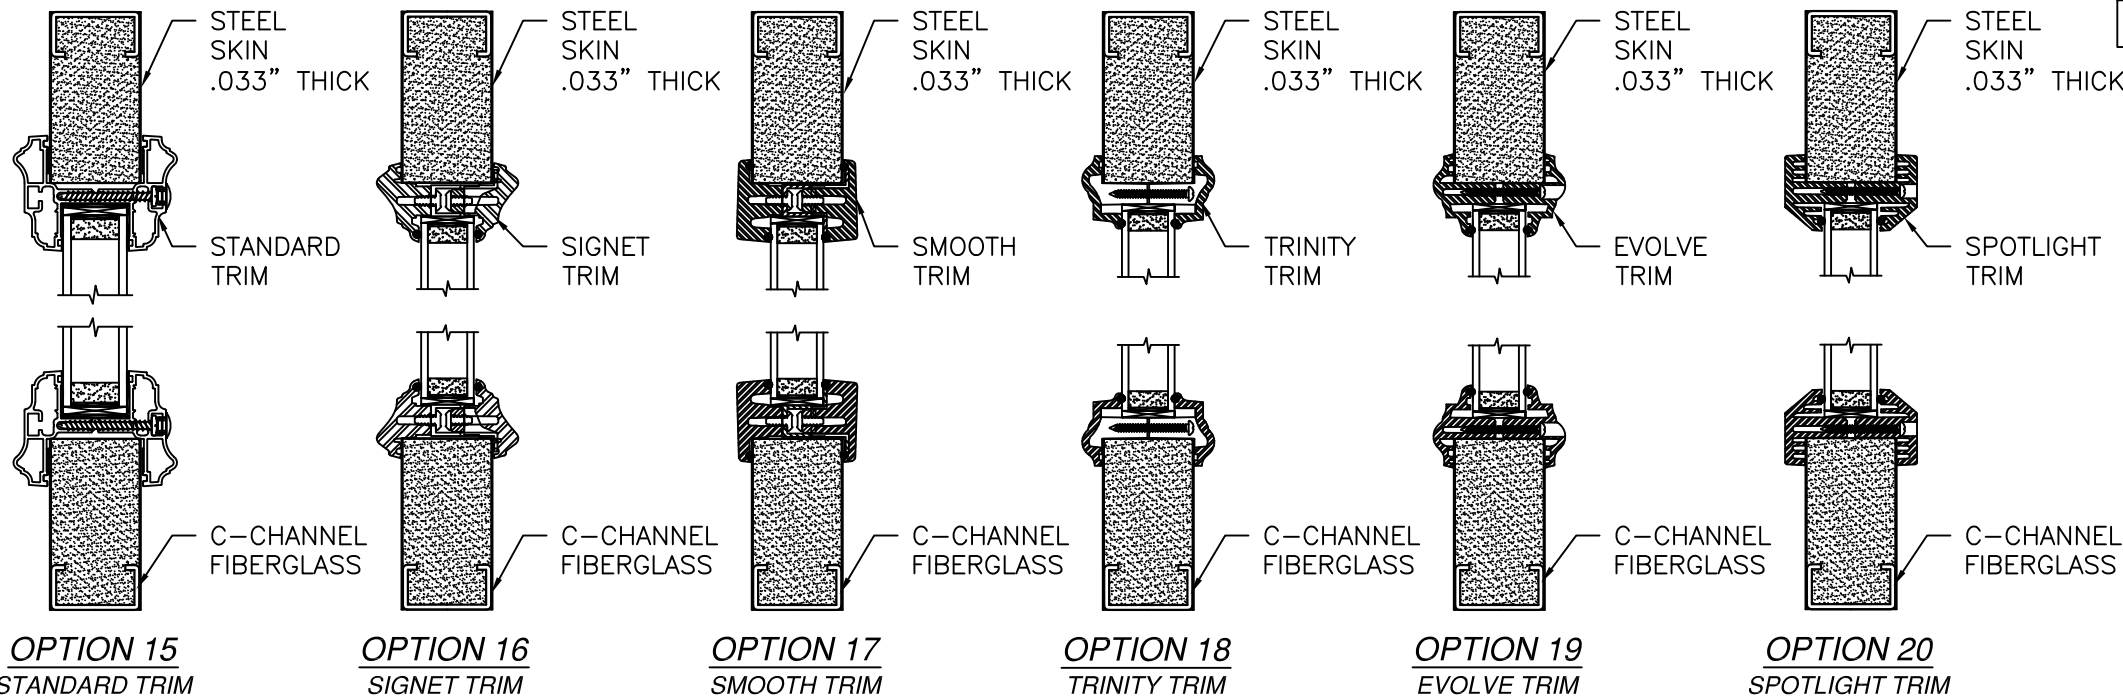

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

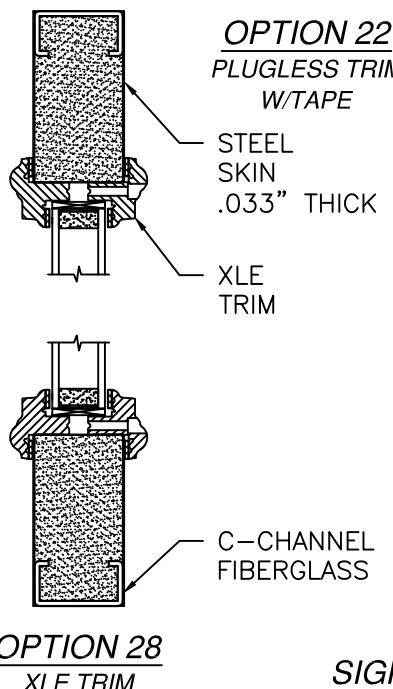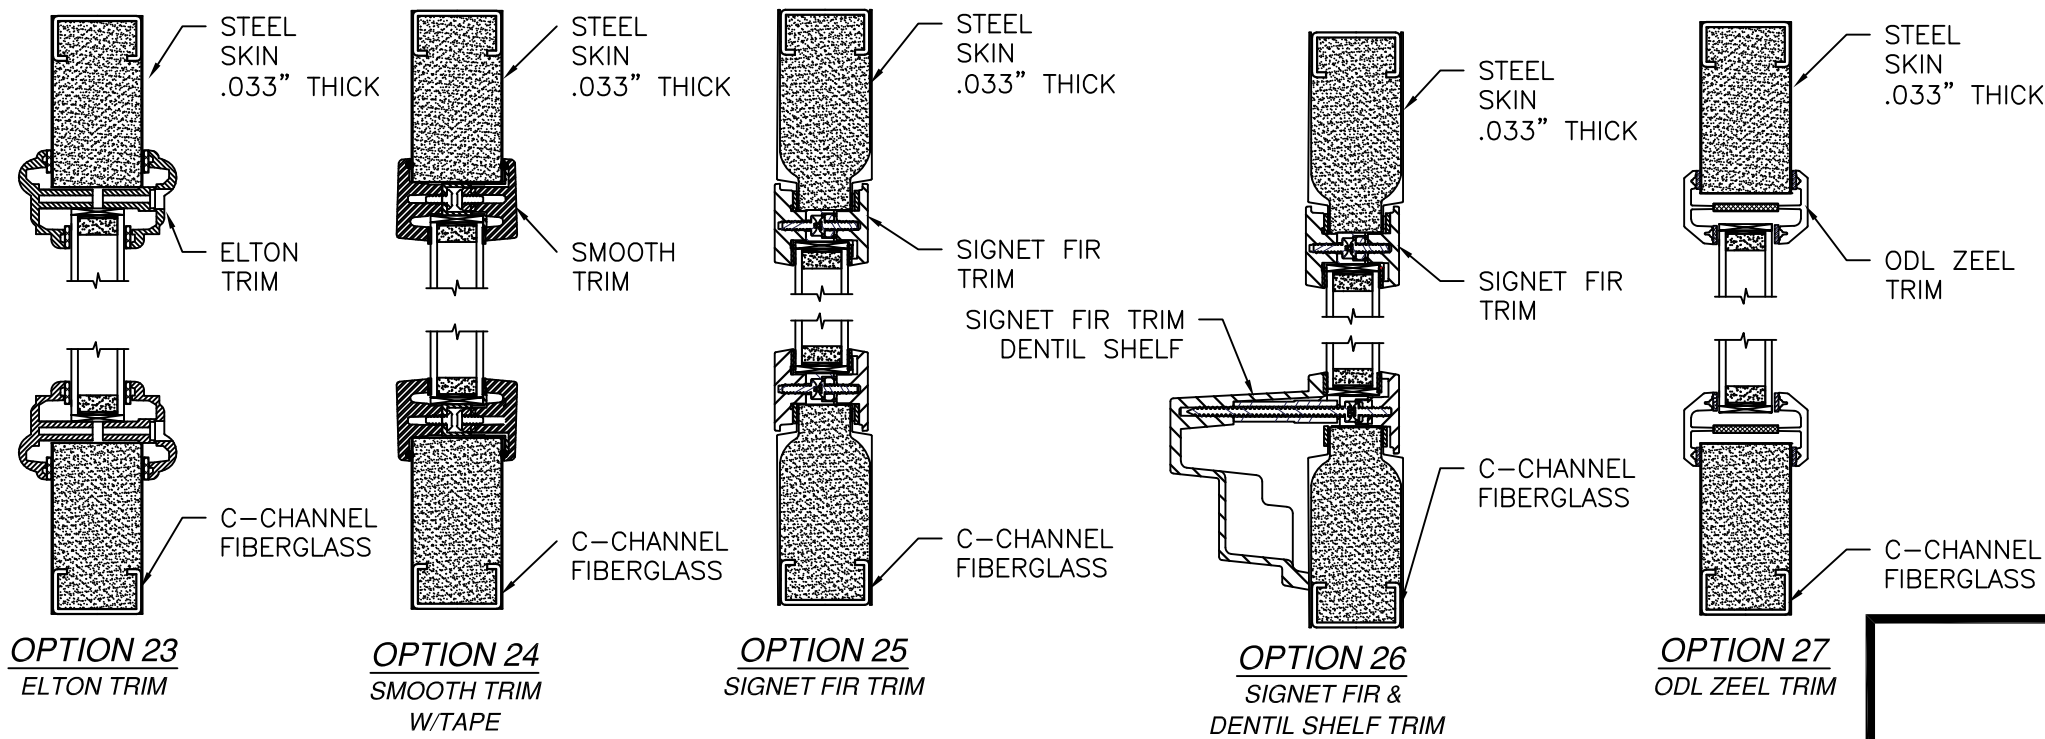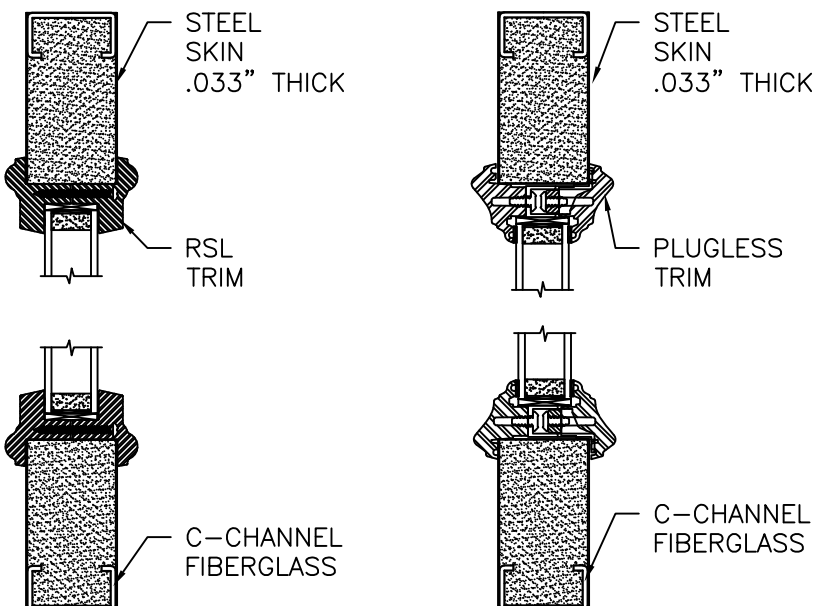

APPROVED SLABS AND TRIMS


PROVIA, LLC.
2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR
W/SIDELITES & TRANSOM NON-IMPACT
APPROVED SLABS AND TRIMS


DRAWN: N.G.	DWG NO. 08-02079	REV L
SCALE NTS	DATE 06/19/13	SHEET 16 OF 18

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 09/09/2026

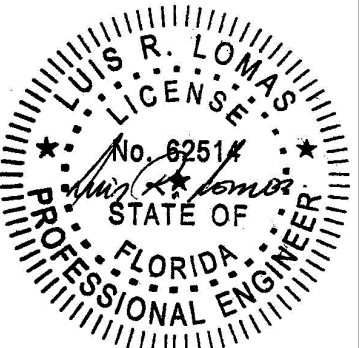

Luis R. Lomas P.E.
FL No.: 62514

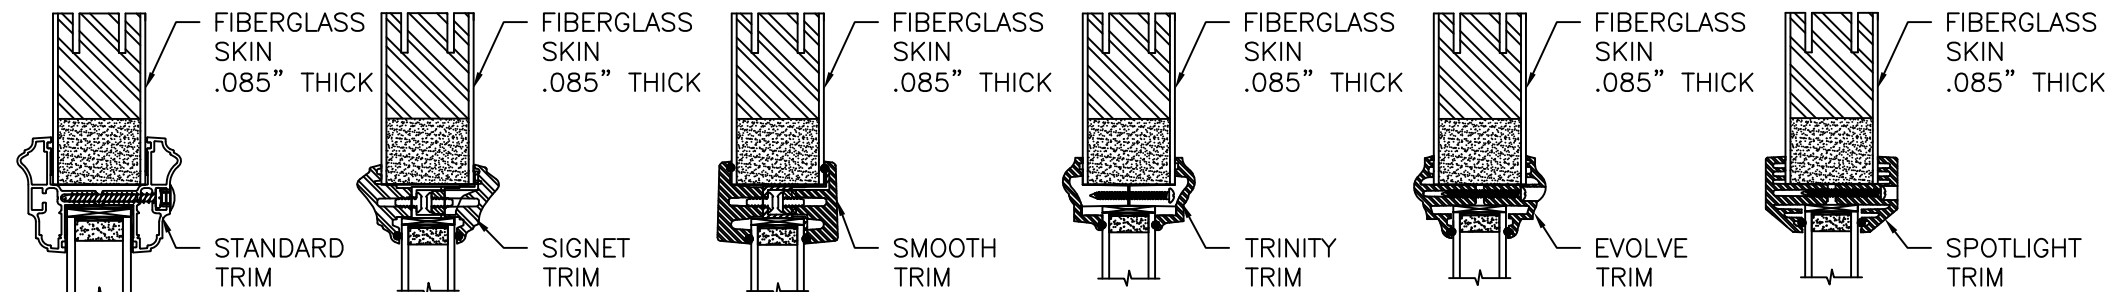

OPTION 29
STANDARD TRIM


OPTION 30
SIGNET TRIM

OPTION 31
SMOOTH TRIM


OPTION 32
TRINITY TRIM

OPTION 33
EVOLVE TRIM










OPTION 34
SPOTLIGHT TRIM

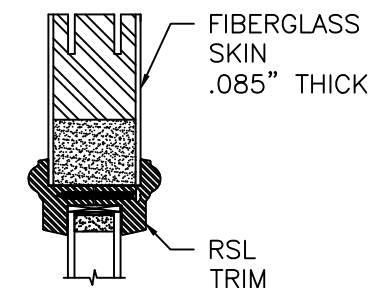


OPTION 35
RSL TRIM

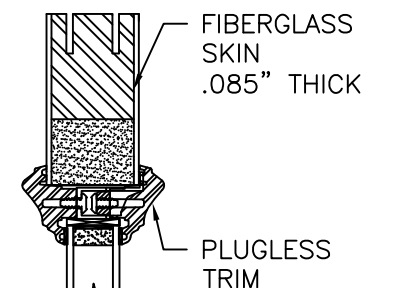


OPTION 36
PLUGLESS TRIM
W/TAPE

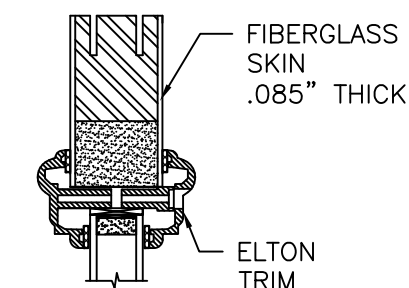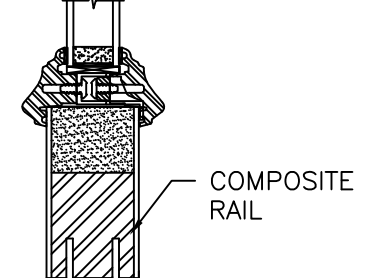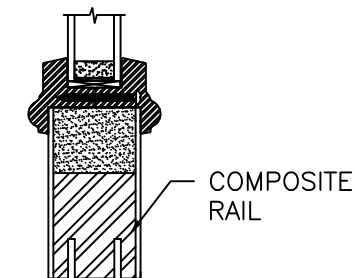


OPTION 37
ELTON TRIM

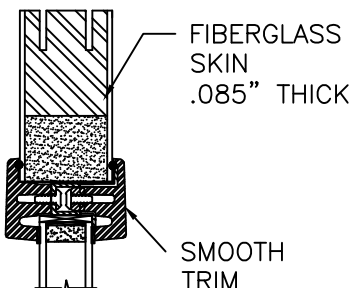


OPTION 38
SMOOTH TRIM
W/TAPE

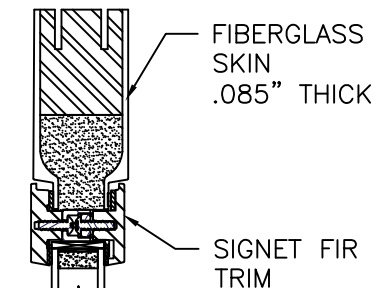


OPTION 39
SIGNET FIR TRIM

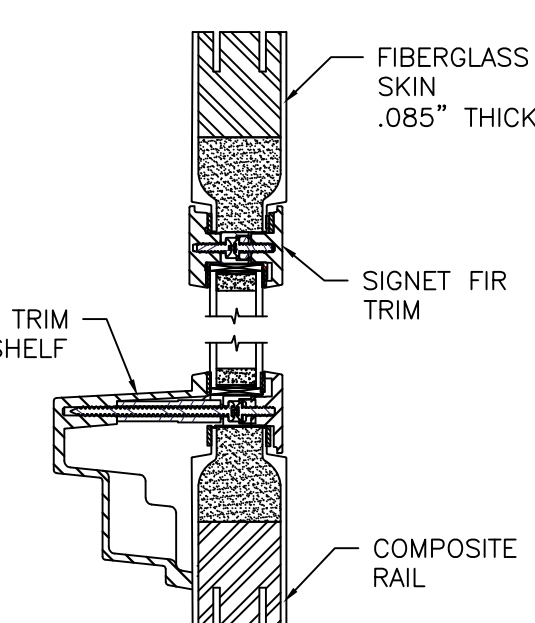


OPTION 40
SIGNET FIR &
DENTIL SHELF TRIM

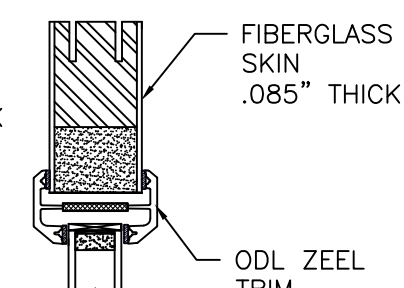

OPTION 41
ODL ZEEL TRIM

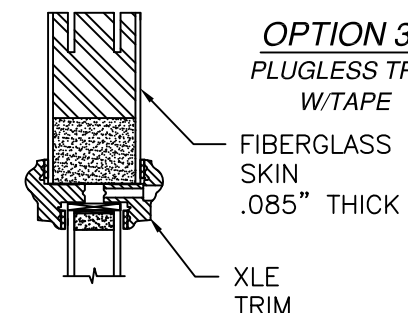

OPTION 42
XLE TRIM

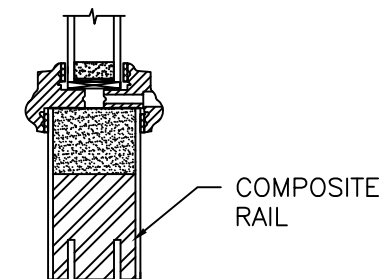


APPROVED SLABS AND TRIMS

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.


PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR W/SIDELITES & TRANSOM NON-IMPACT APPROVED SLABS AND TRIMS		
DRAWN: N.G.	DWG NO. 08-02079	REV L
SCALE NTS	DATE 06/19/13	SHEET 17 OF 18
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 09/09/2026

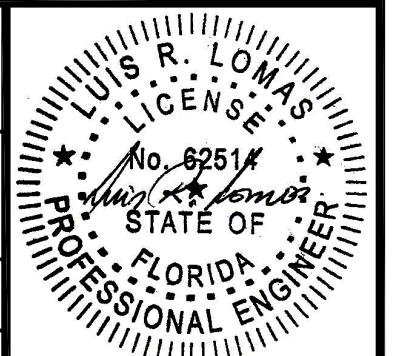


Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/09/26	R.L.

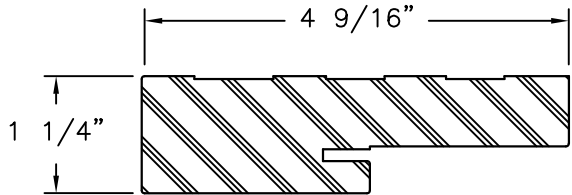


COMPOSITE FRAME PROFILE

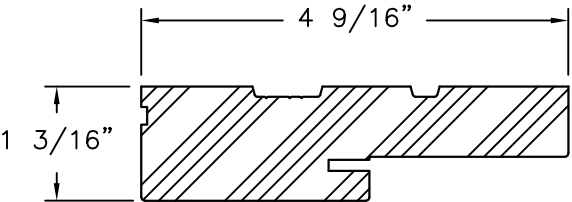


WOOD FRAME PROFILE

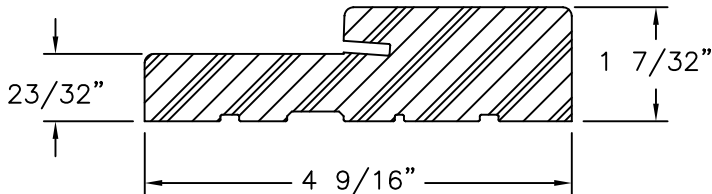


FRAMESAVER
COMPOSITE

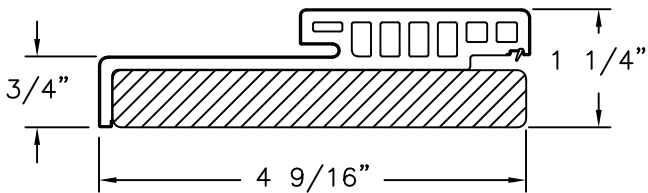


HYBRID HEAD
WOOD/COMPOSITE

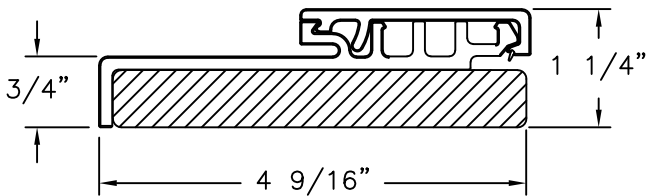


HYBRID JAMB
WOOD/COMPOSITE

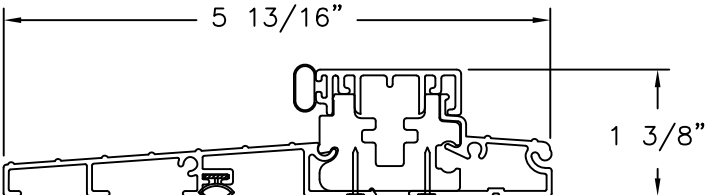


STANDARD OUTSWING THRESHOLD

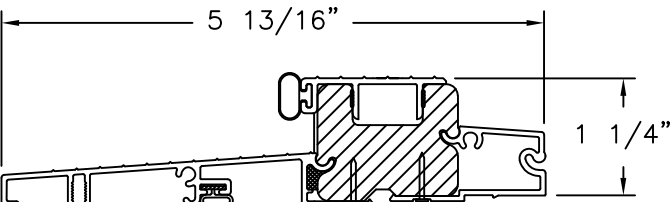


SAHARA OUTSWING THRESHOLD

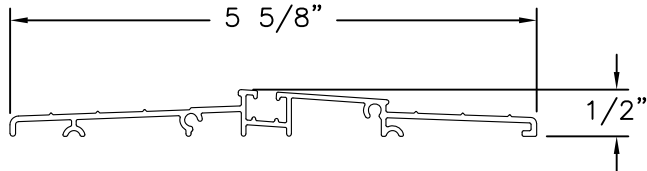


ADA THRESHOLD

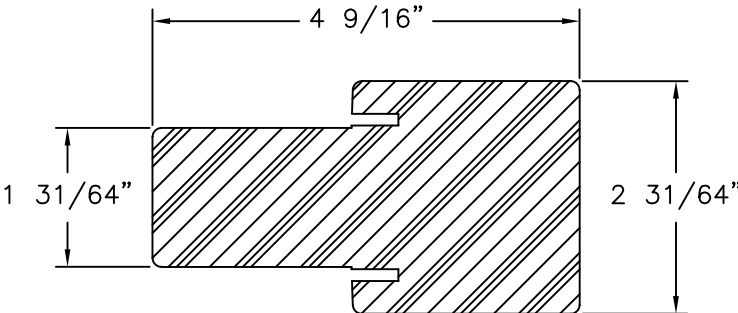


FAT BOY MULLION
COMPOSITE

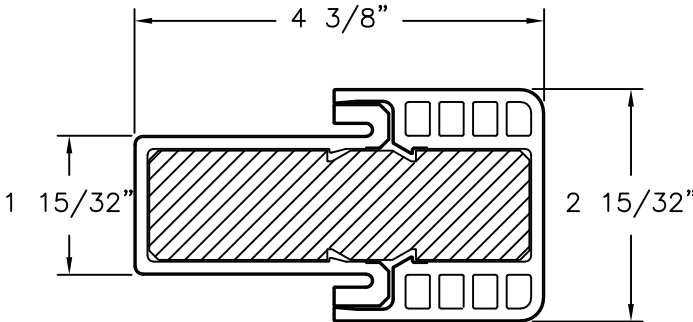


HYBRID FAT BOY MULLION
COMPOSITE

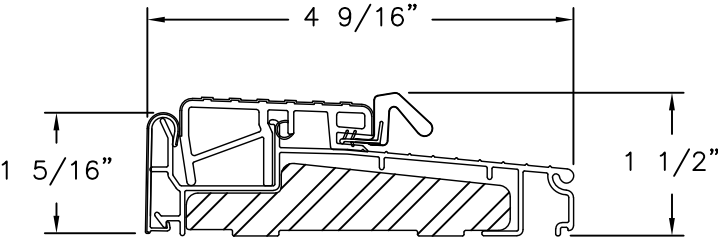

OUTSWING SILL ZOBL4565

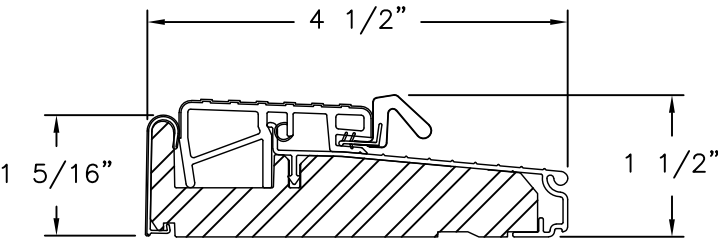

OUTSWING SILL ZOB4565F

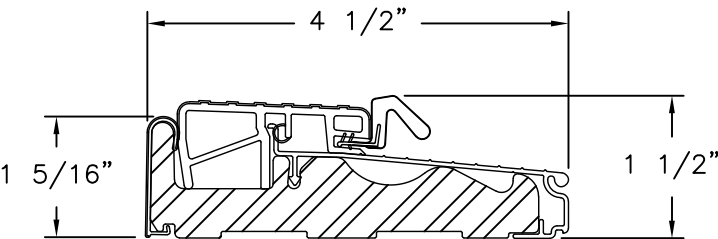

OUTSWING SILL ZOBLH4565

SIGNED: 09/09/2026

PROVIA, LLC.

2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

STEEL/FIBERGLASS OUTSWING GLAZED DOUBLE DOOR
W/SIDELITES & TRANSOM NON-IMPACT
COMPONENTS

DRAWN:
N.G.

DWG NO.
08-02079

REV
L

SCALE
NTS


DATE
06/19/13

SHEET
18 OF 18

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

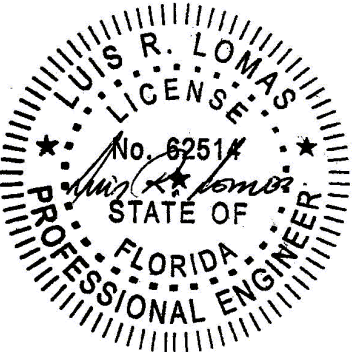

Luis R. Lomas P.E.
FL No.: 62514